Sanitary Sewer Connection
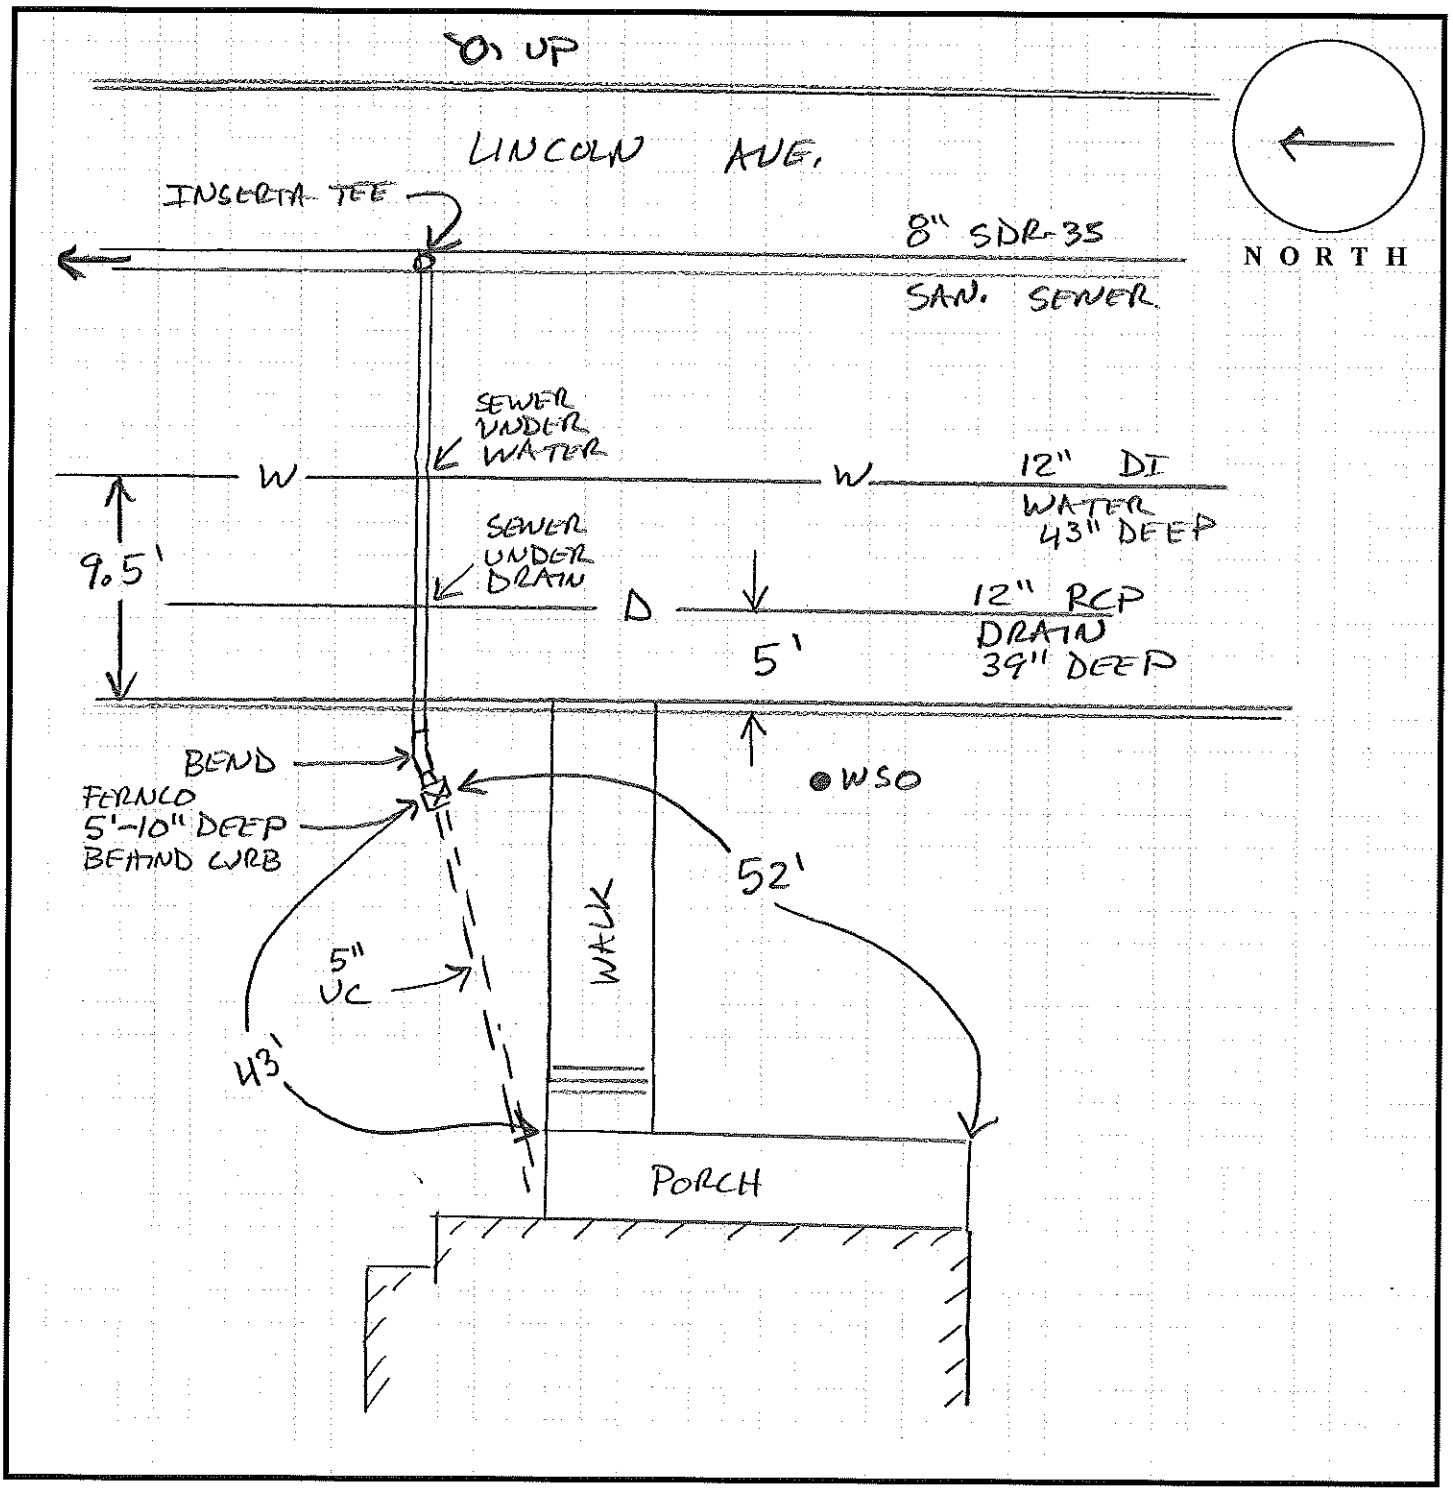
Address 204 LINCOLN AVE Inspector PD
Date of Inspection 5/15/13 Contractor TOA
Dia. Of Pipe: 4" Type of Pipe SDR-35
Slope (min.1/4"/foot) ✓ Back fill
Bedding Type STONE Scale NTS
Inspected and Approved to backfill X