Sanitary Sewer Connection

Address 50 McCLURE ST Inspector PJ

Date of Inspection 10/31/11 Contractor ROTO-ROOTER

Dia. Of Pipe: 4" Type of Pipe SDR-35

Slope (min.1/4"/foot) ✓ Back fill

Bedding Type STONE Scale NTS
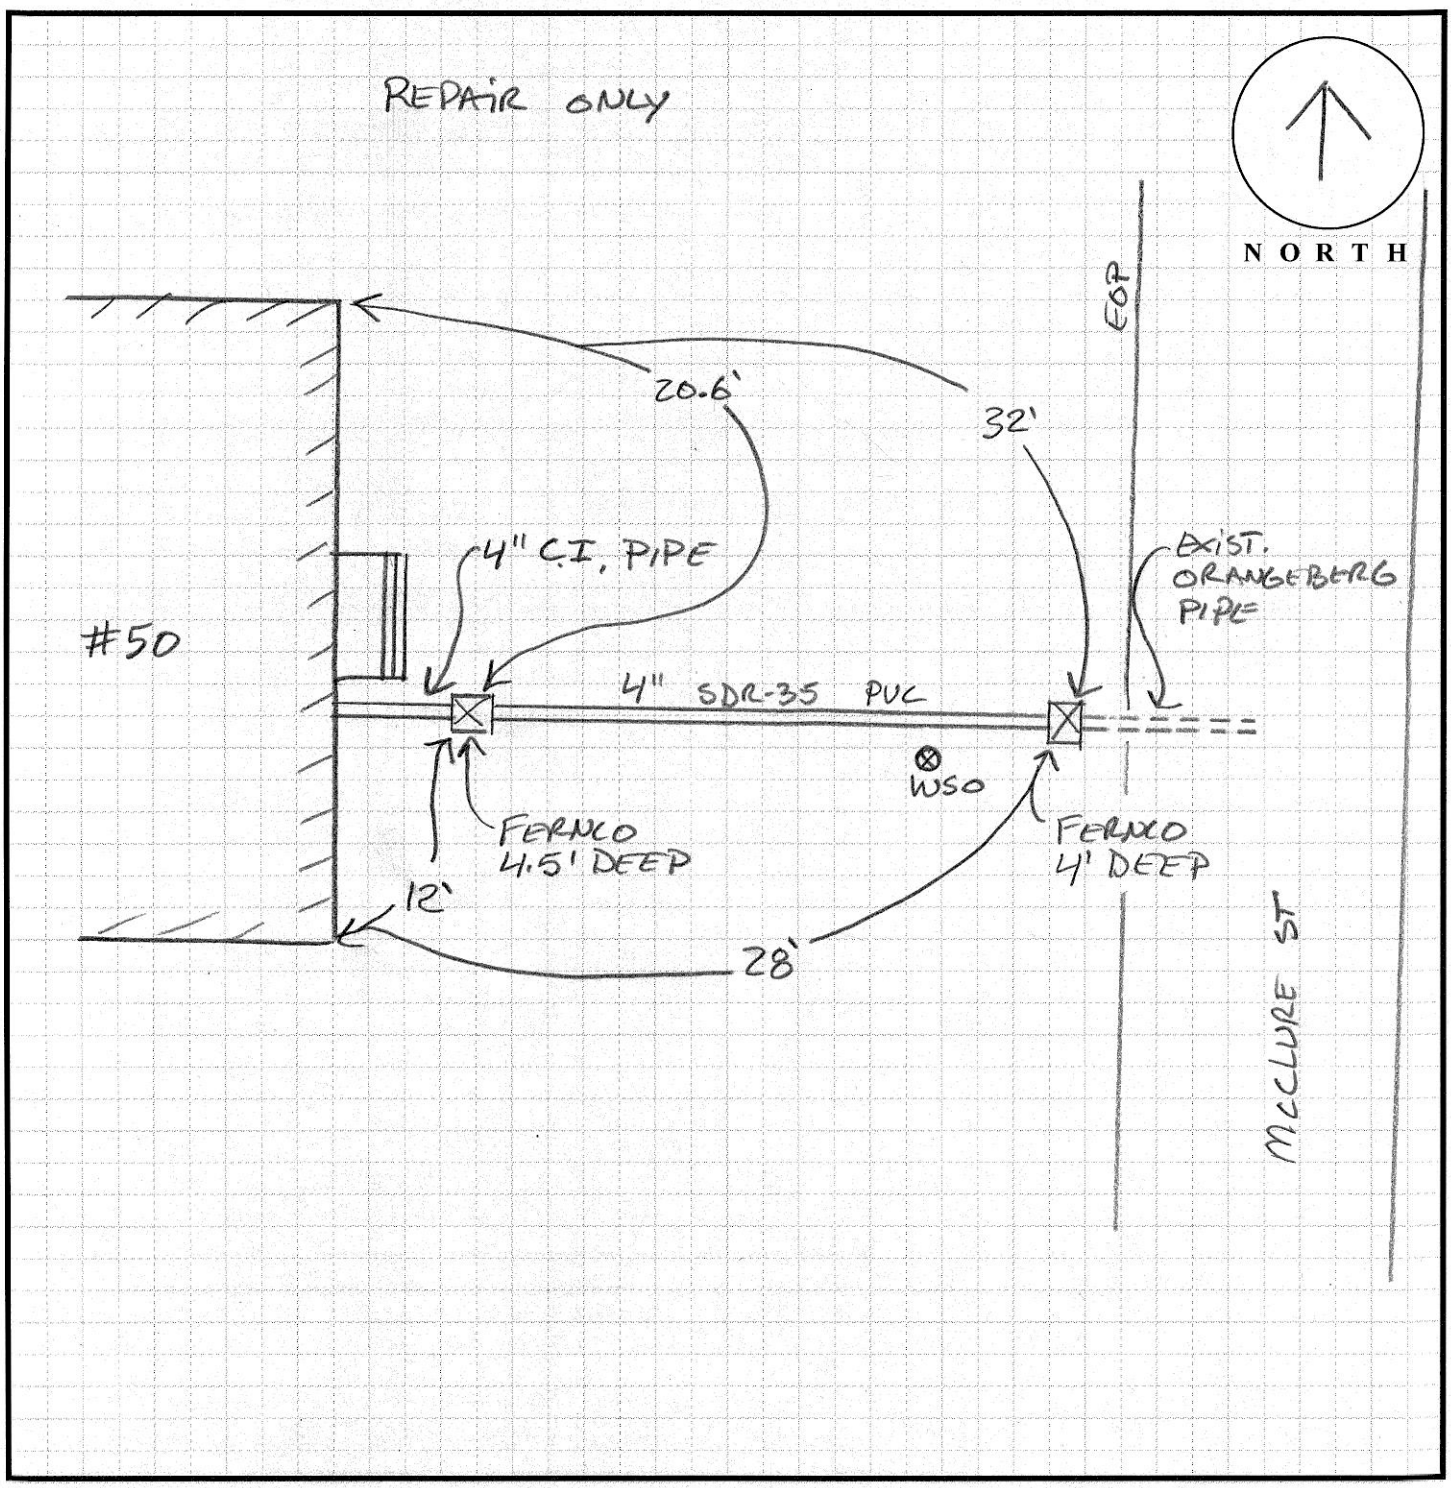
Inspected and Approved to backfill ✓