

**BOARD OF HEALTH, AMHERST, MASSACHUSETTS  
APPLICATION FOR DISPOSAL WORKS CONSTRUCTION PERMIT**

No. 73-5 Date 3/21/73 Fee \$3.00 Date Rec'd. 3/21/73 By DGF

Application is hereby made for a permit to Construct (X) or Repair ( ) an Individual Sewage Disposal System at:  
 Location—Address 72 Chapel Rd. or Lot No. 4 MA  
 Owner Sanders & Roberge Address Bay Rd., Amherst  
 Contractor KARL F.C. Address River, De. N. H.  
 Type of Building Dwelling Dimensions 26x34 Size Lot 33,542 sq ft  
 Dwelling—No. of Bedrooms 3 Expansion Attic (-) Garbage Grinder (yes)  
 Other 1/2 bath. No. of persons \_\_\_\_\_ Showers (1)  
 Other fixtures \_\_\_\_\_  
 Town Water? yes Type of Well \_\_\_\_\_

Design Flow 50 gallons per person per day. Total daily flow 300 gallons  
 Septic Tank—Liquid capacity 1000 gallons Dimensions: L \_\_\_\_\_ W \_\_\_\_\_ D \_\_\_\_\_  
 Disposal Trench—No. \_\_\_\_\_ Width \_\_\_\_\_ Total Length \_\_\_\_\_ Total leaching area \_\_\_\_\_ sq. ft.  
 Disposal Bed—No. 1 Diameter 18x21 Depth below inlet \_\_\_\_\_ Total leaching area 378 sq. ft. 400  
 Dry Well—No. \_\_\_\_\_ Diameter \_\_\_\_\_ Depth below inlet \_\_\_\_\_ Dimensions: \_\_\_\_\_ x \_\_\_\_\_ x \_\_\_\_\_  
 Other: Distribution box ( ) No. \_\_\_\_\_ Dosing tank ( ) \_\_\_\_\_  
 (Depth of Soil Line Below finished grade at foundation \_\_\_\_\_)

Percolation Test Results Performed by Miles J. H. Ubley PE Date 3-14-73  
 Test Pit No. 1 2 minutes per inch Depth of Test Pit 36"  
 Test Pit No. 2 \_\_\_\_\_ minutes per inch Depth of Test Pit \_\_\_\_\_  
 Description of Soil loose clean sand SW Depth to Ground Water none  
 Will disposal area be filled? \_\_\_\_\_ Cut down? \_\_\_\_\_  
 (On reverse side or separate sheet, show plot plan with building. Include dimensions, distances from all boundaries. Show location of wells, streams, ledge, large trees, etc.)

AGREEMENT: The undersigned agrees to construct the aforescribed individual sewage disposal system in accordance with the provisions of Article XI of the Sanitary Code and regulations of the Amherst Board of Health. The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by this board of health.

Application Approved by C. D. Hall Jr. Erard Roberge 3/21/73  
 Owner or builder date  
 Application Disapproved for the following reasons: KEEPS SYSTEM FURTHER FROM ROAD IF POSSIBLE 3-22-73  
 date

**BOARD OF HEALTH, AMHERST, MASSACHUSETTS  
CERTIFICATE OF COMPLIANCE**

THIS IS TO CERTIFY, That the individual Sewage Disposal System installed ( ) or repaired ( ) by \_\_\_\_\_ at \_\_\_\_\_ has been constructed in accordance with the provisions of \_\_\_\_\_ INSTALLER Article XI of the State Sanitary Code as described in the application for Disposal Works Construction Permit No. \_\_\_\_\_ dated \_\_\_\_\_ The issuance of this certificate shall not be construed as a guarantee that the system will function satisfactorily.  
 DATE \_\_\_\_\_ Inspector \_\_\_\_\_

**BOARD OF HEALTH, AMHERST, MASSACHUSETTS  
DISPOSAL WORKS CONSTRUCTION PERMIT**

No. 73-5  
 Permission is hereby granted SANDERS + ROBERGE to construct (X) or repair ( ) an Individual Sewage Disposal System at LOT #4 CHAPEL RD as shown on the application for Disposal Works Construction Permit No. 73-5  
 This permit is issued with the understanding that future alterations or additions will be made if necessary. This permit shall not be construed as permission to create or maintain any sewage nuisance and in the issuance of this permit the Board of Health assumes no responsibility for the future operation or maintenance of the system.  
 DATE 3-22-73 C. D. Hall Jr.  
 Board of Health

114  
BY Mr. Tolbert  
1932

3  
1932

1000

1

1932

1932

1932

1932


1932




Sketch showing  
 Sanitary Disposal  
 for  
 Lot #4 Chapel Road  
 3-14-73 m.g. 1" = 40'



1912  
C. J. ...  
...

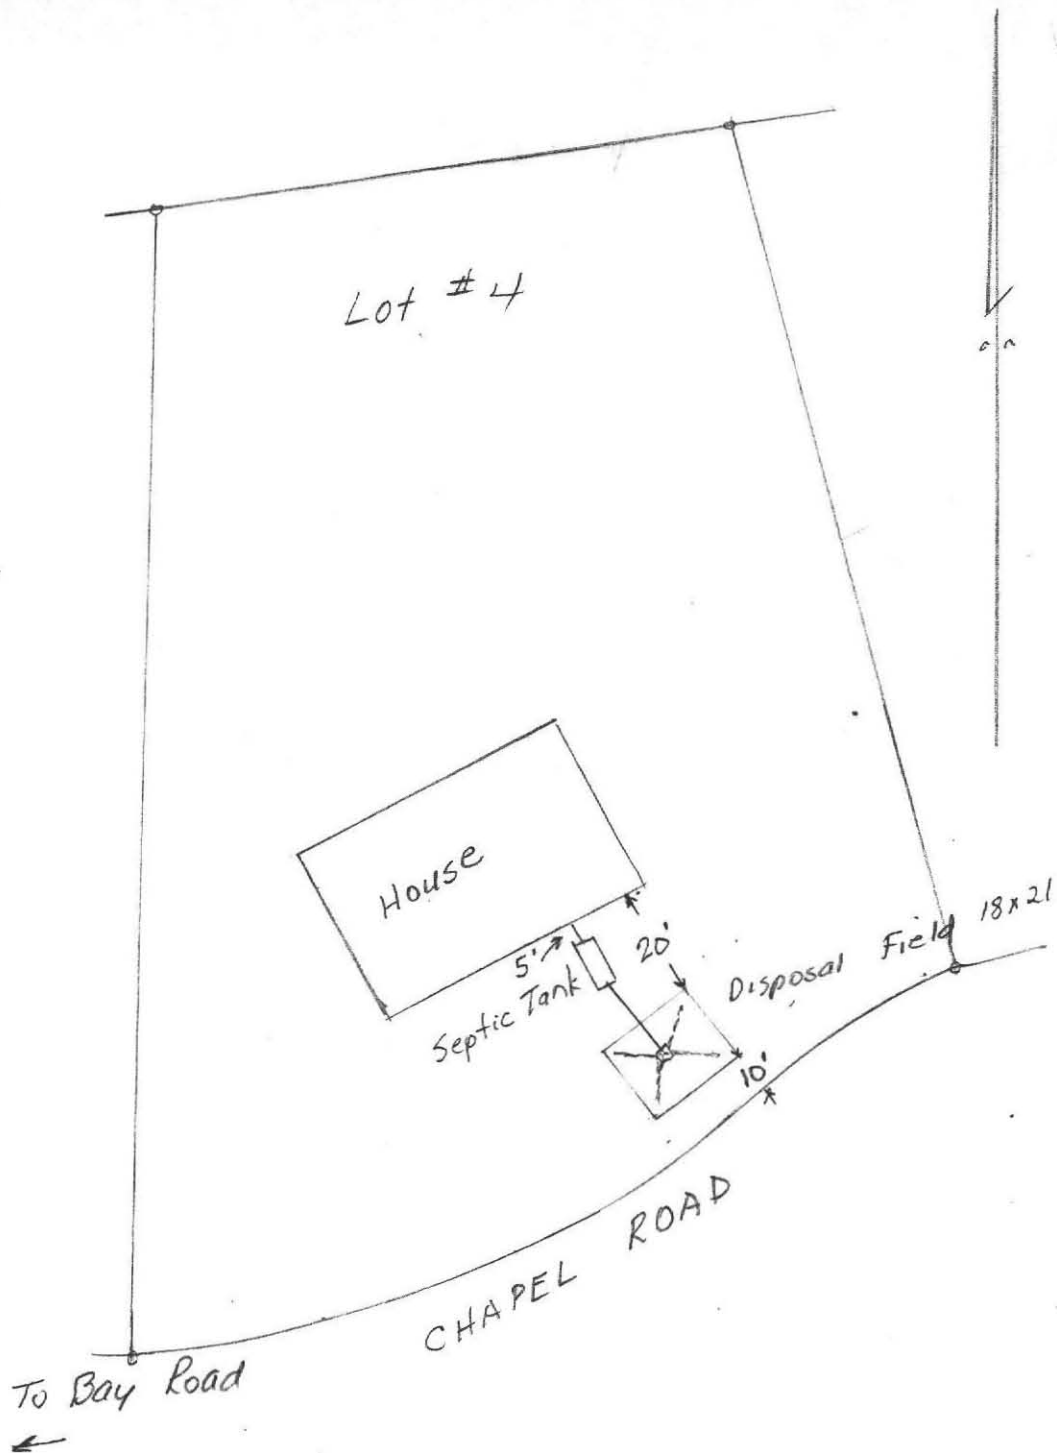

Sketch showing  
 Sanitary Disposal  
 for  
 Lot #4 Chapel Road  
 3-14-73 m.g.H. 1"=40'

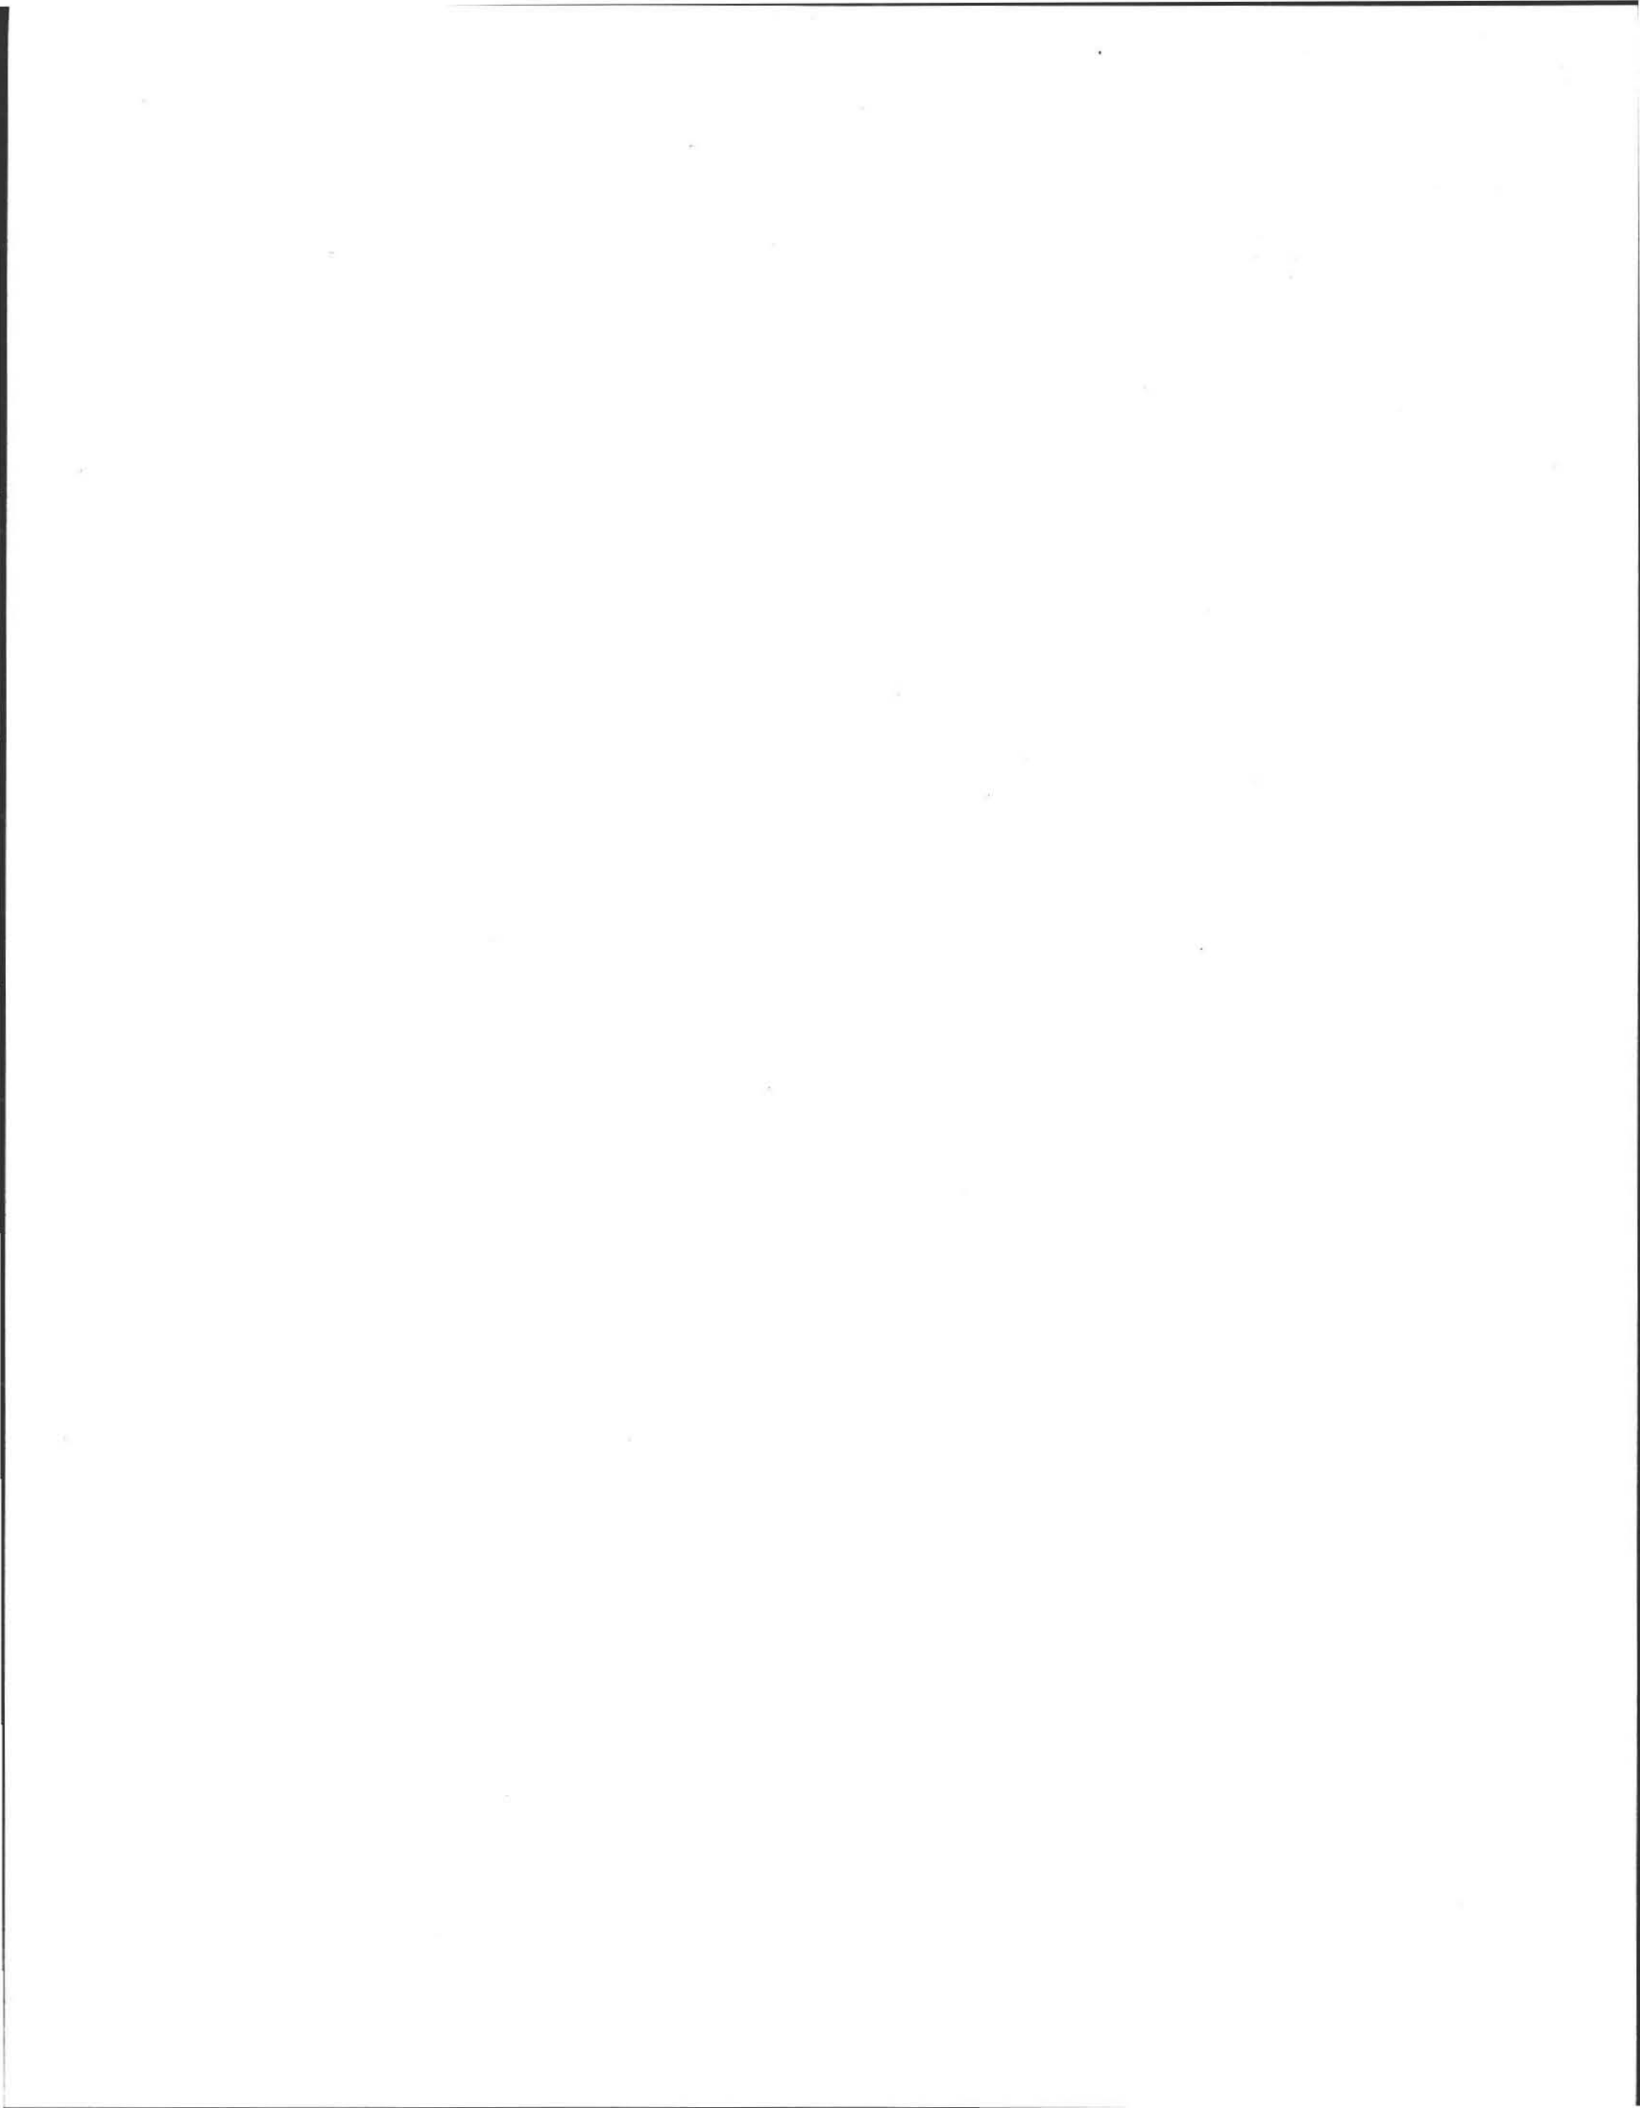


**BOARD OF HEALTH**  
**TOWN OF AMHERST, MASSACHUSETTS**

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

Owner Ben Lee Address 42 Chapel Rd  
 Installer KARLS, ETC. Address River De Wampanoag  
 Date Installation Inspected and Approved Nov 1982  
 Description of System: Tank Capacity: EXISTING 1200  
 Leach Field ( ) Bed ( ) Seepage Pit 11,500 Square Feet: 560<sup>sq</sup>  
 Garbage Grinder Yes ( ) No ( ) No. Bedrooms: 4 No. People 8

AS - BUILT PLAN:

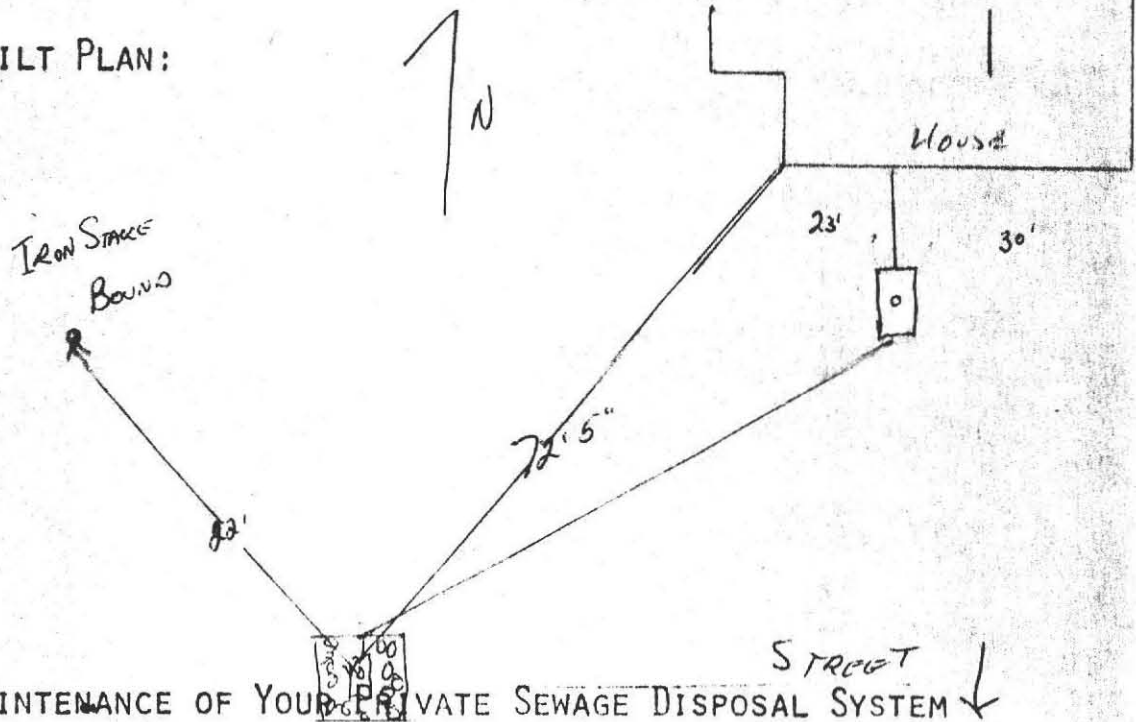

**PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM**

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

