

143 FLAT HILLS



82-6

BOARD OF HEALTH

#143 Flat Hills

TOWN OF AMHERST, MASSACHUSETTS

FLAT HILLS ROAD

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

Owner ~~J-B FRENCH~~ J-B FRENCH Address ~~No Valley Rd~~ PO Box 1005 Amherst, MA

Installer E.O. STONE Address MONTAGUE, MA



Date Installation Inspected and Approved 9-29-82 CED

Description of System: Tank Capacity: 1000

Leach Field ( ) Bed (X) Seepage Pit ( ) Square Feet: 900

Garbage Grinder Yes ( ) No (X) No. Bedrooms: 3 No. People 6


AS - BUILT PLAN:

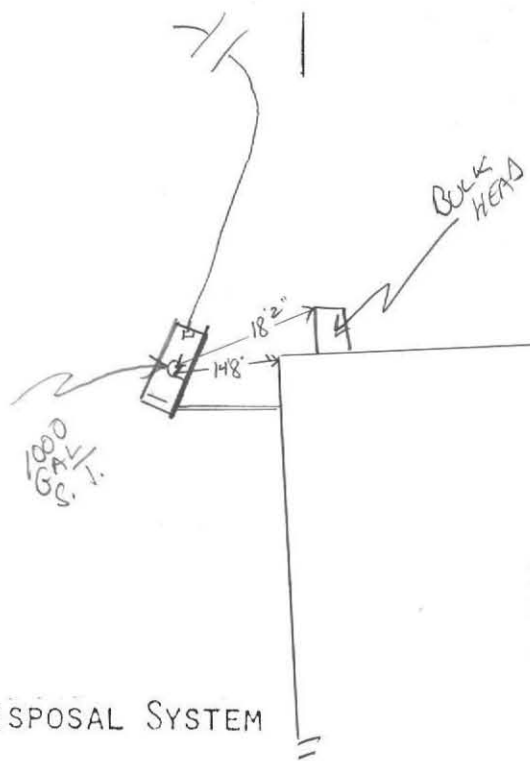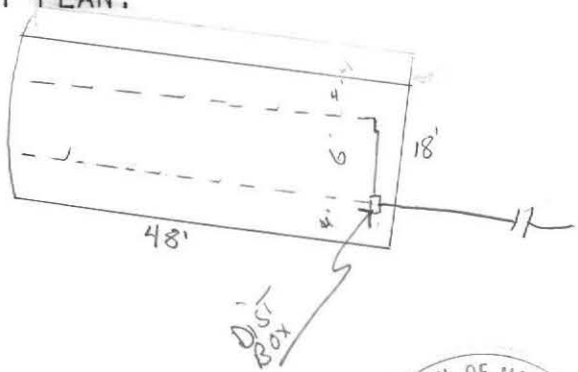

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

- 1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds, as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

Handwritten note: H2O 140' DEEP 60 GAL MINUTE

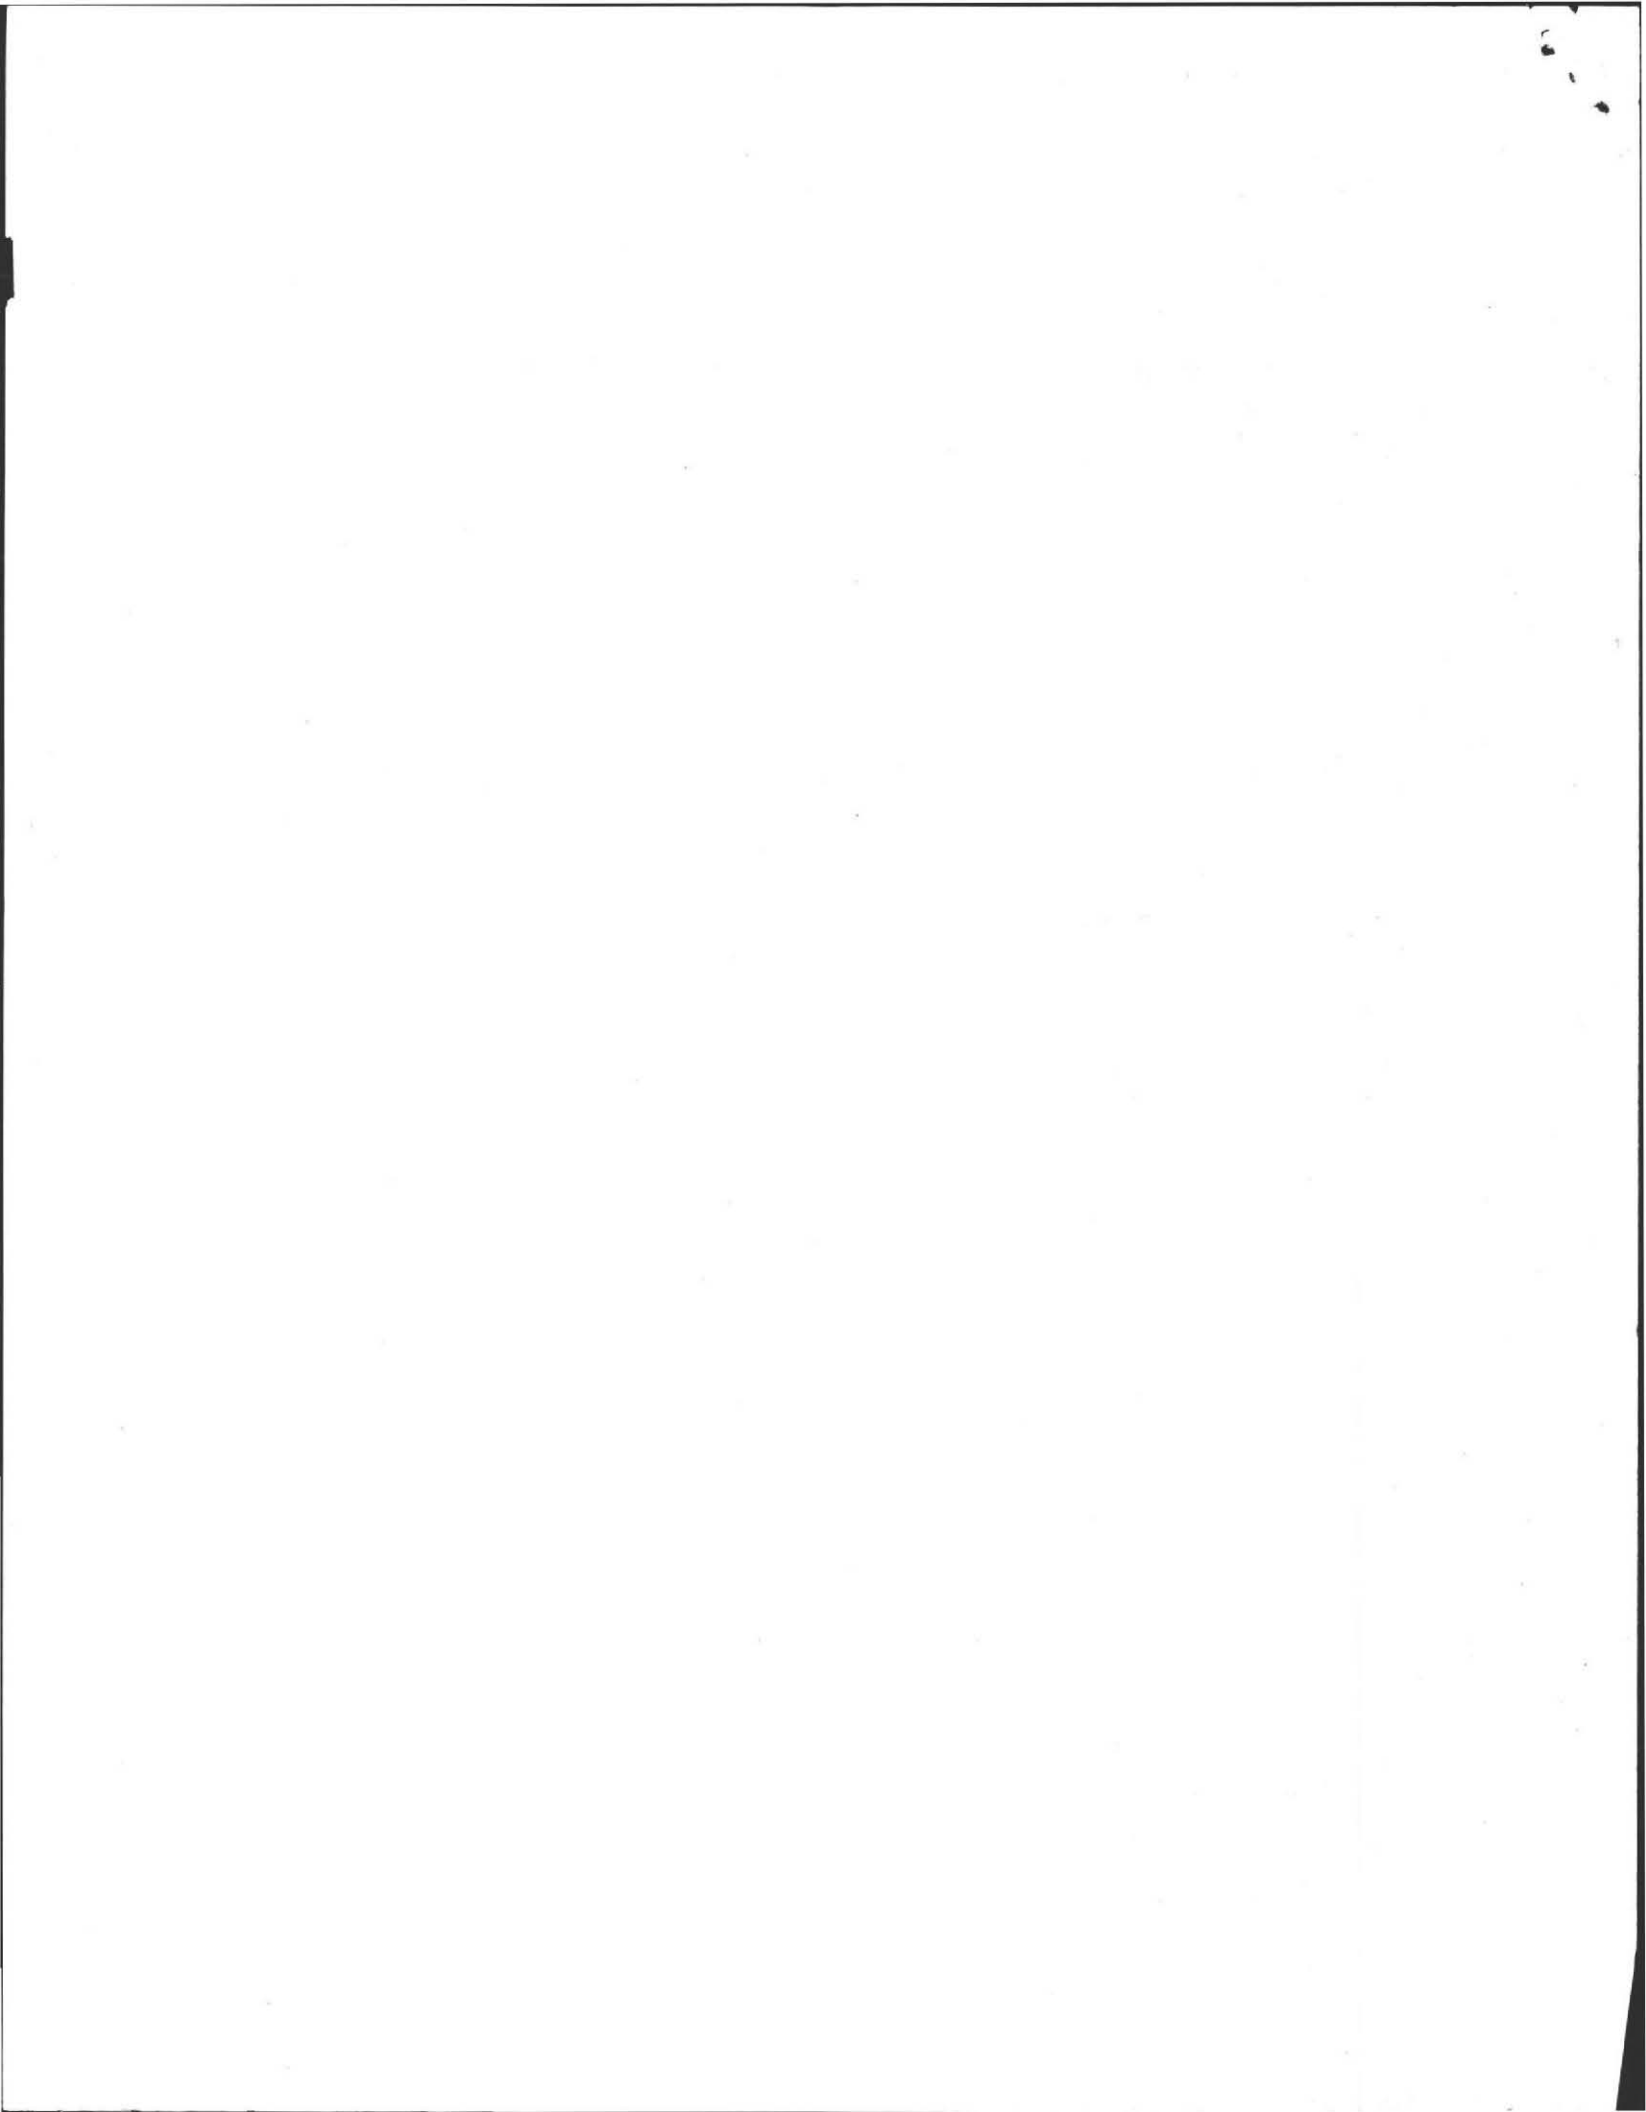

No. 82-6

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

Town OF Amherst

Application for Disposal Works Construction Permit



Application is hereby made for a Permit to Construct (✓) or Repair ( ) an Individual Sewage Disposal System at:

Location - Address: 143 Flat Hills Road  
Owner: J.B. French  
Installer: H. Robin - Ed Stone  
or Lot No.: none  
Address: P.O. Box 1005 Amherst MA  
Leverett Mass

Type of Building: Dwelling — No. of Bedrooms: 3 Expansion Attic ( ) Garbage Grinder (✓)  
Other — Type of Building: \_\_\_\_\_ No. of persons: \_\_\_\_\_ Showers ( ) — Cafeteria ( )  
Other fixtures: \_\_\_\_\_

Design Flow: 5.5 gallons per person per day. Total daily flow: 330 gallons.  
Septic Tank — Liquid capacity: 1000 gallons Length: \_\_\_\_\_ Width: \_\_\_\_\_ Diameter: \_\_\_\_\_ Depth: \_\_\_\_\_  
Disposal Trench — No.: 1 Width: 18' Total Length: 22' Total leaching area: 396 sq. ft.  
Seepage Pit No.: \_\_\_\_\_ Diameter: \_\_\_\_\_ Depth below inlet: \_\_\_\_\_ Total leaching area: \_\_\_\_\_ sq. ft.  
Other Distribution box ( ) Dosing tank ( )  
Percolation Test Results Performed by: Frederick Filios Date: Dec 3 1981  
Test Pit No. 1: 4 minutes per inch Depth of Test Pit: 7'4" Depth to ground water: none  
Test Pit No. 2: \_\_\_\_\_ minutes per inch Depth of Test Pit: \_\_\_\_\_ Depth to ground water: \_\_\_\_\_

Description of Soil: Enclosed  
Nature of Repairs or Alterations — Answer when applicable: \_\_\_\_\_

Agreement: The undersigned agrees to install the aforescribed Individual Sewage Disposal System in accordance with the provisions of TITLE 5 of the State Sanitary Code — The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by the board of health.  
Signed: Howard Robin Date: 7-20-82  
Application Approved By: [Signature] Date: 7-20-82  
Application Disapproved for the following reasons: \_\_\_\_\_  
Date: \_\_\_\_\_

Permit No. \_\_\_\_\_ Issued \_\_\_\_\_ Date \_\_\_\_\_

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

OF

Certificate of Compliance

THIS IS TO CERTIFY, That the Individual Sewage Disposal System constructed ( ) or Repaired ( ) by \_\_\_\_\_ Installer

at \_\_\_\_\_ has been installed in accordance with the provisions of TITLE 5 of The State Sanitary Code as described in the application for Disposal Works Construction Permit No. \_\_\_\_\_ dated \_\_\_\_\_

THE ISSUANCE OF THIS CERTIFICATE SHALL NOT BE CONSTRUED AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORY.

DATE \_\_\_\_\_ Inspector \_\_\_\_\_

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

Town OF Amherst

No. 82-6

FEE \$90


Disposal Works Construction Permit

Permission is hereby granted Howard Robin - Ed Stone to Construct (✓) or Repair ( ) an Individual Sewage Disposal System at No. FLAT HILLS RD

as shown on the application for Disposal Works Construction Permit No. 82-6 Dated 7-20-82

DATE 7-20-82 Board of Health

CHECK OR FILL IN WHERE APPLICABLE

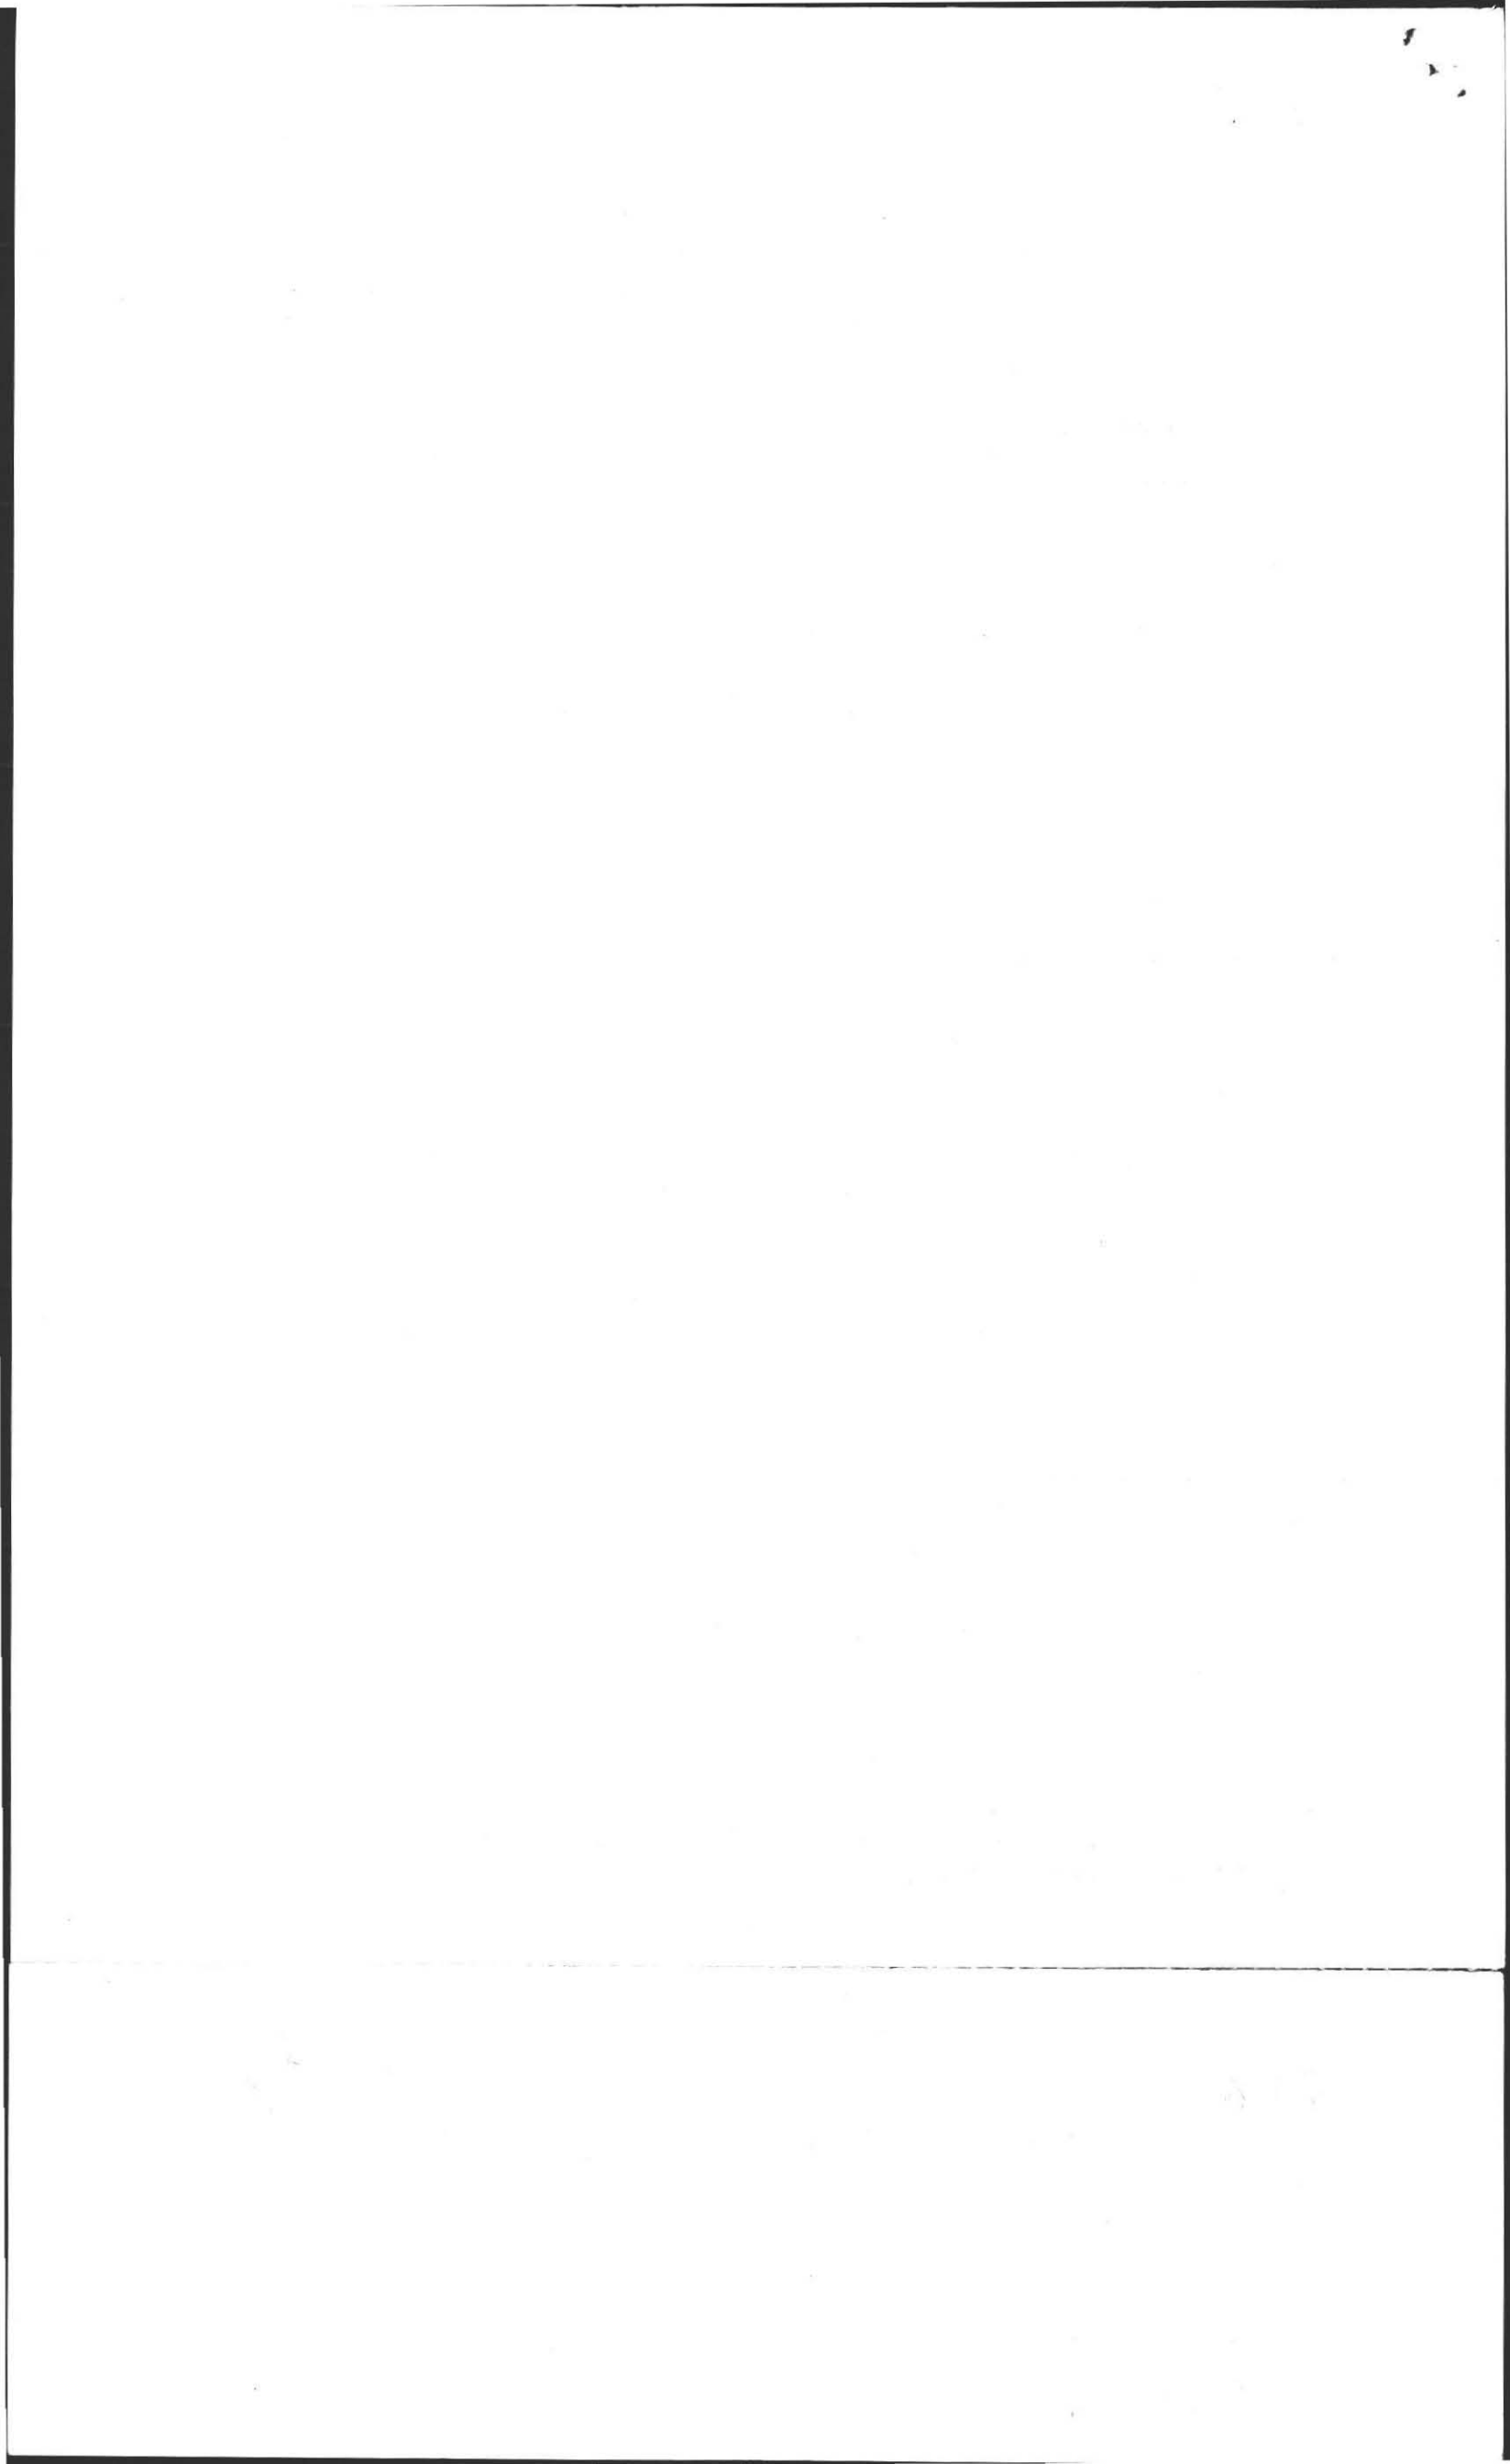



# PLAN SHOWING SEWAGE DISPOSAL

For: J.B. French  
Box 1005  
Amherst Mass

Scale: 1" = 40'

By: Frederick A. Filios

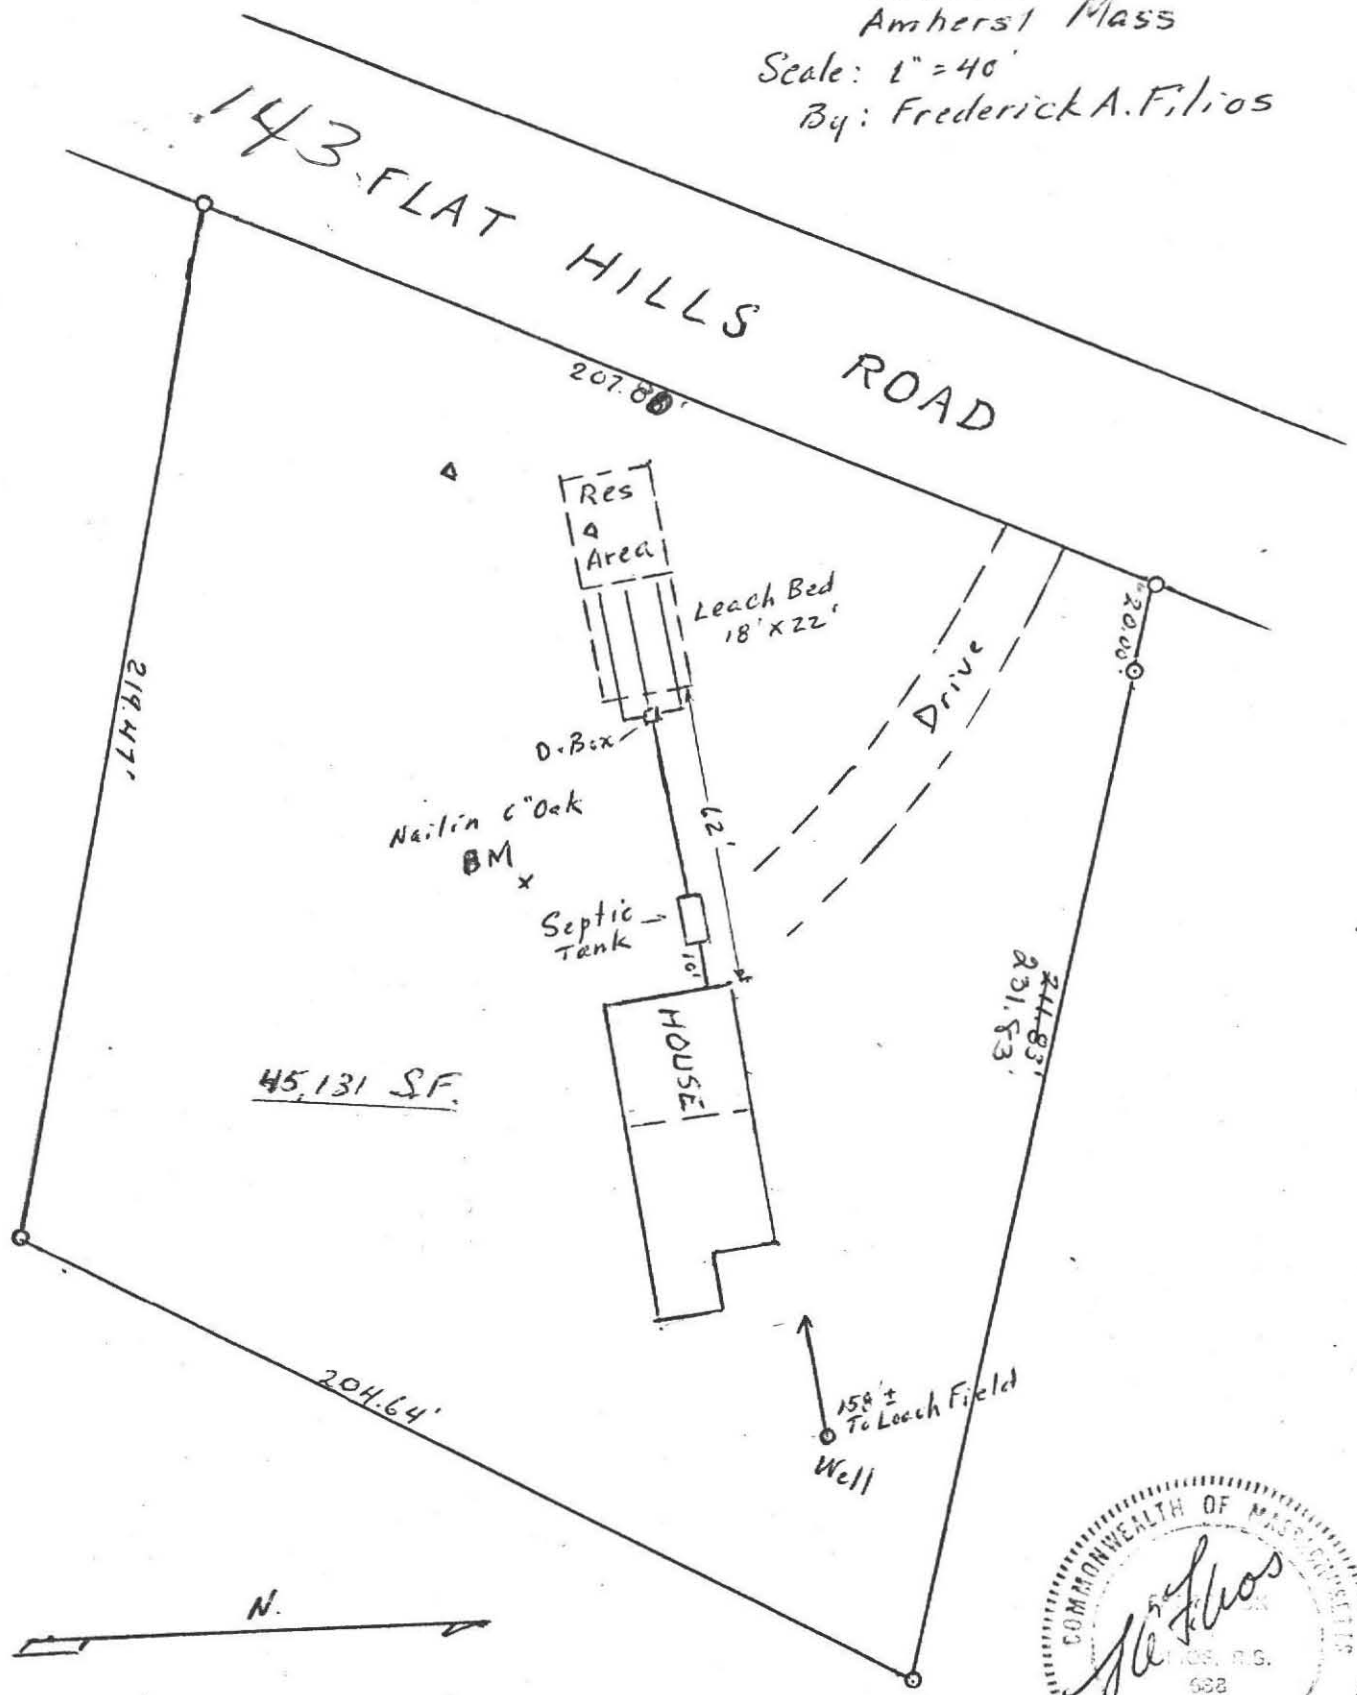

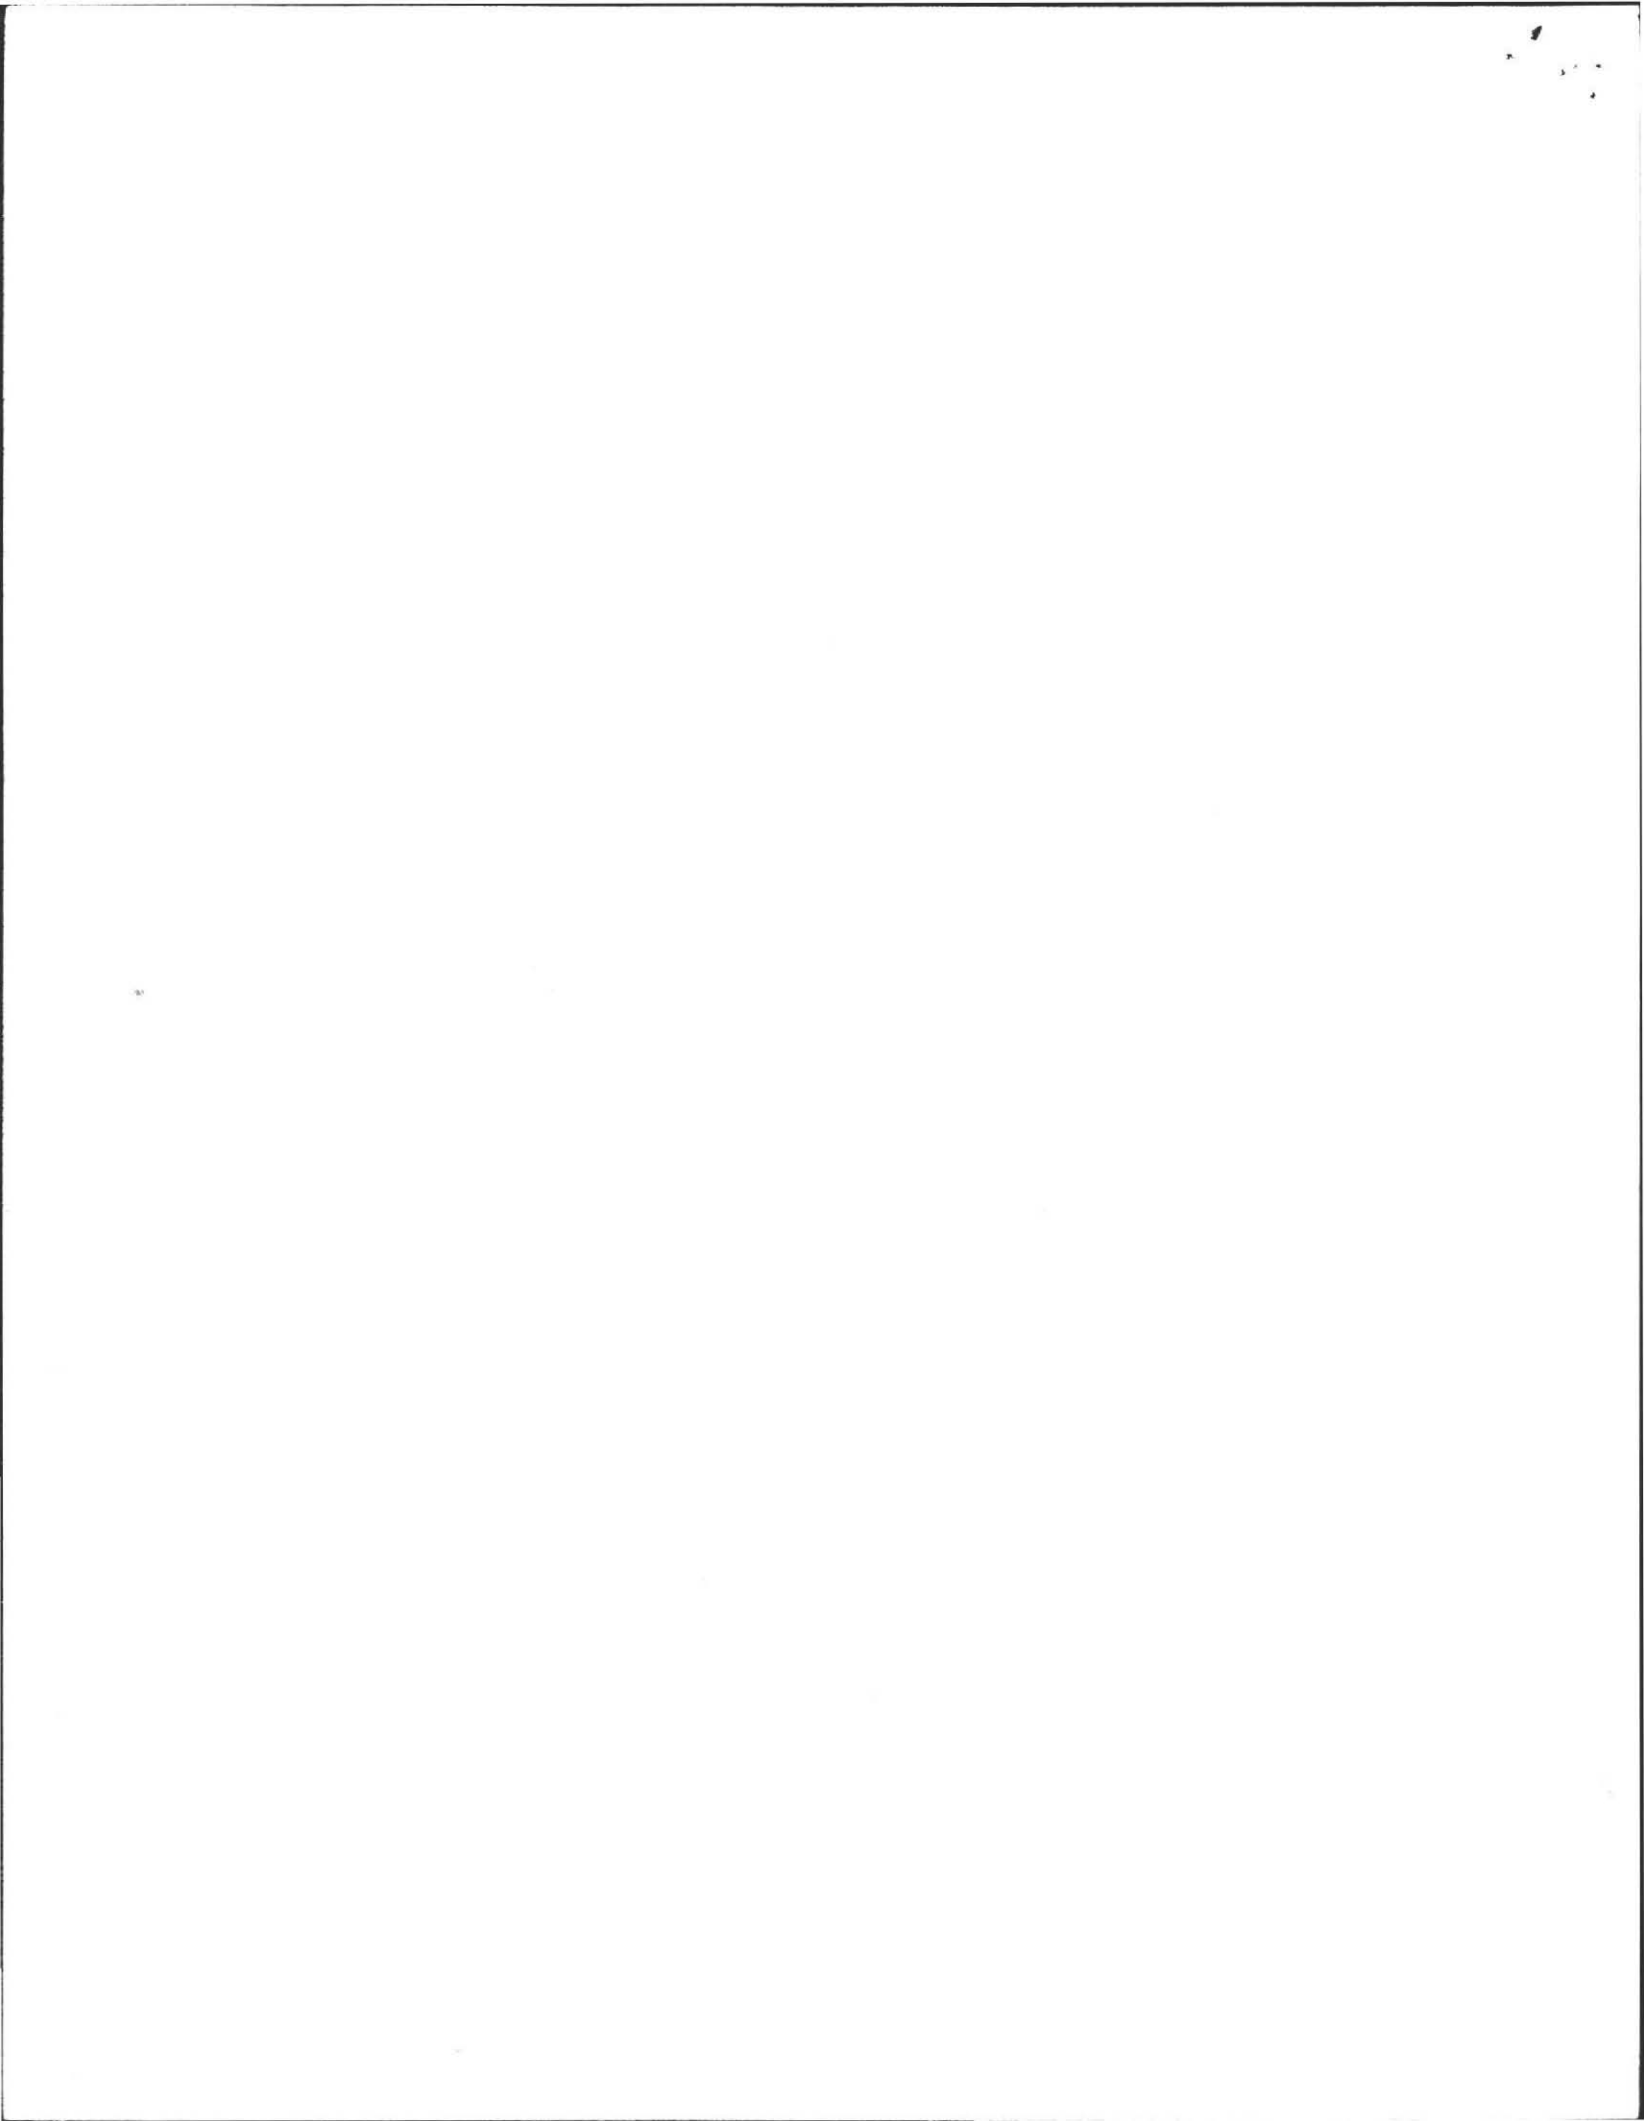





# PROFILE OF SEPTIC SYSTEM

For: J.B. French  
Box 1005  
Amherst Mass

Scale: Horizontal, 1" = 10'  
Vertical, 1" = 3'  
By: Frederick Filios

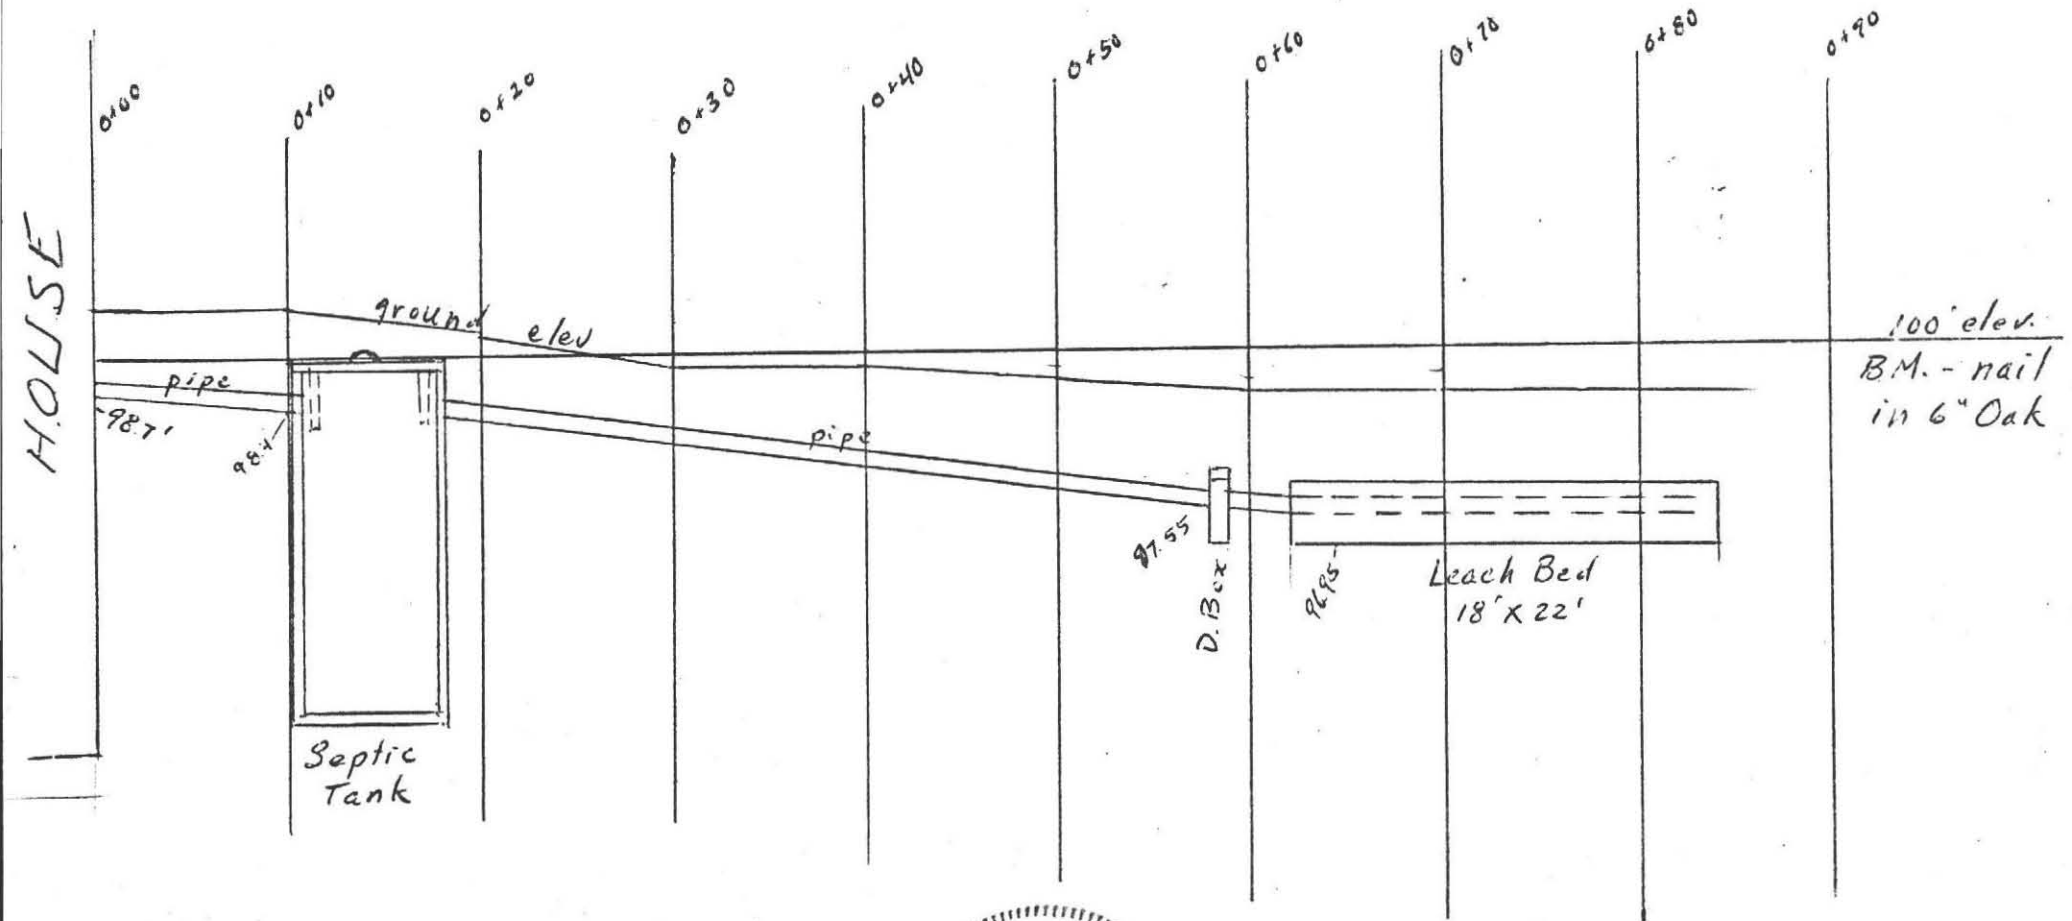

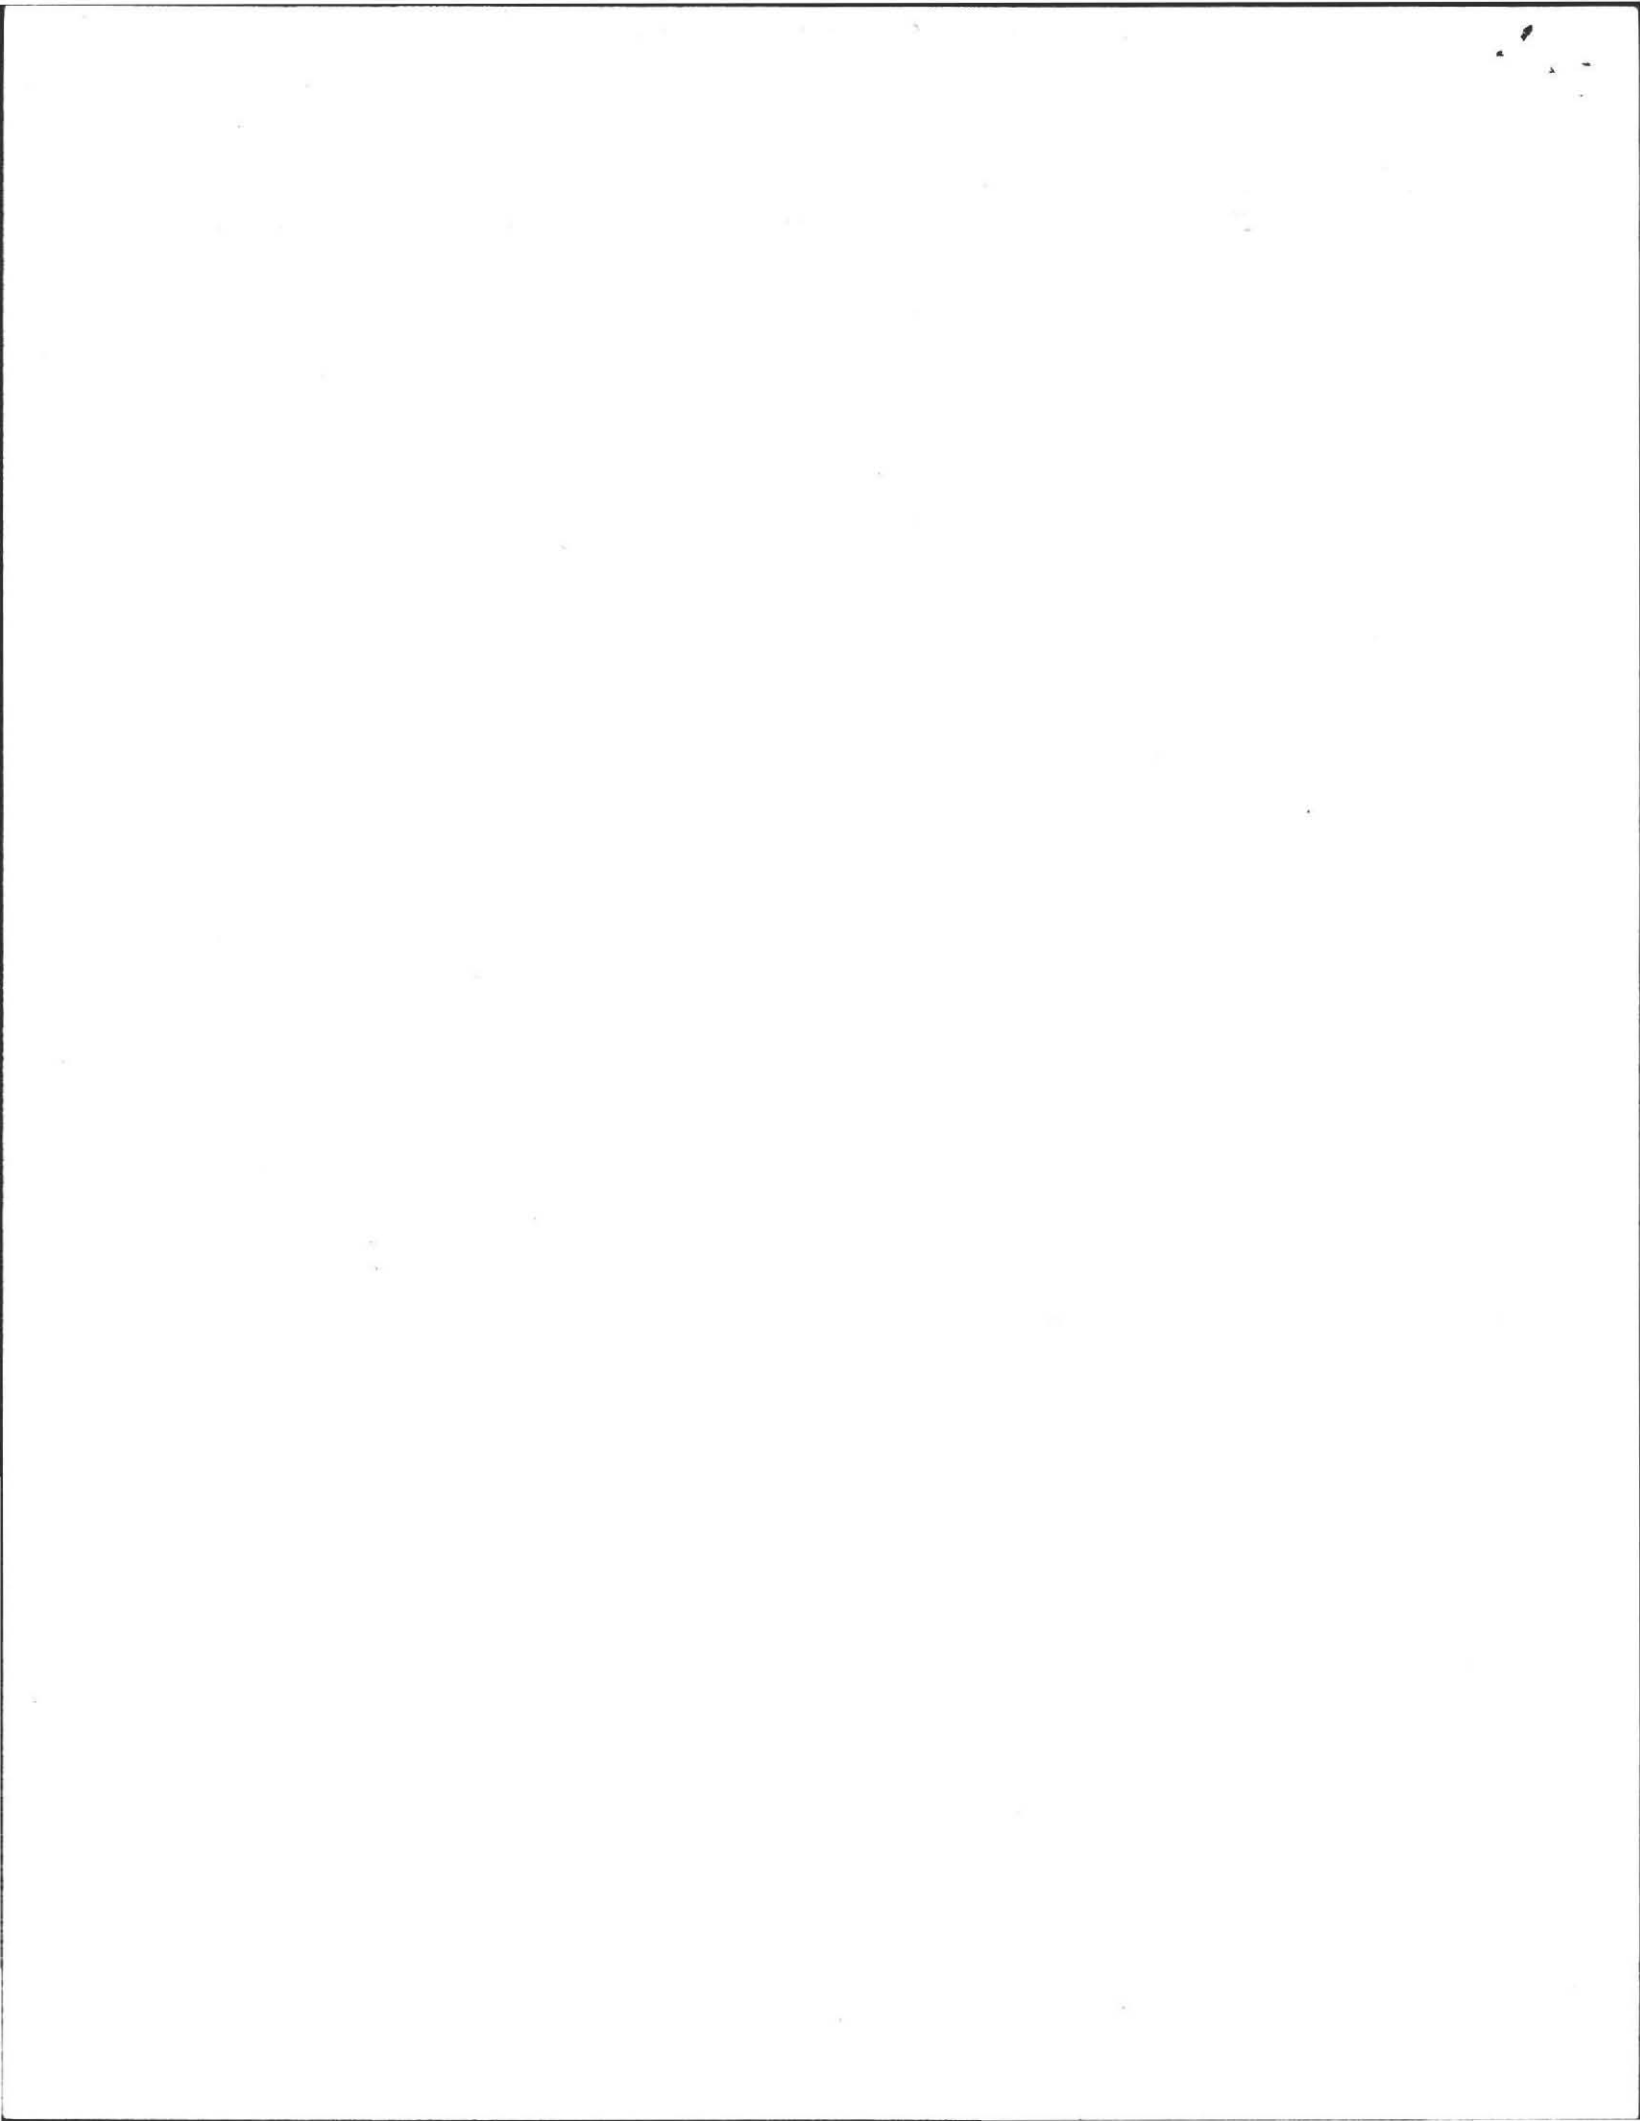


# DEEP SOIL LOGS

OWNER JB French  
Richard E Harding


Date Dec 3, 1981

LOCATION Flat Hills Road


OBSERVER FA Filios

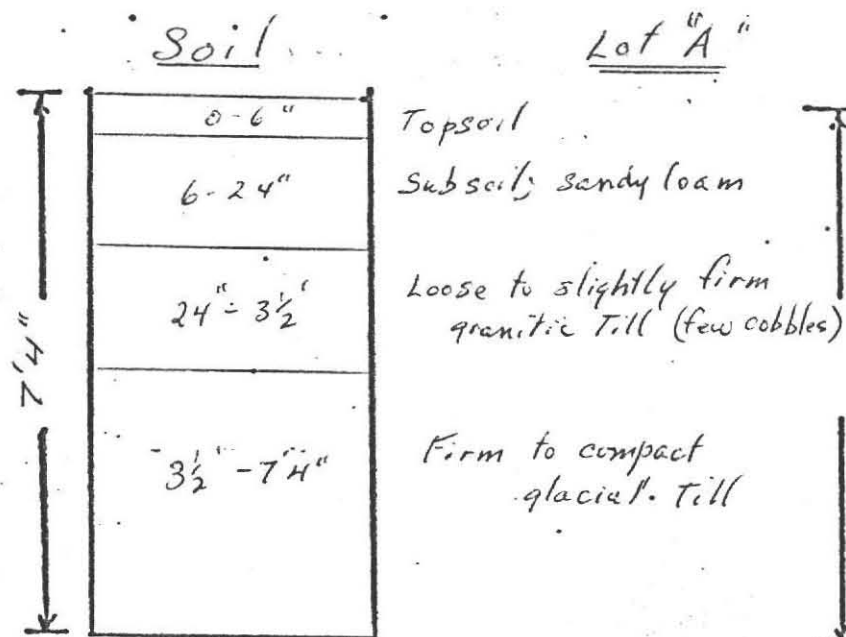


Ground Water none

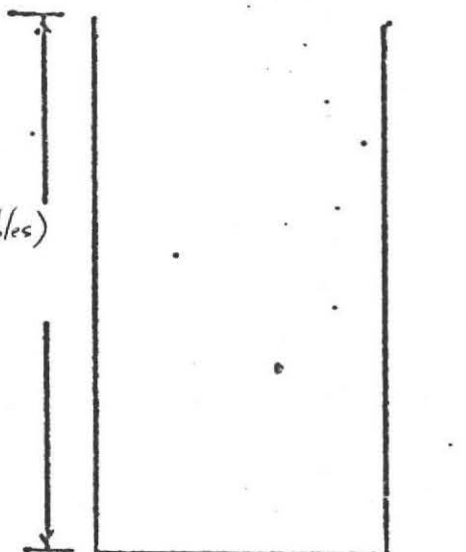

Ground Water \_\_\_\_\_

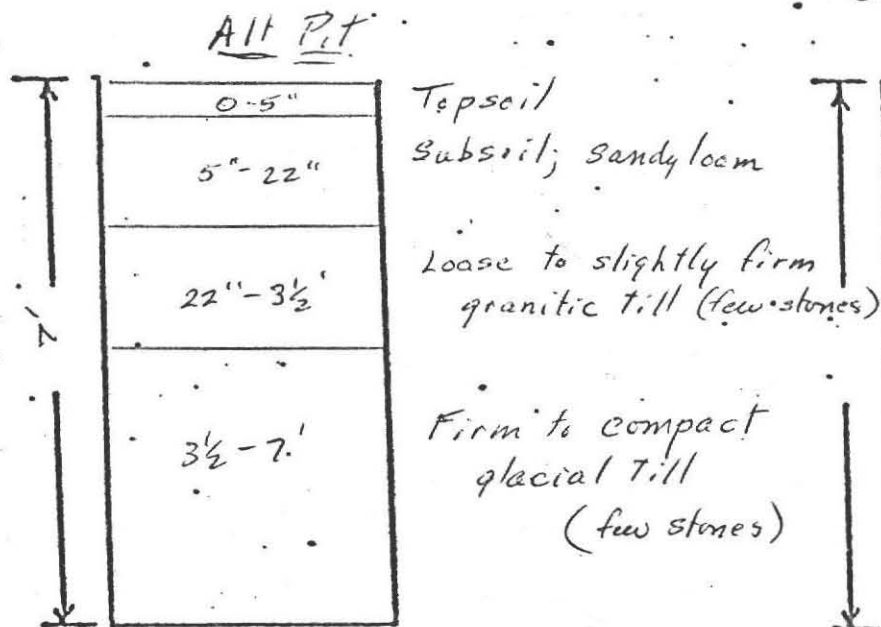

Ground Water none

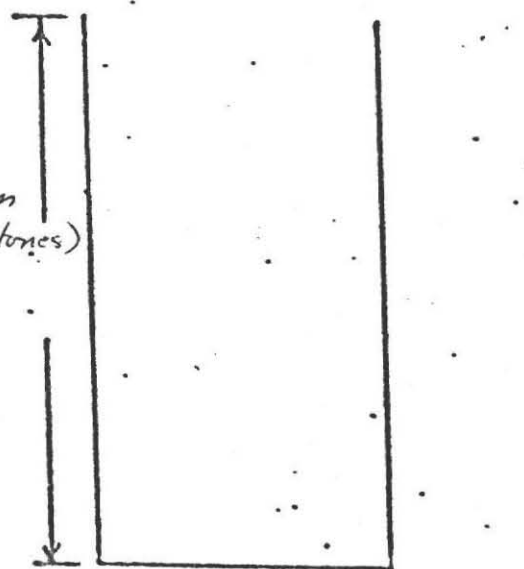

Ground Water \_\_\_\_\_

Rate of Percolation at 30"

4 minutes/inch



