

BOARD OF HEALTH, AMHERST, MASSACHUSETTS #324
APPLICATION FOR DISPOSAL WORKS CONSTRUCTION PERMIT

No. 77-8 Date 12-2-77 Fee 45.00 Date Rec'd. 12/8/77 By DGF

Application is hereby made for a permit to Construct (x) or Repair () an Individual Sewage Disposal System at:

Location—Address 324 Henry Street or Lot No. _____

Owner Dan Canon Address 151 N. Leverett

Contractor Wysocki Tracung Address Henry St

Type of Building _____ Dimensions _____ Size Lot S.

Dwelling—No. of Bedrooms 3 Expansion Attic () Garbage Grinder (x)

Other _____ No. of persons _____ Showers ()

Other fixtures _____

Town Water? _____ Type of Well _____

Design Flow 55 gallons per person per day. Total daily flow 330 gallons

Septic Tank—Liquid capacity 1500 gallons Dimensions: L _____ W _____ D _____

Disposal Trench—No. 1 Width 20' Total Length 30' Total leaching area 600 sq. ft.

Disposal Bed—No. _____ Diameter _____ Depth below inlet _____ Total leaching area _____ sq. ft.

Dry Well—No. 1 Diameter 8" Depth below inlet 6' Dimensions: 6 x 8 x 8 420

Other: Distribution box () No. _____ Dosing tank () _____

(Depth of Soil Line Below finished grade at foundation _____)

Percolation Test Results Performed by D.S.-Huntley Assoc., Inc. Date 6/18/74

Test Pit No. 1 0.75 minutes per inch Depth of Test Pit 3'6"

Test Pit No. 2 _____ minutes per inch Depth of Test Pit 6'6"

Description of Soil Coarse Sand & Gravel Depth to Ground Water None

Will disposal area be filled? NO Cut down? NO

(On reverse side or separate sheet, show plot plan with building. Include dimensions, distances from all boundaries. Show location of wells, streams, ledge, large trees, etc.)

AGREEMENT: The undersigned agrees to construct the aforescribed individual sewage disposal system in accordance with the provisions of Article XI of the Sanitary Code and regulations of the Amherst Board of Health. The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by this board of health.

Application Approved by [Signature] Walter J. Wysocki 12-2-77
 Owner or builder date
[Signature] 12-2-77
 date

Application Disapproved for the following reasons:

BOARD OF HEALTH, AMHERST, MASSACHUSETTS
CERTIFICATE OF COMPLIANCE

THIS IS TO CERTIFY, That the individual Sewage Disposal System installed () or repaired () by _____ at _____ has been constructed in accordance with the provisions of

INSTALLER
 Article XI of the State Sanitary Code as described in the application for Disposal Works Construction Permit No. _____ dated _____

The issuance of this certificate shall not be construed as a guarantee that the system will function satisfactorily.

DATE _____ Inspector _____

BOARD OF HEALTH, AMHERST, MASSACHUSETTS
DISPOSAL WORKS CONSTRUCTION PERMIT

No. 77-8
 Permission is hereby granted DAN CANON to construct (x) or repair () an Individual Sewage Disposal System at HENRY ST as shown on the application for Disposal Works Construction Permit No. 77-8

This permit is issued with the understanding that future alterations or additions will be made if necessary. This permit shall not be construed as permission to create or maintain any sewage nuisance and in the issuance of this permit the Board of Health assumes no responsibility for the future operation or maintenance of the system.

DATE 12-2-77 [Signature]
 Board of Health

Plot plan to follow.



1900

1900

30

1

1900

1900

1900

1900

1900

1900

1900

Allen M. Muntley Jr.

1900

1900

1900

1900

1900

1900

1900

1900

1900

1900

BOARD OF HEALTH
TOWN OF AMHERST, MASSACHUSETTS

Henry St

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

Owner DAN CANNON Address Henry St


Installer SELF Address 1

Date Installation Inspected and Approved Nov. 78?

Description of System: Tank Capacity: 1500


Leach Field () Bed () Seepage Pit (X) Square Feet:

Garbage Grinder Yes (X) No () No. Bedrooms: 3 No. People 6

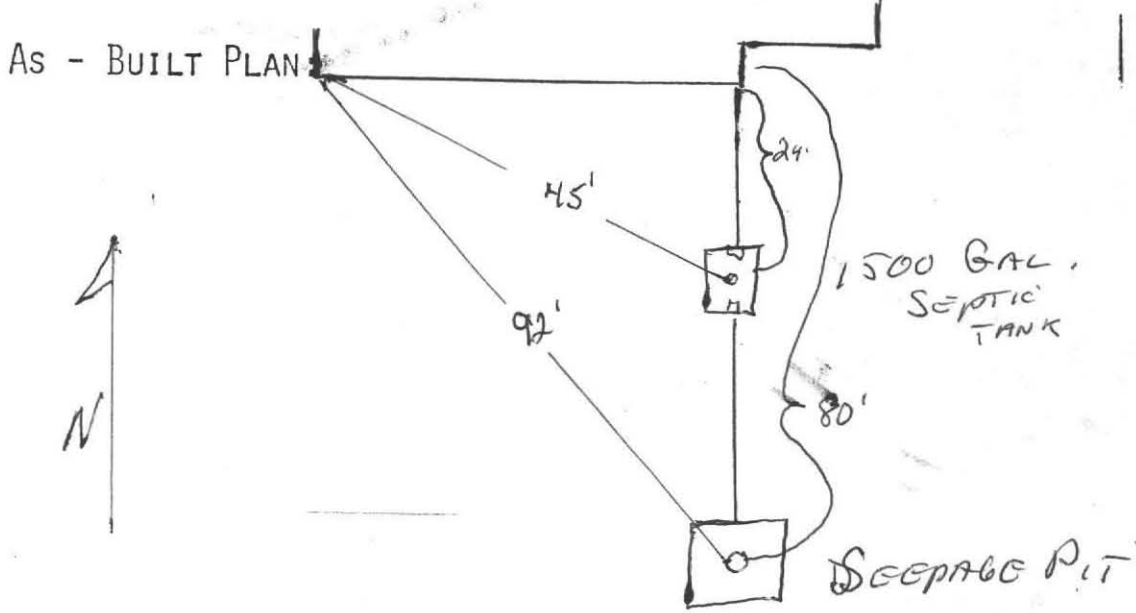

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

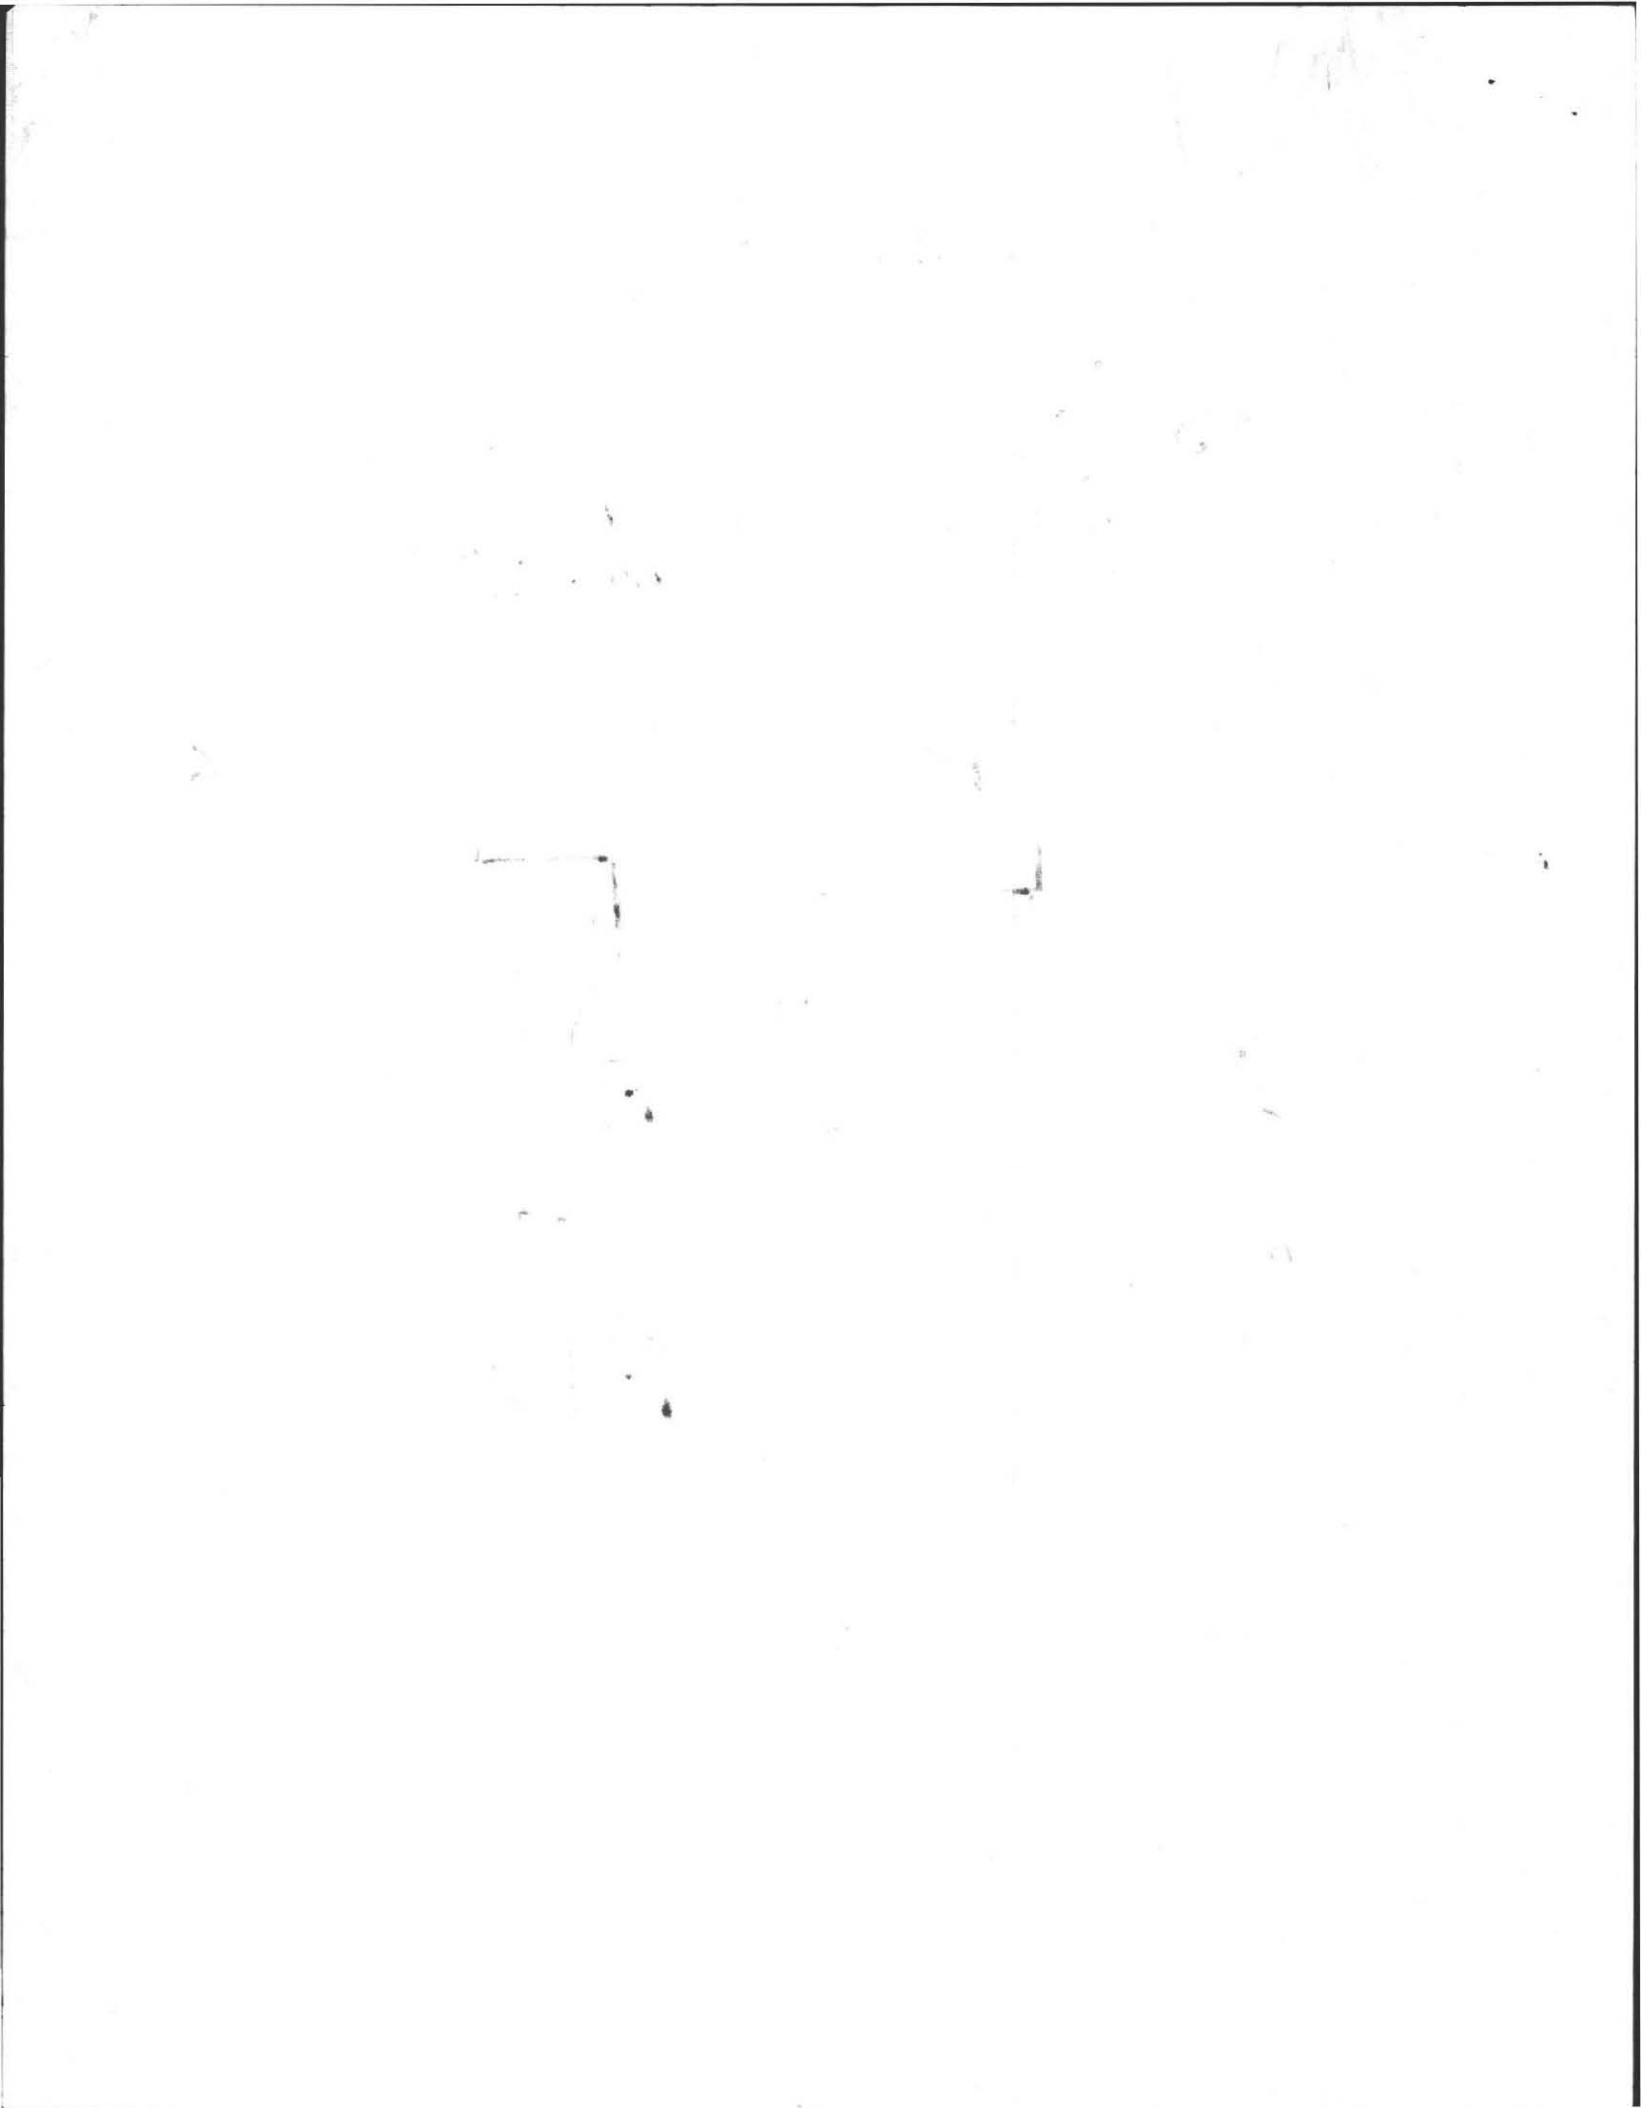

CANON
Henry
ST

