

APR. 25 1986. Noon #11 FEE \$90  
PK 0828

No. 86-40

THE COMMONWEALTH OF MASSACHUSETTS  
BOARD OF HEALTH

TOWN OF AMHERST, MASS.

Application for Disposal Works Construction Permit

Application is hereby made for a Permit to Construct (✓) or Repair ( ) an Individual Sewage Disposal System at:

11 LADY SHIPPER DRIVE LOT # 99  
ROBERT HOWES, JR. 66 EAST MYRTLE ST, ORANGE, MA.  
X RONALD CLARK ORANGE, MA 01364  
Location - Address or Lot No.  
Owner Address  
Installer Address

Type of Building Dwelling — No. of Bedrooms 4 Expansion Attic ( ) Garbage Grinder ( )  
Other — Type of Building FRAME No. of persons MAX 8 Showers ( ) — Cafeteria ( )  
Other fixtures

Design Flow 55 gallons per person per day. Total daily flow 440 gallons.  
Septic Tank — Liquid capacity 1500 gallons Length 10' Width 6' Diameter — Depth 5'  
Disposal Trench — No. — Width — Total Length — Total leaching area — sq. ft.  
Seepage Pit No. 2 Diameter 7.50 GAL Depth below inlet 2.5' Total leaching area 600 sq. ft.  
Other Distribution box (✓) Dosing tank ( )  
Percolation Test Results Performed by F.A. FILIOS, R.S. Date 4/23/85  
Test Pit No. 1 2 minutes per inch Depth of Test Pit 36" Depth to ground water NONE  
Test Pit No. 2 — minutes per inch Depth of Test Pit 120" Depth to ground water NONE

Description of Soil 0" to 24" TOP & SUBSOIL — 24" to 120" GRAVEL —  
NO WATER

Nature of Repairs or Alterations — Answer when applicable

Agreement:  
The undersigned agrees to install the aforescribed Individual Sewage Disposal System in accordance with the provisions of TITLE 5 of the State Sanitary Code — The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by the board of health.

Signed Robert H. Howes 4/24/86  
Application Approved By [Signature] 4/23/86  
Date

Application Disapproved for the following reasons:

Permit No. 86-40 Issued 4/28/86 7:50 AM  
Date

THE COMMONWEALTH OF MASSACHUSETTS  
BOARD OF HEALTH

OF  
Certificate of Compliance

THIS IS TO CERTIFY, That the Individual Sewage Disposal System constructed ( ) or Repaired ( )  
by  
Installer

at  
has been installed in accordance with the provisions of TITLE 5 of The State Sanitary Code as described in the application for Disposal Works Construction Permit No. dated

THE ISSUANCE OF THIS CERTIFICATE SHALL NOT BE CONSTRUED AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORY.

DATE Inspector

THE COMMONWEALTH OF MASSACHUSETTS  
BOARD OF HEALTH

No. 86-40 TOWN OF AMHERST FEE \$90

Disposal Works Construction Permit


Permission is hereby granted ROBERT HOWES JR. — RONALD CLARK  
to Construct (X) or Repair ( ) an Individual Sewage Disposal System  
at No. LOT #99 - 11 LADY SHIPPER CIRCLE  
Street

as shown on the application for Disposal Works Construction Permit No. 86-40 Dated 4/24/86  
[Signature]

DATE 4/28/86 7:50 AM Board of Health

CHECK OR FILL IN WHERE APPLICABLE



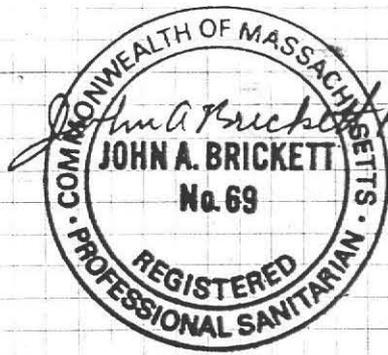

JOHN A. BRICKETT, R.S.  
 19 SUMMER STREET  
 GREENFIELD, MASS. 01301


John A. Brickett R.S.  
 11/8/86  
 NO SCALE

LOT #99


1.477 ACS


Need:


- 1 - 1500 GAL. SEPTIC TANK
- 2 - 750 GAL. LEACH TANKS
- MIN. 12" - 1 1/2" WASHED STONE
- BELOW TANKS + 24" AROUND TANKS
- 1 - DIST. BOX

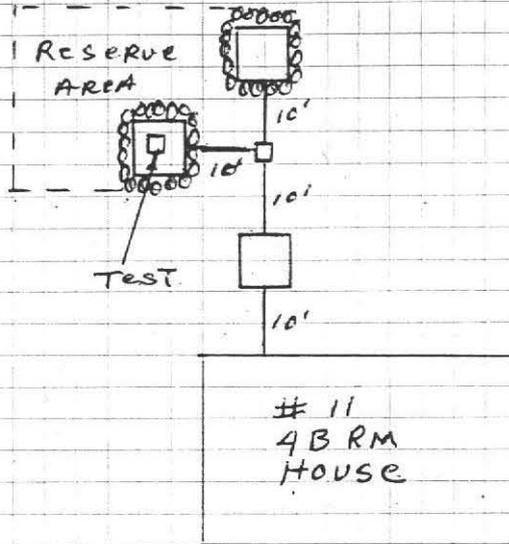


TEST PIT LOG

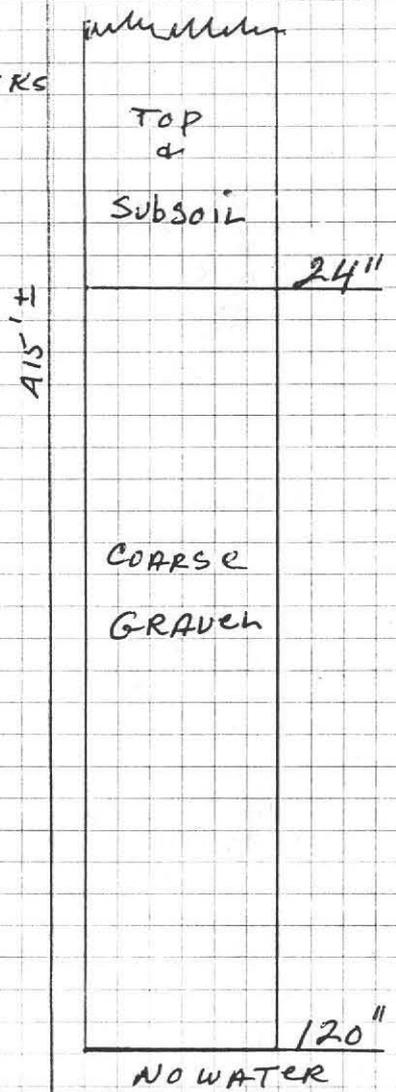



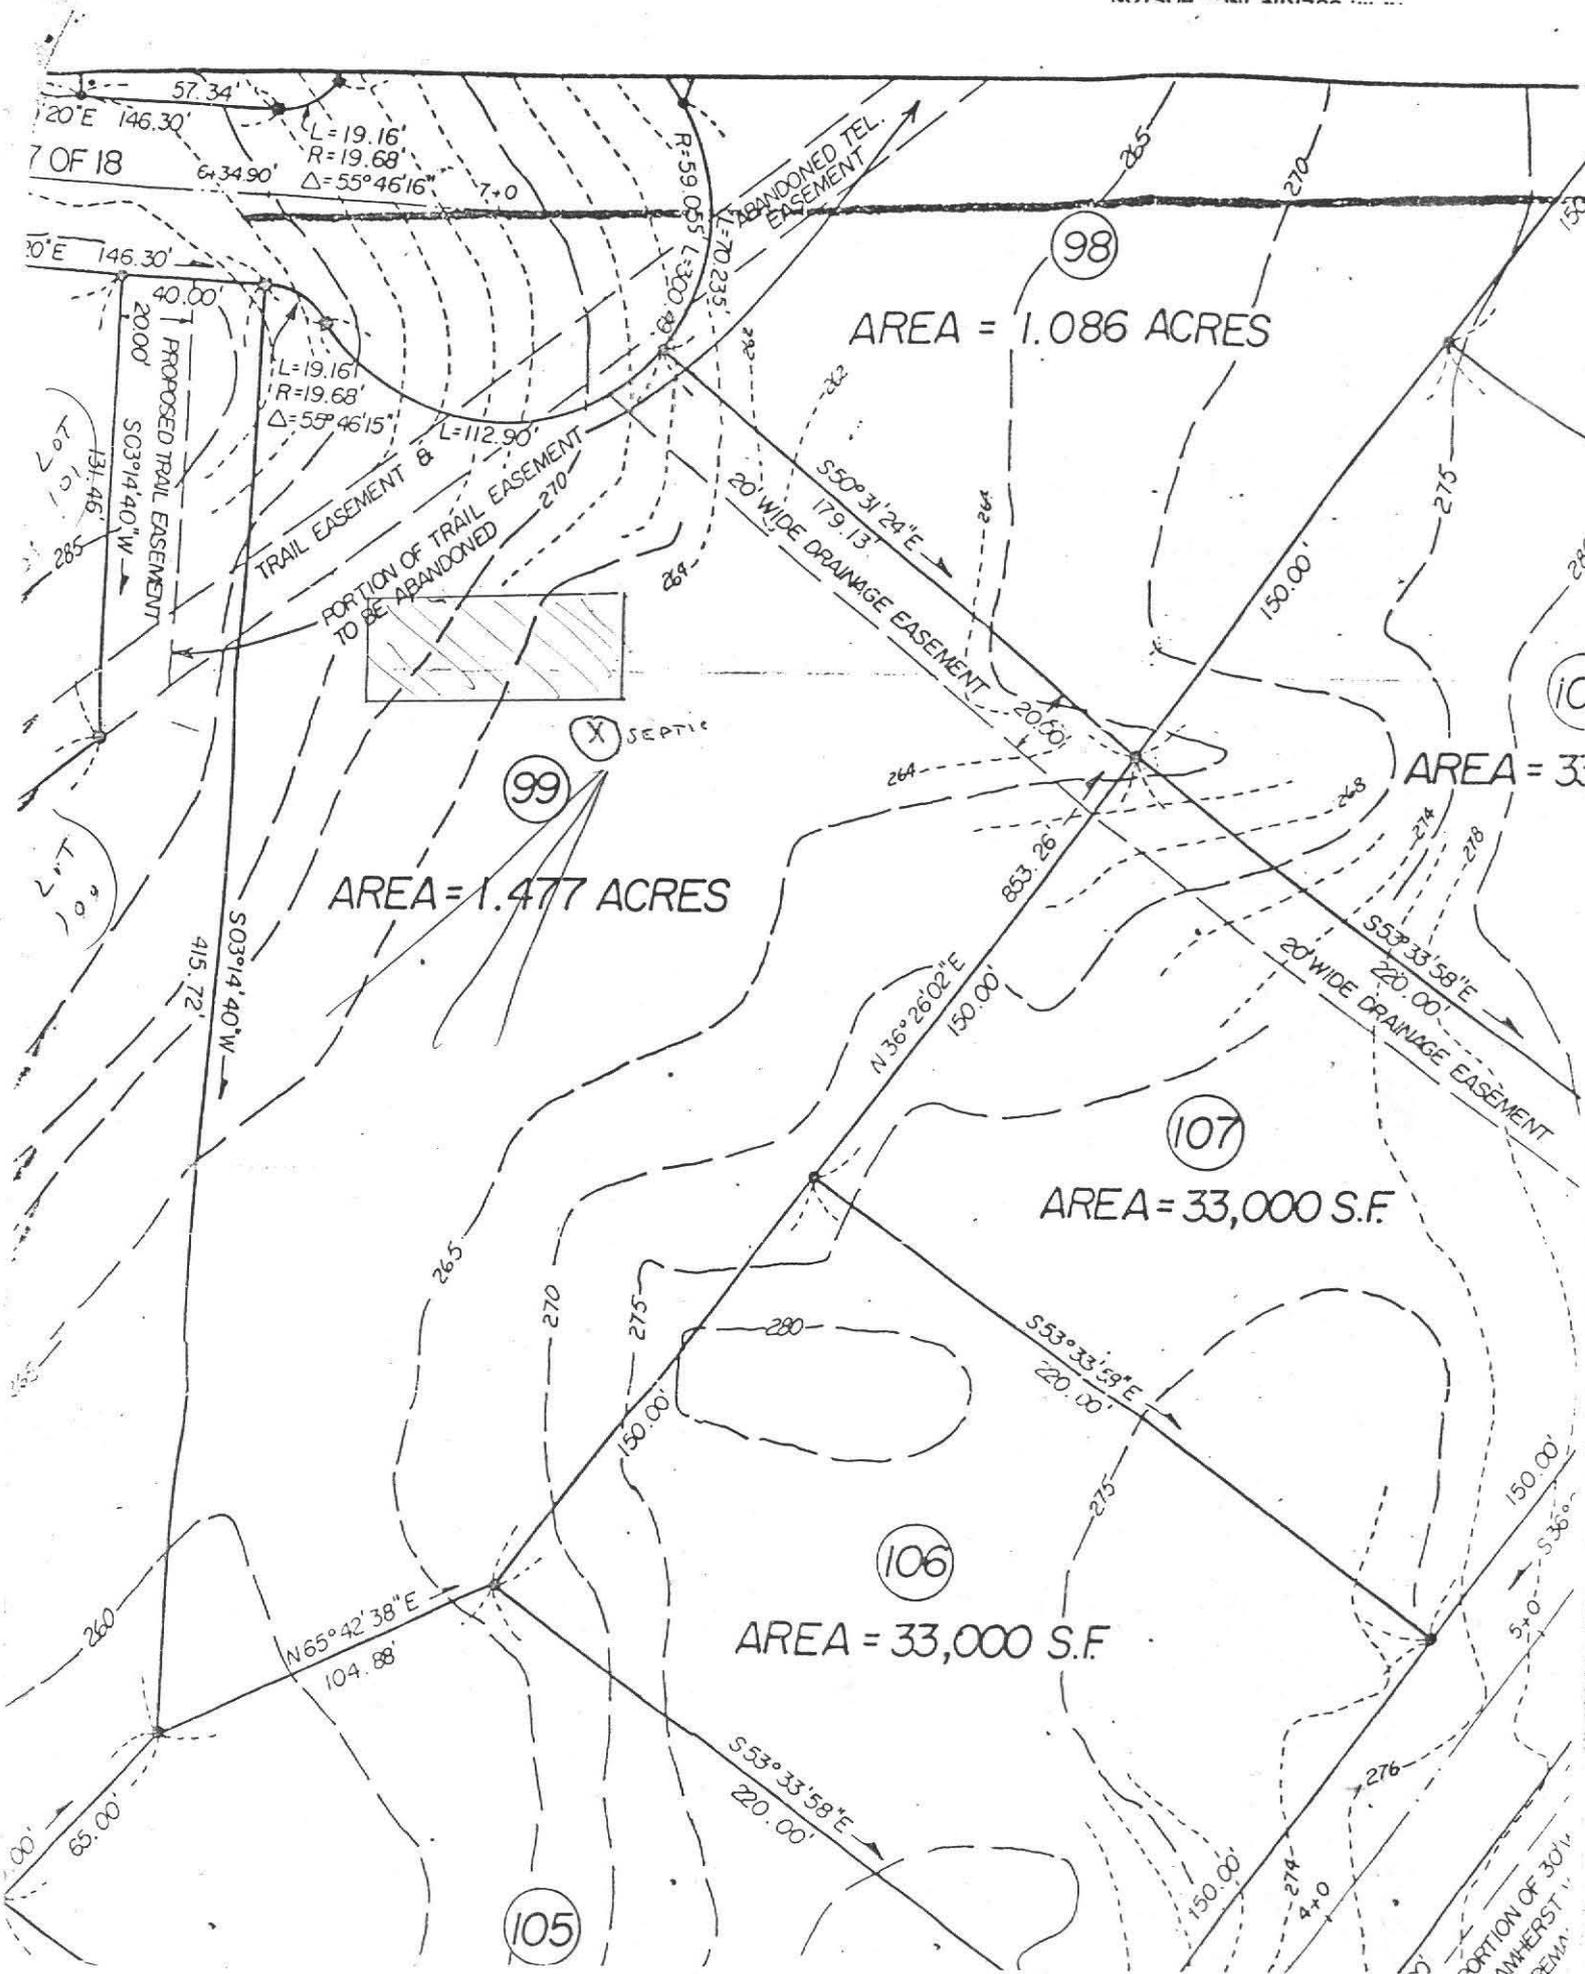



BOARD OF HEALTH

TOWN OF AMHERST, MASSACHUSETTS

Lot 99. LADY SUPPER DR

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

Owner Robert Nowes Jr. Address 66 East Myrtle St, Orange, MA.

Installer RON CLARK Address ORANGE, MA.


Date Installation Inspected and Approved 6/30/86

Description of System: Tank Capacity: 1500 <sup>750 GALLON</sup> 300 <sup>TO SIDES</sup>

Leach Field ( ) Bed ( ) 2 Seepage Pit ( X ) Square Feet: 300 <sup>BOTTOM</sup>

Garbage Grinder Yes ( X ) No ( ) No. Bedrooms: 4 No. People 8

AS - BUILT PLAN:

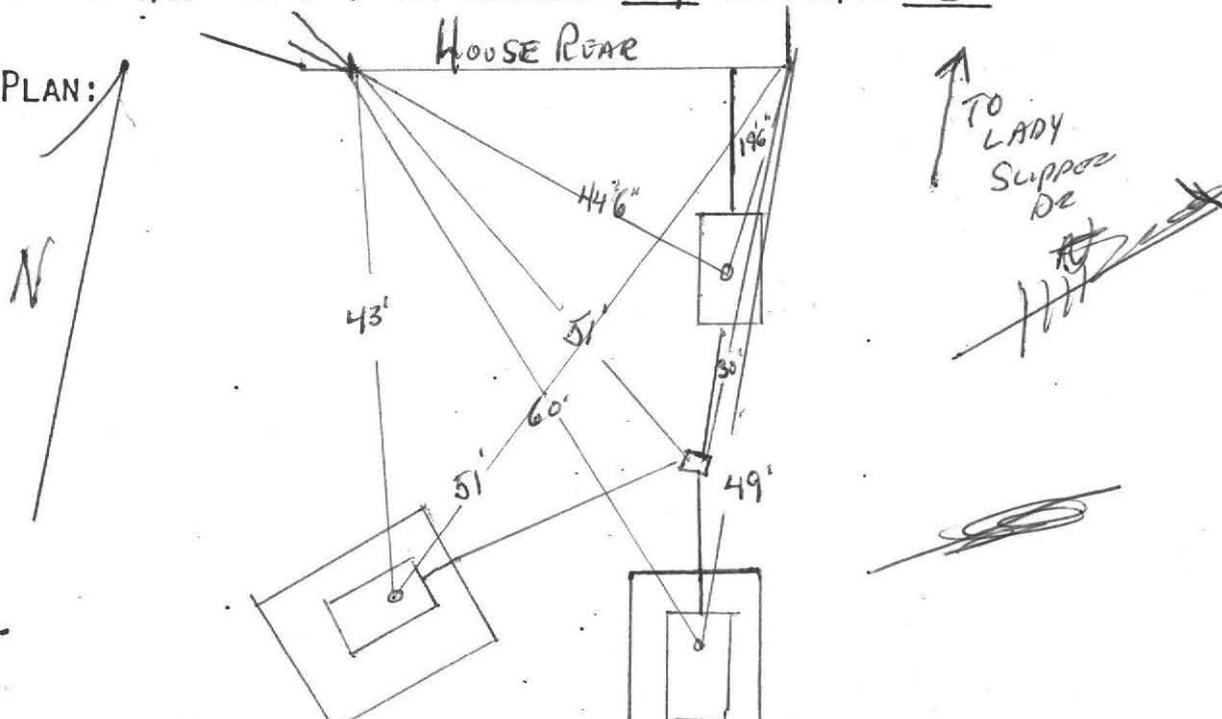

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed \_\_\_\_\_ years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

