

TOWN OF AMHERST, MASSACHUSETTS


51 MIDDLE ST.

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE


Owner WILLIAM J MANNING Address 51 MIDDLE ST.
 Installer KARL'S E.C. Address RIVER DR. WADLEY.
 Date Installation Inspected and Approved 11-14-79

Description of System: Tank Capacity: EXISTING 1000 GAL
 Leach Field () Bed (X) Seepage Pit () Square Feet: 1,000
 Garbage Grinder Yes () No () No. Bedrooms: 4 No. People 8

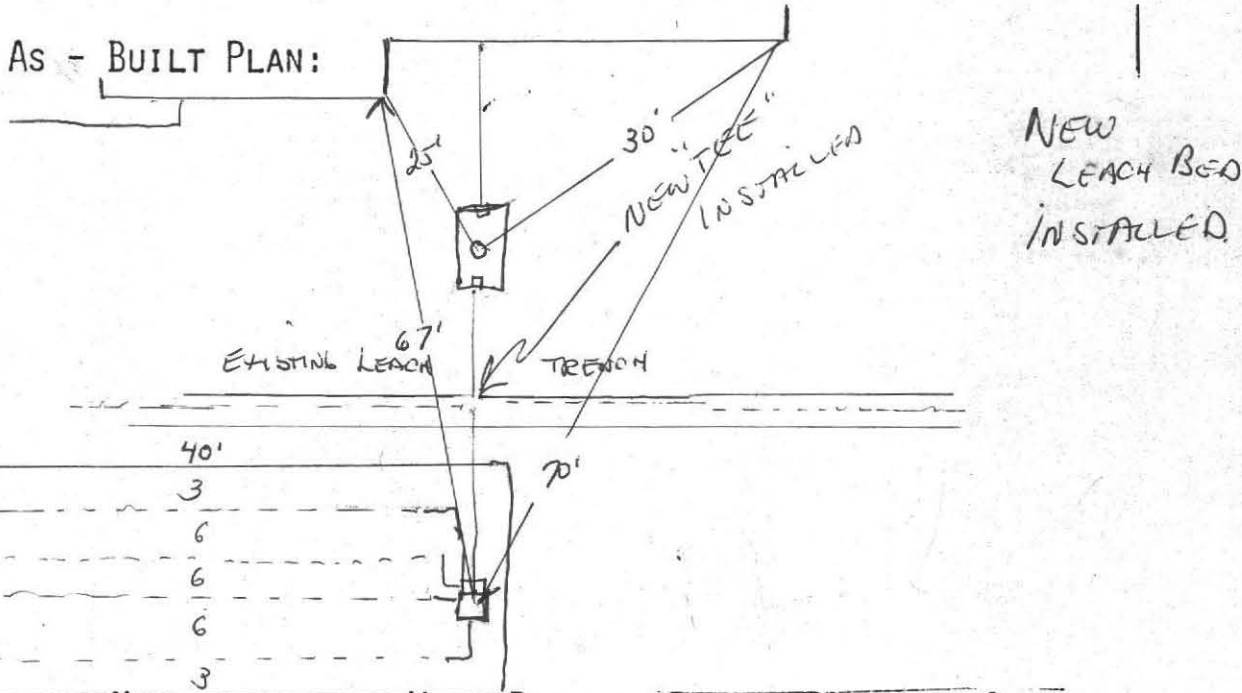

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

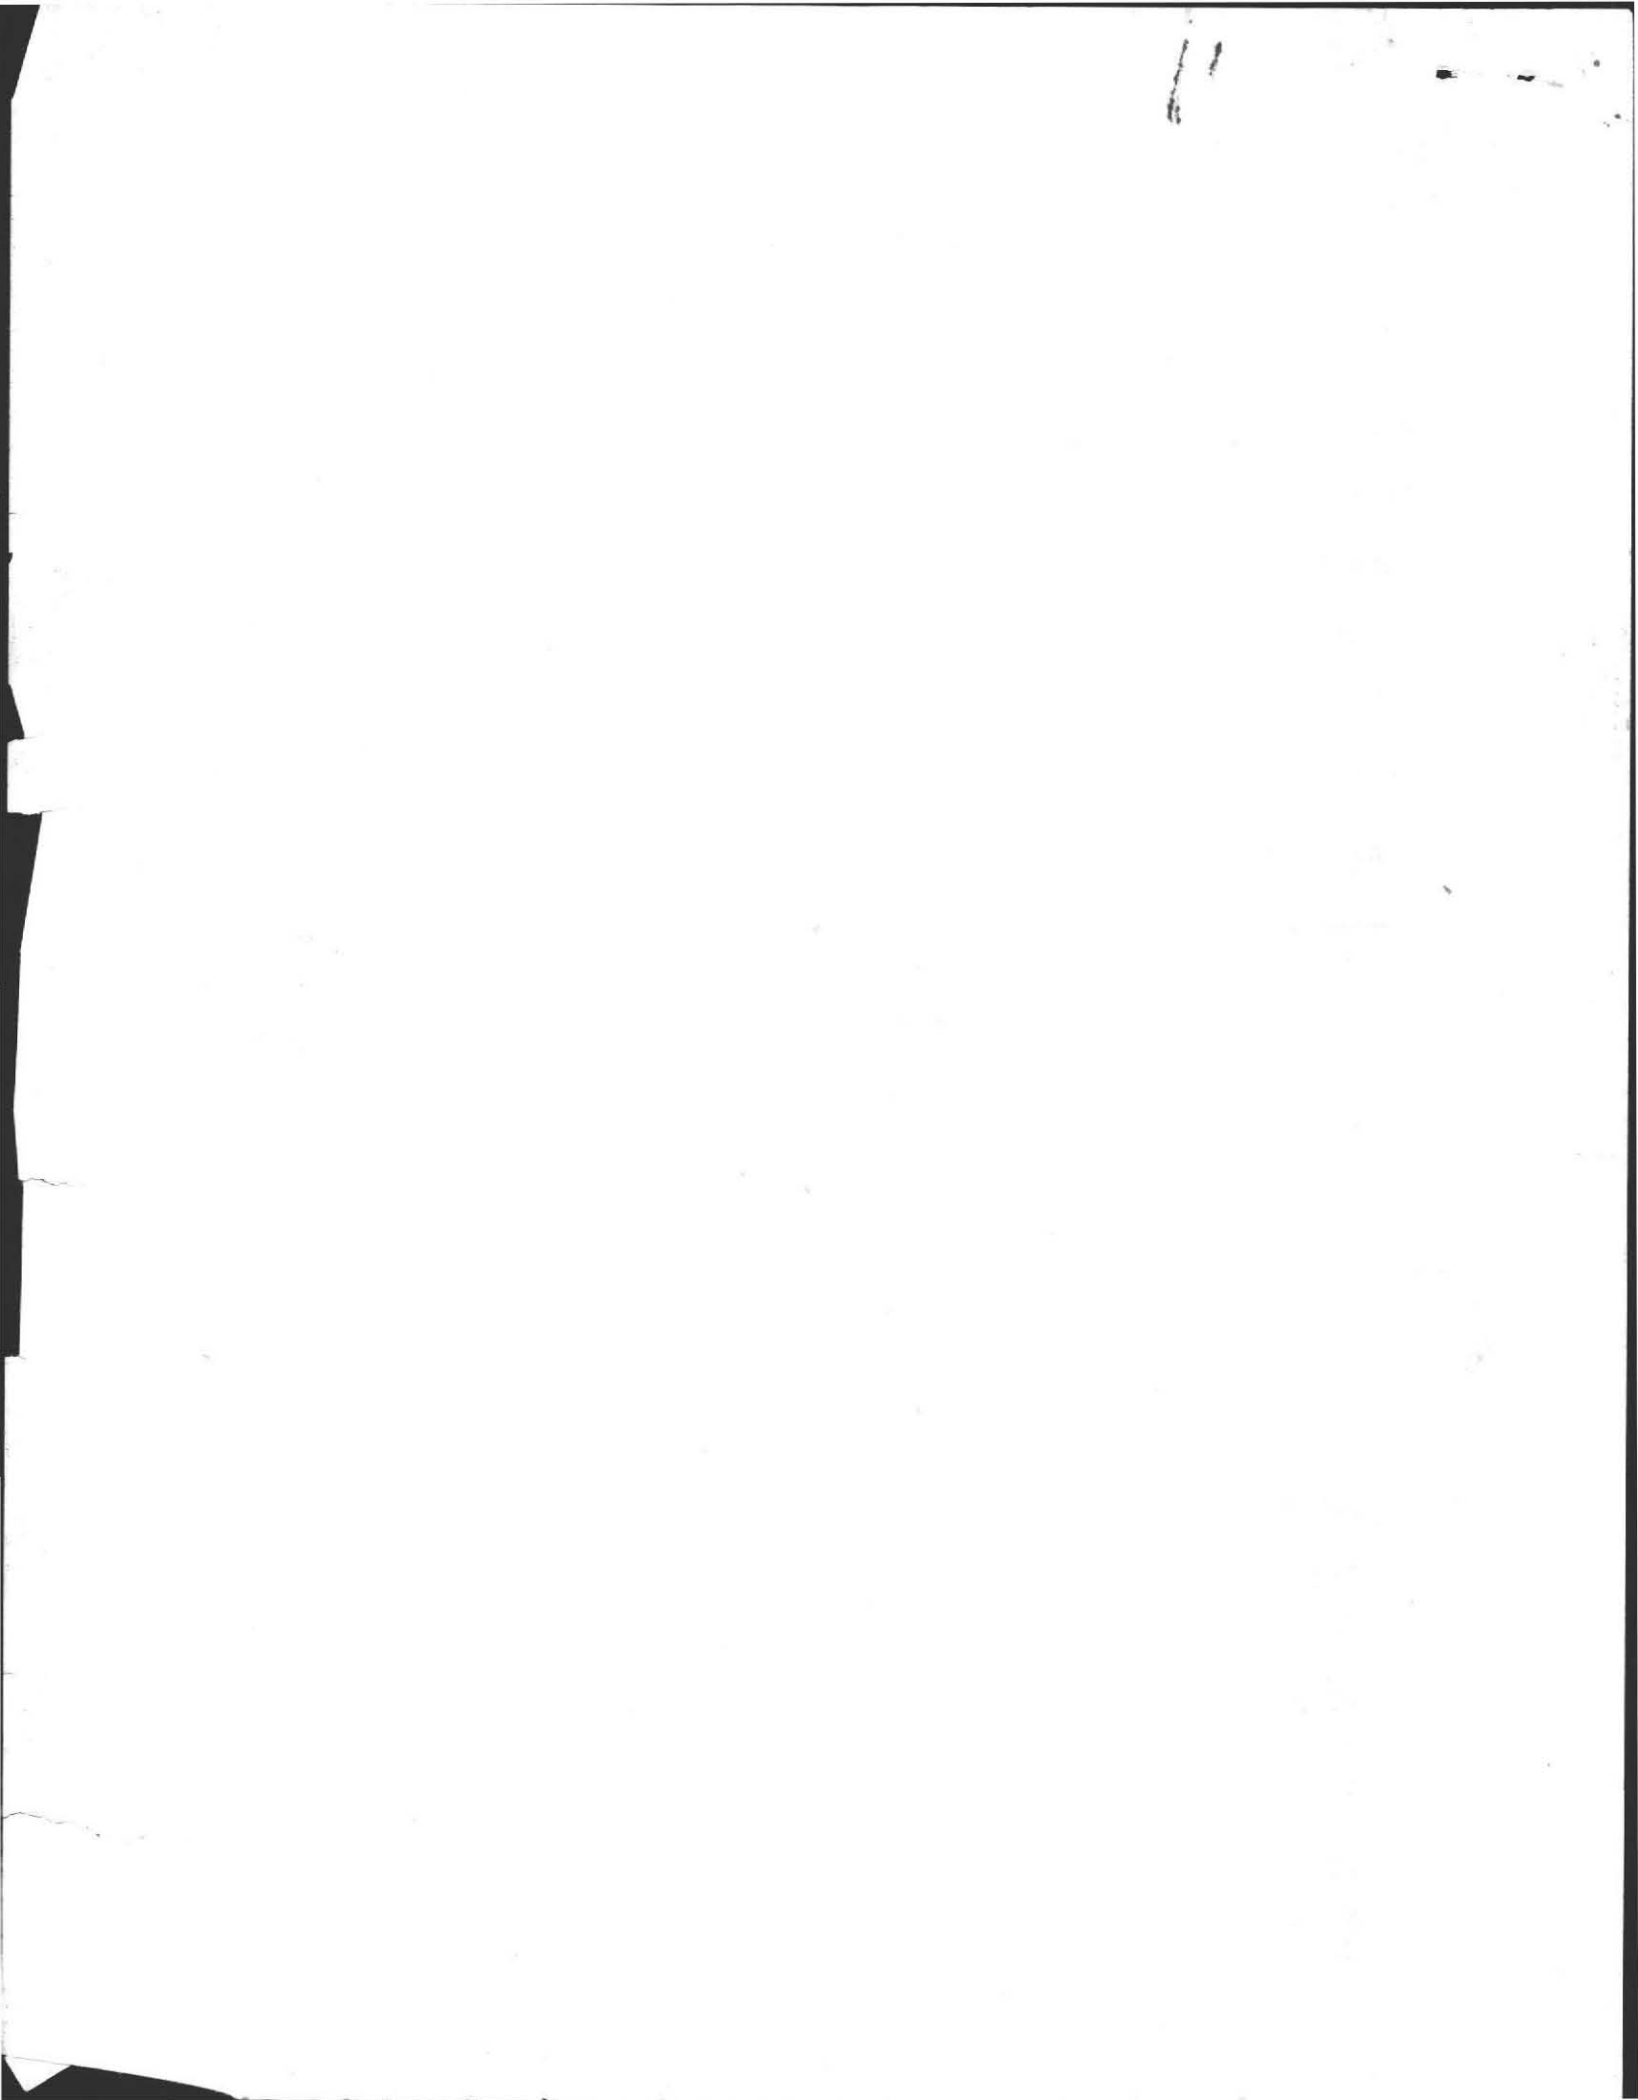

KARL KONIECZNY
KARL'S EXCAVATING, INC.

327 River Drive, Hadley


Phone 549-5396

date 11-13+14-79

William Manning
51 Middle St., So. Amherst

FOLD
▼

subject:

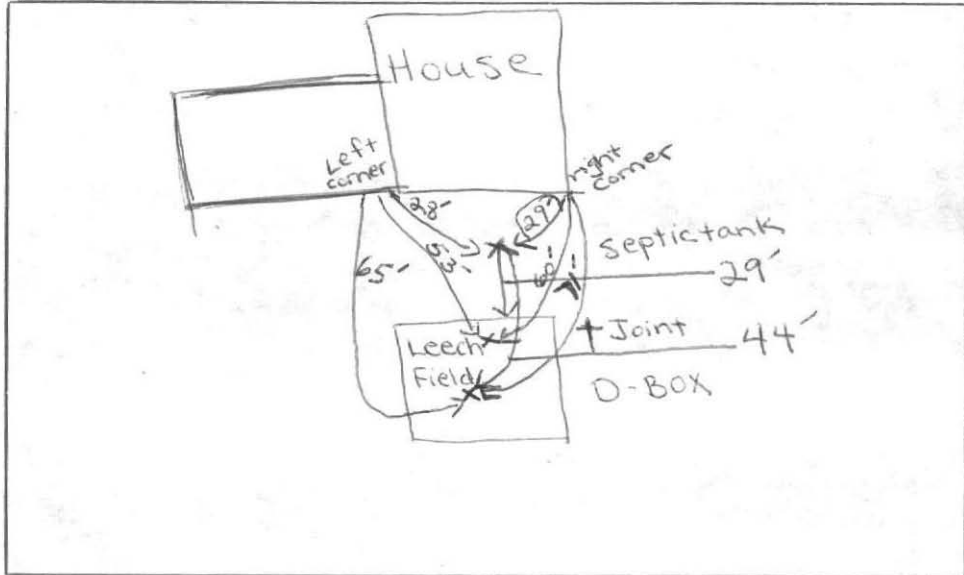

W. H. KENNEDY
LARRY F. KENNEDY, JR.
207 River Dr., B-104
Phone 34-2373

11-13-14-17

William M. Smith
21 Middle St., 2nd Floor