

RECEIVED
7/8/05

ok

**TITLE 5
OFFICIAL INSPECTION FOR - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM FORM
PART A
CERTIFICATION**

Property Address: 711 Northeast Street, Amherst, MA 01002

Owner's Name: Dee & Bob Waterman
Owner's Address: 711 Northeast Street
Amherst, Ma 01002

Date of Inspection: June 29, 2005

Name of Inspector: Alan E. Weiss, R.S # 933
Company Name: Cold Spring Environmental Inc.
Mailing Address: 350 Old Enfield Road
Belchertown, Massachusetts 01007
Telephone Number: (413) 323-5957 fax: 413-323-4916

CERTIFICATION STATEMENT

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of the inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on site sewage disposal systems. I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000). The system:

- XX - Passes
- Conditionally Passes
- Needs Further Evaluation by the Local Approving Authority
- Falls


Inspector's Signature:  **Date:** June 29, 2005

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

Notes and Comments:

1000 gal. Septic Tank had good levels. The tank was pumped. The L. Tank was noted in good condition with no standing liquid. No evidence of High Groundwater in area. Effective height is 24 inches with (2) 5' x 10' L. tanks. Property has town water. System was used by 2 person, & is 6+/- years old.

******This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same different conditions of use.**

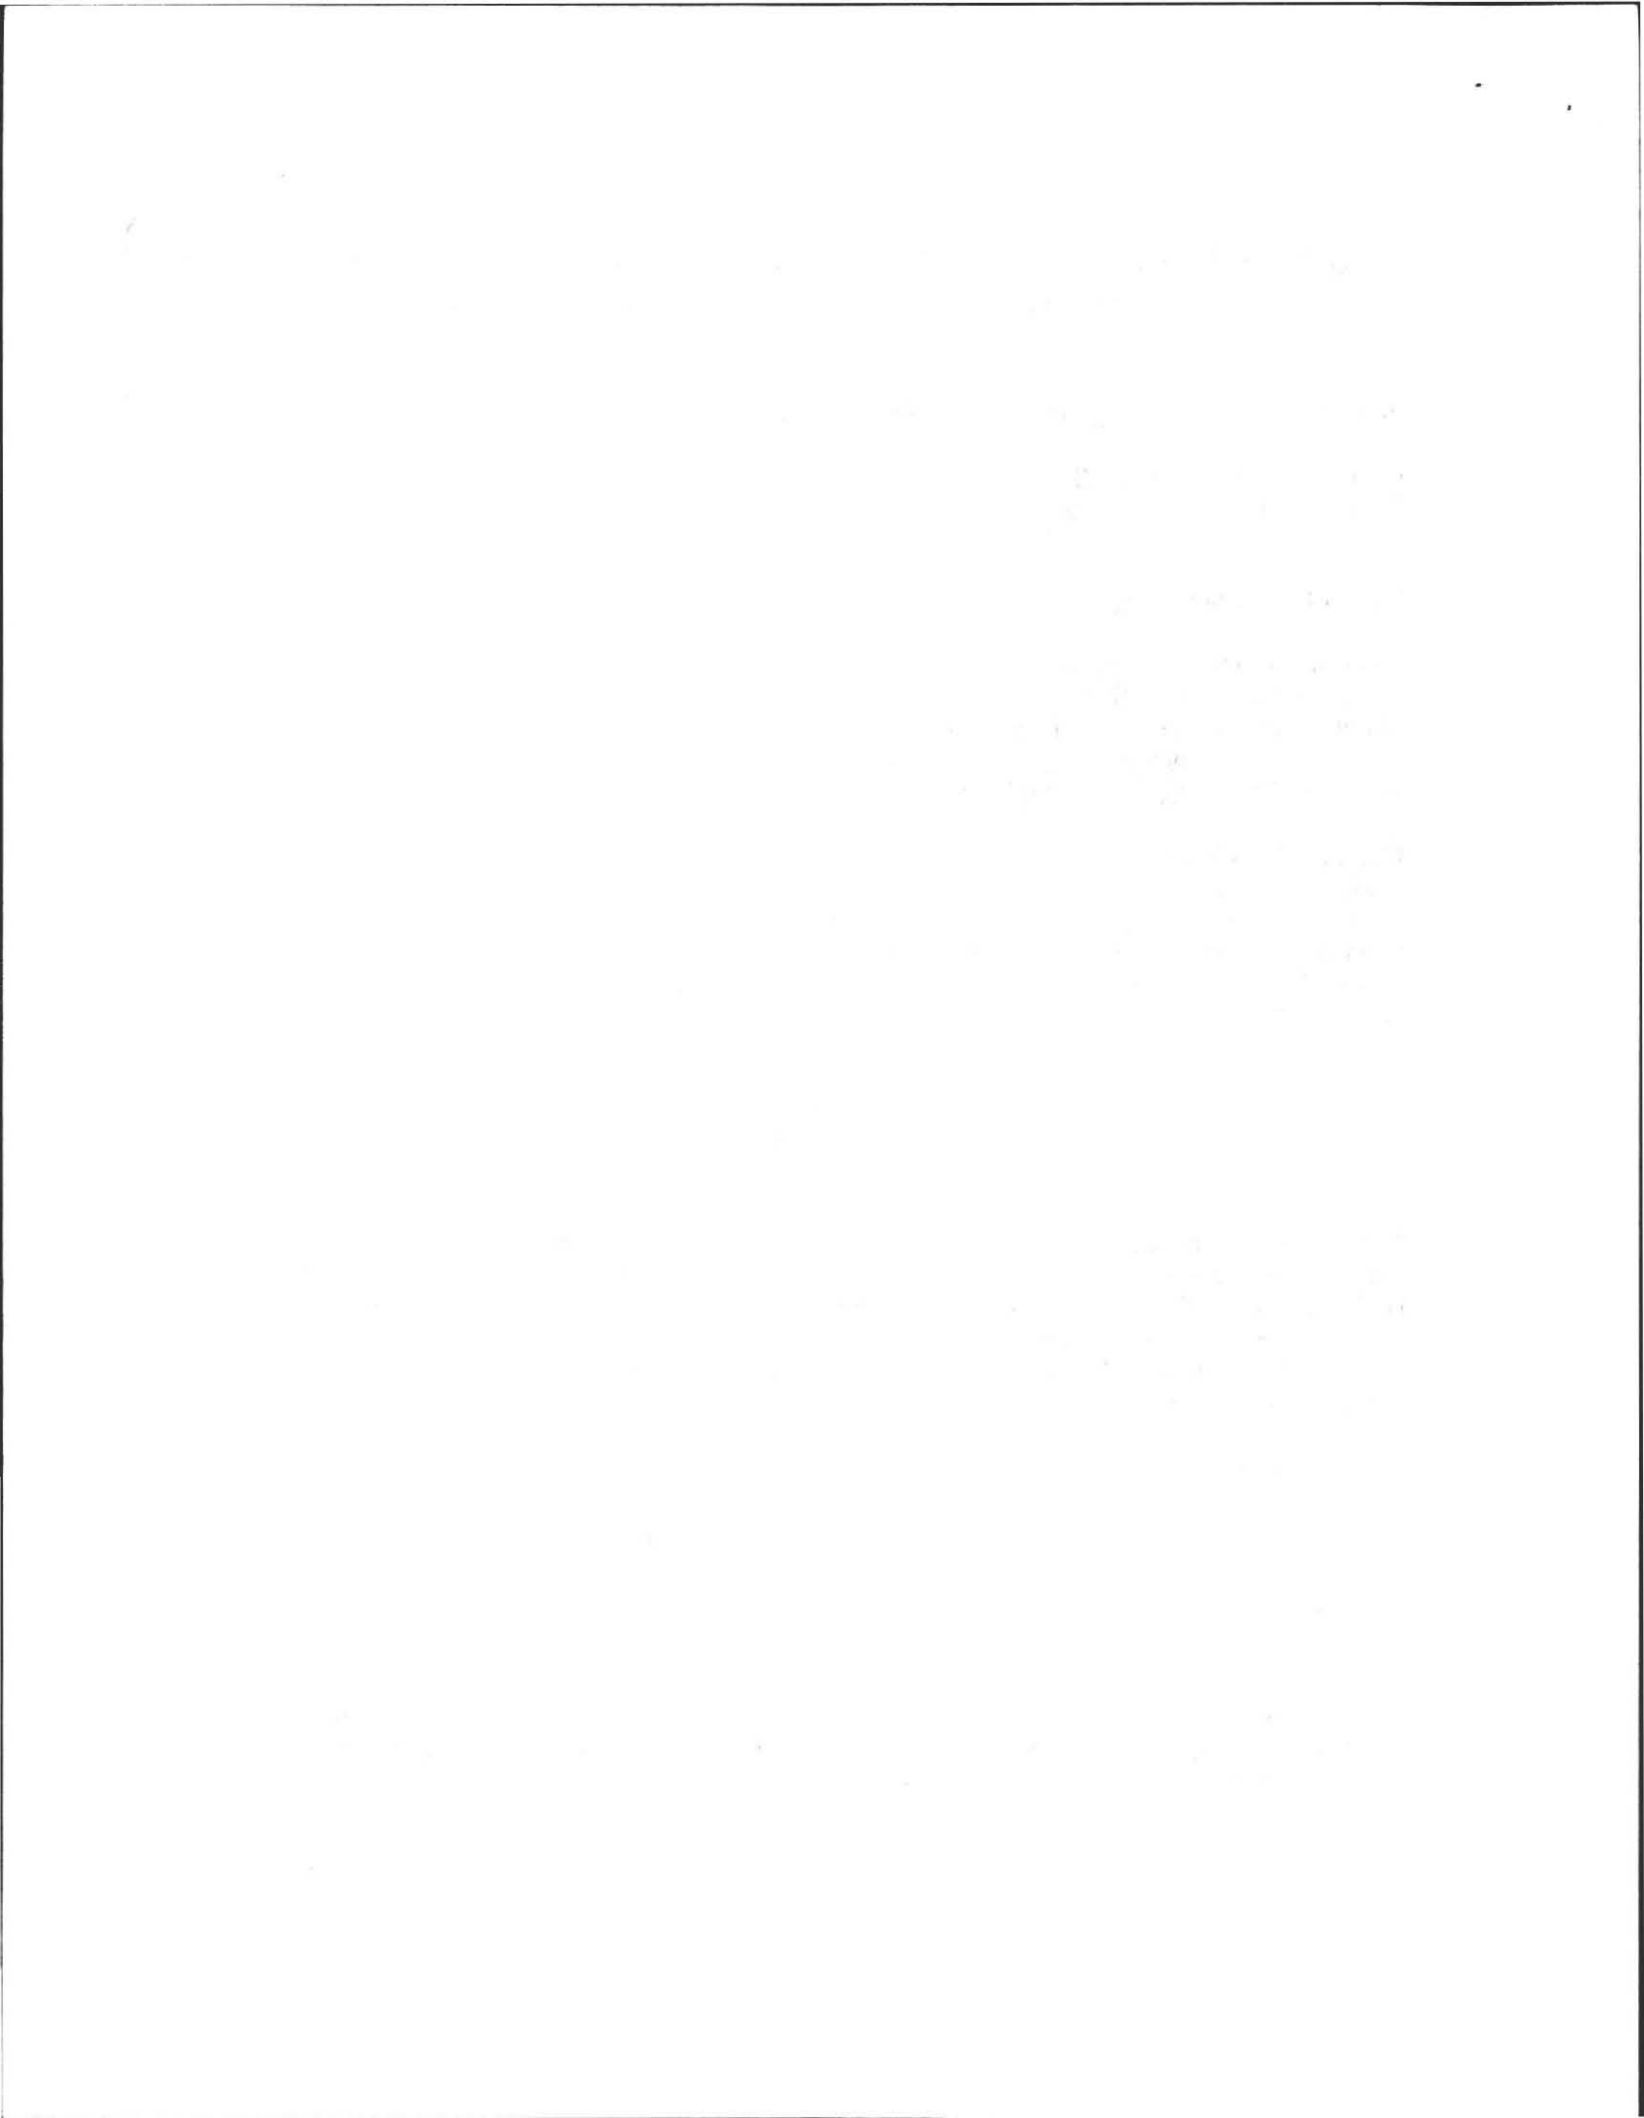

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 711 Northeast Street, Amherst

Owner: Waterman

Date of Inspection: June 29, 2005

Inspection Summary: Check A,B,C,D or E / ALWAYS complete all of Section D

A. System Passes:

XX I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments: Good condition, no signs of failure

B. System Conditionally Passes:

___ One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Answer yes, no or not determined (Y,N,ND) in the ___ for the following statements. If "not determined" please explain.

___ The septic tank is metal and over 20 years old* or the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health. *A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

ND explain:

___ observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System will pass inspection if (with approval of Board of Health):

- ___ broken pipe(s) are replaced
- ___ obstruction is removed
- ___ distribution box is leveled or replaced


ND explain:

___ The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

- ___ broken pipe(s) are replaced
- ___ obstruction is removed

ND explain:

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS

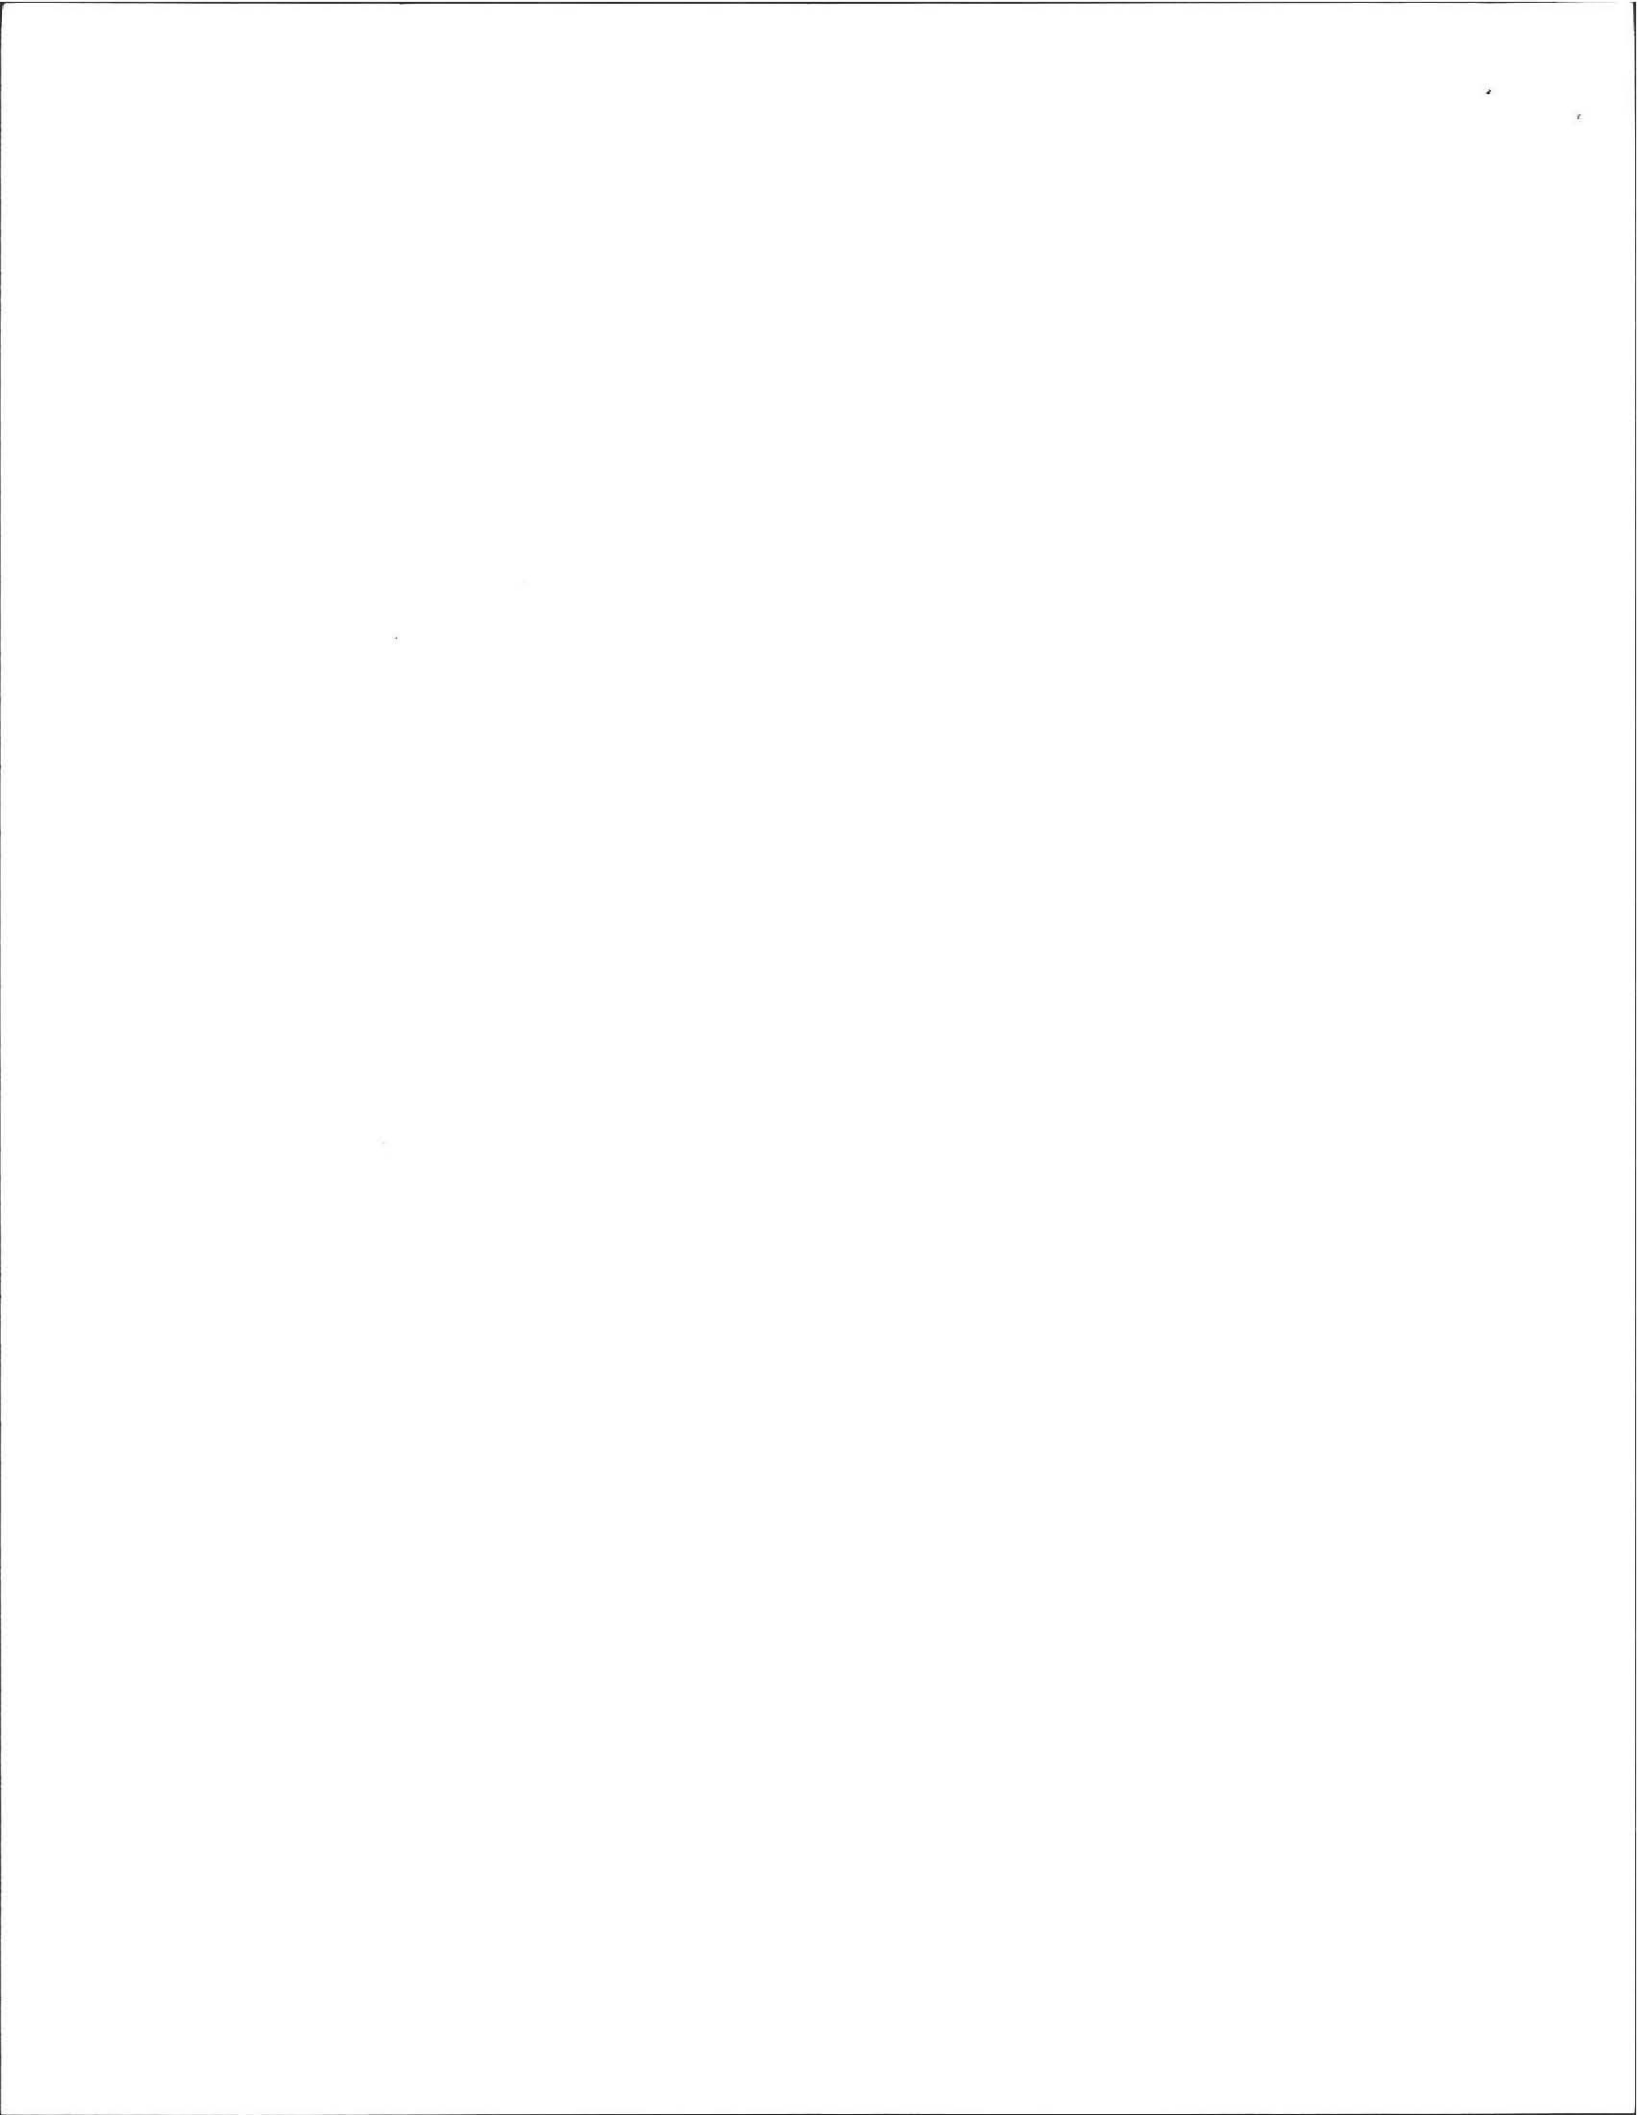

SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 711 Northeast Street, Amherst

Owner: Waterman

Date of Inspection: June 29, 2005

C. Further Evaluation is Required by the Board of Health:

Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

1. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:

Cesspool or privy is within 50 feet of a surface water

Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

2. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:

The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.

The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.


The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.

The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well**. Method used to determine distance meas.

**This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

3. Other:

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS

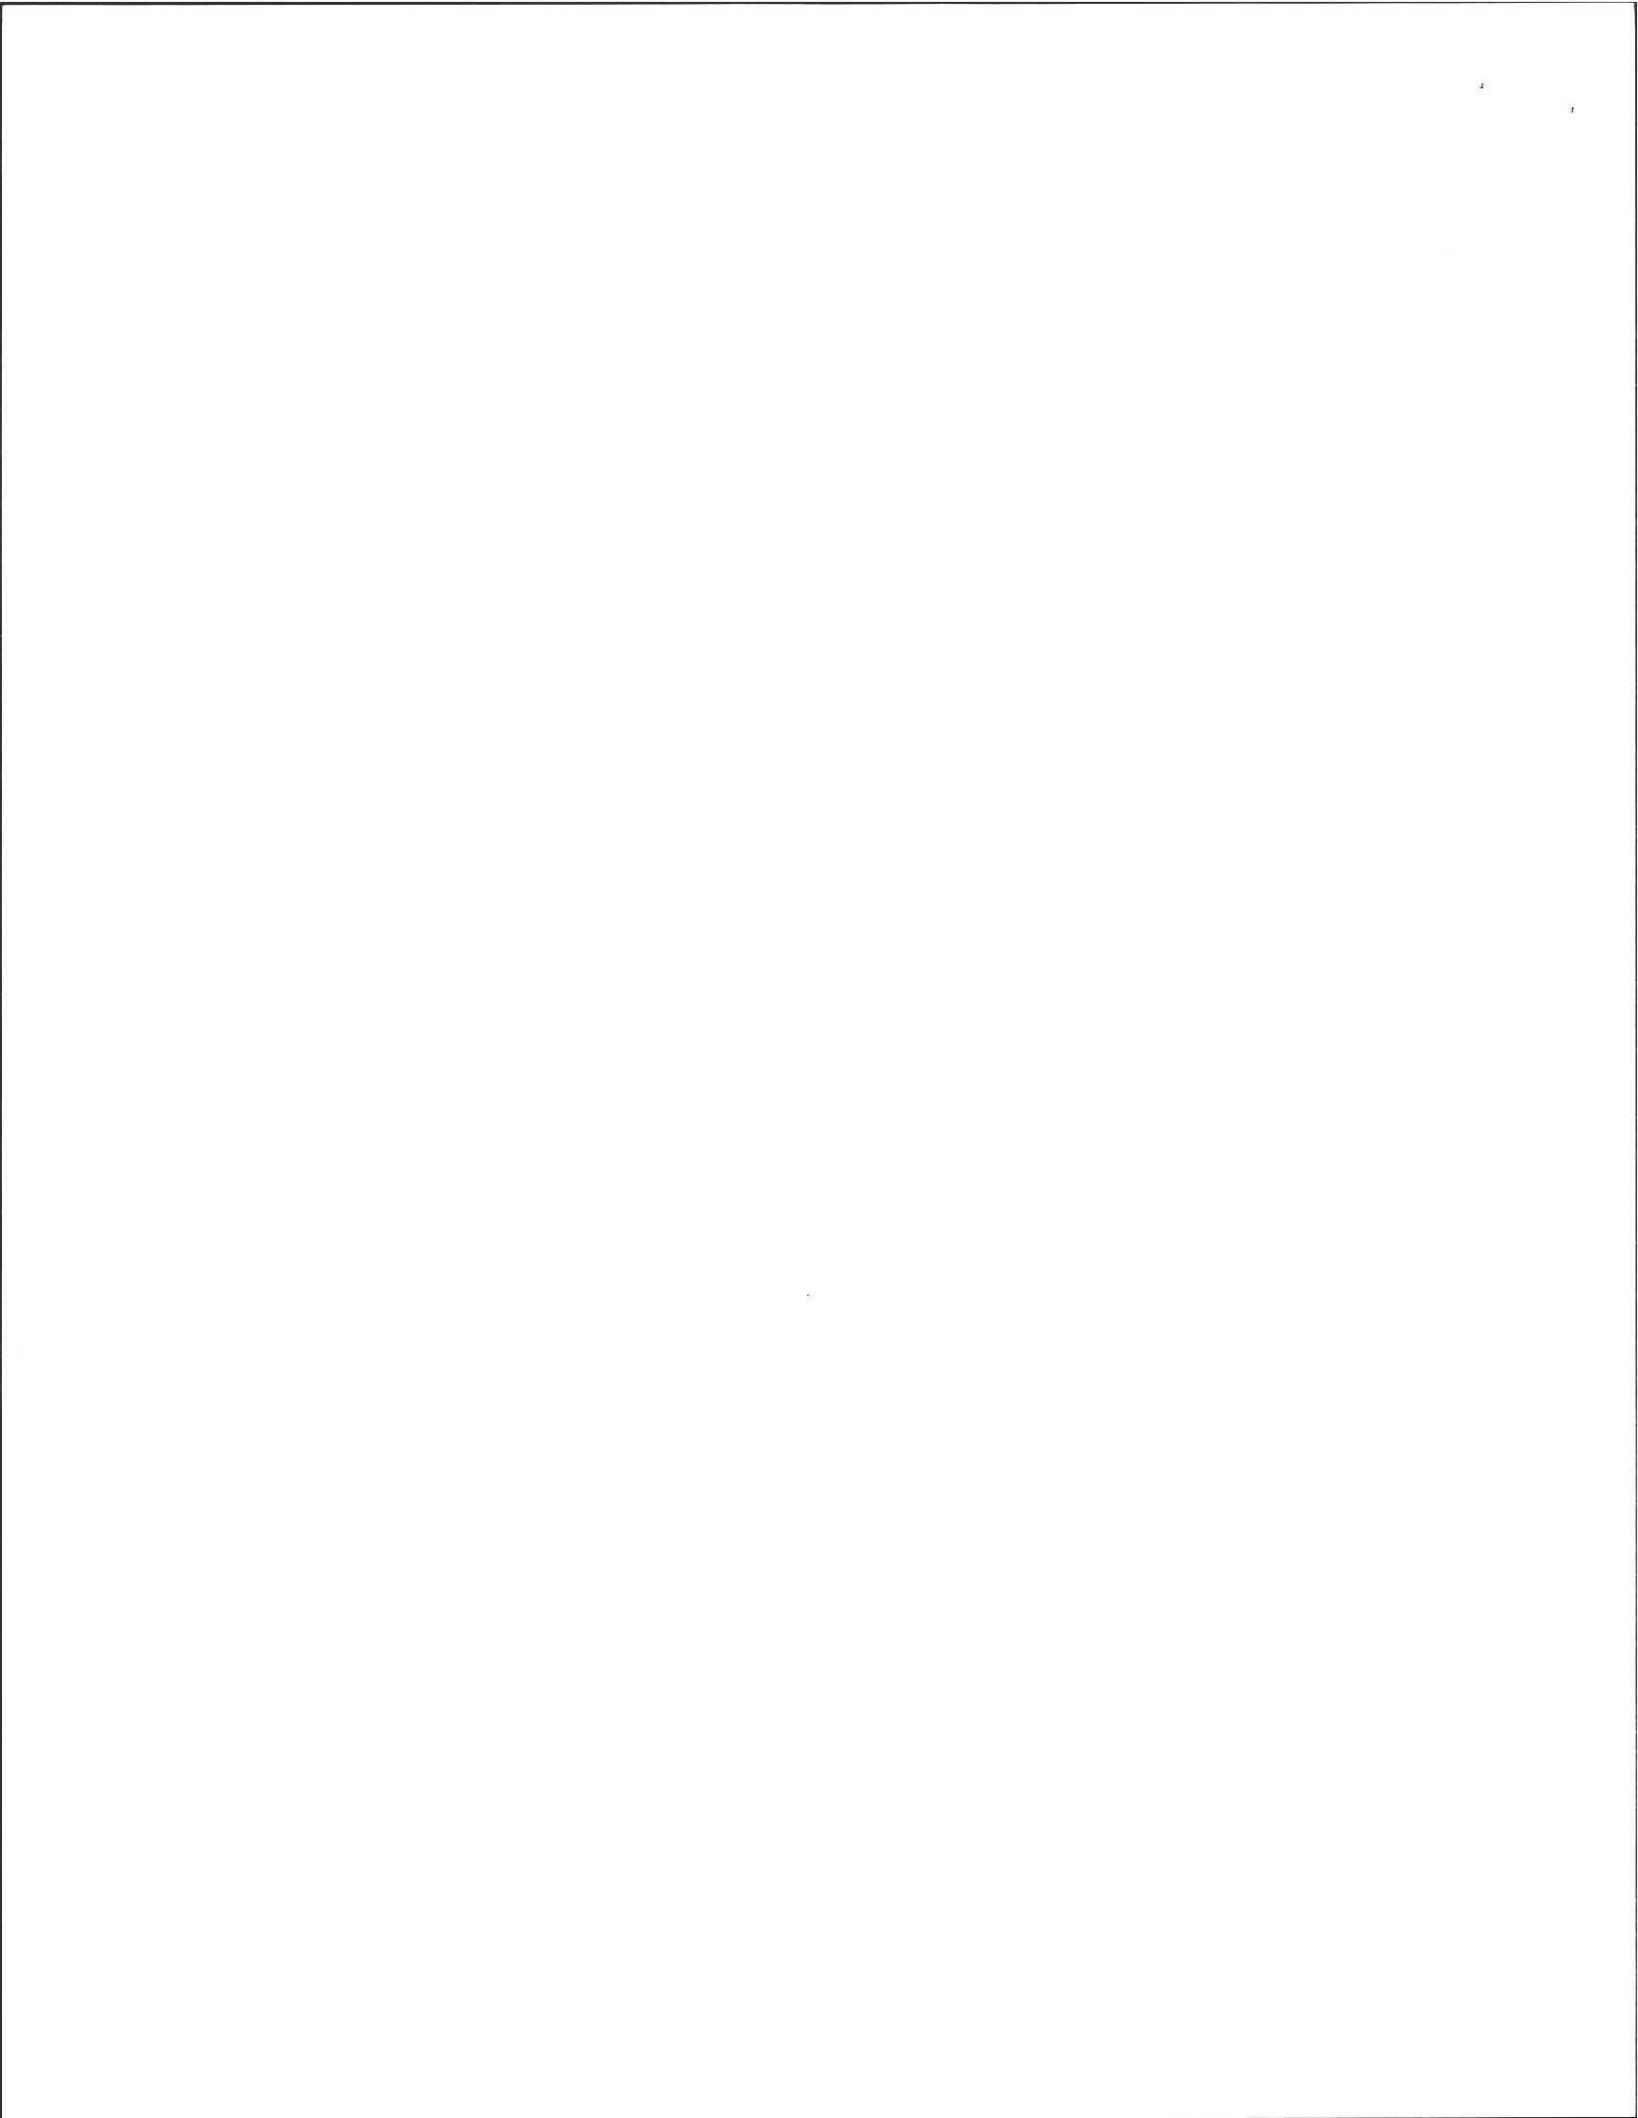

SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 711 Northeast Street, Amherst

Owner: Waterman

Date of Inspection: June 29, 2005

D. System Failure Criteria applicable to all systems:

You must indicate "yes" or "no" to each of the following for all inspections:

- | Yes | No | |
|-------------------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Liquid depth in cesspool is less than 6" below invert or available volume is less than ½ day flow |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Required pumping more than 4 times in the last year <u>NOT</u> due to clogged or obstructed pipe(s). Number of times pumped <u> </u> . |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of the SAS, cesspool or privy is below high ground water elevation. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within a Zone 1 of a public well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within 50 feet of a private water supply well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. [This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.] |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | NO (Yes/No) <u>The system fails.</u> I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure. |

E. Large Systems:

To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.


You must indicate either "yes" or "no" to each of the following:

(The following criteria apply to large systems in addition to the criteria above)

- | yes | no | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 400 feet of a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 200 feet of a tributary to a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area - IWPA) or a mapped Zone II of a public water supply well |

If you have answered "yes" to any question in Section E the system is considered a significant threat, or answered "yes" in Section D above the large system has failed. The owner or operator of any large system considered a significant threat under Section E or failed under Section D shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM

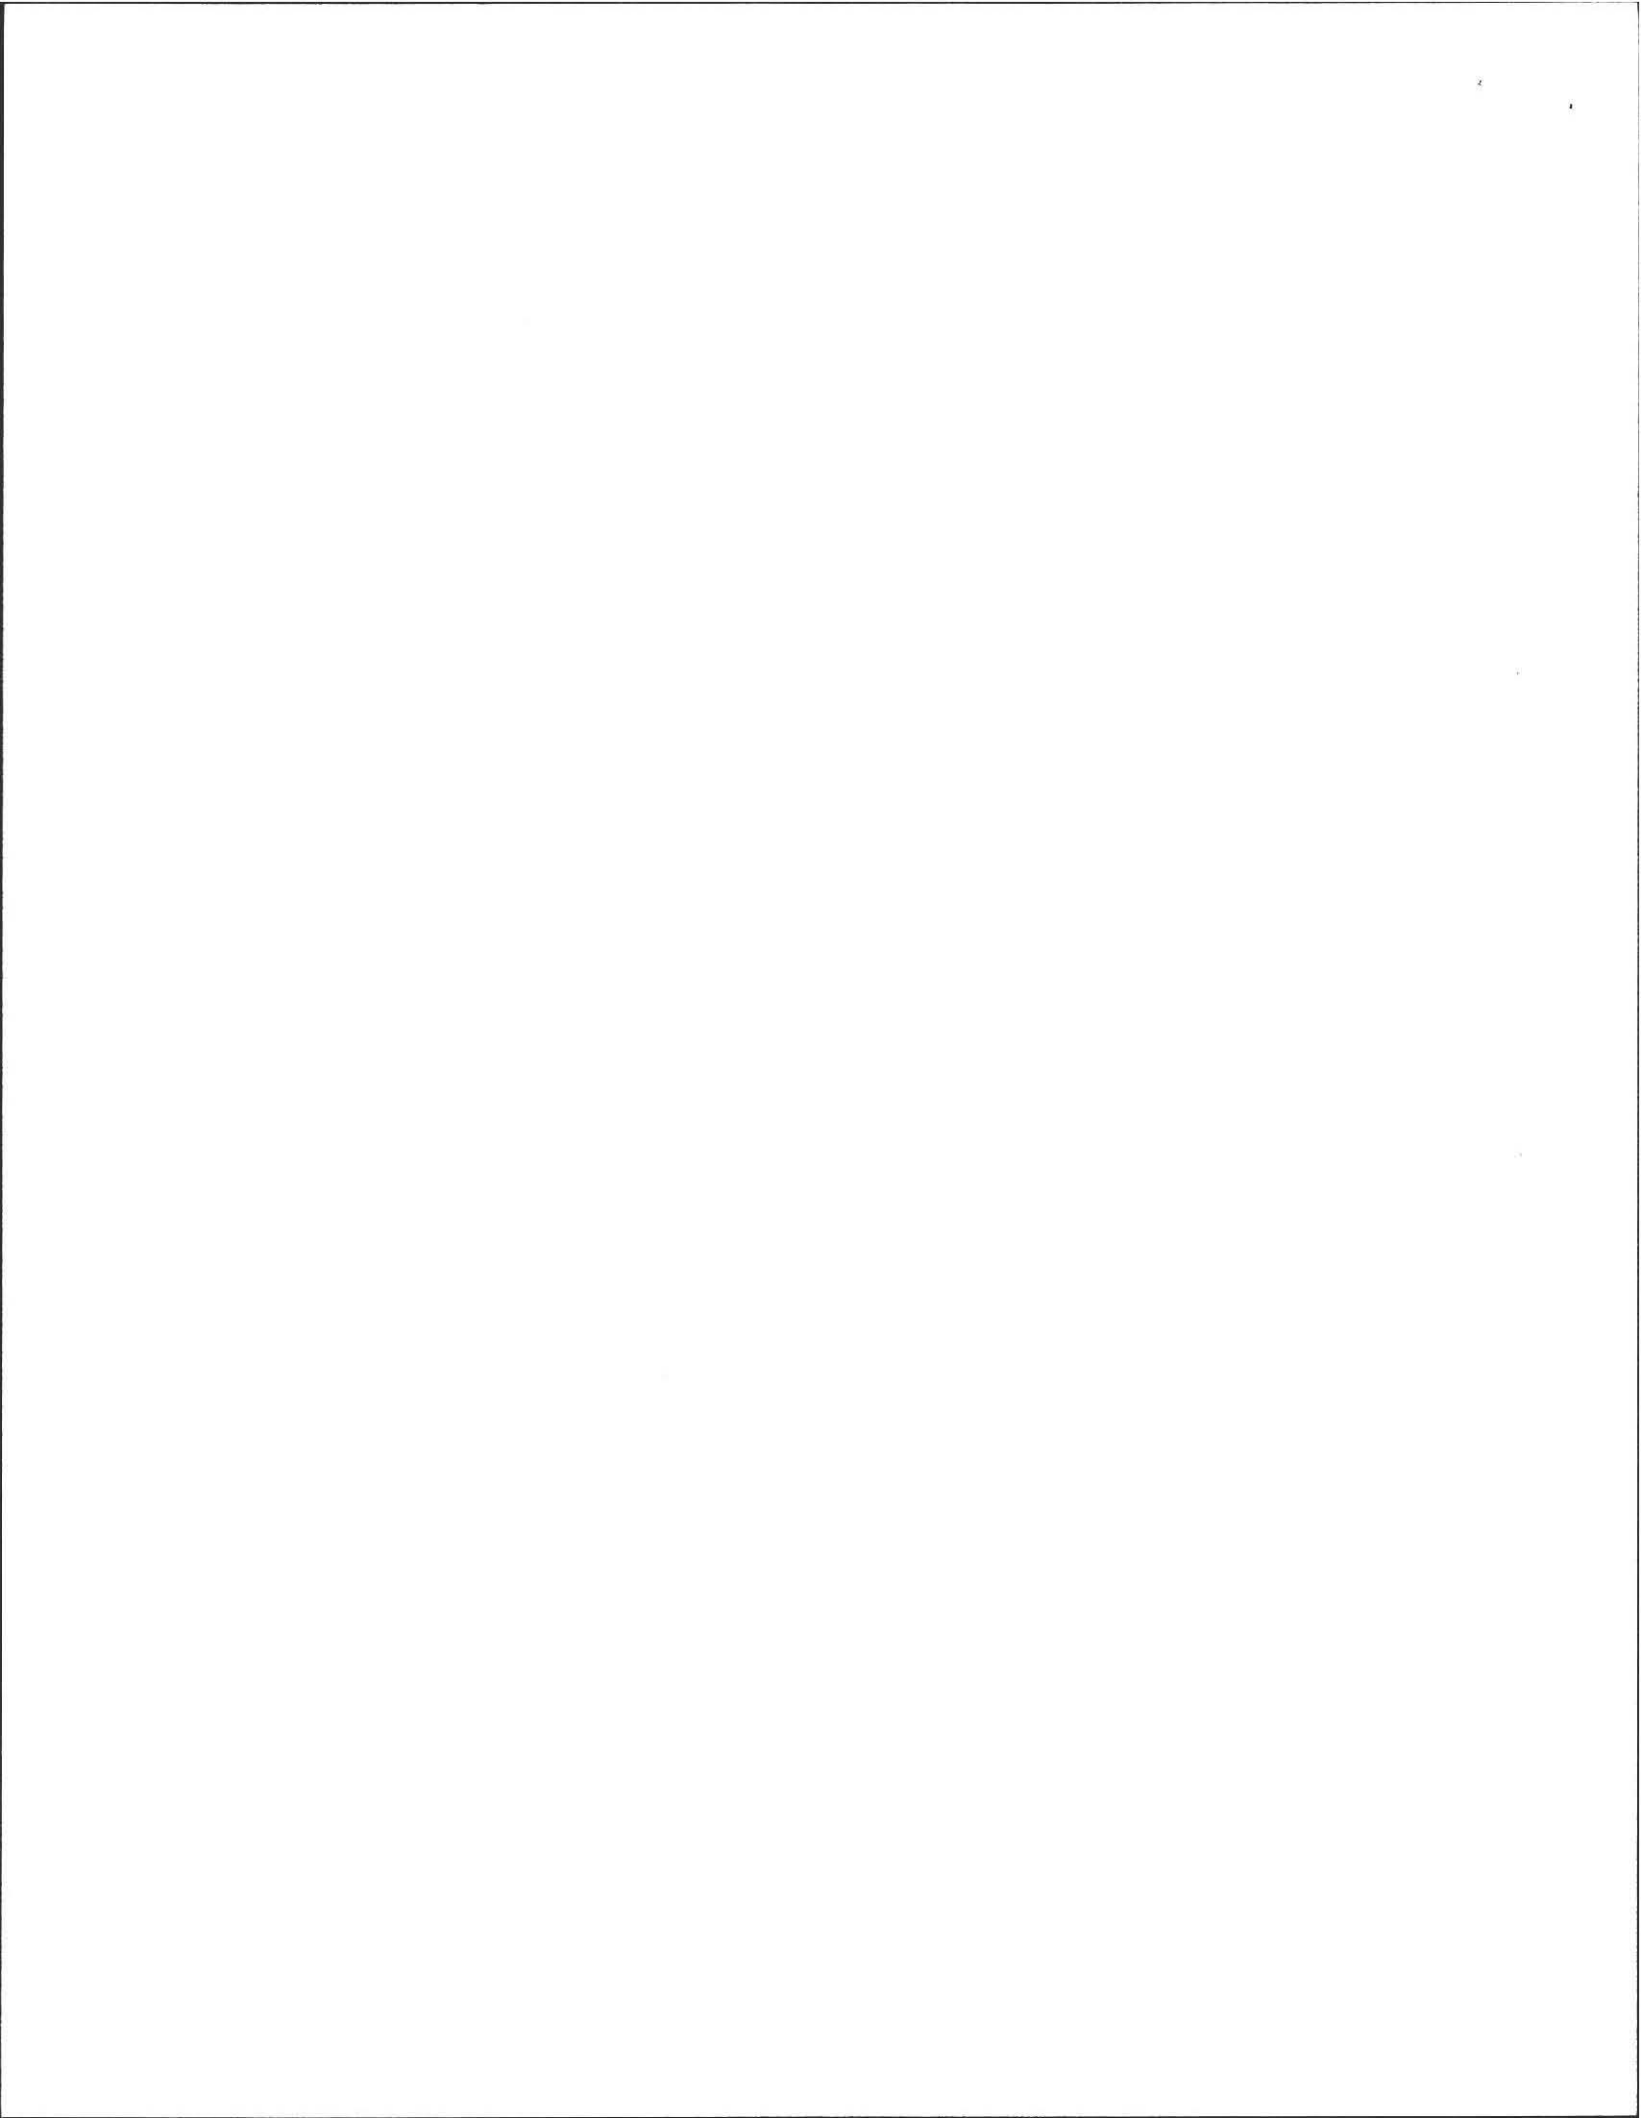

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART B
CHECKLIST


Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005

Check if the following have been done. You **must** indicate "yes" or "no" as to each of the following:

- Yes No
- Pumping information was provided by the owner, occupant, or Board of Health
- Were any of the system components pumped out in the previous two weeks ?
- Has the system received normal flows in the previous two week period ?
- Have large volumes of water been introduced to the system recently or as part of this inspection ?
- Were as built plans of the system obtained and examined? (If they were not available note as N/A)
- Was the facility or dwelling inspected for signs of sewage back up ?
- Was the site inspected for signs of break out ?
- Were all system components, excluding the SAS, located on site ?
- Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum ?
- Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems ?

The size and location of the Soil Absorption System (SAS) on the site has been determined based on:

- Yes no
- Existing information. For example, a plan at the Board of Health.
- Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(3)(b)]

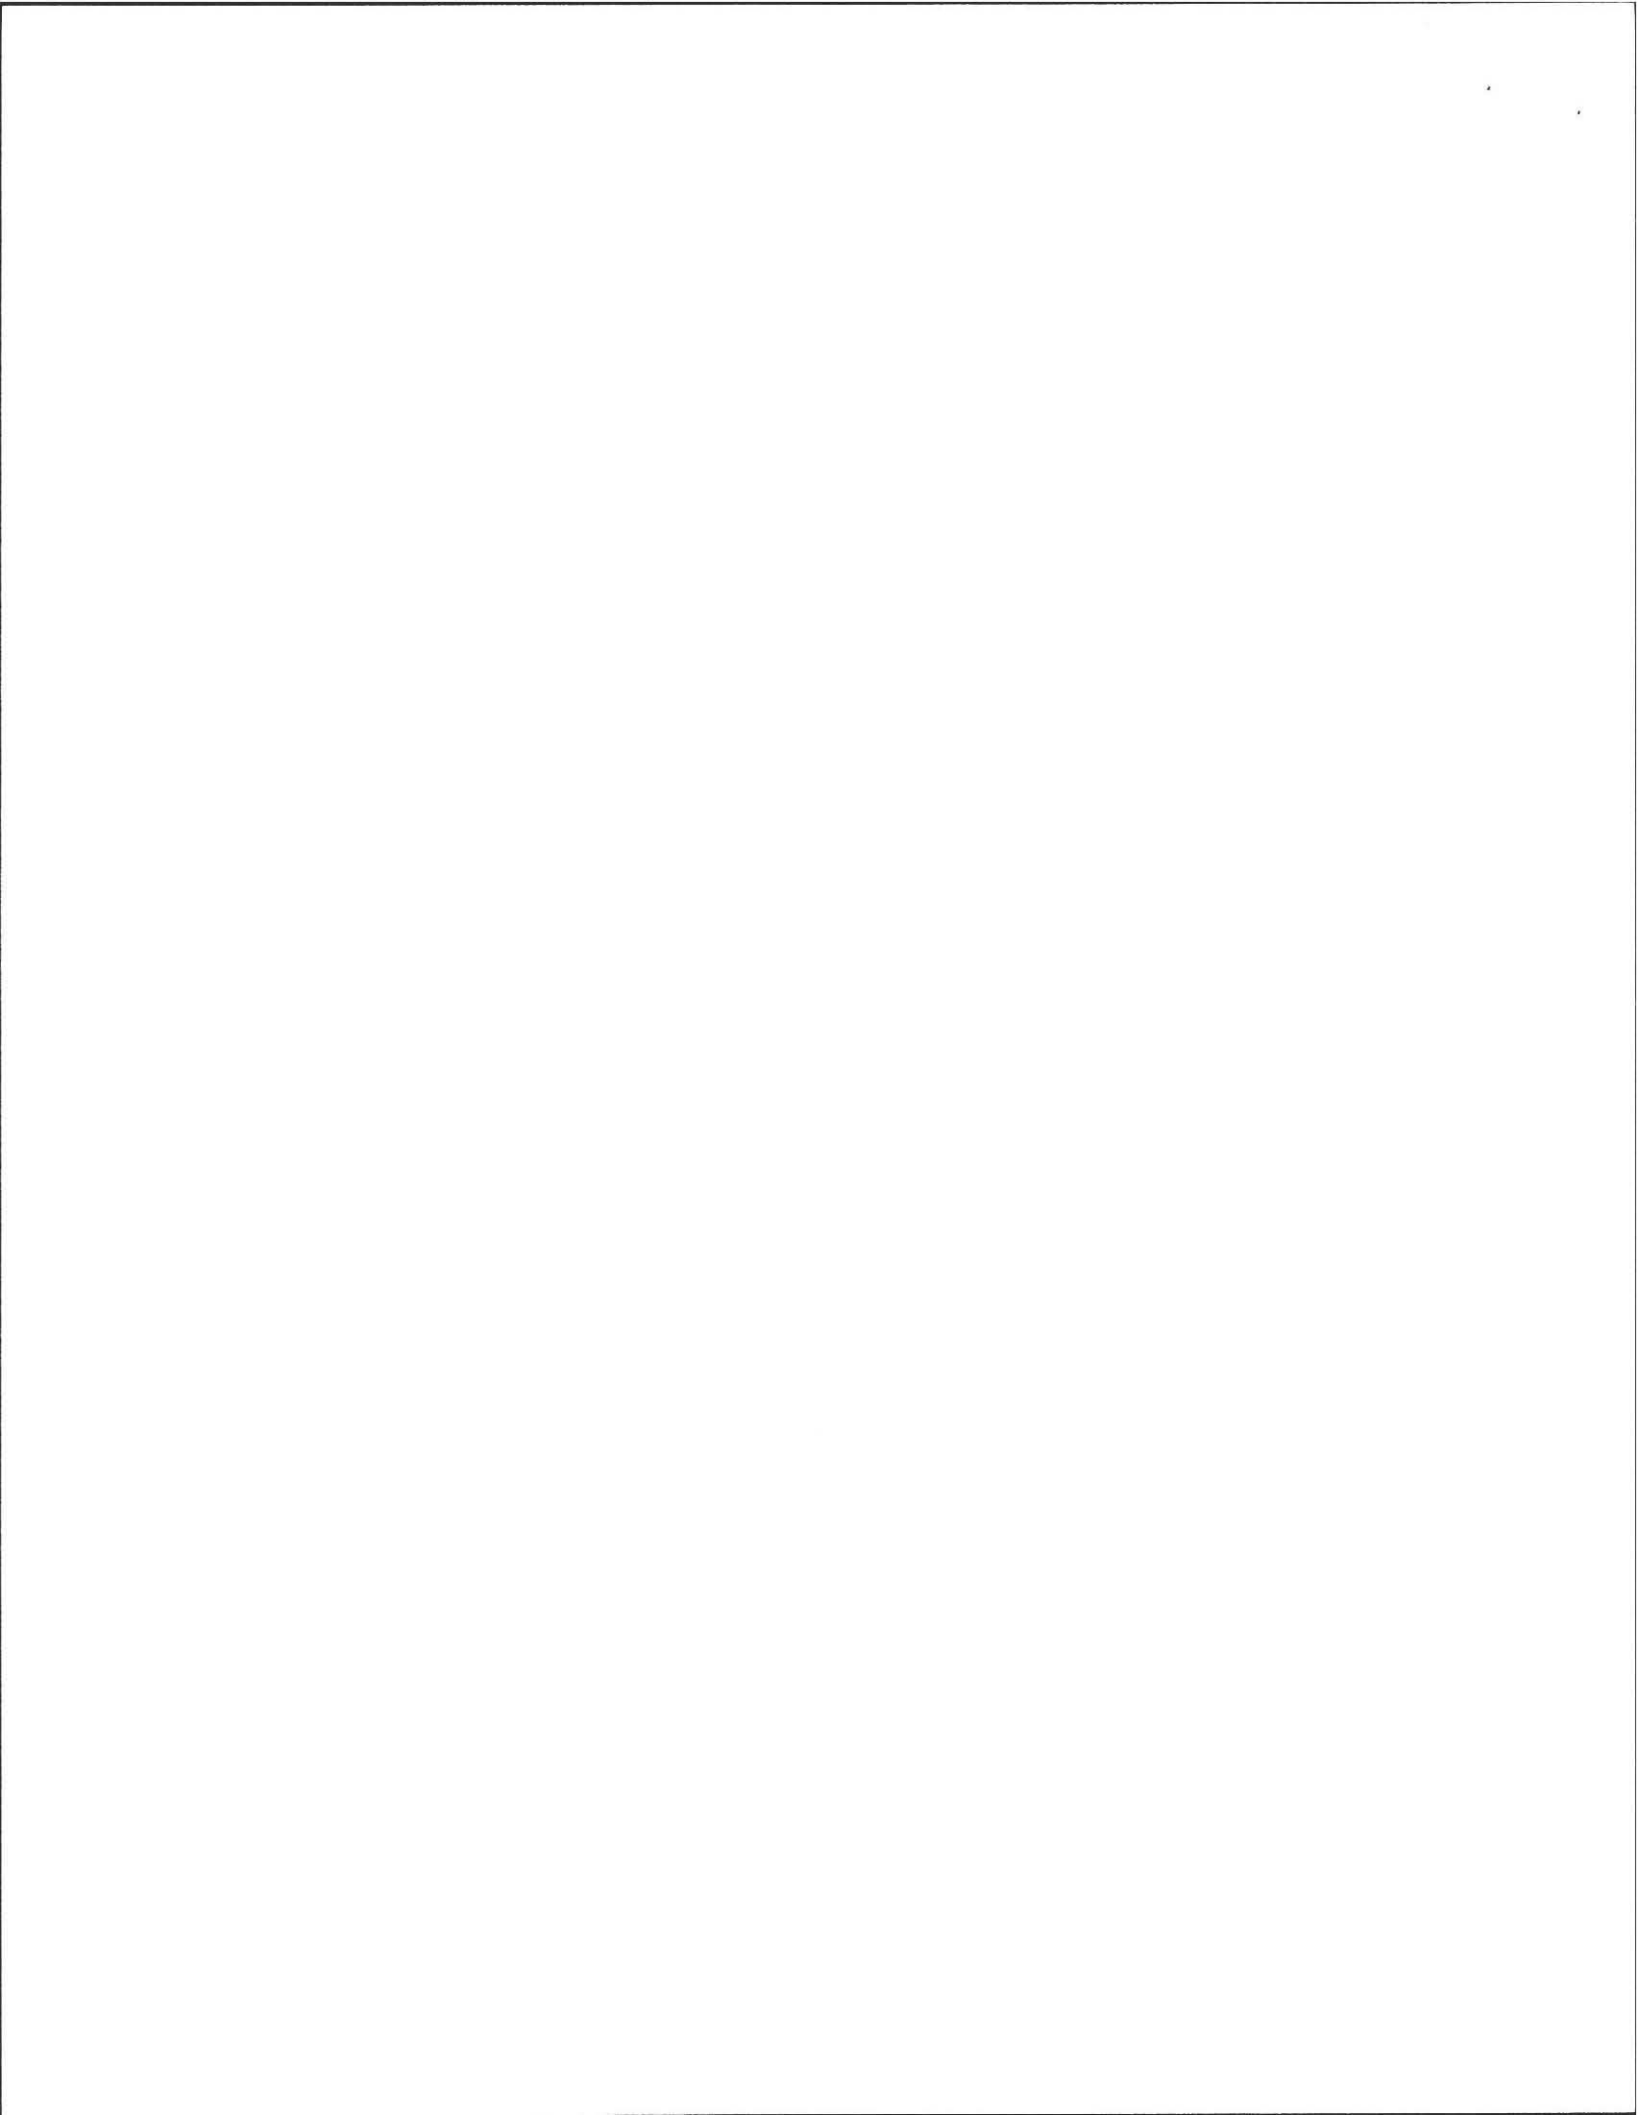

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION

Property Address: 711 Northeast Street, Amherst

Owner: Waterman

Date of Inspection: June 29, 2005

FLOW CONDITIONS

RESIDENTIAL

Number of bedrooms (design): 3? Number of bedrooms (actual): 3

DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): ?_

Number of current residents: 2

Does residence have a garbage grinder (yes or no): NO (NOT RECOMMENDED)

Is laundry on a separate sewage system (yes or no): NO [if yes separate inspection required]

Laundry system inspected (yes or no): --

Seasonal use: (yes or no): NO

Water meter readings, if available (last 2 years usage (gpd)): N/a

Sump pump (yes or no): No

Last date of occupancy: current

COMMERCIAL/INDUSTRIAL

Type of establishment: N/A

Design flow (based on 310 CMR 15.203): _____ gpd

Basis of design flow (seats/persons/sqft, etc.): _____

Grease trap present (yes or no): --

Industrial waste holding tank present (yes or no): _____

Non-sanitary waste discharged to the Title 5 system (yes or NO): _____

Water meter readings, if available: _____

Last date of occupancy/use: _____

OTHER (describe) _____

GENERAL INFORMATION

Pumping Records

Source of information: 1999?

Was system pumped as part of the inspection (YES or NO): YES

If yes, volume pumped: 1000 gallons -- How was quantity pumped determined? Measured

Reason for pumping: TIME

TYPE OF SYSTEM

Septic tank, distribution box, soil absorption system

Single cesspool

Overflow cesspool

Privy

Shared system (yes or no) (if yes, attach previous inspection records, if any)


Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner)

Tight tank Attach a copy of the DEP approval

Other (describe): _____

Approximate age of all components, date installed (if known) and source of information: 6 years

Were sewage odors detected when arriving at the site (yes or no): NO

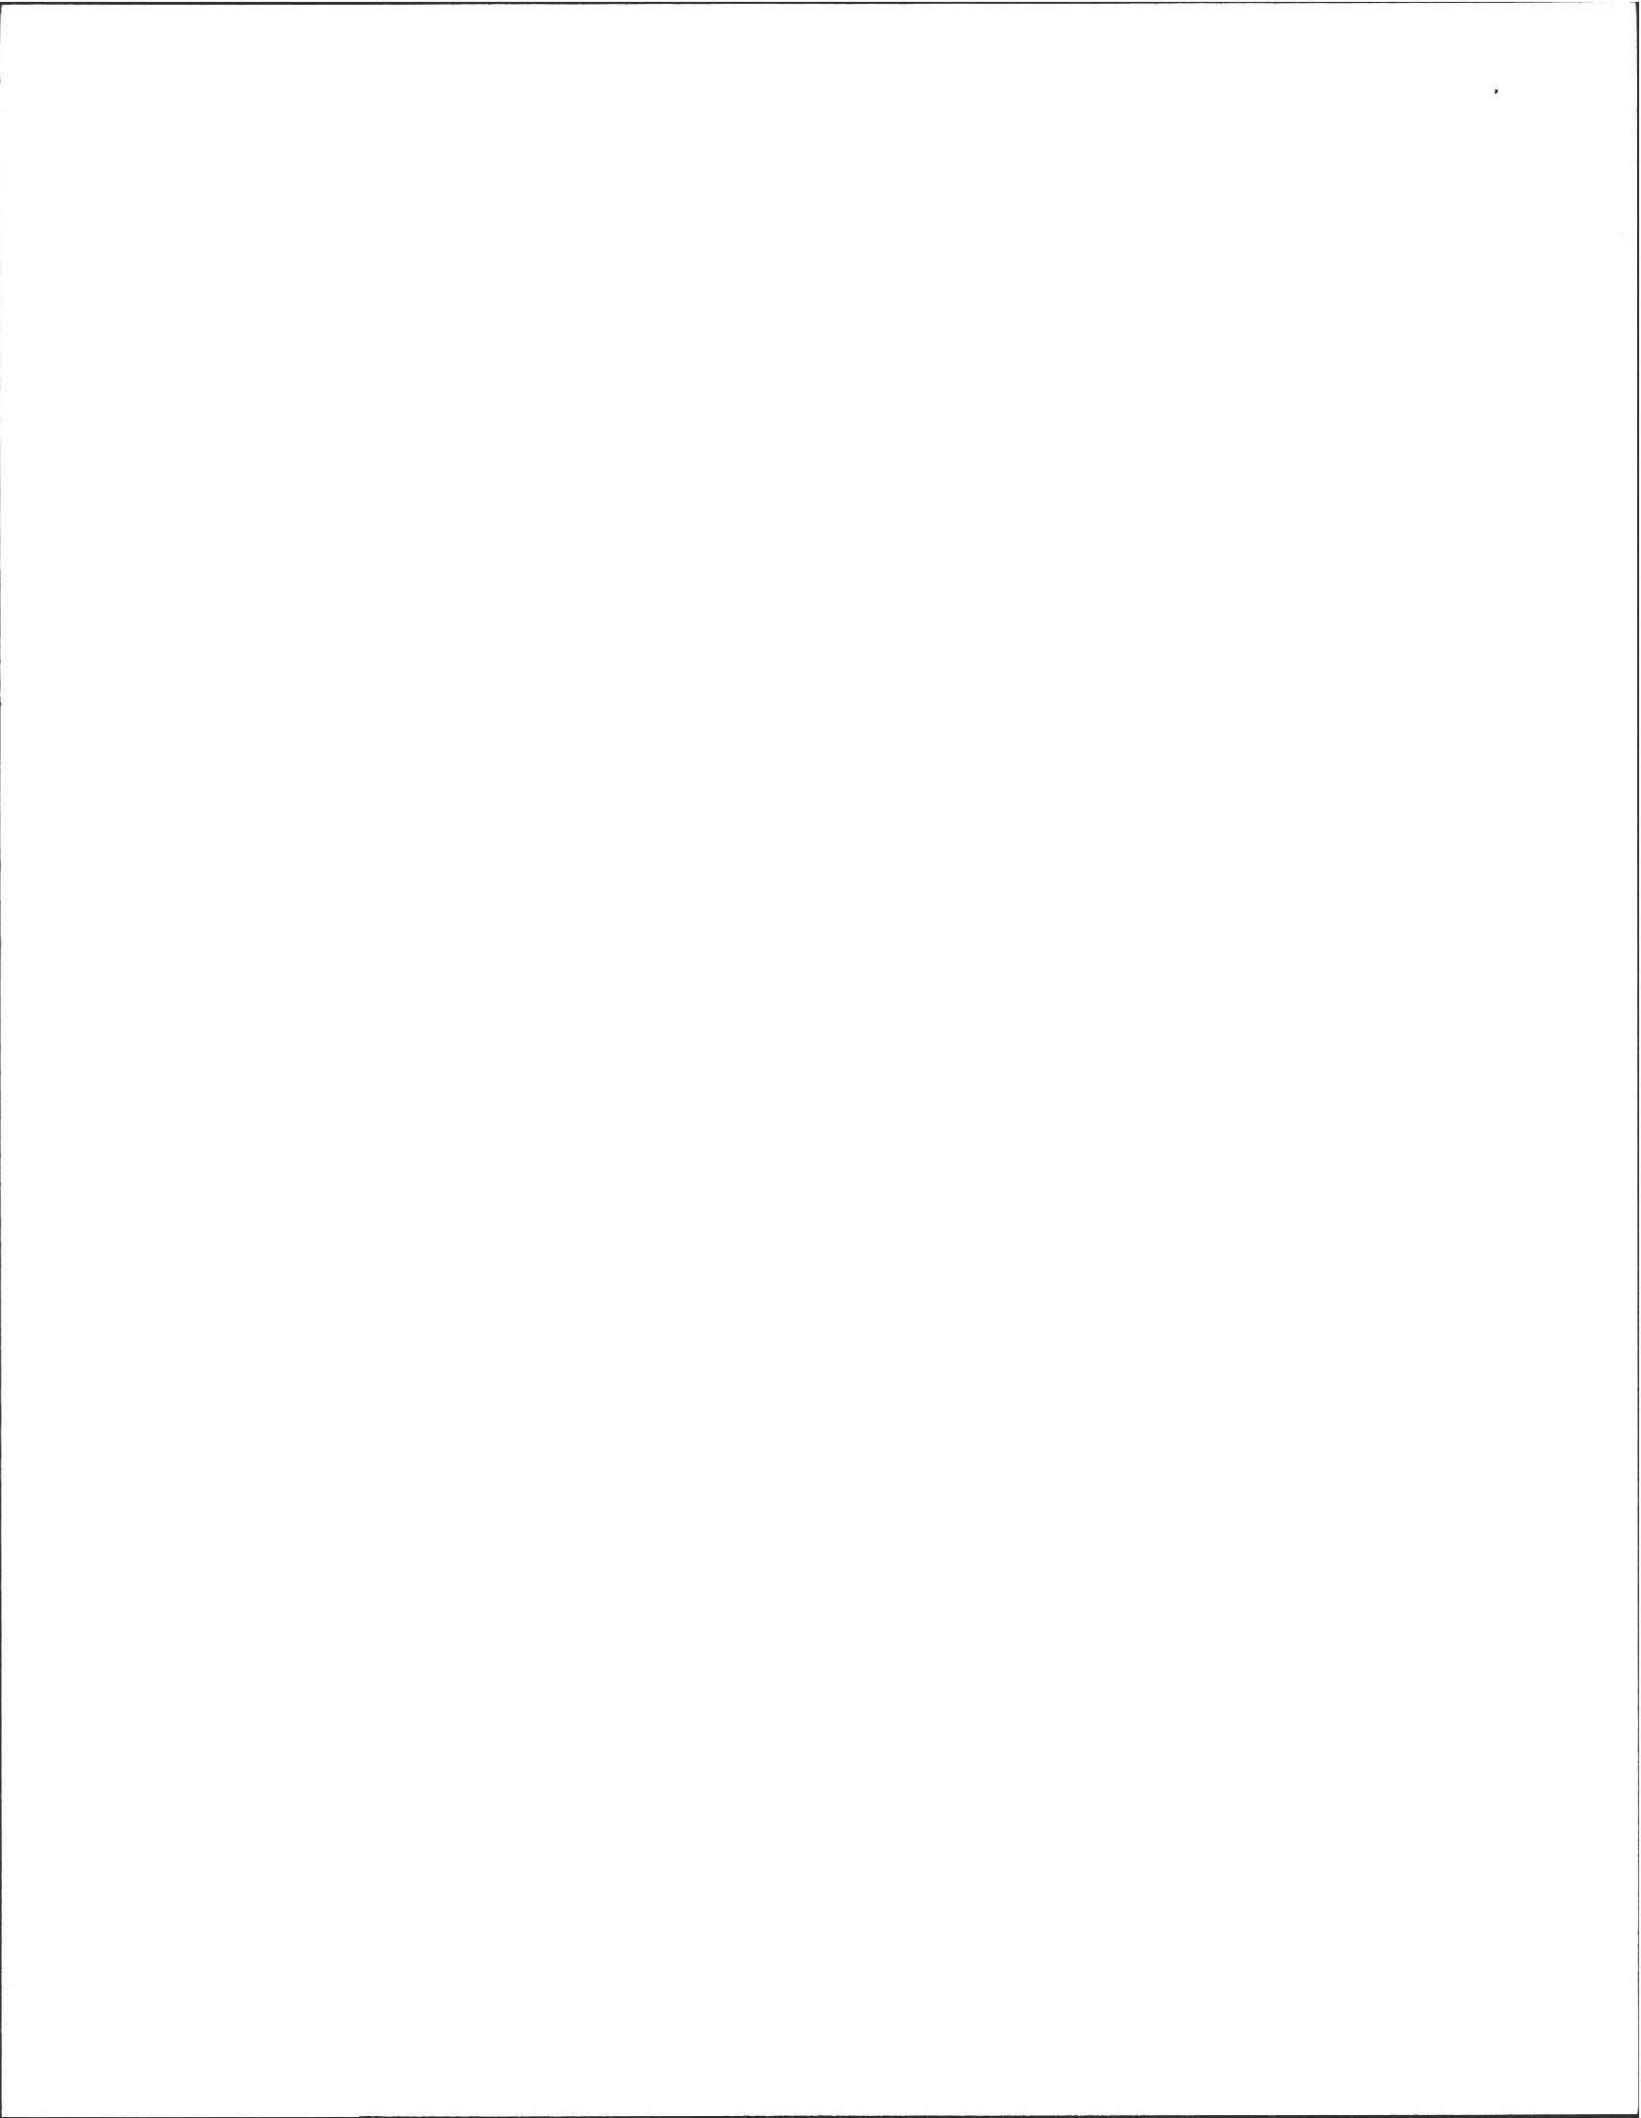

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005

BUILDING SEWER (locate on site plan)


Depth below grade: 16"
Materials of construction: ___ cast iron Y 40 PVC ___ other (explain): _____
Distance from private water supply well or suction line: 10'+
Comments (on condition of joints, venting, evidence of leakage, etc.):

SEPTIC TANK: Yes(locate on site plan)

Depth below grade: 24"
Material of construction: X concrete ___ metal ___ fiberglass ___ polyethylene
___ other(explain) _____
If tank is metal list age: ___ Is age confirmed by a Certificate of Compliance (yes or no): ___ (attach a copy of certificate)
Dimensions: 4.5'w x 8.5'l x 4.5'd
Sludge depth: 3"
Distance from top of sludge to bottom of outlet tee or baffle: 38"
Scum thickness: 3"
Distance from top of scum to top of outlet tee or baffle: 5"
Distance from bottom of scum to bottom of outlet tee or baffle: 10"
How were dimensions determined: MEASURED
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.): TANK CONDITION OK
tank has built in inlet & outlet (cross sectional)

GREASE TRAP: N/A (locate on site plan)

Depth below grade: ___
Material of construction: ___ concrete ___ metal ___ fiberglass ___ polyethylene ___ other
(explain): _____
Dimensions: _____
Scum thickness: _____
Distance from top of scum to top of outlet tee or baffle: _____
Distance from bottom of scum to bottom of outlet tee or baffle: _____
Date of last pumping: _____
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

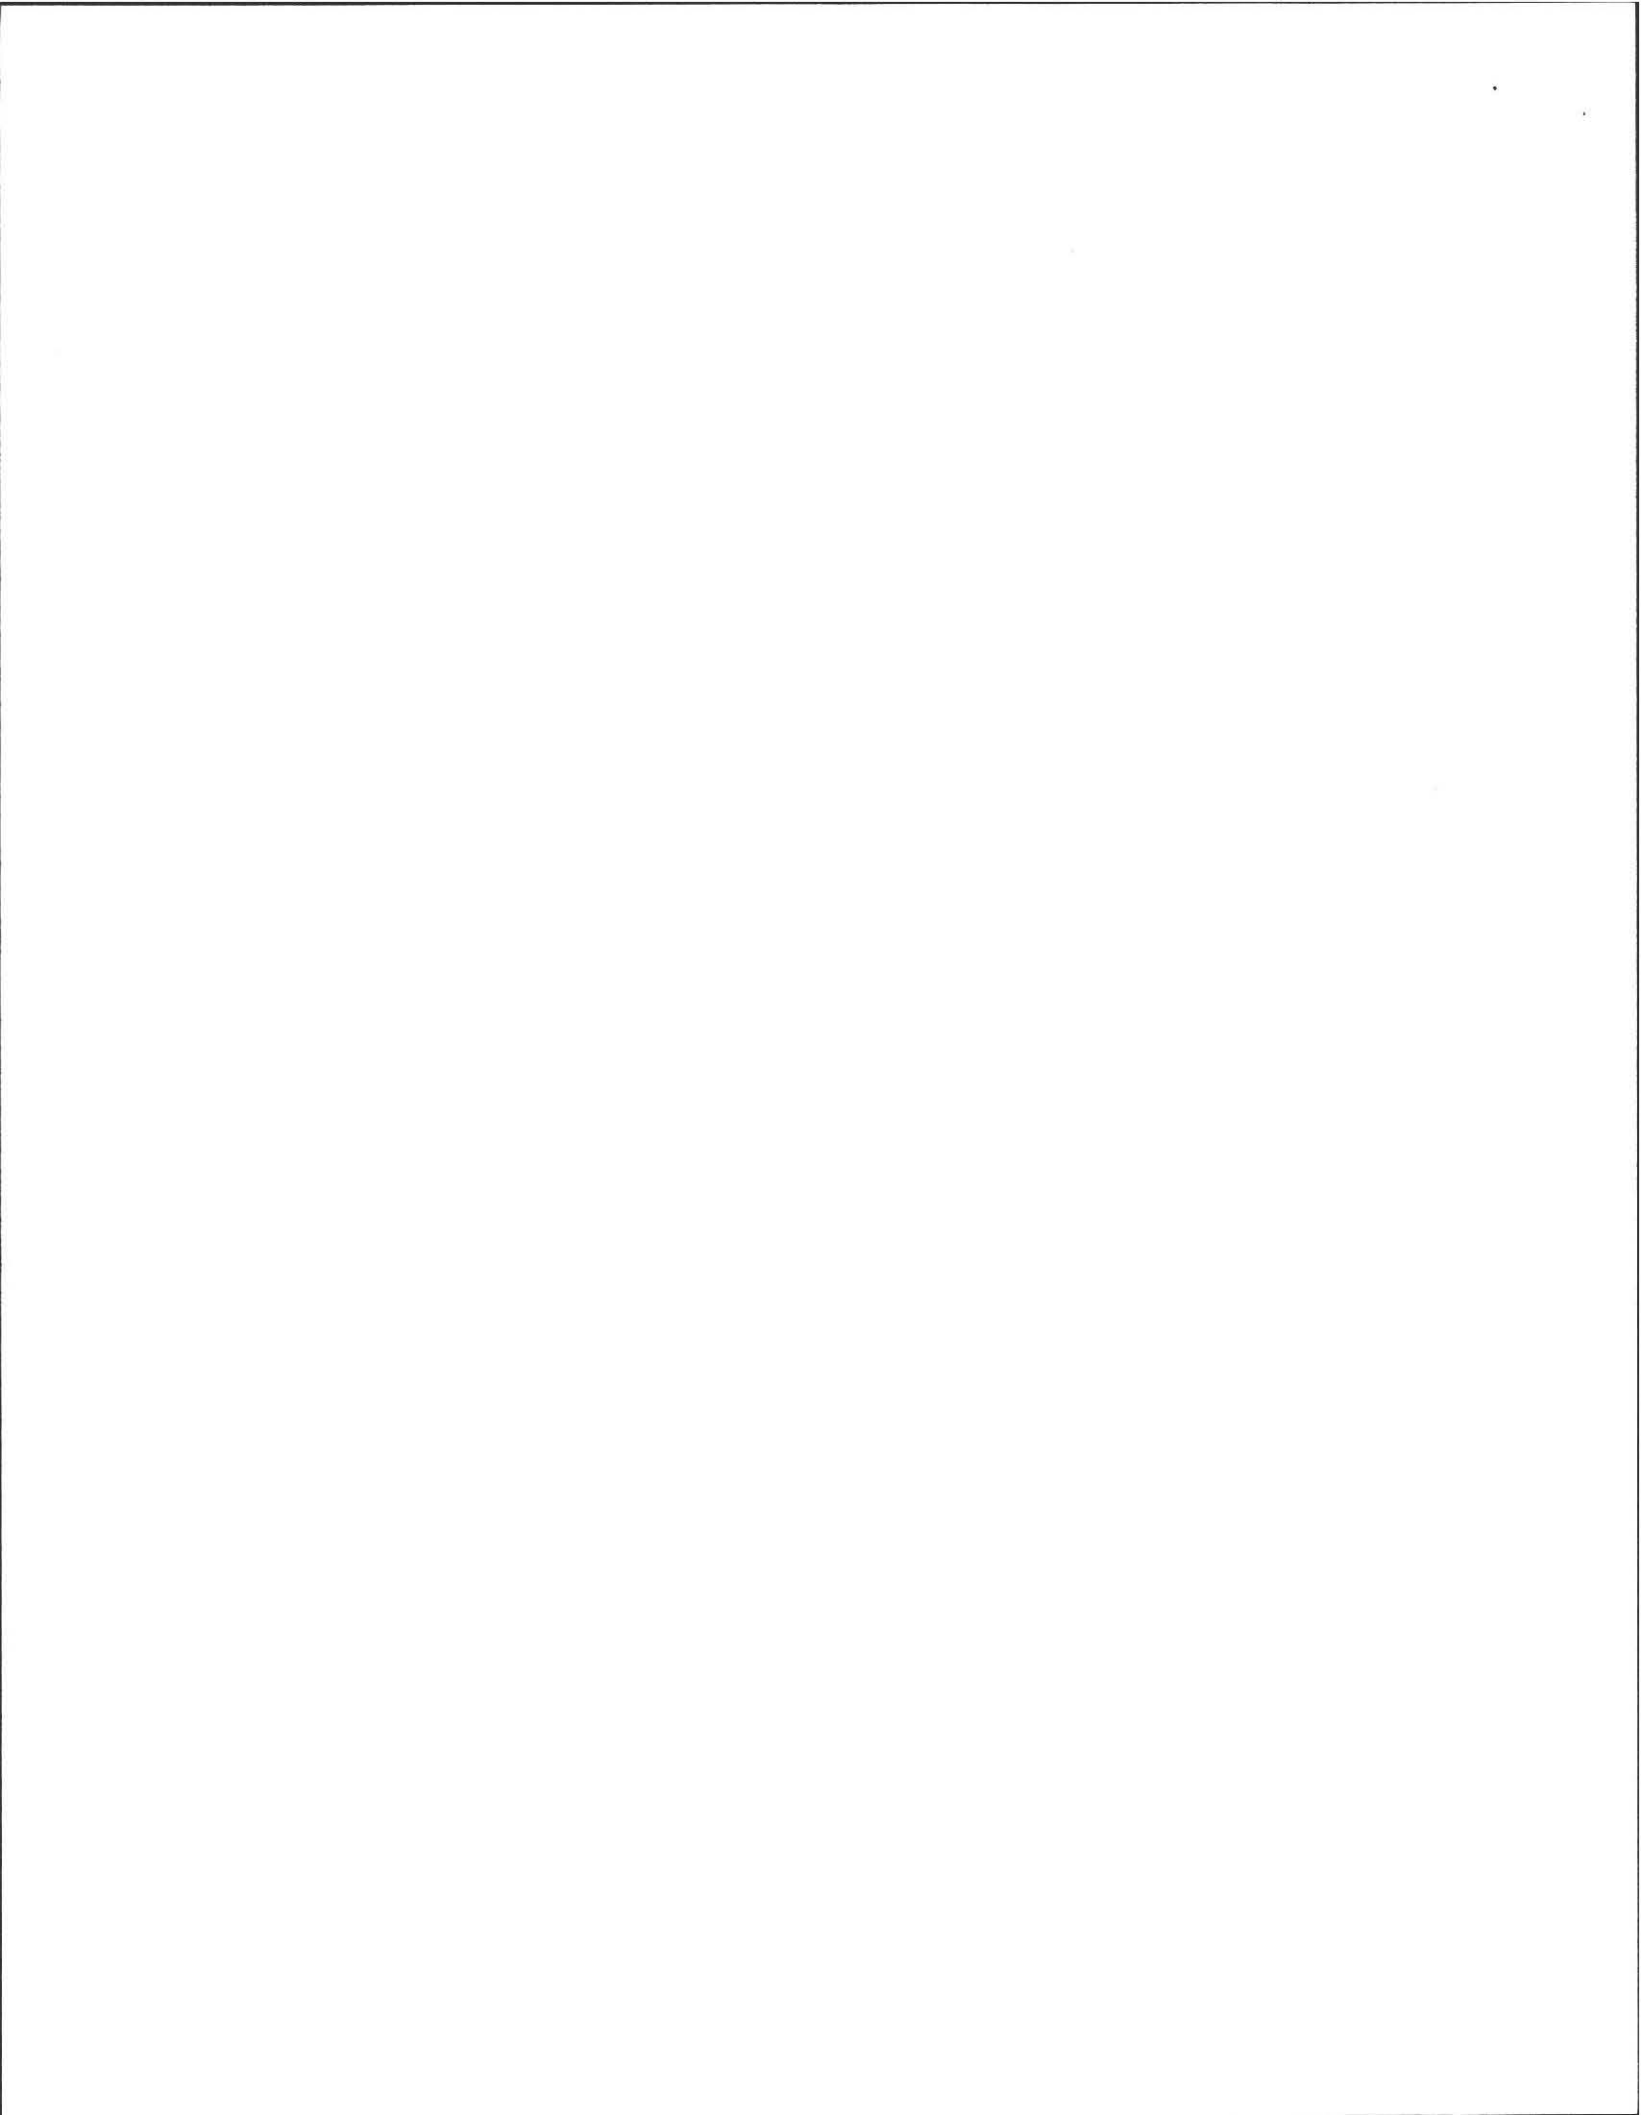

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005

BUILDING SEWER (locate on site plan)


Depth below grade: 16"
Materials of construction: ___ cast iron Y 40 PVC ___ other (explain): _____
Distance from private water supply well or suction line: 10'+
Comments (on condition of joints, venting, evidence of leakage, etc.):

SEPTIC TANK: Yes(locate on site plan)

Depth below grade: 24"
Material of construction: X concrete ___ metal ___ fiberglass ___ polyethylene
___ other(explain) _____
If tank is metal list age: ___ Is age confirmed by a Certificate of Compliance (yes or no): ___ (attach a copy of certificate)
Dimensions: 4.5'w x 8.5'l x 4.5'd
Sludge depth: 3"
Distance from top of sludge to bottom of outlet tee or baffle: 38"
Scum thickness: 3"
Distance from top of scum to top of outlet tee or baffle: 5"
Distance from bottom of scum to bottom of outlet tee or baffle: 10"
How were dimensions determined: MEASURED
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.): TANK CONDITION OK
tank has built in inlet & outlet (cross sectional)

GREASE TRAP: N/A (locate on site plan)

Depth below grade: ___
Material of construction: ___ concrete ___ metal ___ fiberglass ___ polyethylene ___ other
(explain): _____
Dimensions: _____
Scum thickness: _____
Distance from top of scum to top of outlet tee or baffle: _____
Distance from bottom of scum to bottom of outlet tee or baffle: _____
Date of last pumping: _____
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

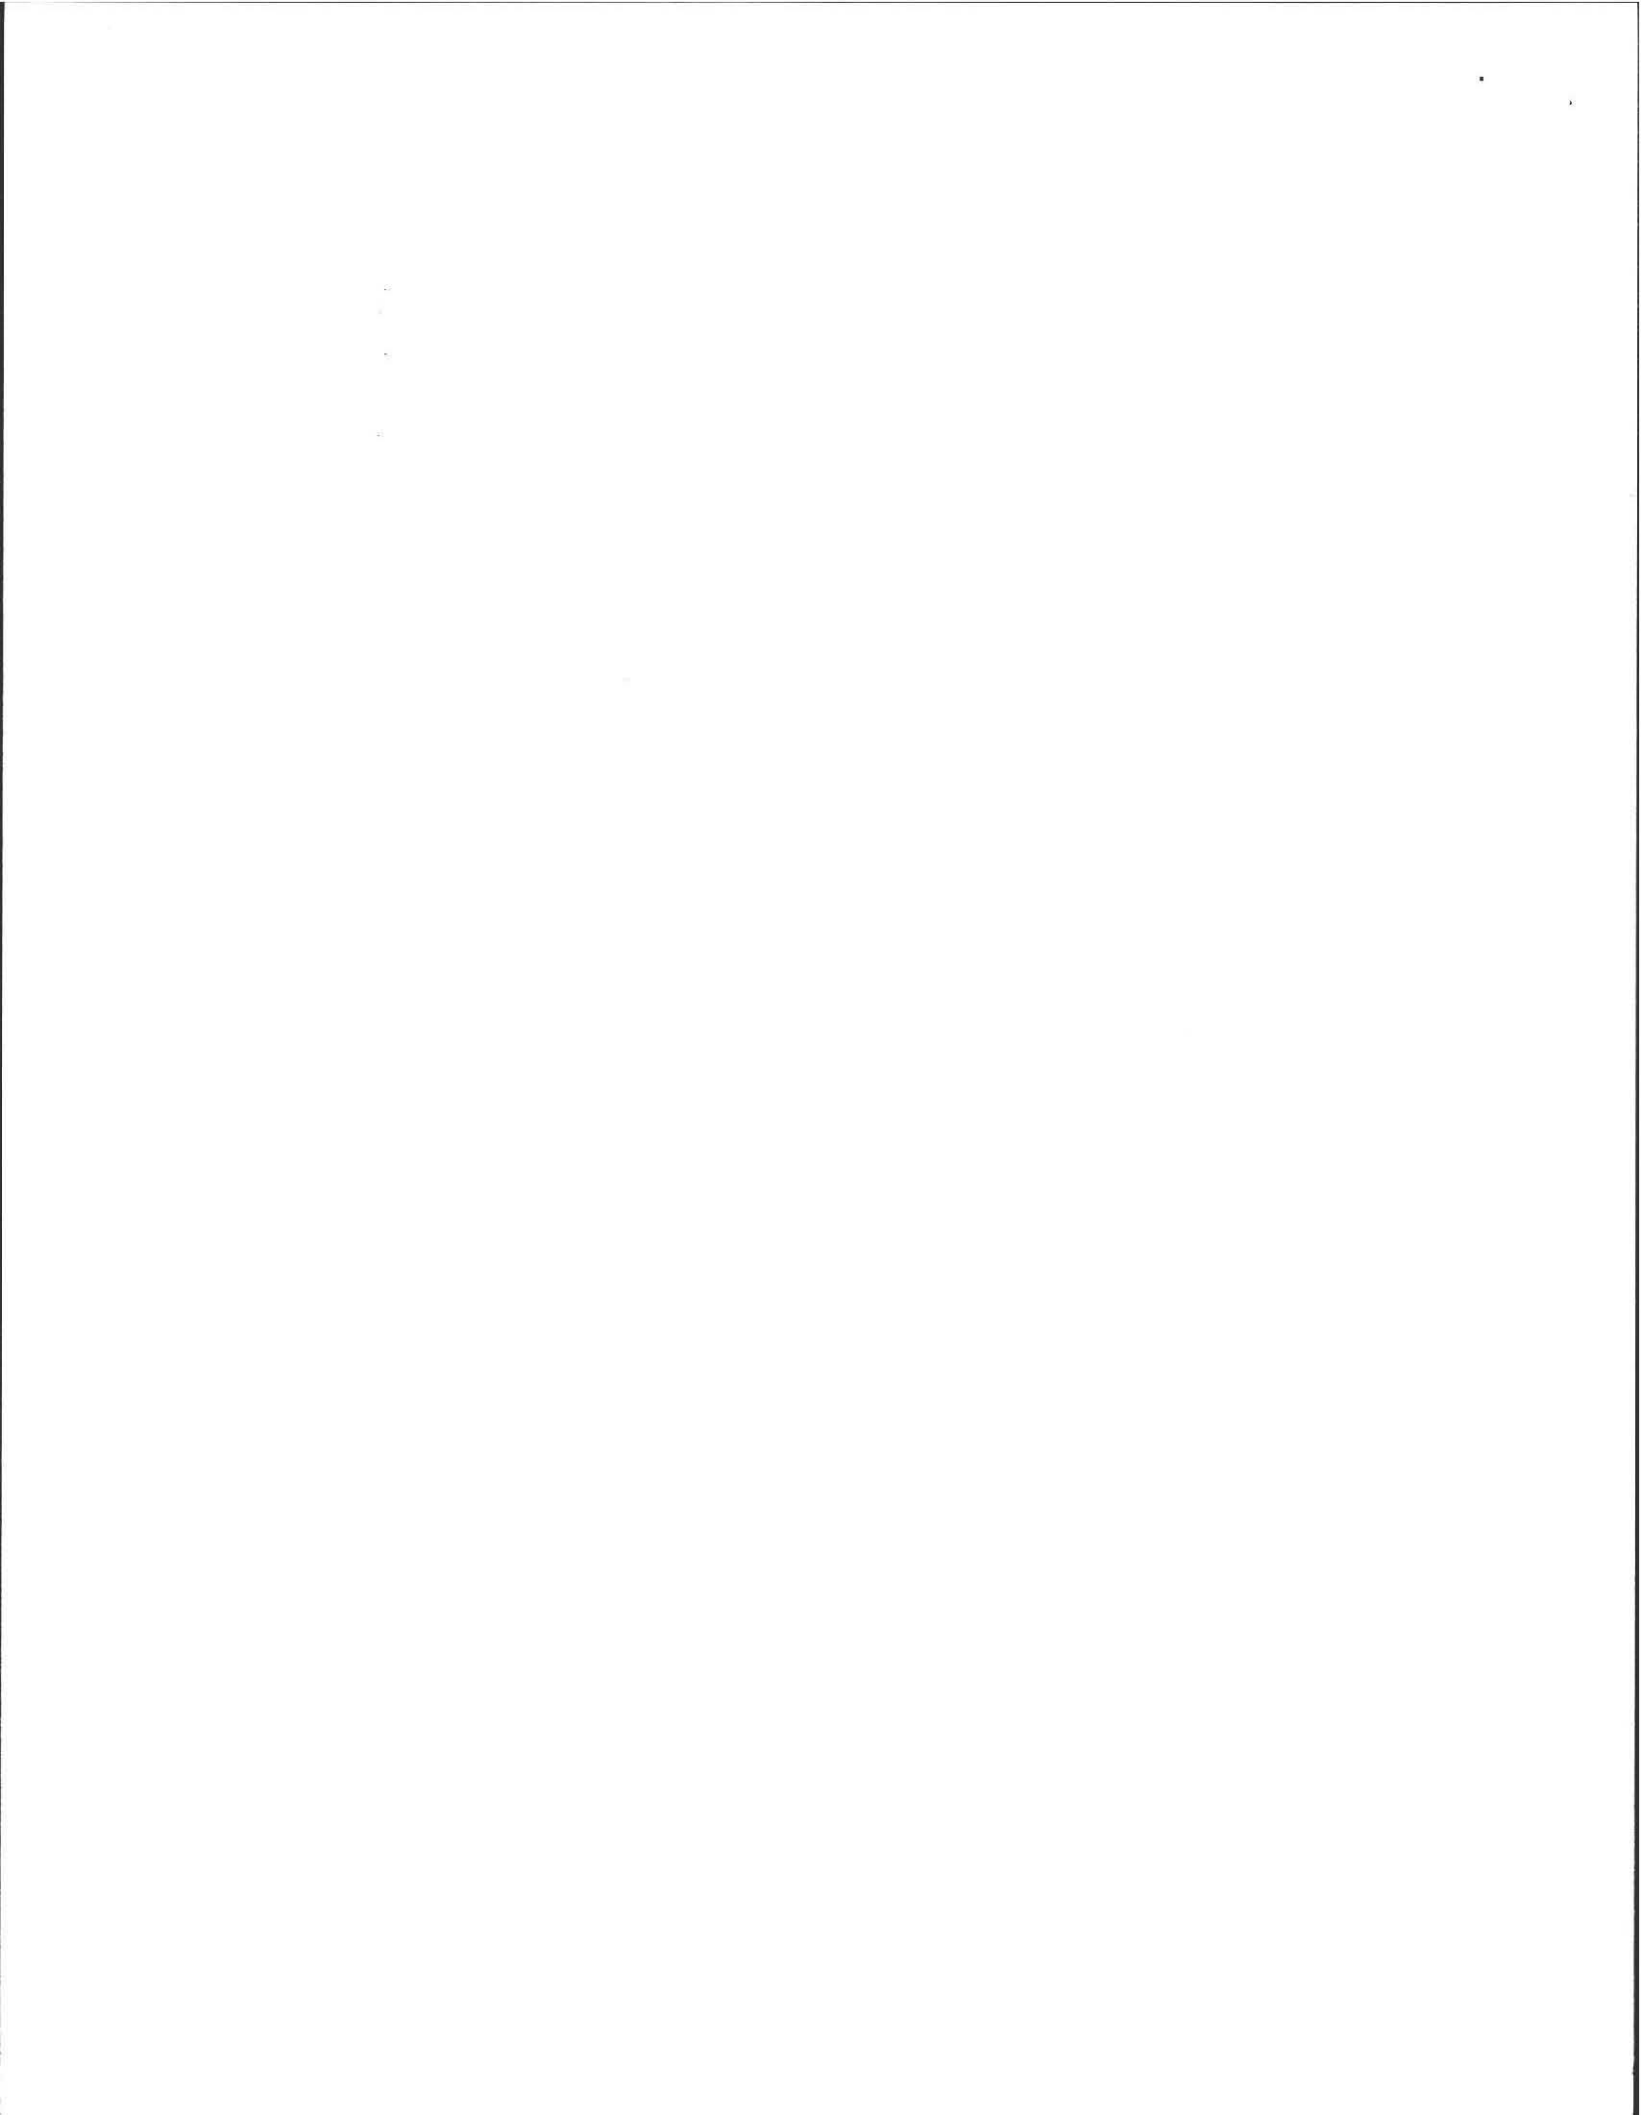

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005

TIGHT or HOLDING TANK: no (tank must be pumped at time of inspection)(locate on site plan)

Depth below grade: _____
Material of construction: ___concrete ___metal ___fiberglass ___polyethylene ___other(explain): _____


Dimensions: _____
Capacity: _____gallons
Design Flow: _____gallons/day
Alarm present (yes or no): _____
Alarm level: _____ Alarm in working order (yes or no): _____
Date of last pumping: _____
Comments (condition of alarm and float switches, etc.): _____

DISTRIBUTION BOX: NO if present must be opened)(locate on site plan)

Depth of liquid level above outlet invert: _____
Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.): _____

PUMP CHAMBER: NO (locate on site plan)

Pumps in working order (yes or no): _____
Alarms in working order (yes or no): _____
Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.): _____

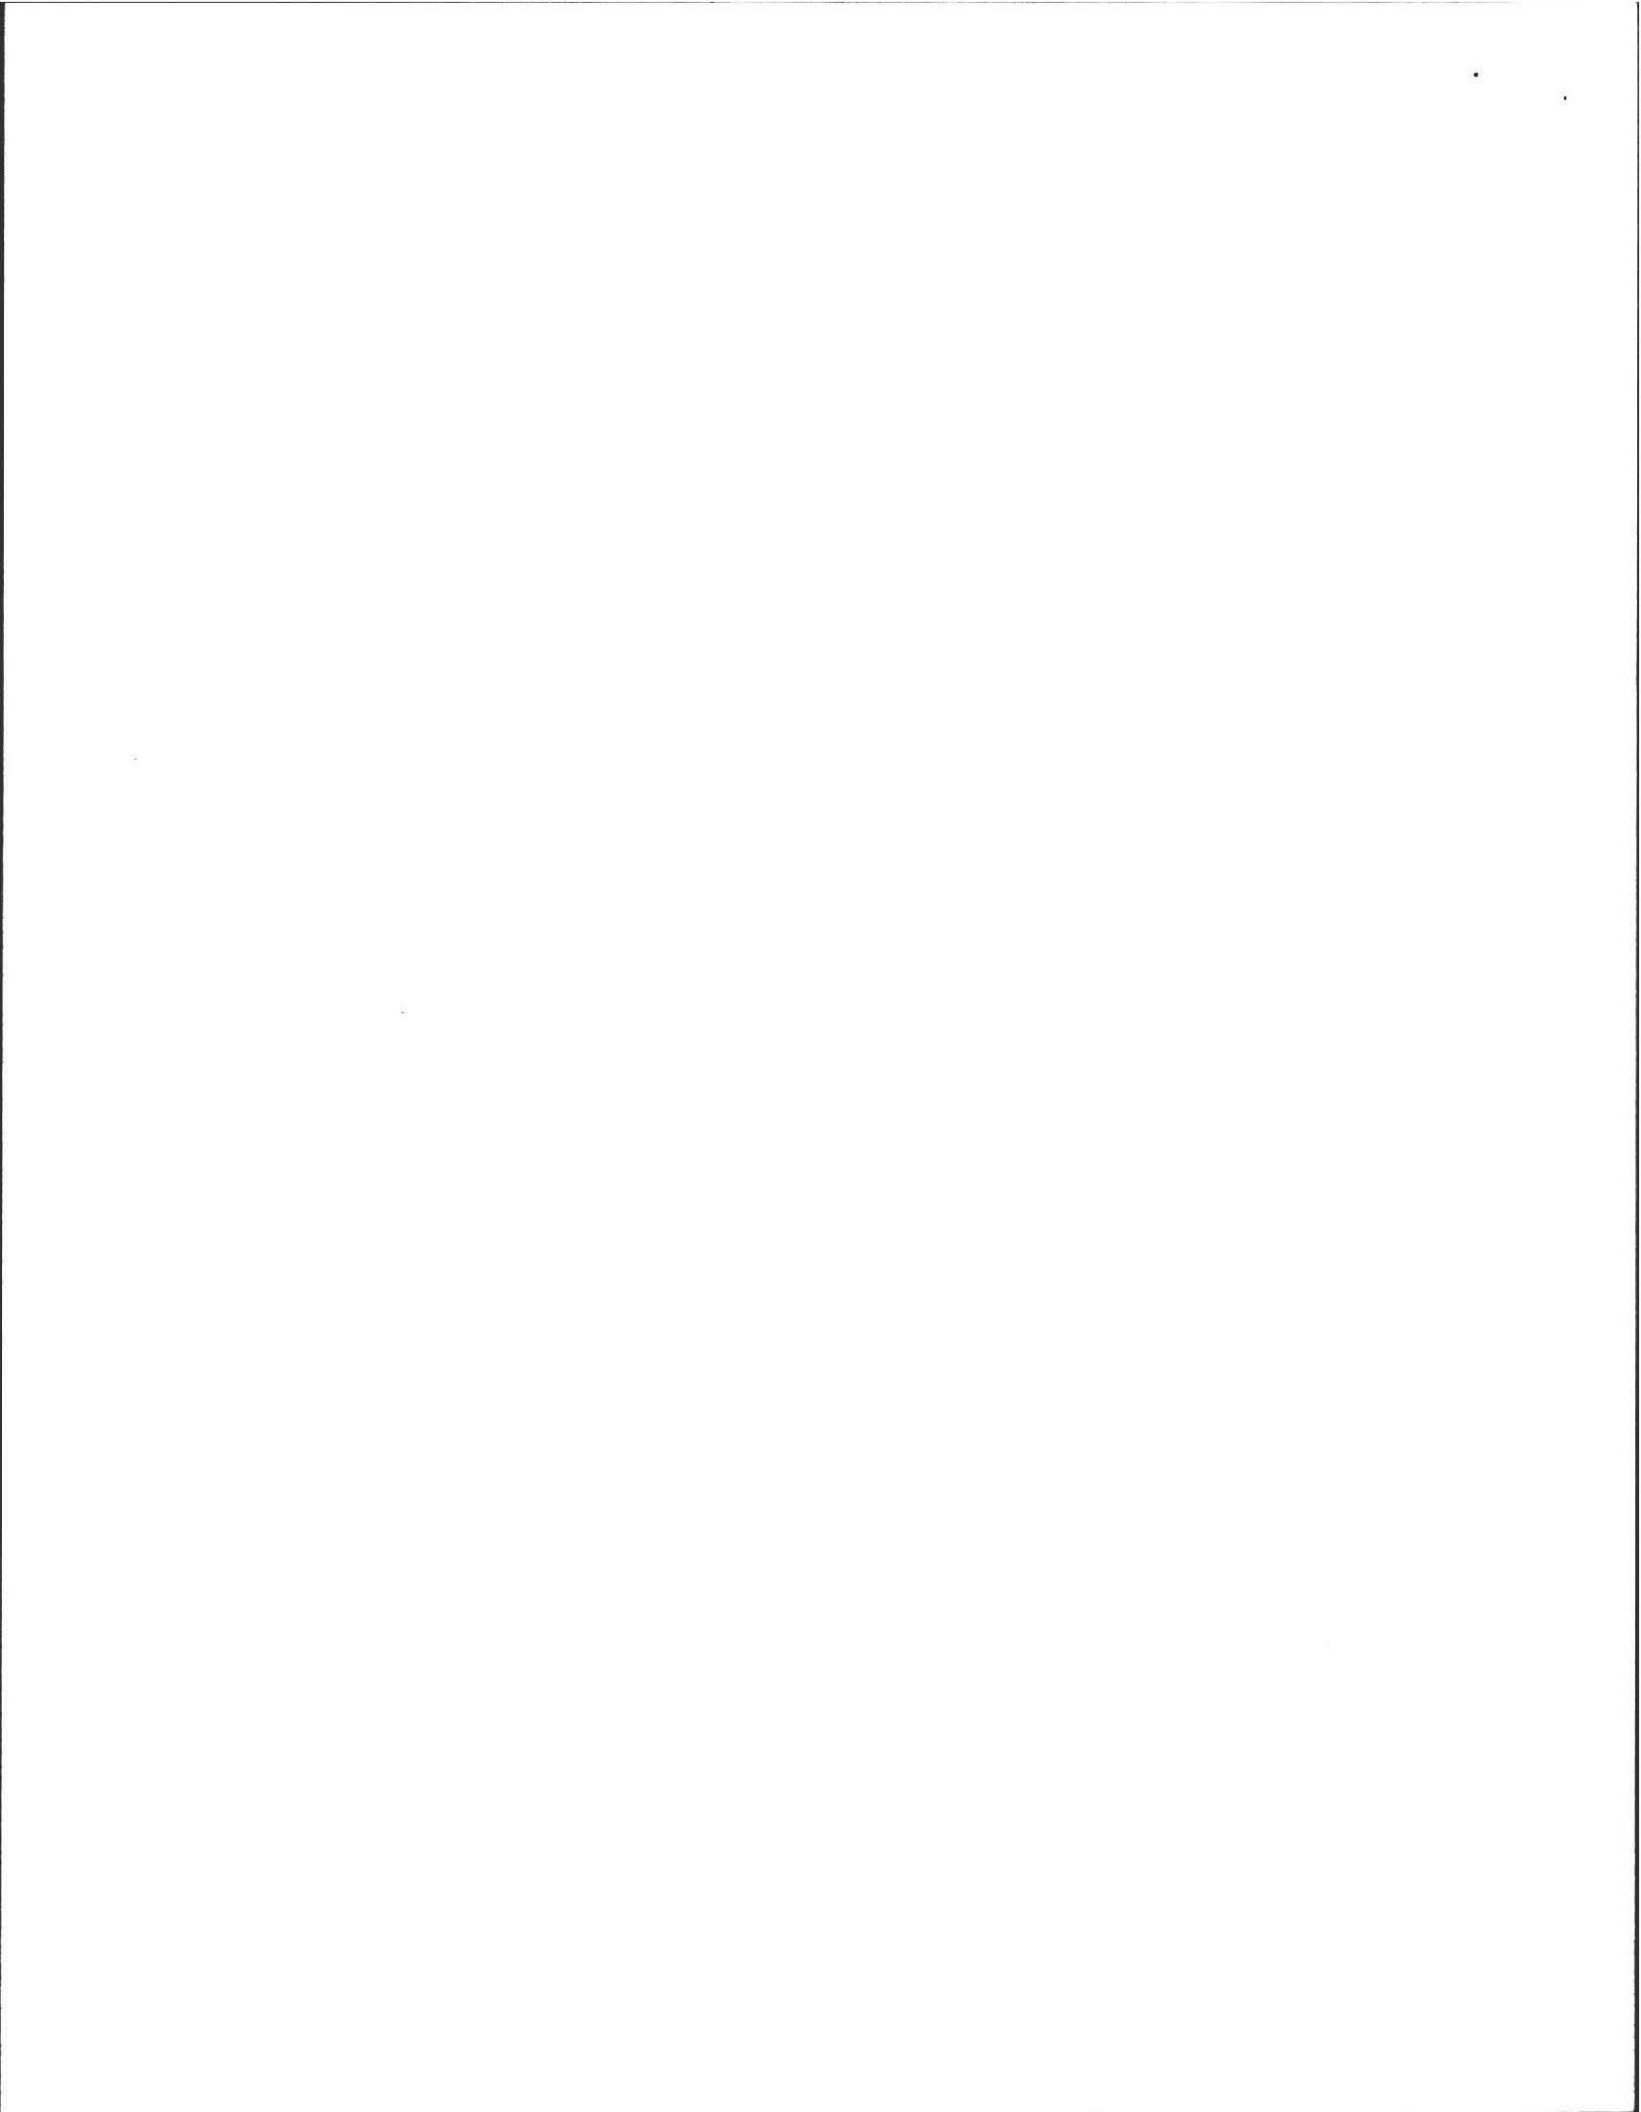

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005

SOIL ABSORPTION SYSTEM (SAS): YES (locate on site plan, excavation not required)

If SAS not located explain why:

Type

_____ leaching pits, number: _____
2 leaching chambers, number: 5'w x 108' l x 2' depth (2-750 gallon+/-)
_____ leaching galleries, number: _____
_____ leaching trenches, number, length: _____
_____ leaching fields, number, dimensions: _____
_____ overflow cesspool, number: _____
_____ innovative/alternative system Type/name of technology: _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.): No signs of failure, stone dry, and No Groundwater within 6' of depth'
Top of chamber is 3.0 feet down, no standing liquid in tanks. No hi, staining visible.

CESSPOOLS: N/A (cesspool must be pumped as part of inspection)(locate on site plan)


Number and configuration: _____
Depth - top of liquid to inlet invert: _____
Depth of solids layer: _____
Depth of scum layer: _____
Dimensions of cesspool: _____
Materials of construction: _____

Indication of groundwater inflow (yes or no): _____
Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

PRIVY: N/A (locate on site plan)

Materials of construction: _____
Dimensions: _____
Depth of solids: _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

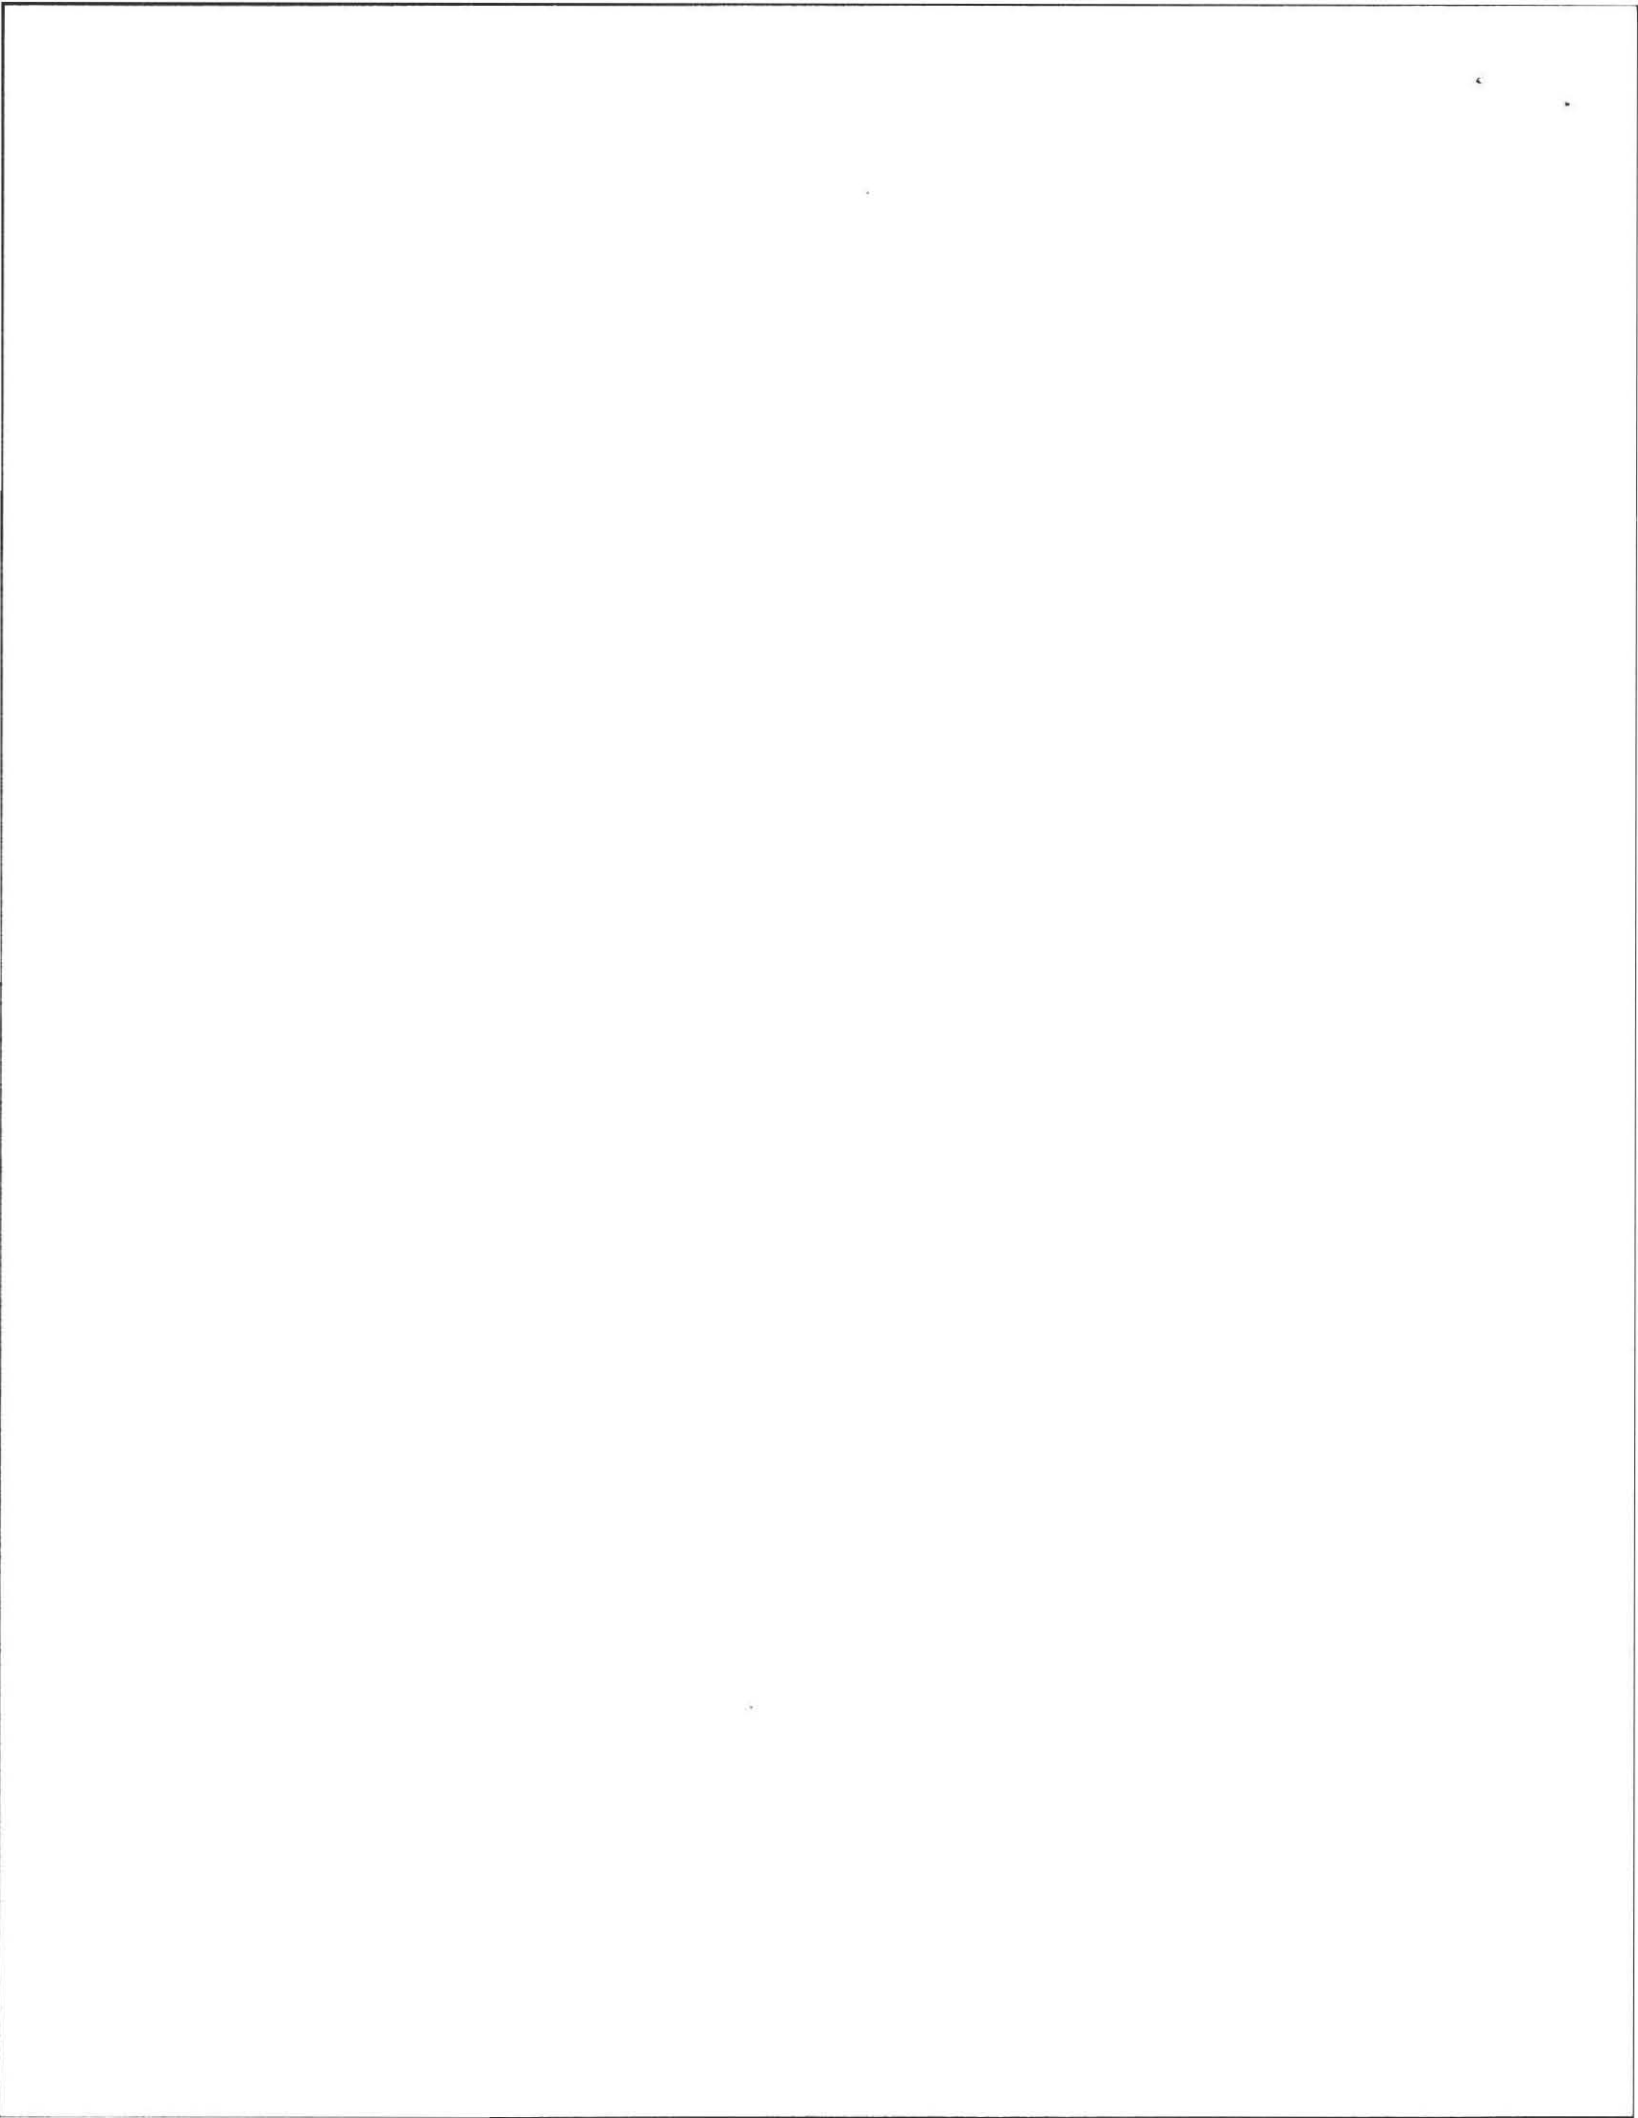



OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 711 Northeast Street, Amherst
Owner: Waterman
Date of Inspection: June 29, 2005


SKETCH OF SEWAGE DISPOSAL SYSTEM

Provide a sketch of the sewage disposal system including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building.

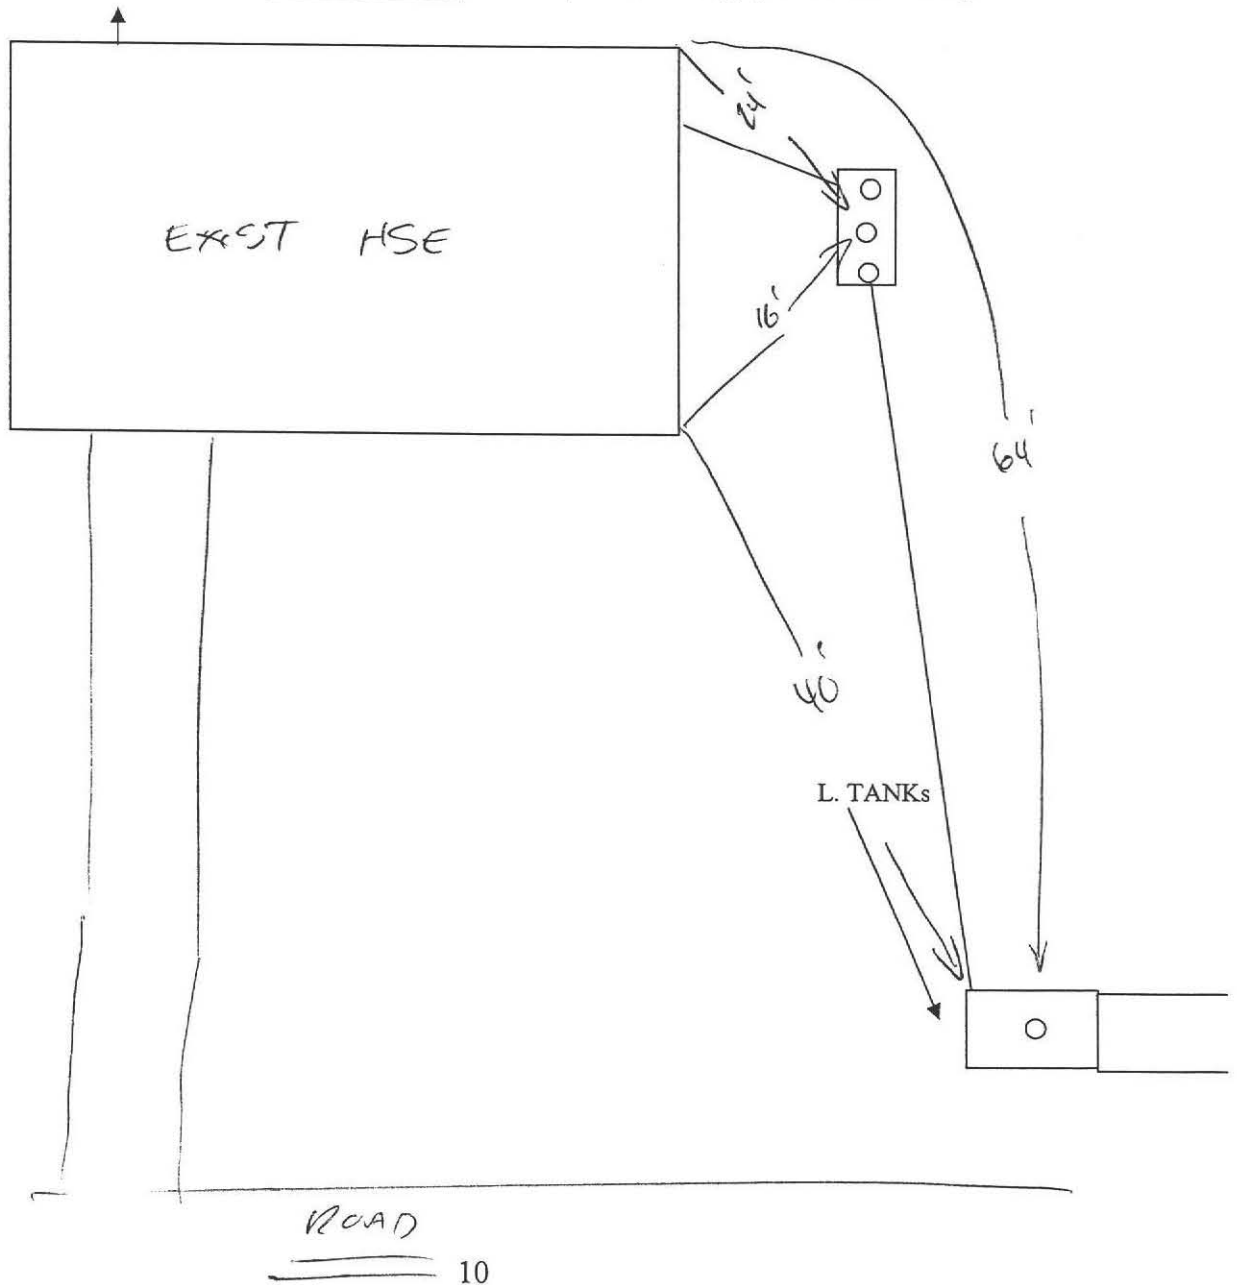

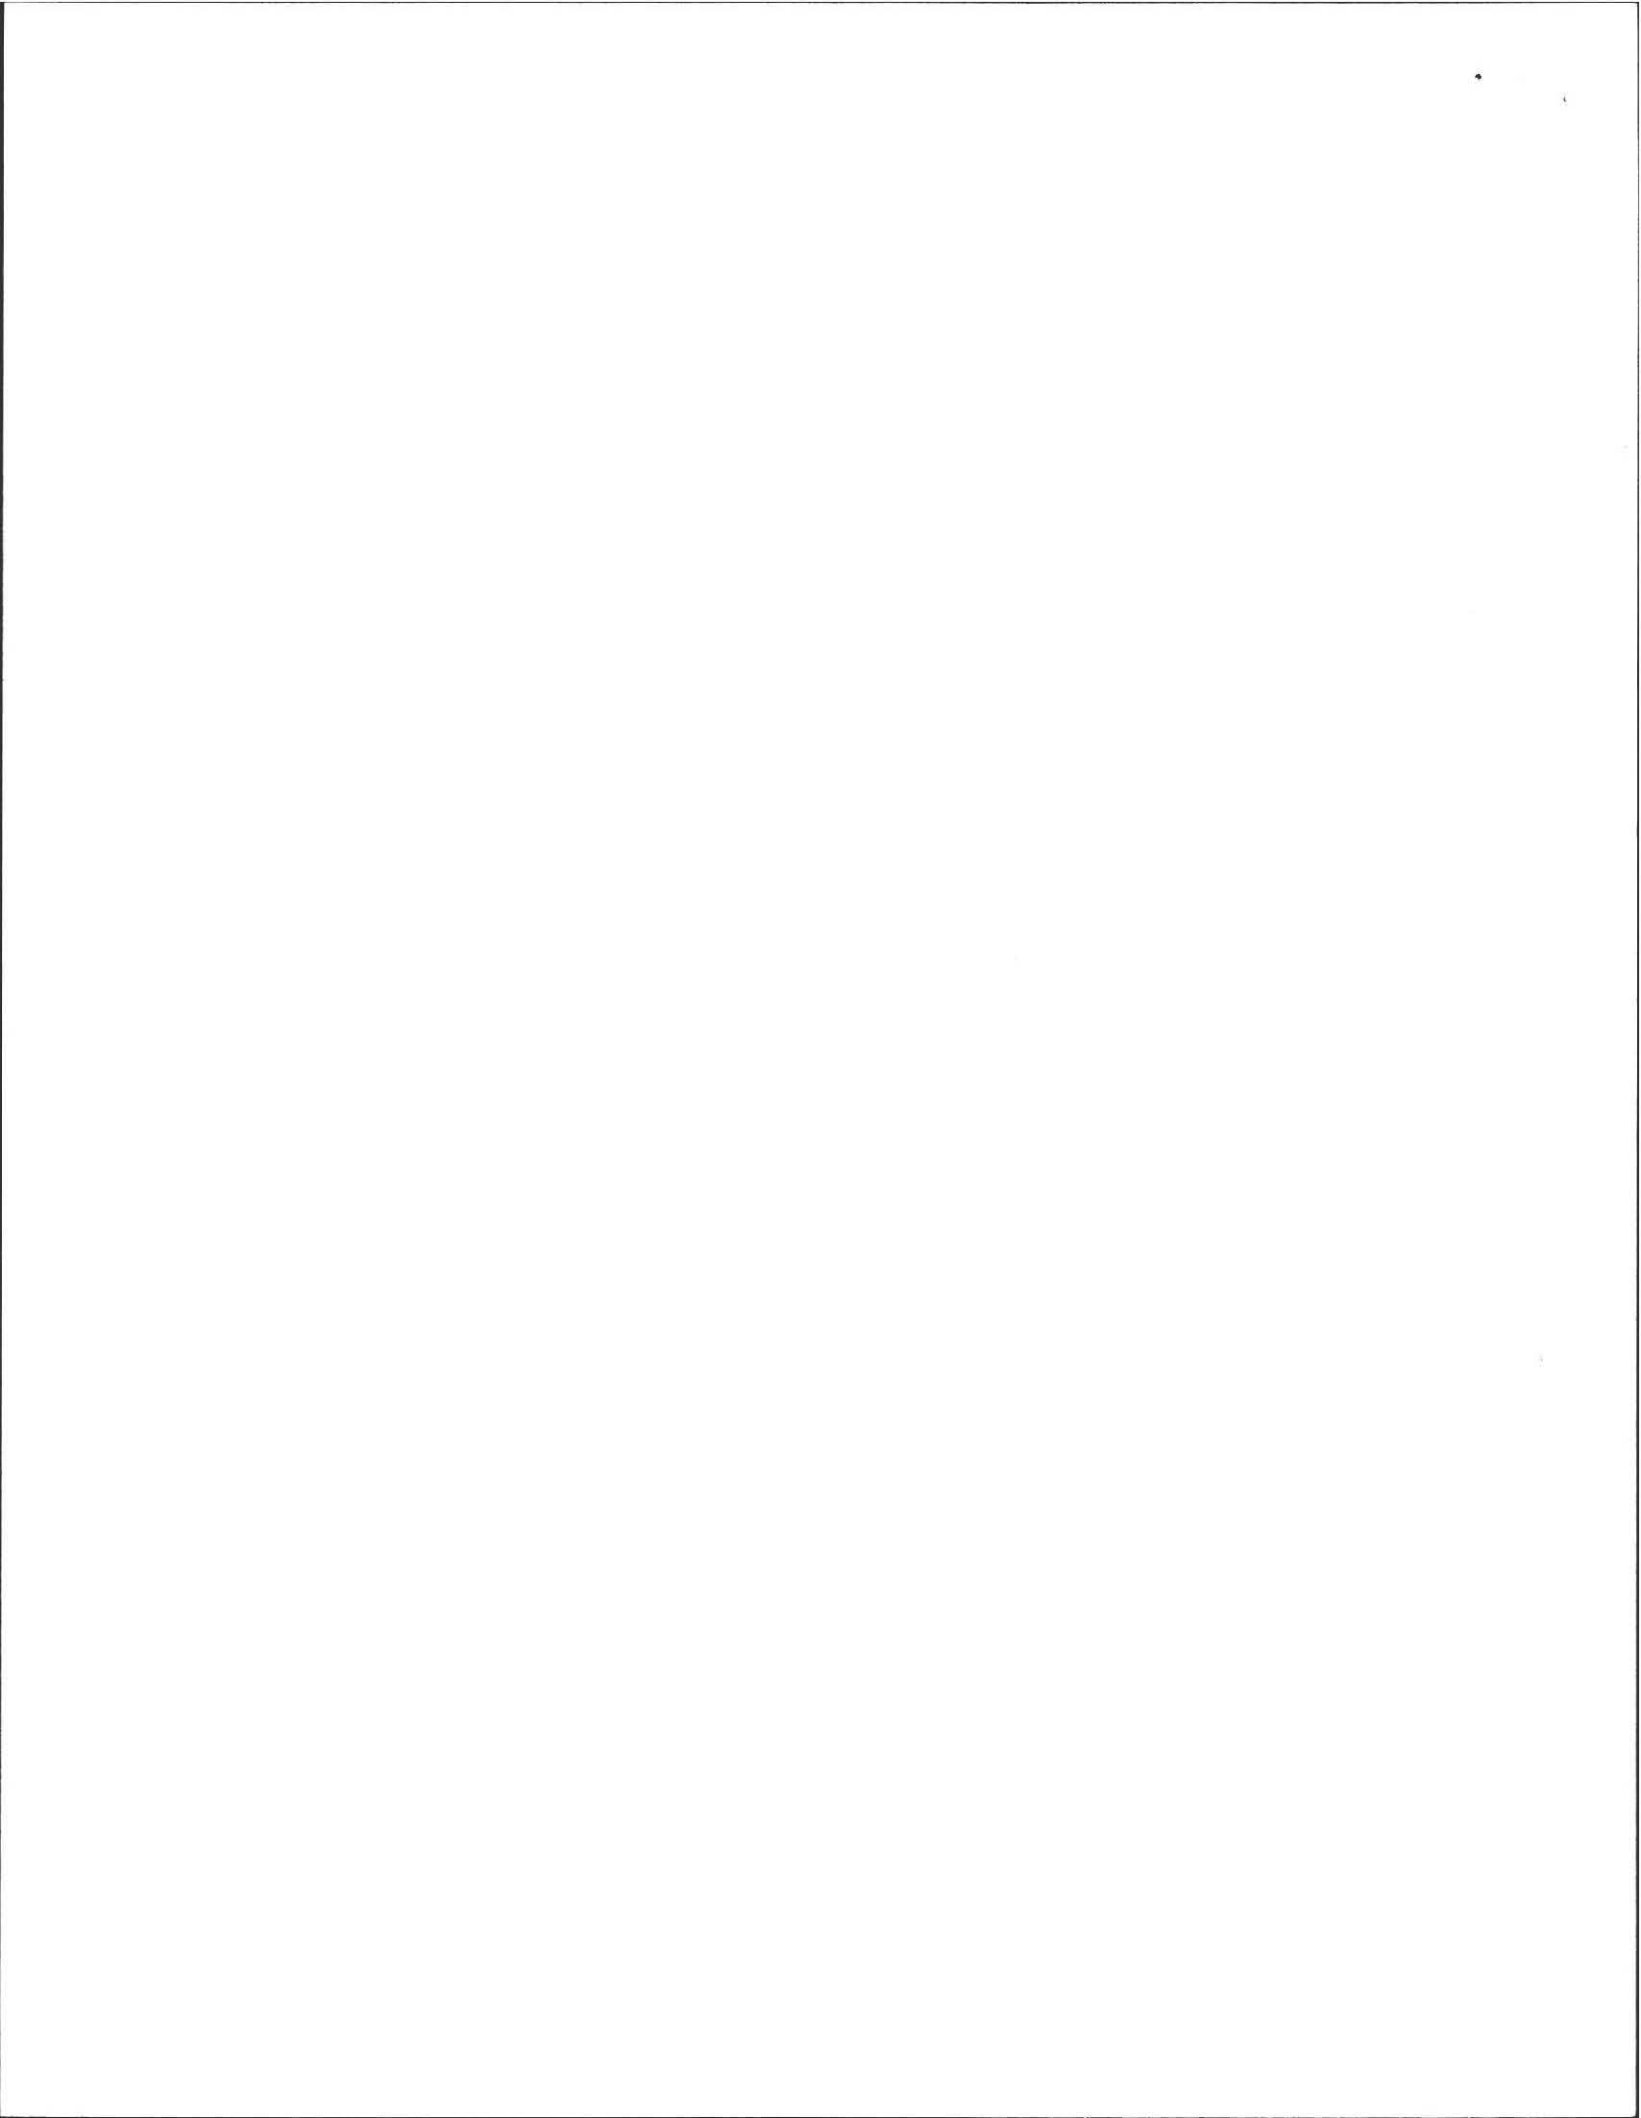

711 Northeast ST.

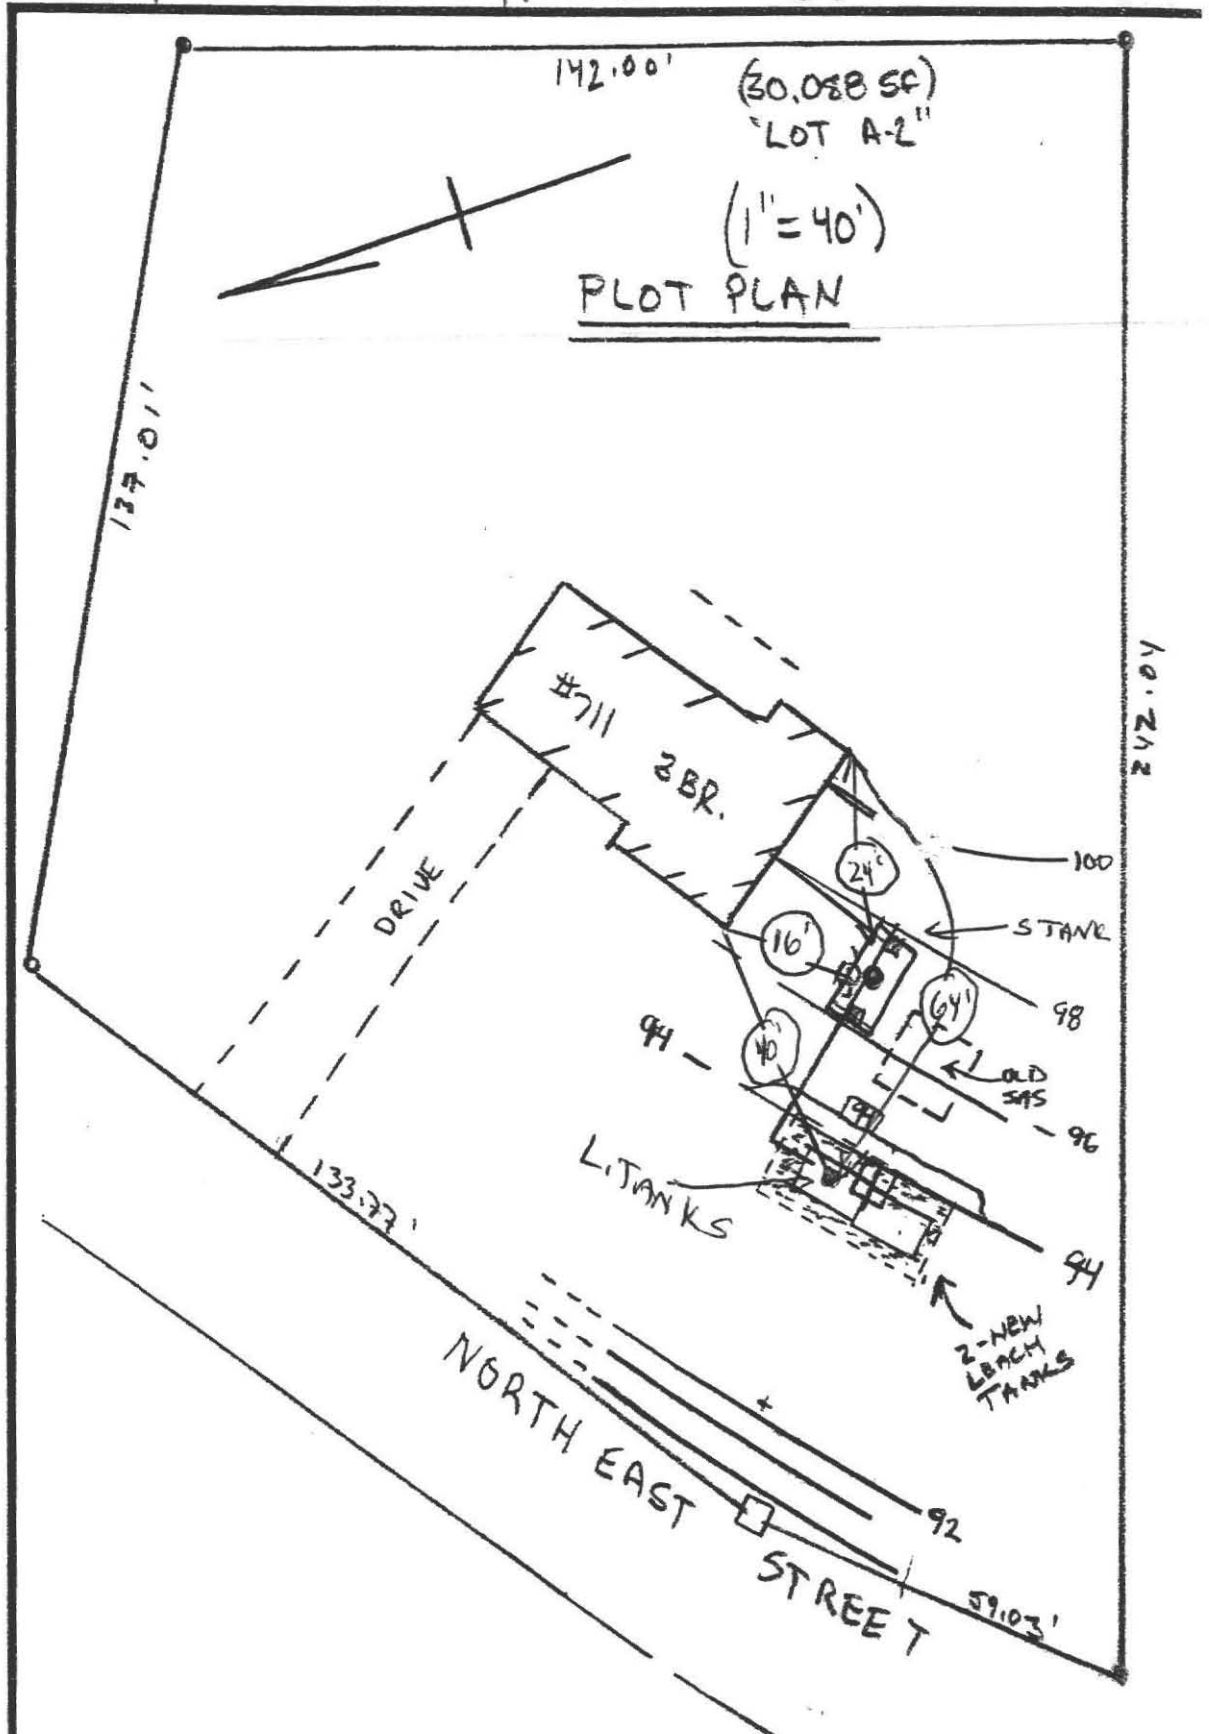

(Note: use 24" OF 3/4-1 1/2" ID stone under l. tank and s. tank for s

1. 3 Bedrooms x 110 gal/day = 330gal./day
2. Use TWO Leach Tanks w/ 4' stone around & 6" stone under
 13' Eff. wide x 28' Eff. long x 2.00' stone on sides of Tanks.
 Bot. Area: 13' wide x 28 long = 364sf.
 Side Area: 13' wide x 2.00hi x 2 SIDES = 52 sf.
 Side Area: 28' wide x 2.0 hi x 2 SIDES = 112 sf
 Tot. Area: 528 sf x 0.74 gal.sf. = 391 gal./day.
3. NO GARBAGE DISPOSAL ALLOWED
4. USE TWO 750 GAL LEACH TANKS (EACH 5' X10') W/ 4' STONE.
5. ALL WELLS WITHIN 100 FEET OF SYSTEM NOTED (TOWN WATER
 REROUTE WATER LINE AWAY FROM SAS PER 310 CMR 15.00.
6. NO WETLANDS WITHIN 100 FEET OF SYSTEM NOTED.
7. PRE & POST CONTOURS NOTED AS NECESSARY.
8. RESERVE AREA NOT REQUIRED.
9. SLOPE CALCS NOT APPLIC.
10. 2% MIN. SLOPE OVER SAS
11. FINAL GRADE RUNOFF, MAY NOT INTERFERE WITH SAS.
12. BENCHMARK = 100.0' S. TANK TOP.
13. USE EXISTING 1000 GAL.. S. TANK WITH PROPER TEE/BAFFLE AT OUTLET
 & INLET IF TANK SOUND (REPLACE W. 1,500 GAL IF NOT STRUCT. SOUND.
14. UNDER LEACH TANK USE 24" OF 3/4" STONE REMOVE C1 & C2 LAYER TO 86.20 FOR
 FIVE FEET AROUND PLACE STONE AT 87.5 FOR STABLE BASE OF LEACH TANK.
 SUBGRADE INSPECTION REQUIRED.

SOIL EVALUATION BY A. Weiss ON 04/21/99 , D. ZAROZINSKI, BOH AGENT.
 PERC1 AT 78" DEPTH= 5 MIN/IN, CLASS I SOIL, USE 4' SEPARATION

SOIL LOG

TP-1 EL. 92.70'	TP-2 EL. --'
0"-10" A. LOAM, FINE SANDY LOAM (2.5Y3/3), FRIABLE	—"
10-20" Bw FINE SANDY LOAM (2.5Y6/8), FRIABLE	
20-36" C1 FINE SAND, LOOSE (2.5Y 7/7)	
36-78" C2 FINE SANDY LOAM STIFF SOME SILT (2.5Y 5/4)	
78"-148" C3 WELL SORTED FINE TO COARSE SAND, LOOSE (2.5 Y5/3)	

(STRATIFIED DRIFT, CLASS 1 SOIL) ESHWT= 80.70'

148" 10 YR 5/8 OXIDES	NA.	
NOT OBS. STATIC H2O (SEEPS)	NA.	
" BEDROCK	NA..	

