

14 OVERLOOK PRINE



Richard Scott, P.E.
31 Shutesbury Road
Pelham, MA 01002
(413) 256-0647

July 22, 2003

Dave Zarozinski
Inspection Services
4 Boltwood Avenue
Amherst, MA 01002-2351

Subject: Title 5 Septic System Inspection at 14 Overlook Drive
(Property of Prem Menon)

Dear Dave:

On June 25, 2003 I completed an inspection of the septic system at the subject property in accordance with 310 CMR 15.000 (Title 5) requirements. A copy of the report are enclosed for your use.

This system is certified as, "Passed" by the criteria in the regulation. Additional notations are included in the report.

If you have questions on any aspect of the inspection or the report please contact me at the address above or by phone evenings.

Sincerely,

A handwritten signature in cursive script that reads "Richard Scott". The signature is written in black ink and has a long, sweeping horizontal line extending to the right.

Richard Scott, P.E.

cc:Prem Menon, Owner
Sally Malsch, Realtor
Buyer c/o Sally Malsch

1000
1000
1000
1000

1000

1000
1000
1000
1000

1000
1000
1000

1000

1000
1000
1000
1000

1000
1000
1000

1000
1000
1000

1000

1000
1000

1000

1000
1000
1000

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 14 OVERLOOK DRIVE

Owner: PREM MENON
AMHERST,

Date of Inspection: 6-25-03

Inspection Summary: Check A,B,C,D or E / ALWAYS complete all of Section D

A. System Passes:

I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments:

B. System Conditionally Passes: N/A

_____ One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Answer yes, no or not determined (Y,N,ND) in the _____ for the following statements. If "not determined" please explain.

_____ The septic tank is metal and over 20 years old* or the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health.

*A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

ND explain:

_____ Observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System will pass inspection if (with approval of Board of Health):

- _____ broken pipe(s) are replaced
- _____ obstruction is removed
- _____ distribution box is leveled or replaced

ND explain:

_____ The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

- _____ broken pipe(s) are replaced
- _____ obstruction is removed

ND explain:



COMMONWEALTH OF MASSACHUSETTS
 EXECUTIVE OFFICE OF ENVIRONMENTAL AFFAIRS
 DEPARTMENT OF ENVIRONMENTAL PROTECTION

TITLE 5
 OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
 SUBSURFACE SEWAGE DISPOSAL SYSTEM FORM
 PART A
 CERTIFICATION

Property Address: 14 OVERLOOK DRIVE
AMHERST
 Owner's Name: PREM MENON
 Owner's Address: 14 OVERLOOK DRIVE
AMHERST, MA 01002
 Date of Inspection: 6-25-03

Name of Inspector: (please print) RICHARD SCOTT
 Company Name: RICHARD SCOTT, P.E.
 Mailing Address: 31 SHUTESBURY ROAD
PELHAM, MA 01002
 Telephone Number: 413-256-0647

CERTIFICATION STATEMENT

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of the inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on site sewage disposal systems. I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000). The system:

- Passes
- Conditionally Passes
- Needs Further Evaluation by the Local Approving Authority
- Fails

Inspector's Signature: Richard Scott Date: 6-25-03

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

Notes and Comments

****This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same or different conditions of use.

**OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)**

Property Address: 14 OVERLOOK DRIVE
AMHERST
Owner: PREM MENON
Date of Inspection: 6-25-03

D. System Failure Criteria applicable to all systems:
You must indicate “yes” or “no” to each of the following for all inspections:

- | Yes | No | |
|--------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Liquid depth in cesspool is less than 6” below invert or available volume is less than ½ day flow |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Required pumping more than 4 times in the last year <u>NOT</u> due to clogged or obstructed pipe(s). Number of times pumped <u> </u> . |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of the SAS, cesspool or privy is below high ground water elevation. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within a Zone 1 of a public well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within 50 feet of a private water supply well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. [This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.] |

No (Yes/No) The system fails. I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure.

E. Large Systems: N/A
To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.

You must indicate either “yes” or “no” to each of the following:
(The following criteria apply to large systems in addition to the criteria above)

- | yes | no | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 400 feet of a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 200 feet of a tributary to a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area – IWPA) or a mapped Zone II of a public water supply well |

If you have answered “yes” to any question in Section E the system is considered a significant threat, or answered “yes” in Section D above the large system has failed. The owner or operator of any large system considered a significant threat under Section E or failed under Section D shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 14 OVERLOOK DRIVE
AMHERST

Owner: PREM MENON

Date of Inspection: 6-25-03

C. Further Evaluation is Required by the Board of Health: N/A

_____ Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

1. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:

- ___ Cesspool or privy is within 50 feet of a surface water
- ___ Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

2. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:

___ The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.

___ The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.

___ The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.

___ The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well**. Method used to determine distance _____

**This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

3. Other:

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION

Property Address: 14 OVERLOOK DRIVE
AMHERST

Owner: PREM MENON

Date of Inspection: 6-25-03

FLOW CONDITIONS

RESIDENTIAL

Number of bedrooms (design): 4 Number of bedrooms (actual): 4
DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): _____

Number of current residents: 2

Does residence have a garbage grinder (yes or no): No

Is laundry on a separate sewage system (yes or no): No [if yes separate inspection required]

Laundry system inspected (yes or no): N/A

Seasonal use: (yes or no): No

Water meter readings, if available (last 2 years usage (gpd)): NOT AVAILABLE. PRIVATE WELL WATER SUPPLY.

Sump pump (yes or no): No

Last date of occupancy: CURRENTLY OCCUPIED.

COMMERCIAL/INDUSTRIAL N/A

Type of establishment: _____

Design flow (based on 310 CMR 15.203): _____ gpd

Basis of design flow (seats/persons/sqft, etc.): _____

Grease trap present (yes or no): _____

Industrial waste holding tank present (yes or no): _____

Non-sanitary waste discharged to the Title 5 system (yes or no): _____

Water meter readings, if available: _____

Last date of occupancy/use: _____

OTHER (describe): _____

GENERAL INFORMATION

Pumping Records

Source of information: PUMPED LAST MAY, 2000 PER OWNER

Was system pumped as part of the inspection (yes or no): Yes

If yes, volume pumped: 1000 gallons -- How was quantity pumped determined? FROM TANK DIMENSIONS.

Reason for pumping: SOLIDS REMOVAL & CHECK TANK.

TYPE OF SYSTEM

Septic tank, distribution box, soil absorption system

Single cesspool

Overflow cesspool

Privy

Shared system (yes or no) (if yes, attach previous inspection records, if any)

Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner)

Tight tank Attach a copy of the DEP approval

Other (describe): _____

Approximate age of all components, date installed (if known) and source of information:
LEACH FIELD 6 YEARS OLD. INSTALLED IN 1996. BUILDING SEWER 2 MONTHS OLD -
INSTALLED MAY 2003.

Were sewage odors detected when arriving at the site (yes or no): _____

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART B
CHECKLIST

Property Address: 14 OVERLOOK DRIVE
AMHERST
Owner: PREM MENON
Date of Inspection: 6-25-03

Check if the following have been done. You must indicate "yes" or "no" as to each of the following:

- Yes No
- Pumping information was provided by the owner, occupant, or Board of Health
- Were any of the system components pumped out in the previous two weeks ?
- Has the system received normal flows in the previous two week period ?
- Have large volumes of water been introduced to the system recently or as part of this inspection ?
- Were as built plans of the system obtained and examined? (If they were not available note as N/A) *DESIGN PLAN ONLY*
- Was the facility or dwelling inspected for signs of sewage back up ?
- Was the site inspected for signs of break out ?
- Were all system components, excluding the SAS, located on site ?
- Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum ?
- Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems ?

The size and location of the Soil Absorption System (SAS) on the site has been determined based on:

- Yes no
- Existing information. For example, a plan at the Board of Health.
- Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(3)(b)]

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 14 OVERLOOK DRIVE
AMHERST

Owner: PREM MENON

Date of Inspection: 6-25-03

TIGHT or HOLDING TANK: N/A (tank must be pumped at time of inspection)(locate on site plan)

Depth below grade: _____

Material of construction: _____ concrete _____ metal _____ fiberglass _____ polyethylene _____ other(explain): _____

Dimensions: _____

Capacity: _____ gallons

Design Flow: _____ gallons/day

Alarm present (yes or no): _____

Alarm level: _____ Alarm in working order (yes or no): _____

Date of last pumping: _____

Comments (condition of alarm and float switches, etc.): _____

DISTRIBUTION BOX: (if present must be opened)(locate on site plan)

Depth of liquid level above outlet invert: 0"

Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.):

GOOD CONDITION. NO PROBLEMS APPARENT.

PUMP CHAMBER: (locate on site plan)

Pumps in working order (yes or no): YES

Alarms in working order (yes or no): YES

Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.):

CHAMBER & PUMPS APPEAR IN GOOD CONDITION. LIQUID LEVELS CORRECT.

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 14 OYERLOOK DRIVE
AMHERST
Owner: PREM MENON
Date of Inspection: 6-25-03

BUILDING SEWER (locate on site plan)

Depth below grade: 12" (?) (BELOW SLAB)
Materials of construction: cast iron 40 PVC other (explain): _____
Distance from private water supply well or suction line: APPROX 50' FROM WELL TO BLDG SEWER EXIT FROM HOU.
Comments (on condition of joints, venting, evidence of leakage, etc.):
GOOD CONDITION. VENTED TO ROOF

SEPTIC TANK: _____ (locate on site plan)

Depth below grade: 18"
Material of construction: concrete metal fiberglass polyethylene
 other(explain) _____
If tank is metal list age: _____ Is age confirmed by a Certificate of Compliance (yes or no): _____ (attach a copy of certificate)
Dimensions: 102" x 58" x 48" DEEP
Sludge depth: 4"
Distance from top of sludge to bottom of outlet tee or baffle: 24"
Scum thickness: 1"
Distance from top of scum to top of outlet tee or baffle: 6"
Distance from bottom of scum to bottom of outlet tee or baffle: 20"
How were dimensions determined: DIRECT OBSERVATION AT TIME OF PUMPING.
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):
NEW CENTER OUTLET TEE APPARENTLY 1996 - GOOD CONDITION
NEW ABS INLET SEWER MAY 2003. EXISTING CAST-IN INLET BAFFLE - GOOD CONDITION
TANK IS IN GOOD CONDITION. LIQUID LEVEL IS CORRECT

GREASE TRAP: N/A (locate on site plan)

Depth below grade: _____
Material of construction: concrete metal fiberglass polyethylene other (explain): _____
Dimensions: _____
Scum thickness: _____
Distance from top of scum to top of outlet tee or baffle: _____
Distance from bottom of scum to bottom of outlet tee or baffle: _____
Date of last pumping: _____
Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 14 OVERLOOK DRIVE


AMHERST

Owner: PREM MENON

Date of Inspection: 6-25-03

SKETCH OF SEWAGE DISPOSAL SYSTEM

Provide a sketch of the sewage disposal system including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building.

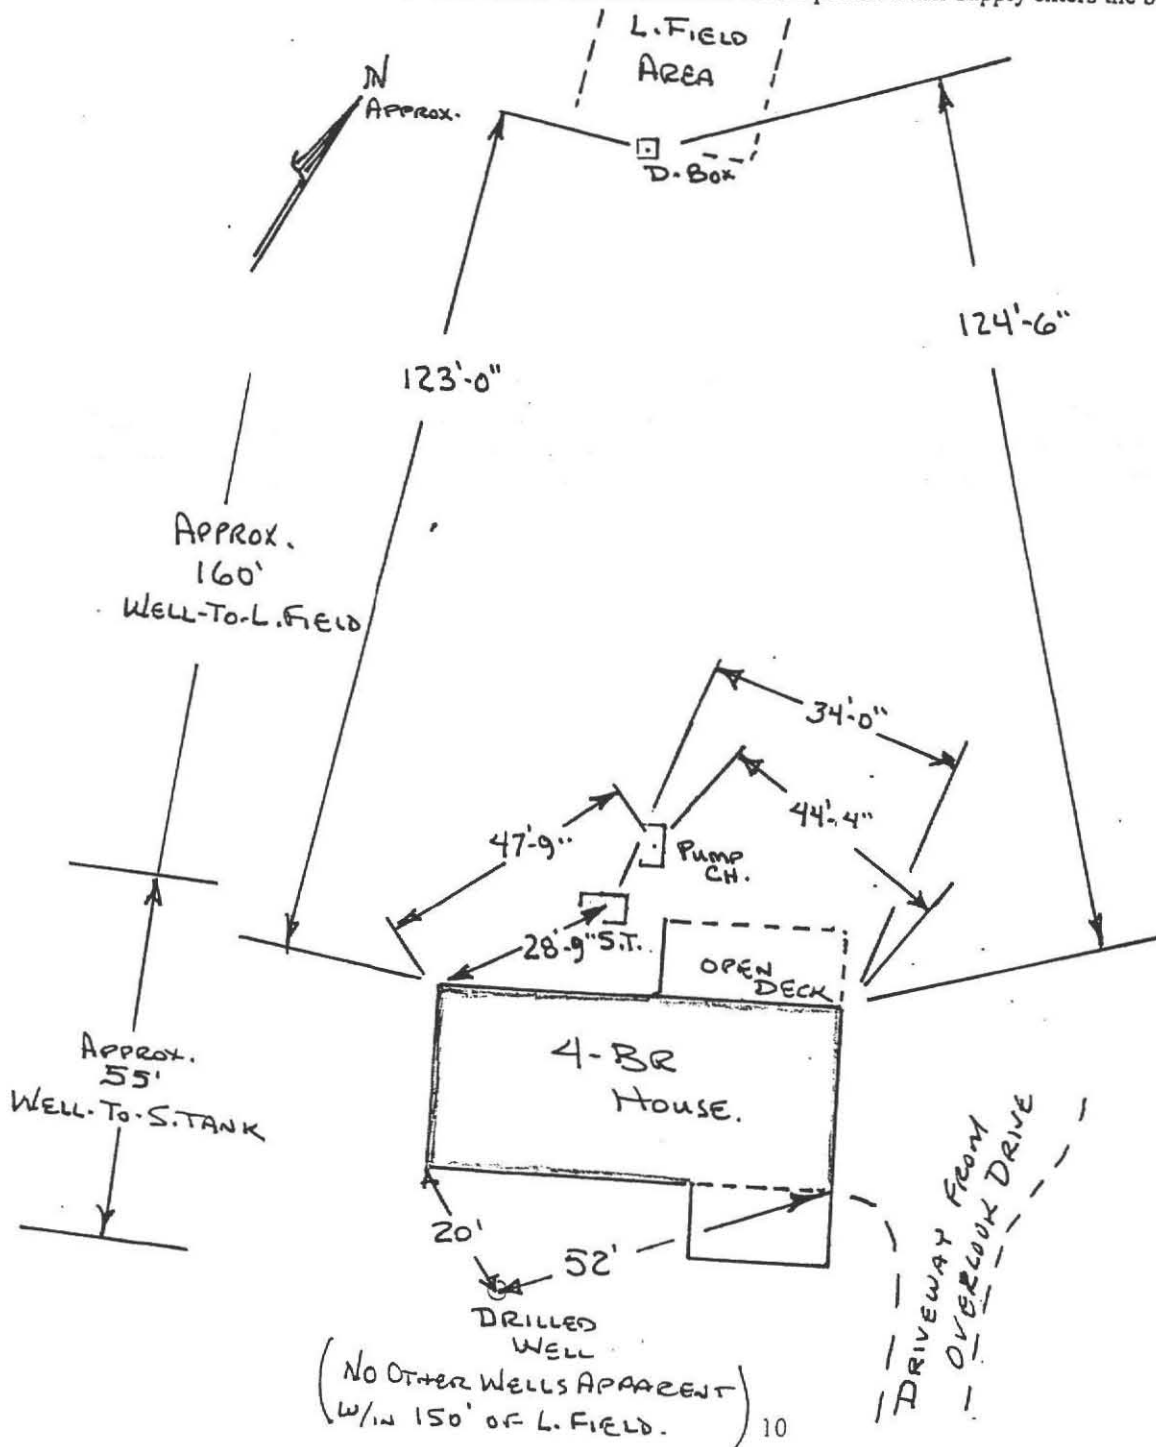

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 14 OVERLOOK DRIVE
AMHERST

Owner: PREM MENON

Date of Inspection: 6-25-07

SOIL ABSORPTION SYSTEM (SAS): (locate on site plan, excavation not required)

If SAS not located explain why:

Type

___ leaching pits, number: ___

___ leaching chambers, number: ___

___ leaching galleries, number: ___

___ leaching trenches, number, length: ___

leaching fields, number, dimensions: ONE FIELD 21' X 47' = 987 SQ. FT.

___ overflow cesspool, number: ___

___ innovative/alternative system Type/name of technology: _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.):

GROUND-SURFACE CONDITIONS AT LEACH PIT ARE GOOD.

CESSPOOLS: N/A (cesspool must be pumped as part of inspection)(locate on site plan)

Number and configuration: _____

Depth – top of liquid to inlet invert: _____

Depth of solids layer: _____

Depth of scum layer: _____

Dimensions of cesspool: _____

Materials of construction: _____

Indication of groundwater inflow (yes or no): _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

PRIVY: N/A (locate on site plan)

Materials of construction: _____

Dimensions: _____

Depth of solids: _____


Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):



PLAN OF SEWAGE DISPOSAL SYSTEM	
14 OVERLOOK DRIVE, AMHERST, MA	
BY: FILIOS ENTERPRISES, INC. 69 PELHAM RD. AMHERST MA 01002 (413)258-8008	FOR: PREMACHANDRAN & MIRA MENON 14 OVERLOOK DRIVE AMHERST, MA 01002
DRAWN BY: J.S.	SCALE: 1" = 30'
SEPTEMBER 24, 1996	1 OF 3

LEGEND:	
○	PT PERCOLATION TEST
△	Hx DEEP TEST PIT
⊗	TREE
~	CONTOUR LINES (1' INTERVAL)

NOTES:
 1. TEM IS NAIL IN BASE OF 36" DIAMETER PINE TREE.
 2. NO OTHER WELLS WITHIN 00' OF THE LEACH AREA AT THE TIME OF SURVEY.

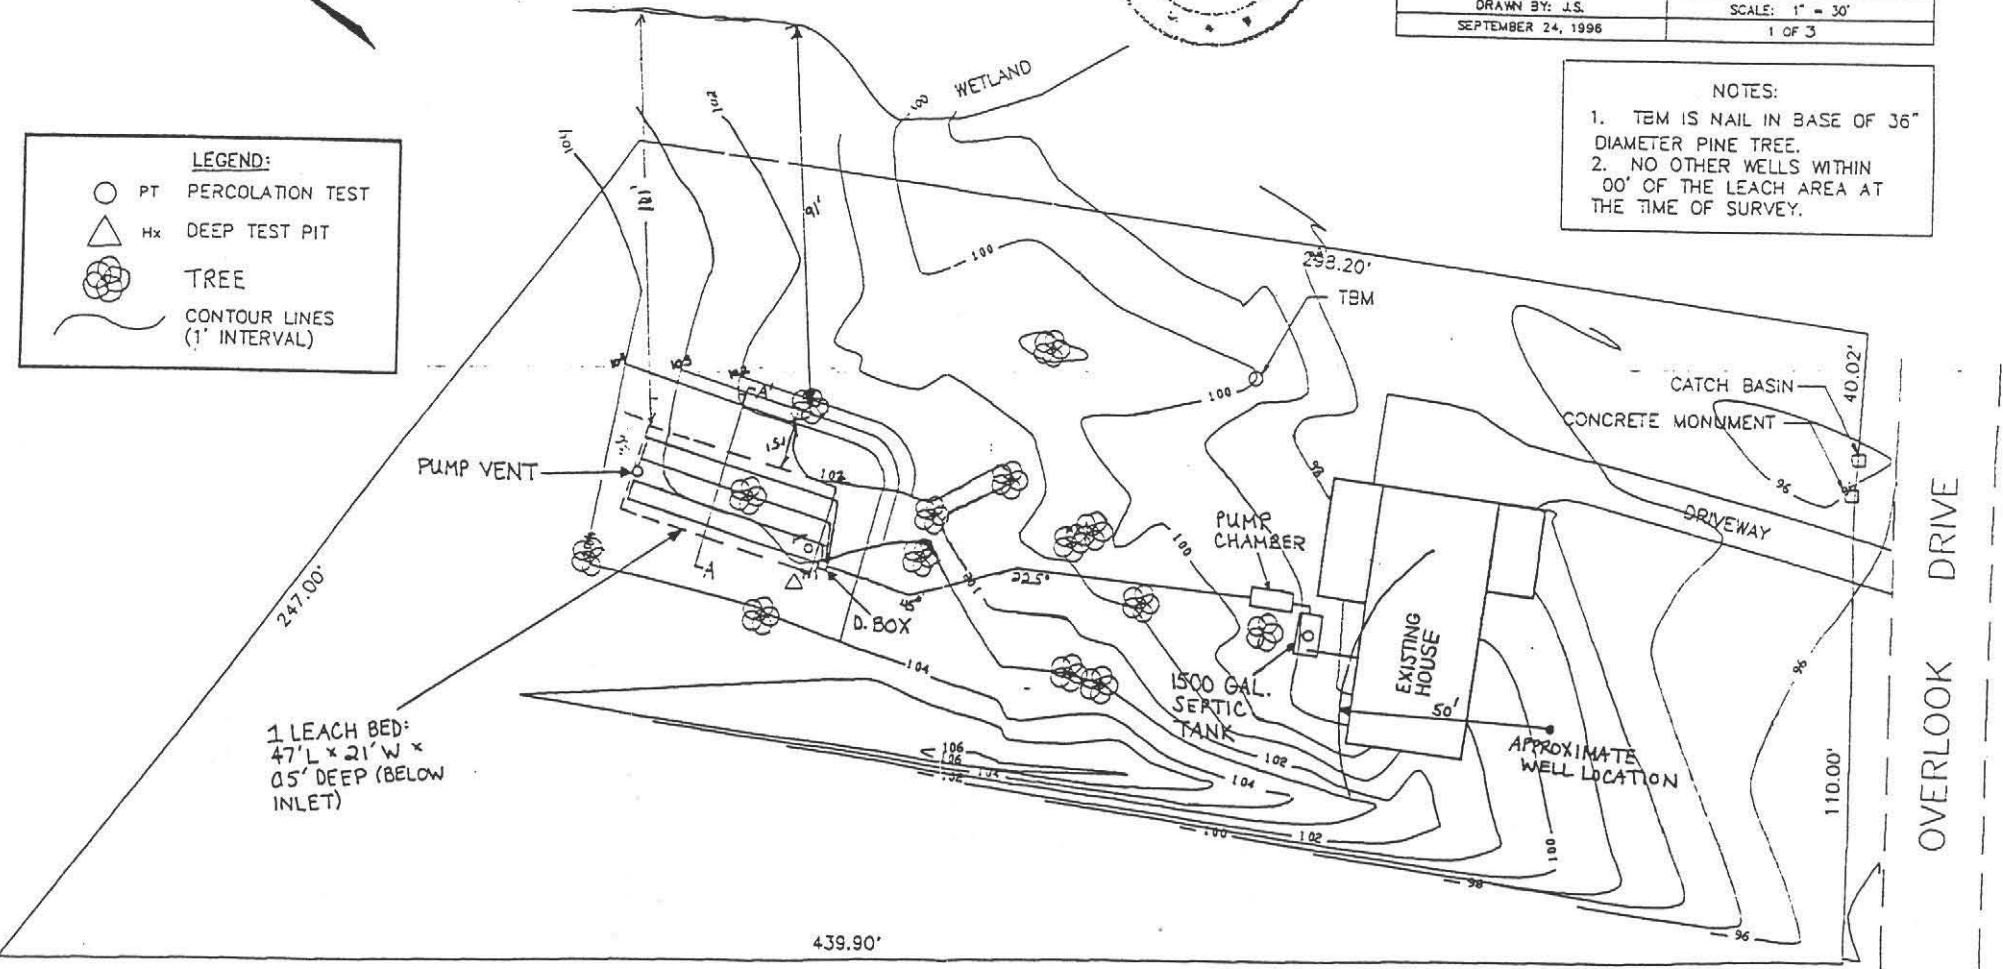

1 LEACH BED:
 47' L x 21' W x
 0.5' DEEP (BELOW
 INLET)

OVERLOOK DRIVE

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 14 OVERLOOK DRIVE
AMHERST
Owner: PREM MENON
Date of Inspection: 6-25-03

SITE EXAM
Slope
Surface water
Check cellar
Shallow wells

Estimated depth to ground water 6+ feet


Please indicate (check) all methods used to determine the high ground water elevation:

- Obtained from system design plans on record - If checked, date of design plan reviewed: 1996
- Observed site (abutting property/observation hole within 150 feet of SAS)
- Checked with local Board of Health-explain: _____
- Checked with local excavators, installers- (attach documentation)
- Accessed USGS database-explain: _____

You must describe how you established the high ground water elevation:

SOIL EVALUATION 7-9-96 BY FRED FILIOS, WITNESSED BY DAVE ZARUBINSKI

PROFILE OF SEWAGE DISPOSAL SYSTEM

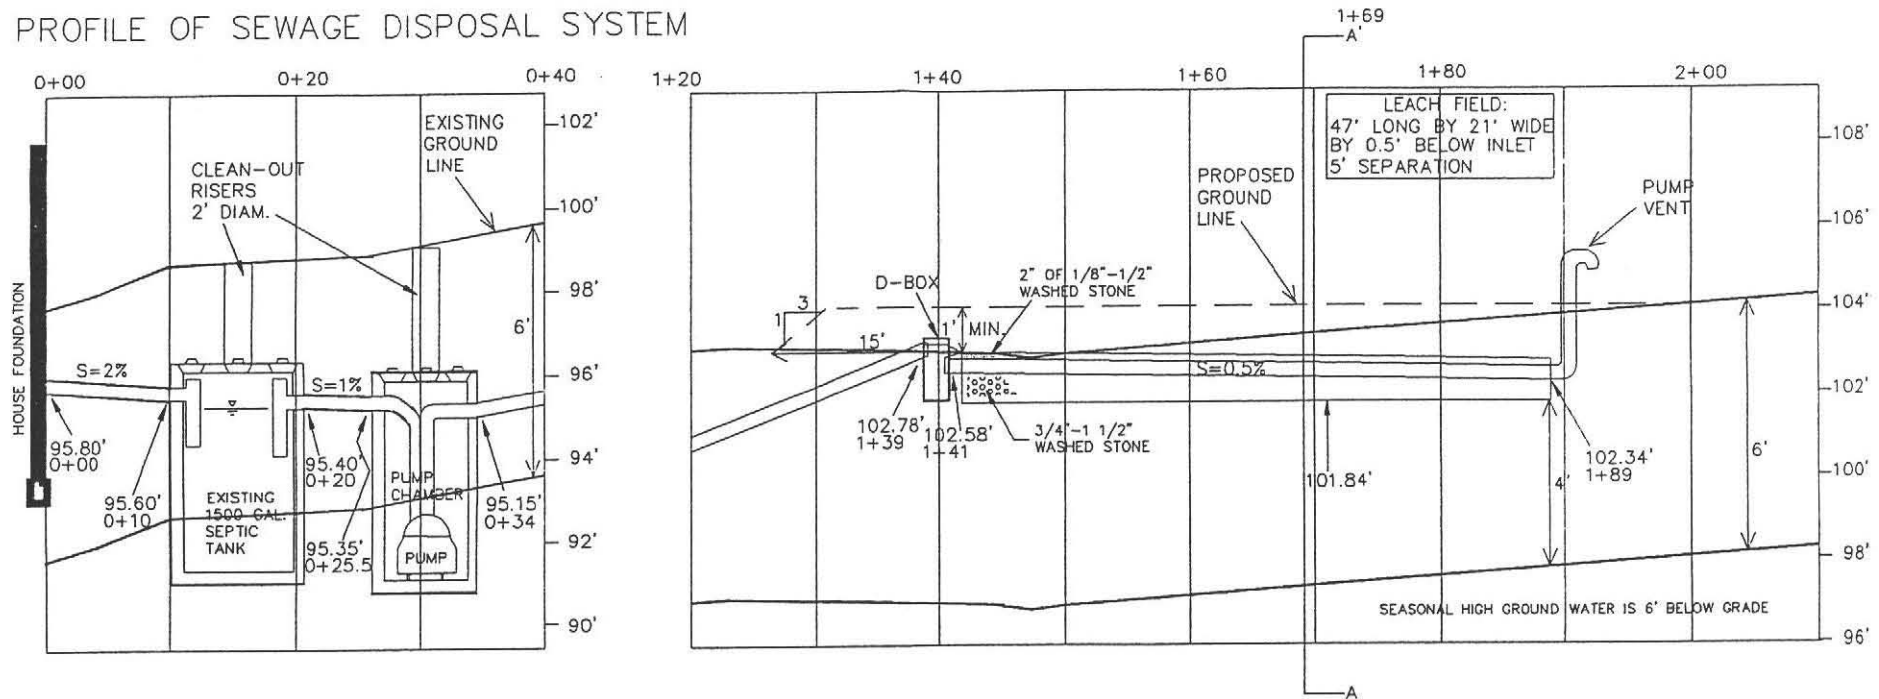

CALCULATIONS	
REQUIRED: For a 4 bedroom house without a garbage grinder a capacity of 440.0 Gal./day X 1.25 = 550.0 Gal./day.	
DESIGNED: 1 leach field 47.0'L X 21.0'W X 0.50' below inlet (effective depth), for a perc rate of 15 min./in. and a soil class of 2 yielding a loading factor of 0.56 gal./sq.ft. for sidewall & bottom area.	
No side factor allowed.	= 0.0 Gal.
BOTTOM: (47.0' X 21.0')0.56 Gal./Sq.Ft.	= 552.7 Gal.
TOTAL	552.7 Gal.

PROFILE OF SEWAGE DISPOSAL SYSTEM	
14 OVERLOOK DRIVE, AMHERST, MA	
BY: FILIOS ENTERPRISES, INC. 69 PELHAM RD. AMHERST MA 01002 (413)258-8008	FOR: PREMACHANDRAN & MIRA MENON 14 OVERLOOK DRIVE AMHERST, MA 01002
DRAWN BY: J.S.	SCALE: 1" = 10' HOR 3" VER.
OCTOBER 4, 1996	PAGE 2 OF 3



