

No. 85-1

#201

FEE \$90

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

Town OF Amherst

Application for Disposal Works Construction Permit



Application is hereby made for a Permit to Construct (X) or Repair () an Individual Sewage Disposal System at:

Shutesbury Road

none

Fil + Jurate Valiunas

132 Village Park Amherst Mass

RIVER DR

Type of Building

Size Lot 47,500 Sq. feet

Dwelling - No. of Bedrooms 3 Expansion Attic () Garbage Grinder ()

Other - Type of Building No. of persons Showers () - Cafeteria ()

Other fixtures

Design Flow 55 gallons per person per day. Total daily flow 330 gallons.

Septic Tank - Liquid capacity 1000 gallons Length Width Diameter Depth

Disposal Trench - No. 2 Width 2' Total Length 132' Total leaching area 264 sq. ft.

Seepage Pit No. Diameter Depth below inlet Total leaching area sq. ft.

Other Distribution box (X) Dosing tank ()

Percolation Test Results Performed by Frederick Filios Date Jan 5 1984

Test Pit No. 1 6:66 minutes per inch Depth of Test Pit 7' Depth to ground water none

Test Pit No. 2 minutes per inch Depth of Test Pit 7 1/2' Depth to ground water none

Description of Soil Enclosed

Nature of Repairs or Alterations - Answer when applicable

Agreement:

The undersigned agrees to install the aforescribed Individual Sewage Disposal System in accordance with the provisions of TITLE 5 of the State Sanitary Code - The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by the board of health.

Signed F. Valiunas

Application Approved By [Signature]

1-2-85 Date 12-27-84 Date

Application Disapproved for the following reasons:

Permit No. 85-1

Issued JAN 2 1985 Date

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

OF

Certificate of Compliance

THIS IS TO CERTIFY, That the Individual Sewage Disposal System constructed () or Repaired () by

Installer

at

has been installed in accordance with the provisions of TITLE 5 of The State Sanitary Code as described in the application for Disposal Works Construction Permit No. dated

THE ISSUANCE OF THIS CERTIFICATE SHALL NOT BE CONSTRUED AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORY.

DATE

Inspector

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

No. 85-1

Town OF Amherst

FEE \$90

Disposal Works Construction Permit

Permission is hereby granted FIL + JURATE VALIUNAS to Construct (X) or Repair () an Individual Sewage Disposal System

at No. SHUTESBURY RD.

as shown on the application for Disposal Works Construction Permit No. 85-1 Dated JAN 1 1985

DATE JAN 2 1985

[Signature] Board of Health

CHECK OR FILL IN WHERE APPLICABLE



Handwritten text at the top center, possibly a title or header.

Two lines of handwritten text, likely the beginning of a paragraph or list.

A line of handwritten text across the middle of the page.

Another line of handwritten text, continuing the content.

A short handwritten phrase or word.

A short handwritten phrase or word.

Handwritten text at the bottom right of the page.

BOARD OF HEALTH

Town OF Amherst

Application for Disposal Works Construction Permit



Application is hereby made for a Permit to Construct (X) or Repair () an Individual Sewage Disposal System at:

Shutesbury Road none
Fil + Jurate Valiunas 132 Village Park Amherst Mass

Type of Building Dwelling - No. of Bedrooms 3 Expansion Attic () Garbage Grinder ()
Other - Type of Building No. of persons Showers () - Cafeteria ()
Other fixtures

Design Flow 55 gallons per person per day. Total daily flow 330 gallons.
Septic Tank - Liquid capacity 1000 gallons Length Width Diameter Depth
Disposal Trench - No. 2 Width 2 Total Length 132 Total leaching area 264 sq. ft. Side Bottom

Seepage Pit No. Diameter Depth below inlet Total leaching area sq. ft.
Other Distribution box (X) Dosing tank ()
Percolation Test Results Performed by Frederick Filios Date Jan 5 1984
Test Pit No. 1 6:66 minutes per inch Depth of Test Pit 7 Depth to ground water none
Test Pit No. 2 minutes per inch Depth of Test Pit 7 1/2 Depth to ground water none

Description of Soil Enclosed

Nature of Repairs or Alterations - Answer when applicable

Agreement: The undersigned agrees to install the aforescribed Individual Sewage Disposal System in accordance with the provisions of TITLE 5 of the State Sanitary Code - The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by the board of health.

Application Approved By X Signed [Signature] Date 12-27-84

Application Disapproved for the following reasons:

Permit No. Issued Date

THE COMMONWEALTH OF MASSACHUSETTS

BOARD OF HEALTH

OF

Certificate of Compliance

THIS IS TO CERTIFY, That the Individual Sewage Disposal System constructed () or Repaired () by


at

has been installed in accordance with the provisions of TITLE 5 of The State Sanitary Code as described in the application for Disposal Works Construction Permit No. dated

THE ISSUANCE OF THIS CERTIFICATE SHALL NOT BE CONSTRUED AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORY.

DATE Inspector

CHECK OR FILL IN WHERE APPLICABLE

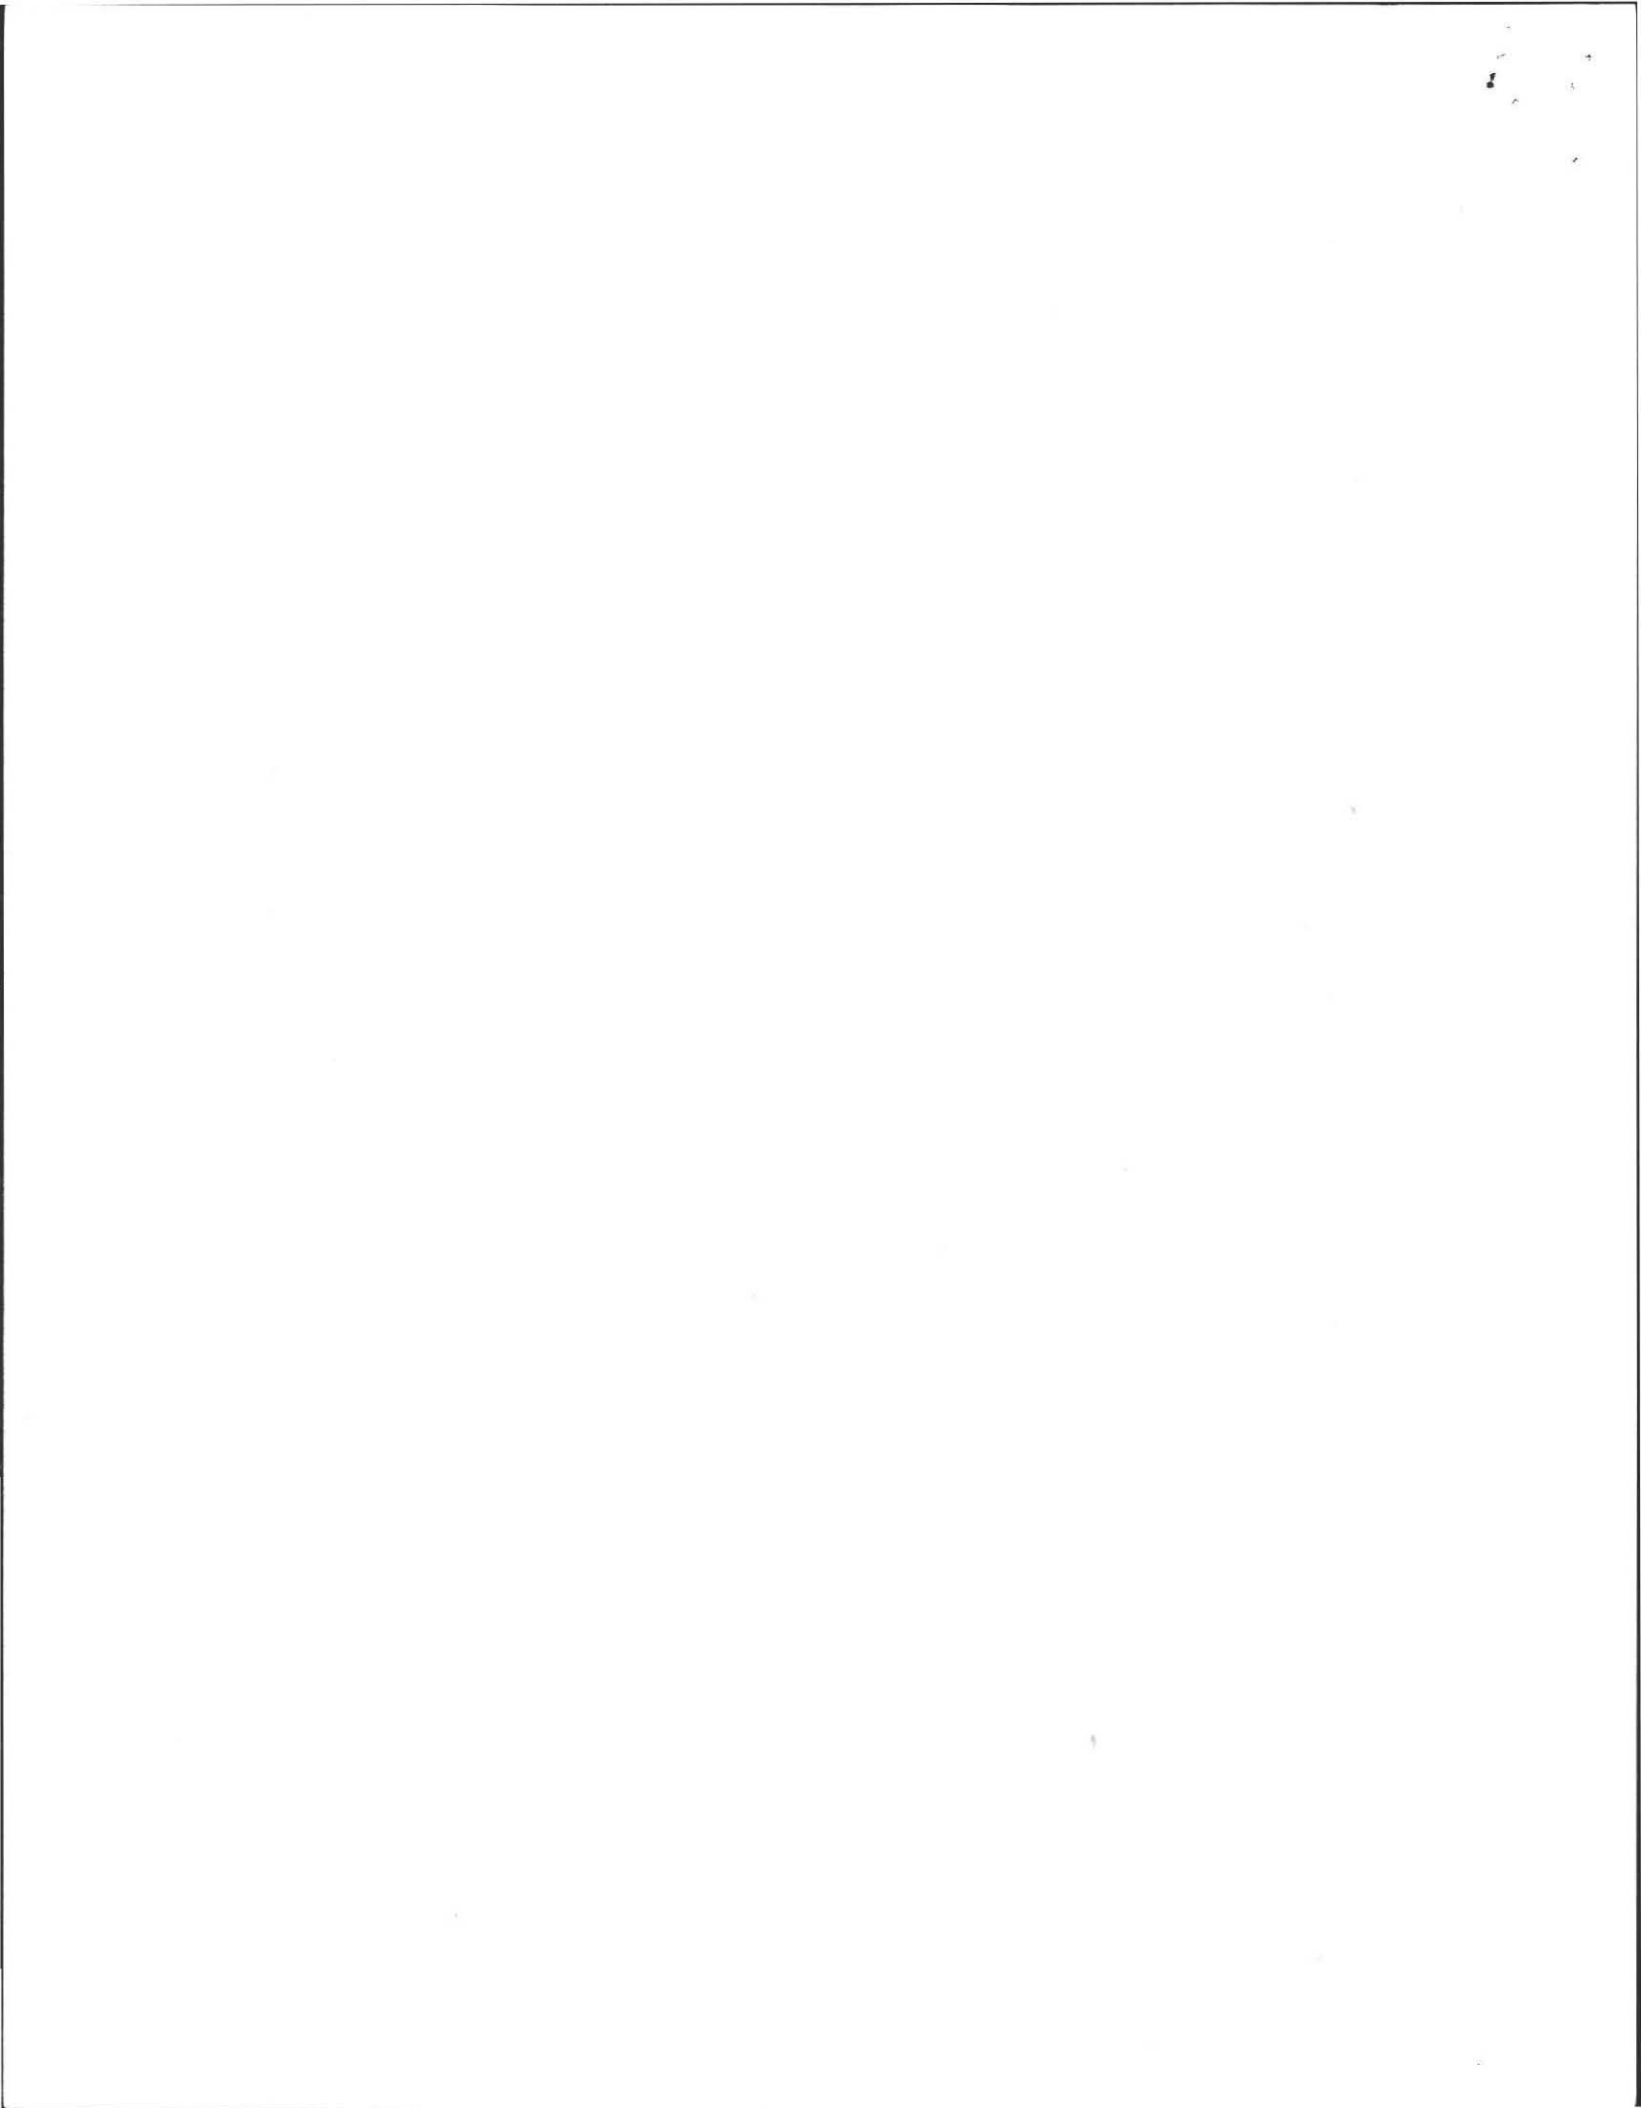

DEEP SOIL LOGS


OWNER F. + J. Valiunas

Date Jan 5 1984


LOCATION Shutesbury Rd.

OBSERVER FA Filios

Soil

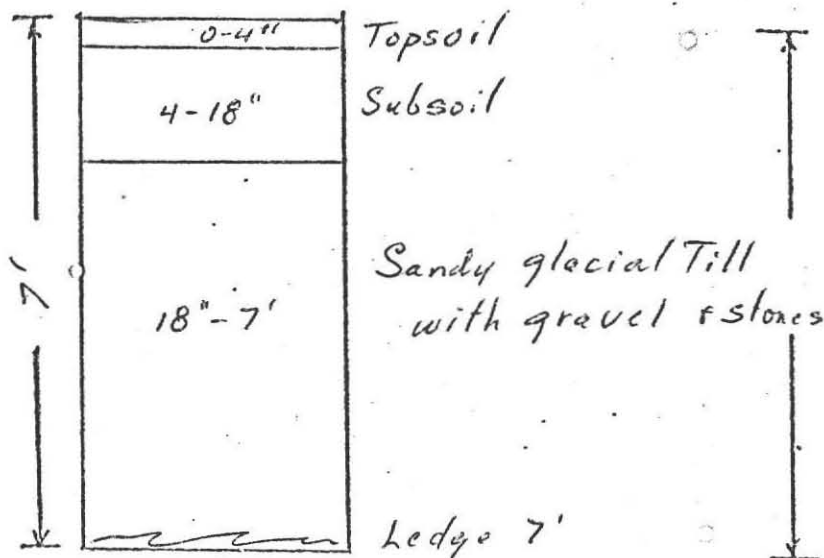


Ground Water none

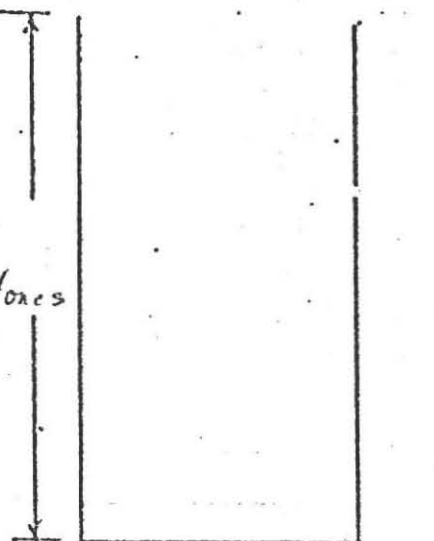


Ground Water

Alt P. 1

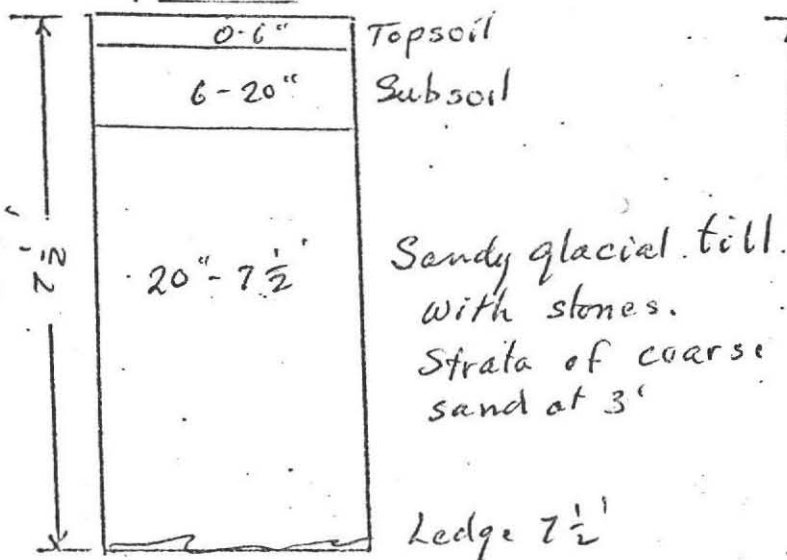

Ground Water none

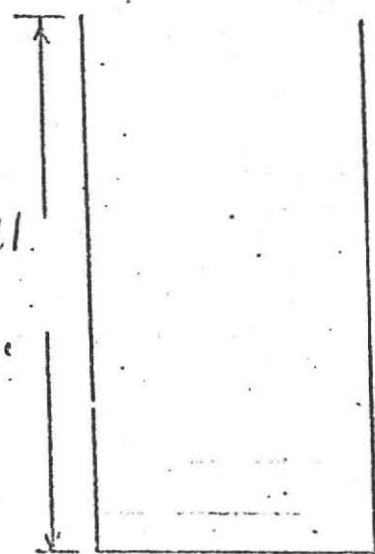


Ground Water

Percolation Rate at 35"

6.66 minutes/inch



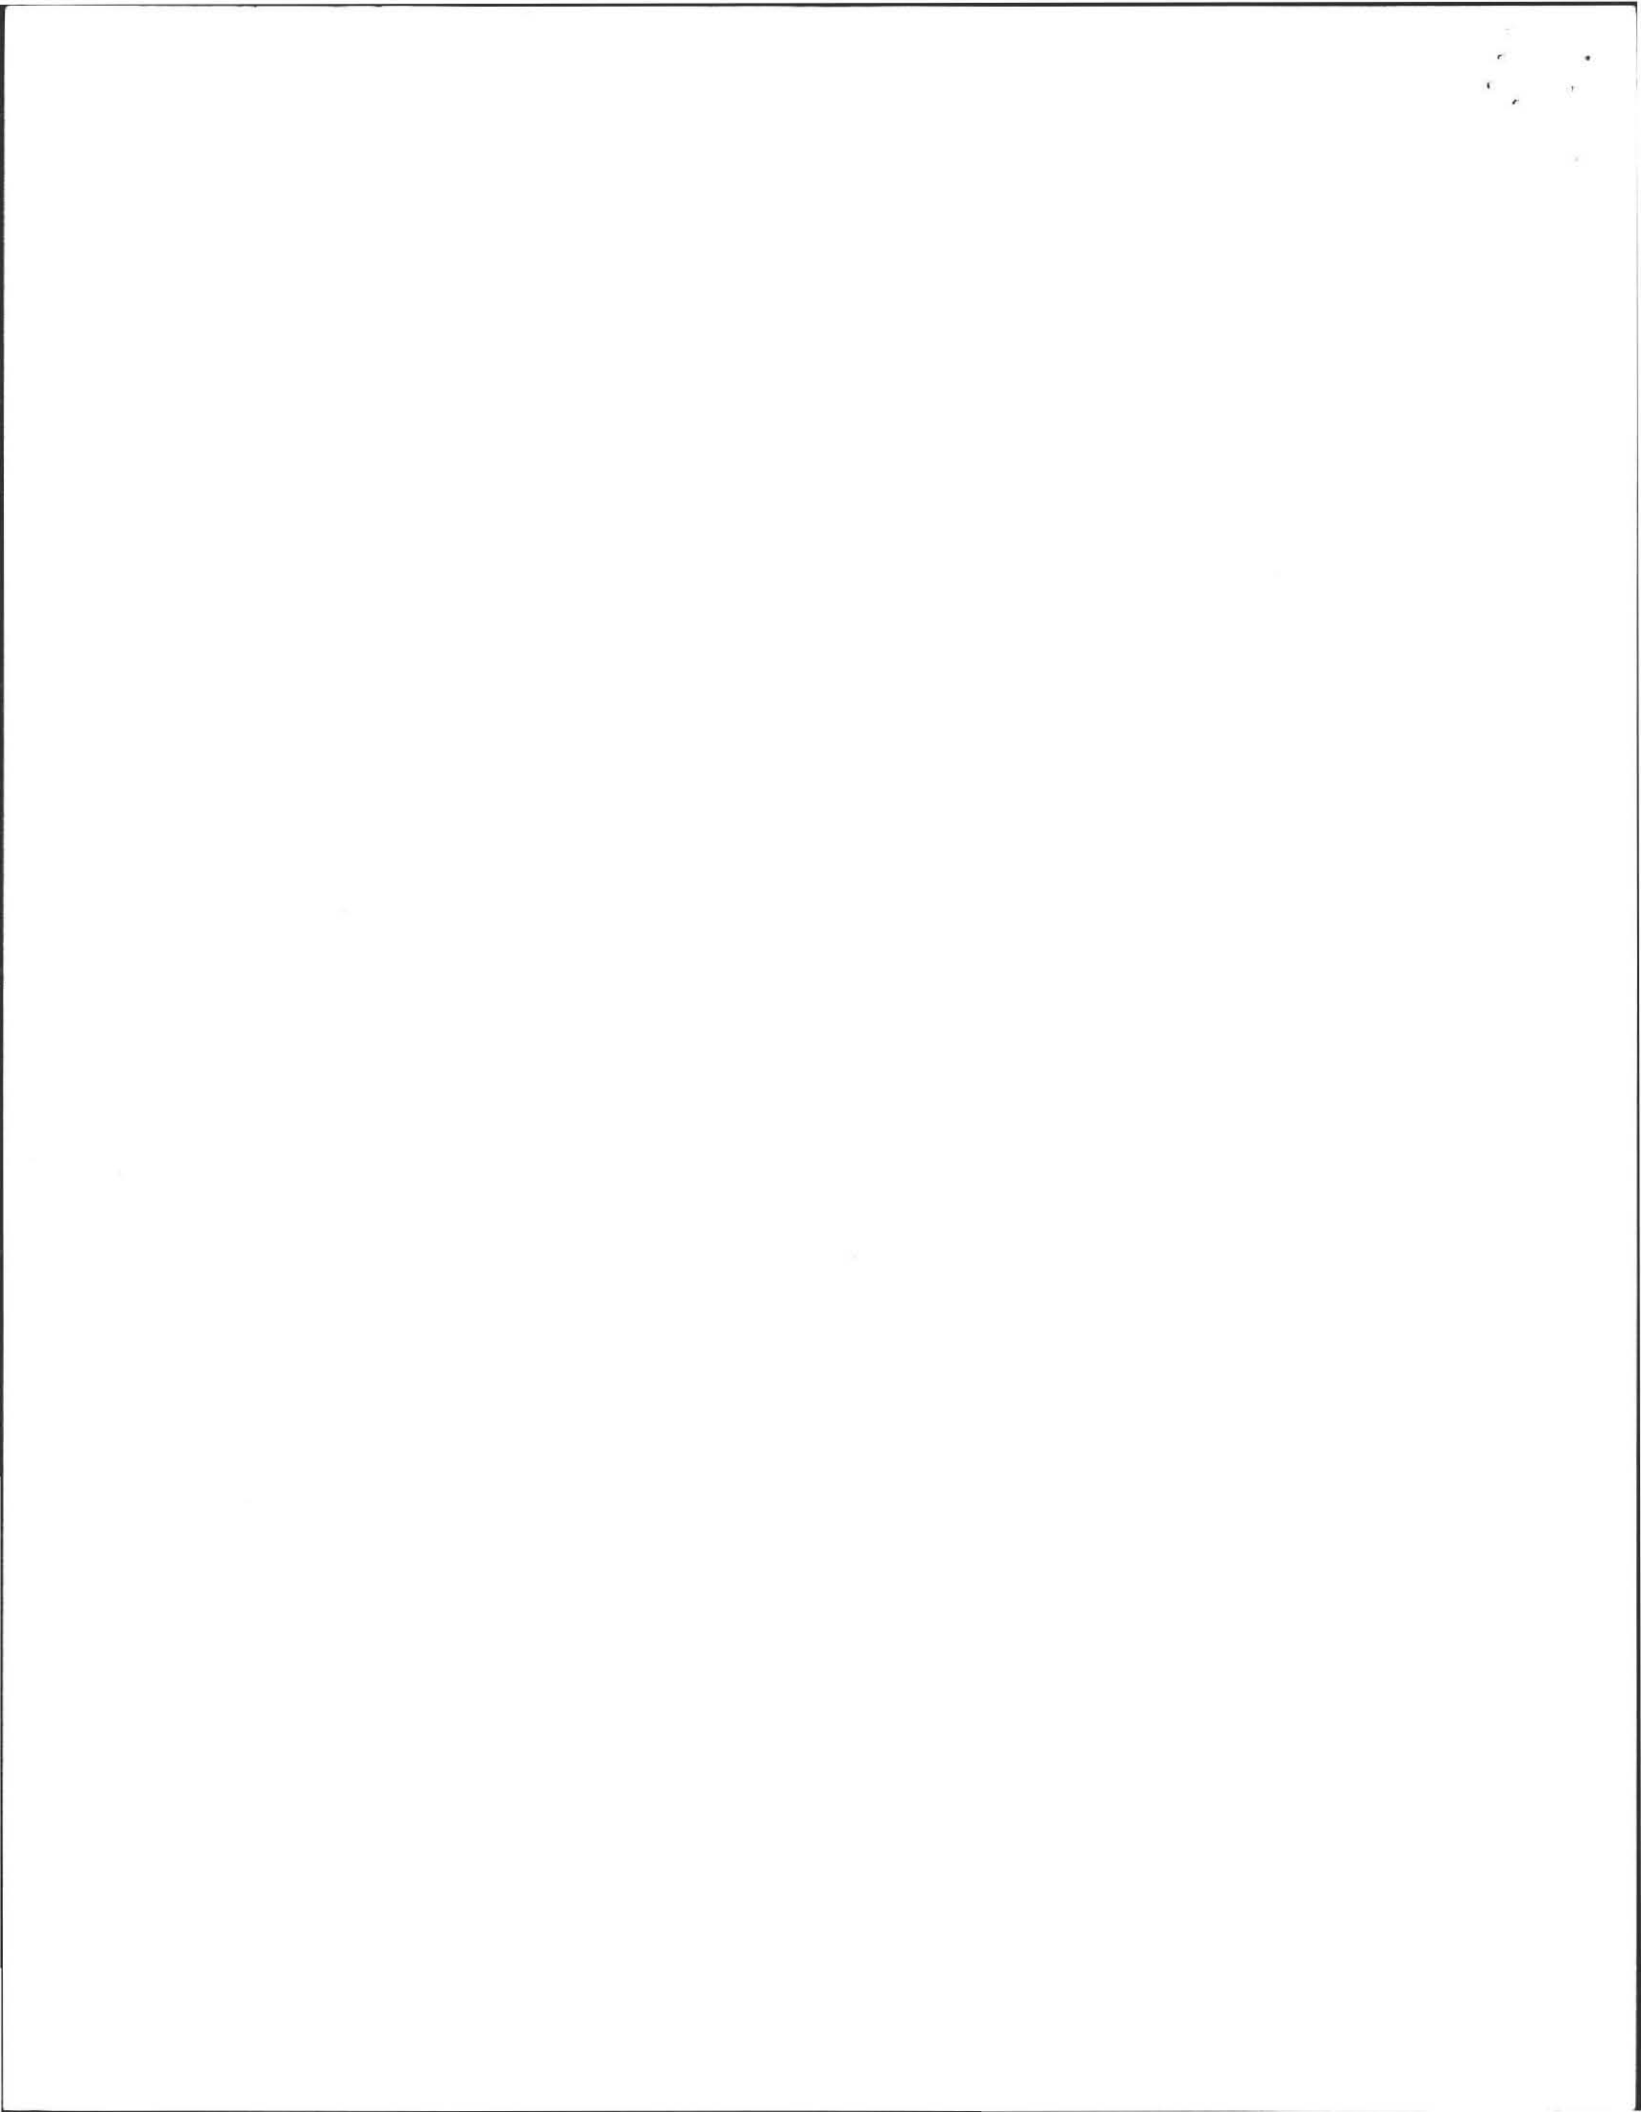


PLAN SHOWING SEWAGE DISPOSAL


FOR: FIL AND JURATE VALIUNAS
132 VILLAGE PARK
AMHERST, MASS. 01002

BY: FREDERICK FILIOS
DECEMBER 1984

SCALE: 1" = 40'

AT: SHUTESBURY RD., AMHERST, MASS.

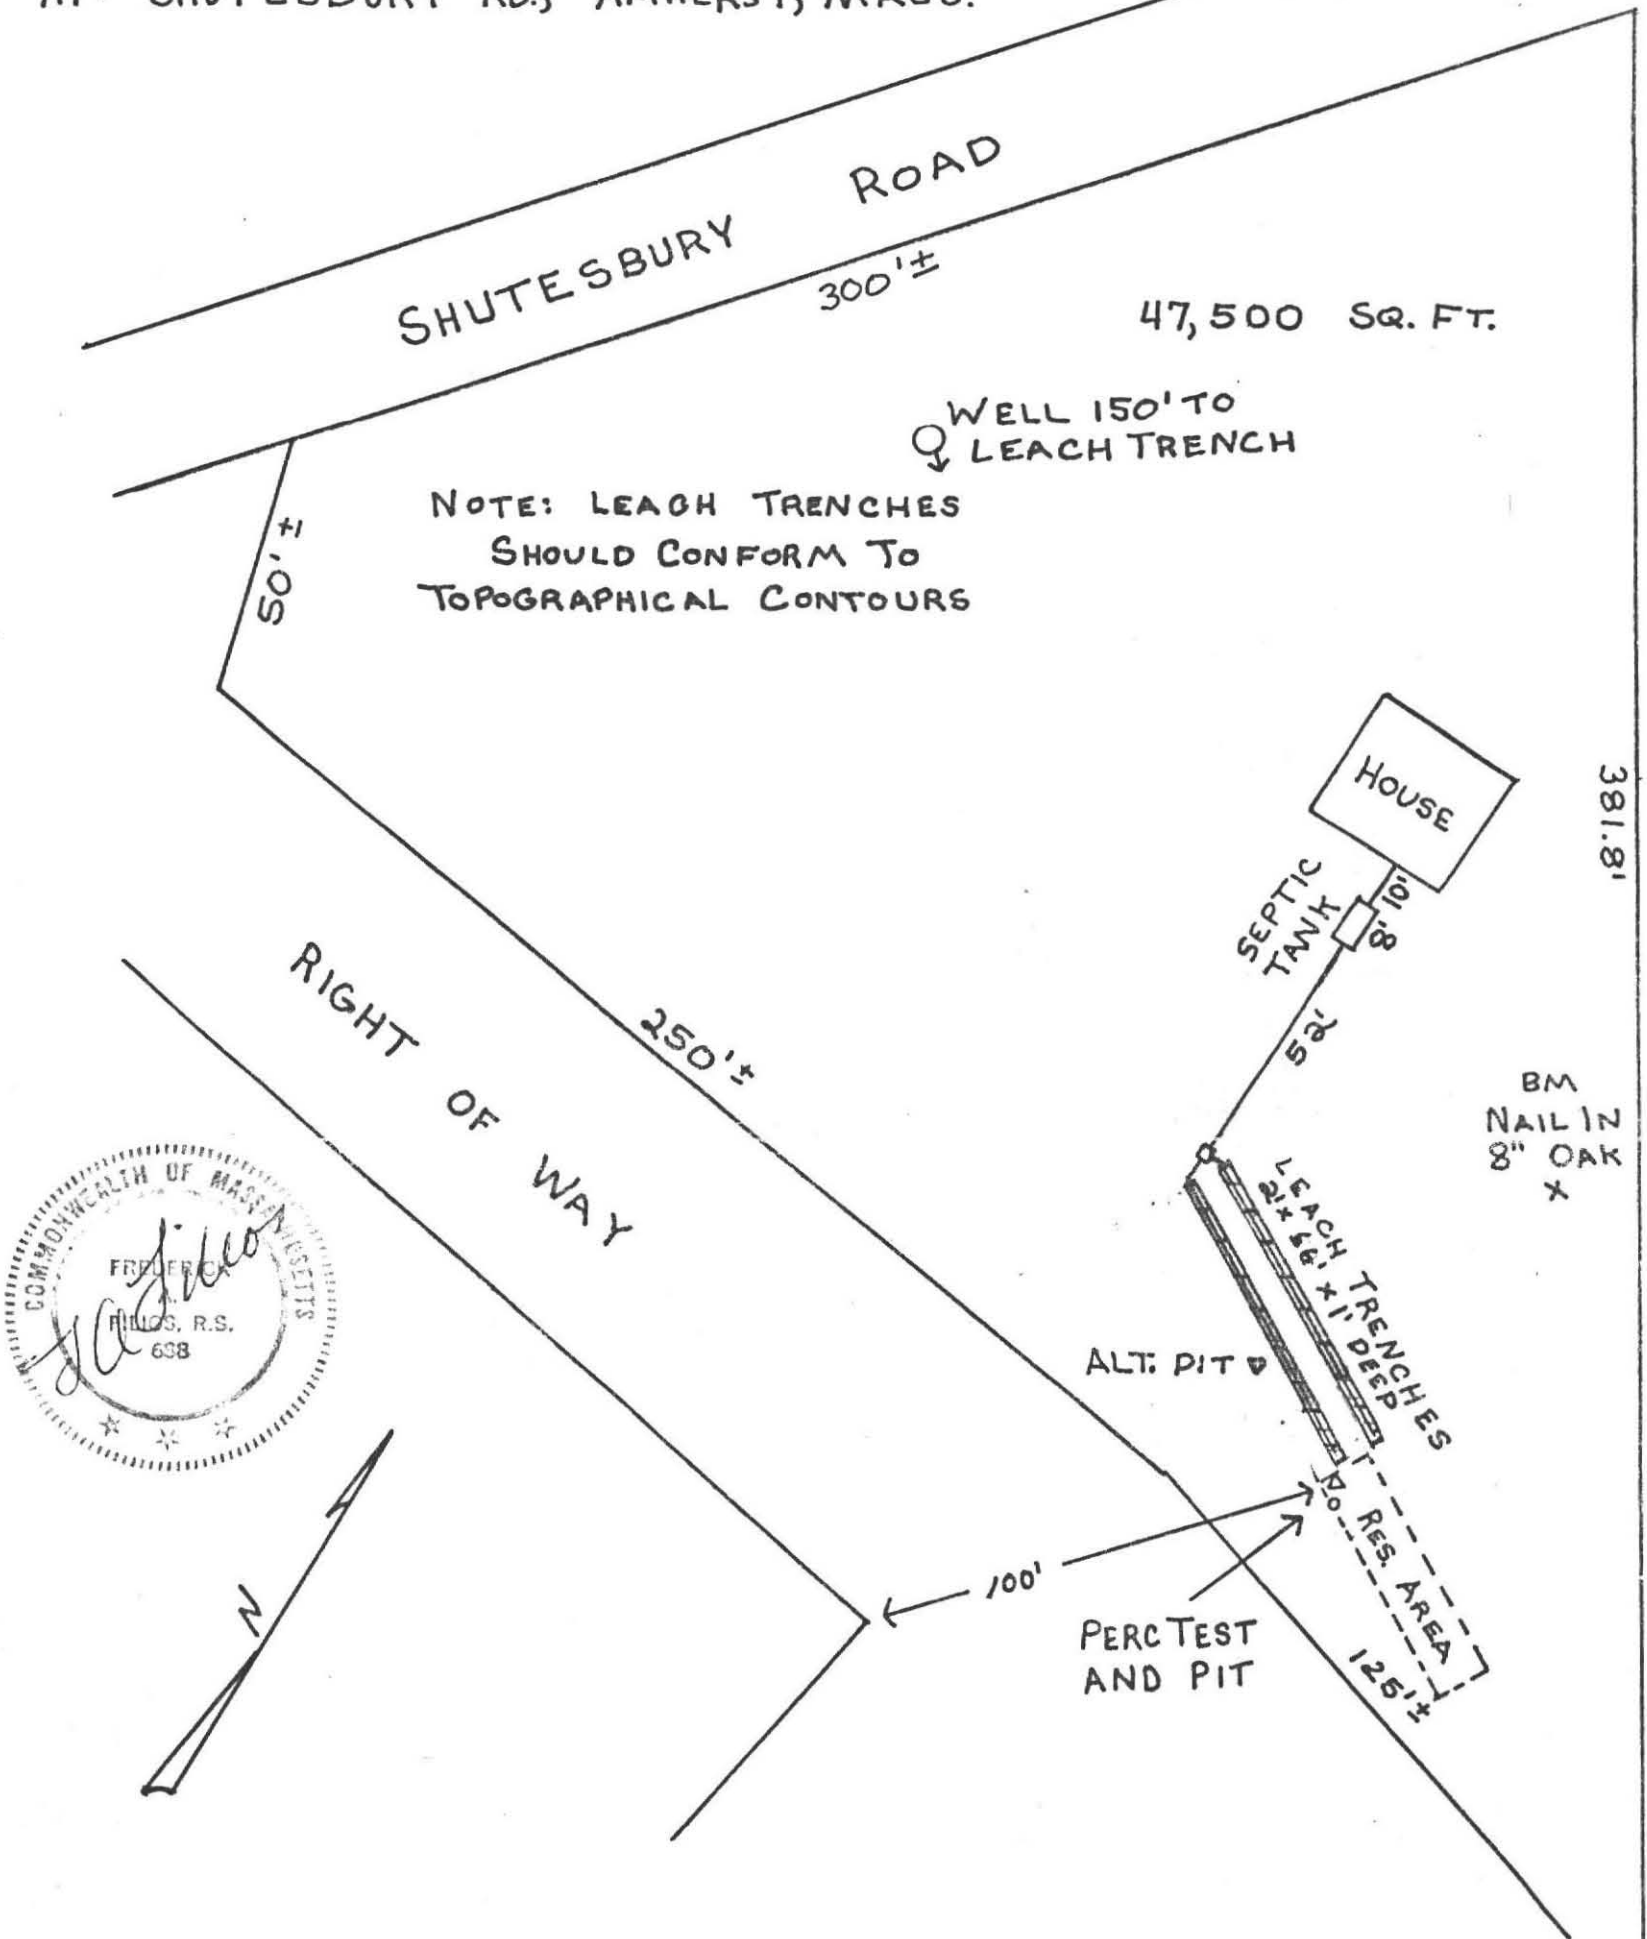


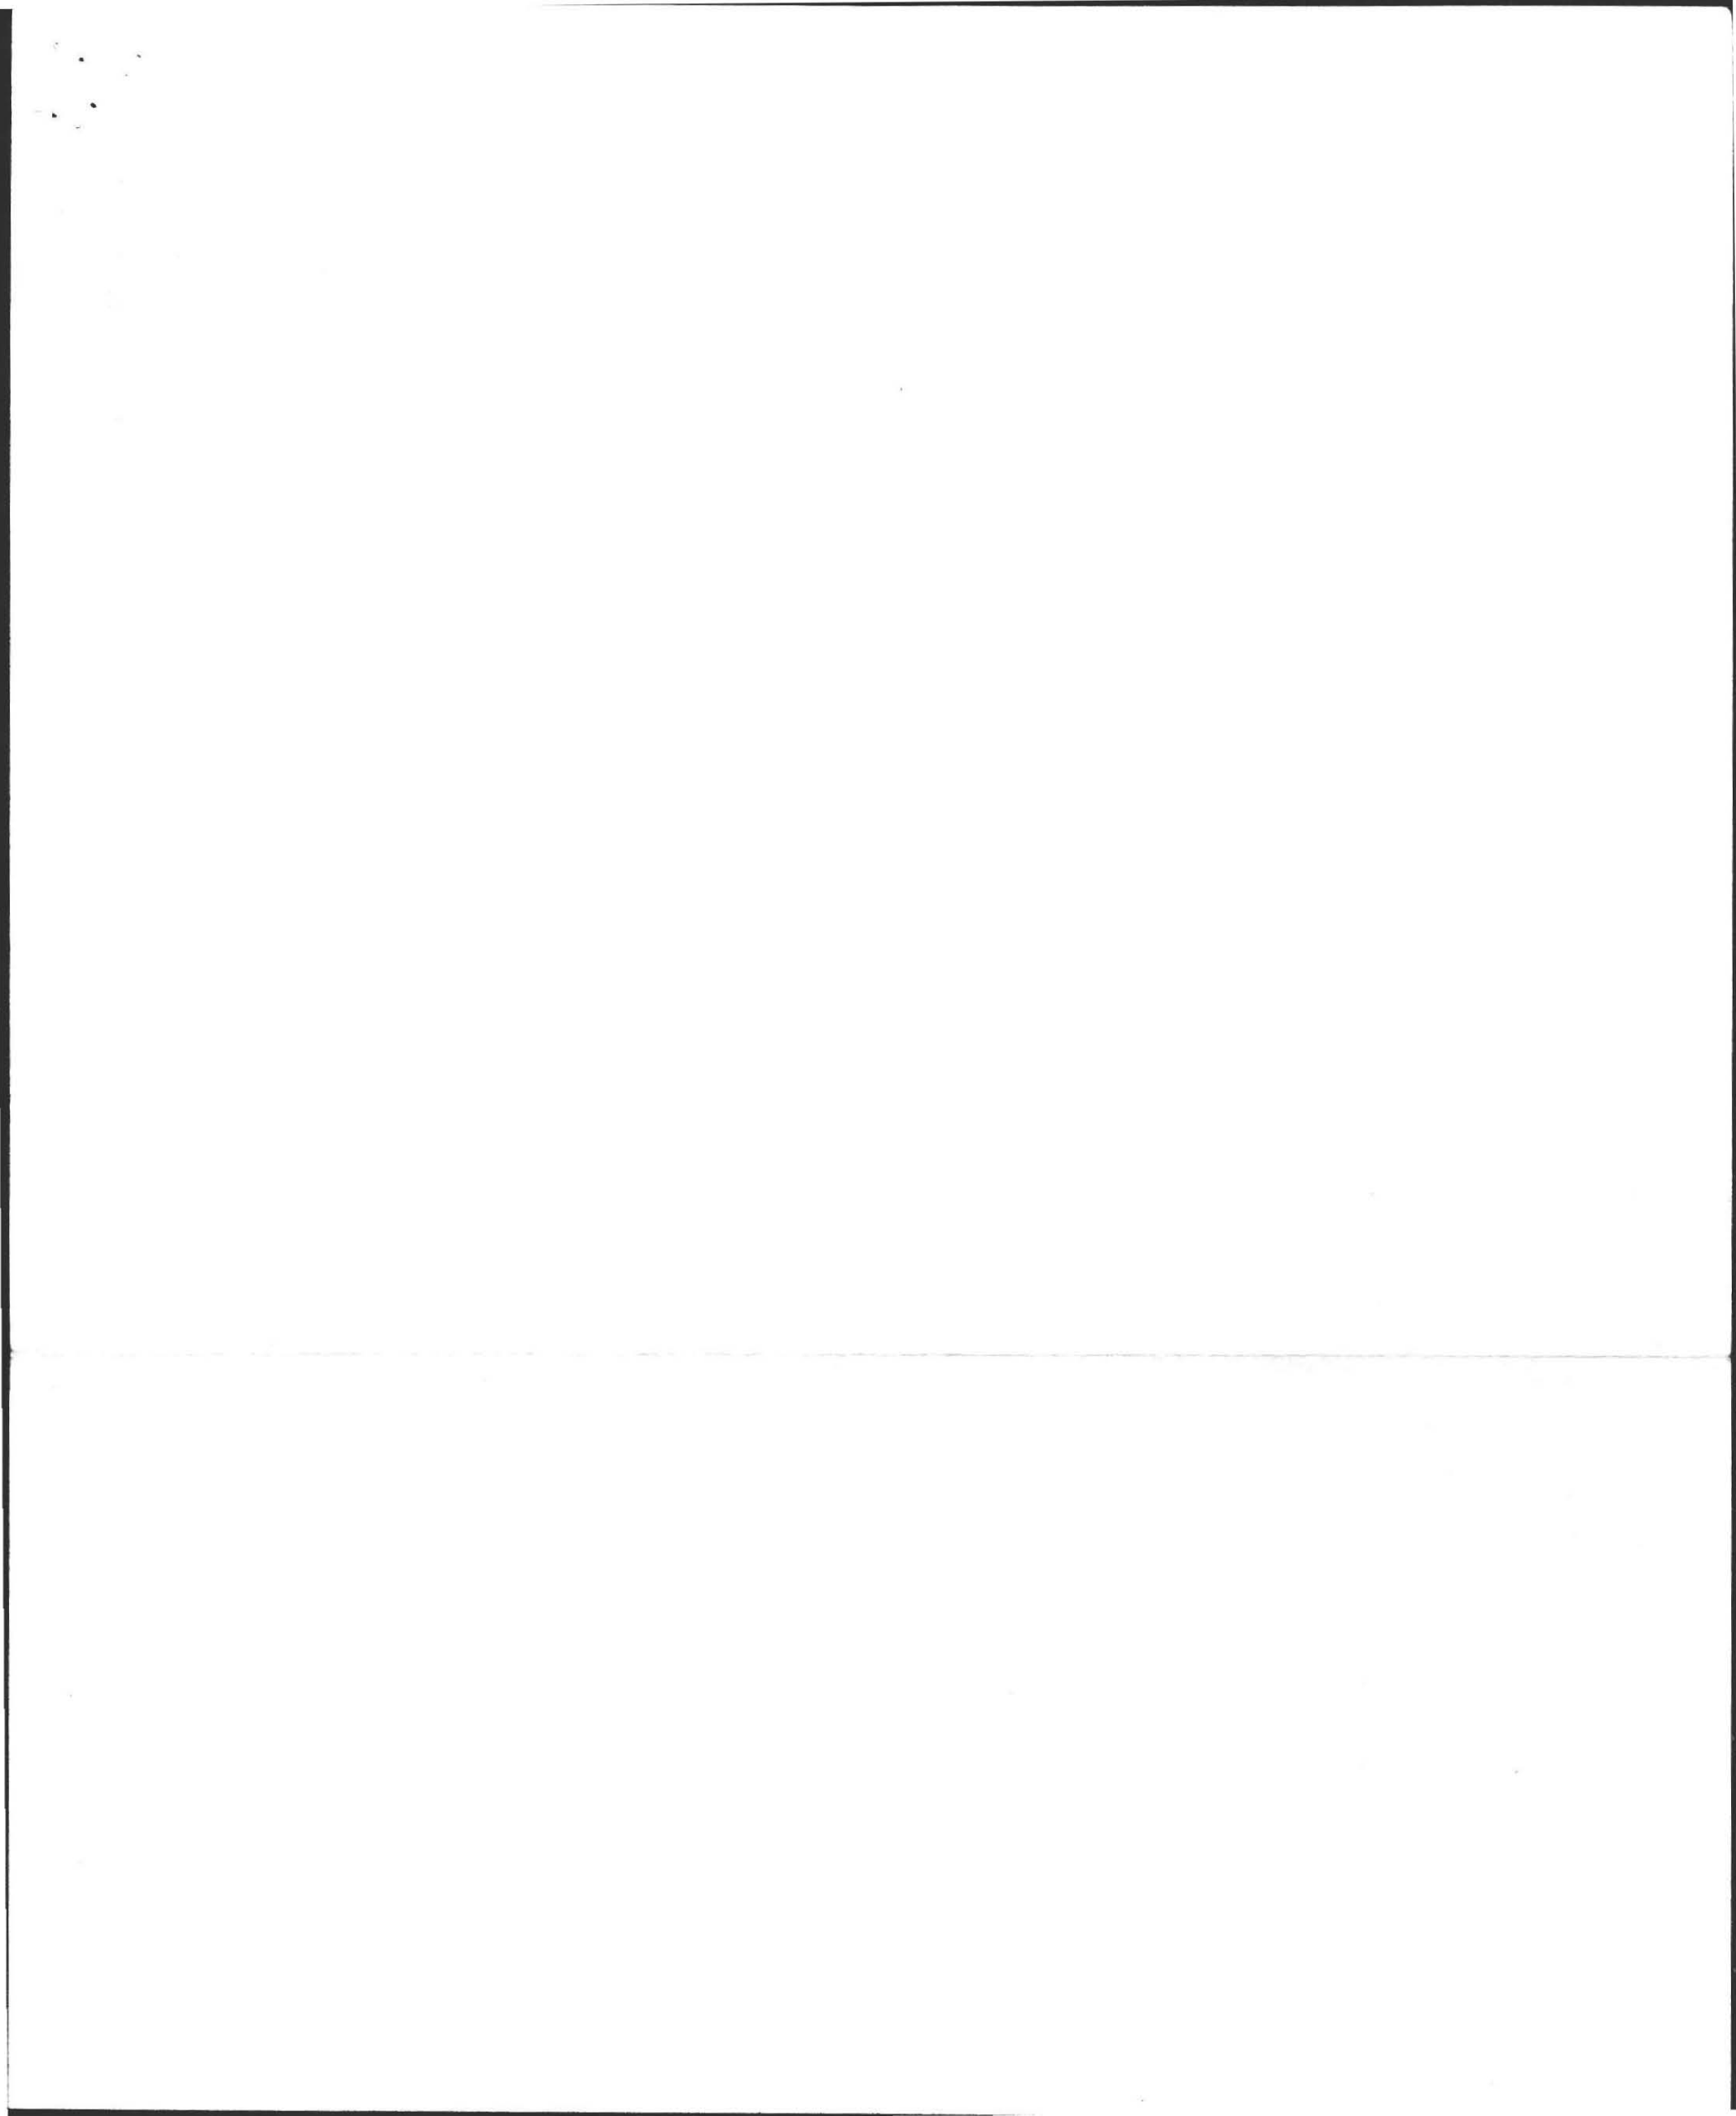

PROFILE OF SEPTIC SYSTEM

FOR: FIL AND JURATE VALIUNAS
 132 VILLAGE PARK
 AMHERST, MASS. 01002
 AT: SHUTESBURY RD., AMHERST

SCALE: HORIZ.: 1" = 10'
 VERT.: 1" = 3'
 BY: FREDERICK FILIOS
 DECEMBER 1984

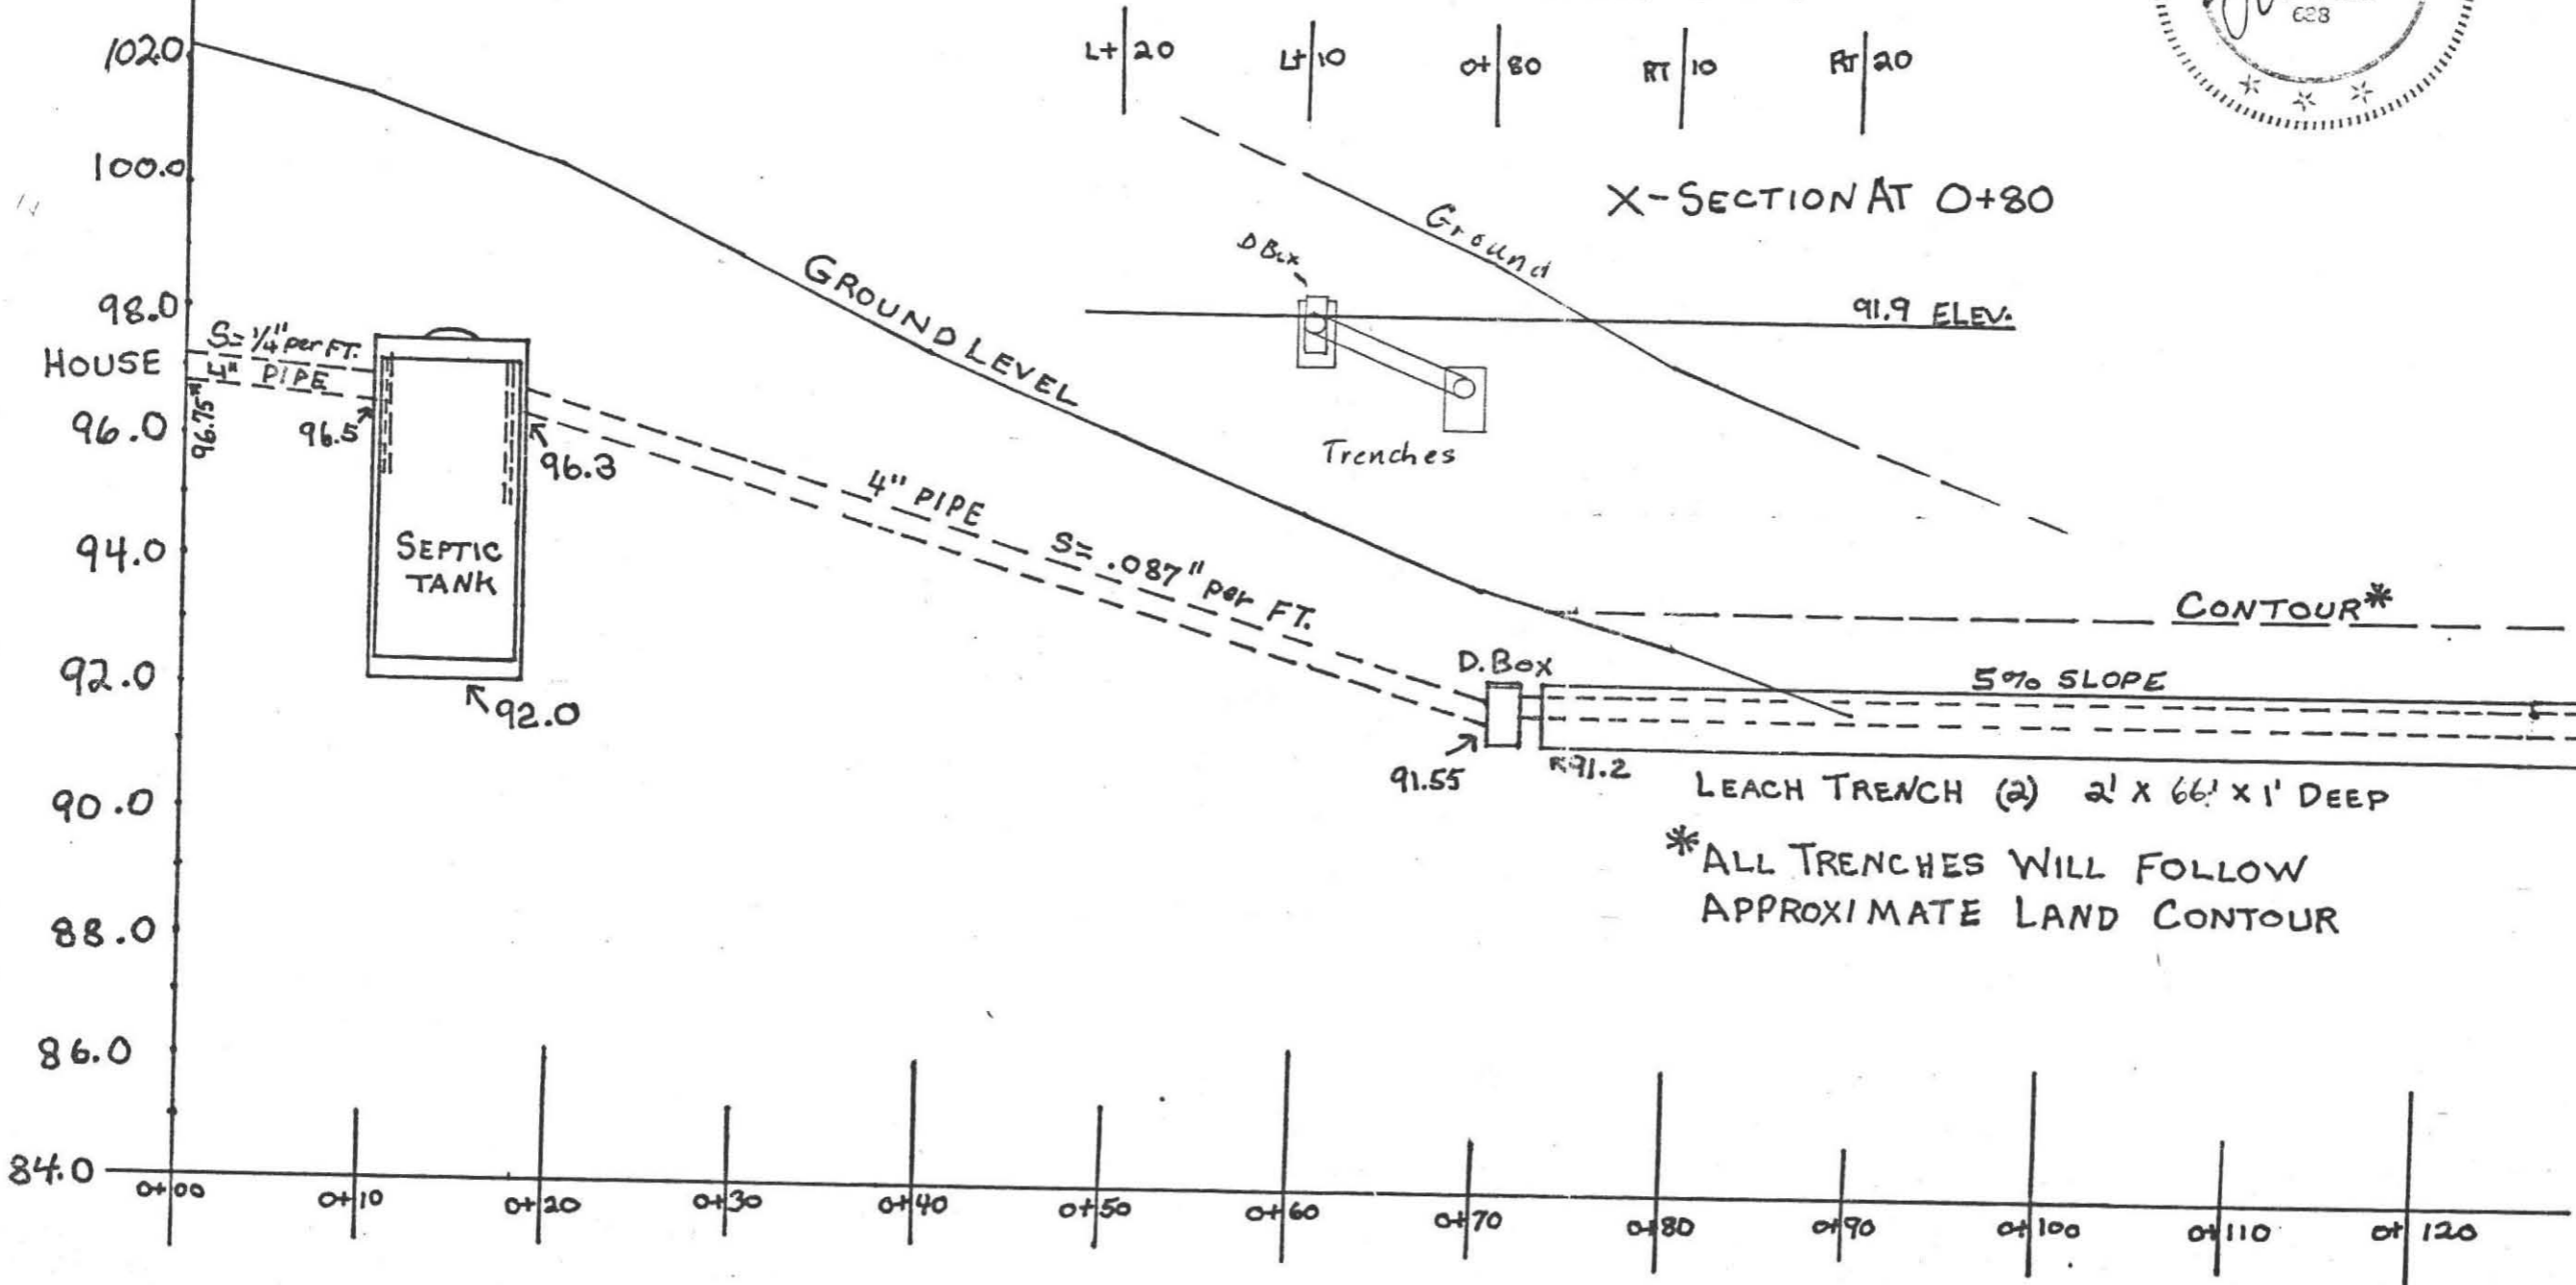


SPECIFICATIONS:

ALL MATERIALS AND CONSTRUCTION WILL BE IN ACCORDANCE WITH COMM. OF MASS. D.E.Q.E. STATE ENVIRONMENTAL CODE TITLE 5.

CALCULATIONS:

3 BDRMS AT 110 = 330 GALS (REQUIRED)
 AT 6.6 MINS PER INCH = Sides - 1.25 gal per Sq. Ft.
 Bottom - .63 gal. per Sq. Ft.
 1.25 gal per linear ft sides + 1.26 bottom = 2.51 gal.
 132 feet trench x 2.51 = 331 gallons proposed

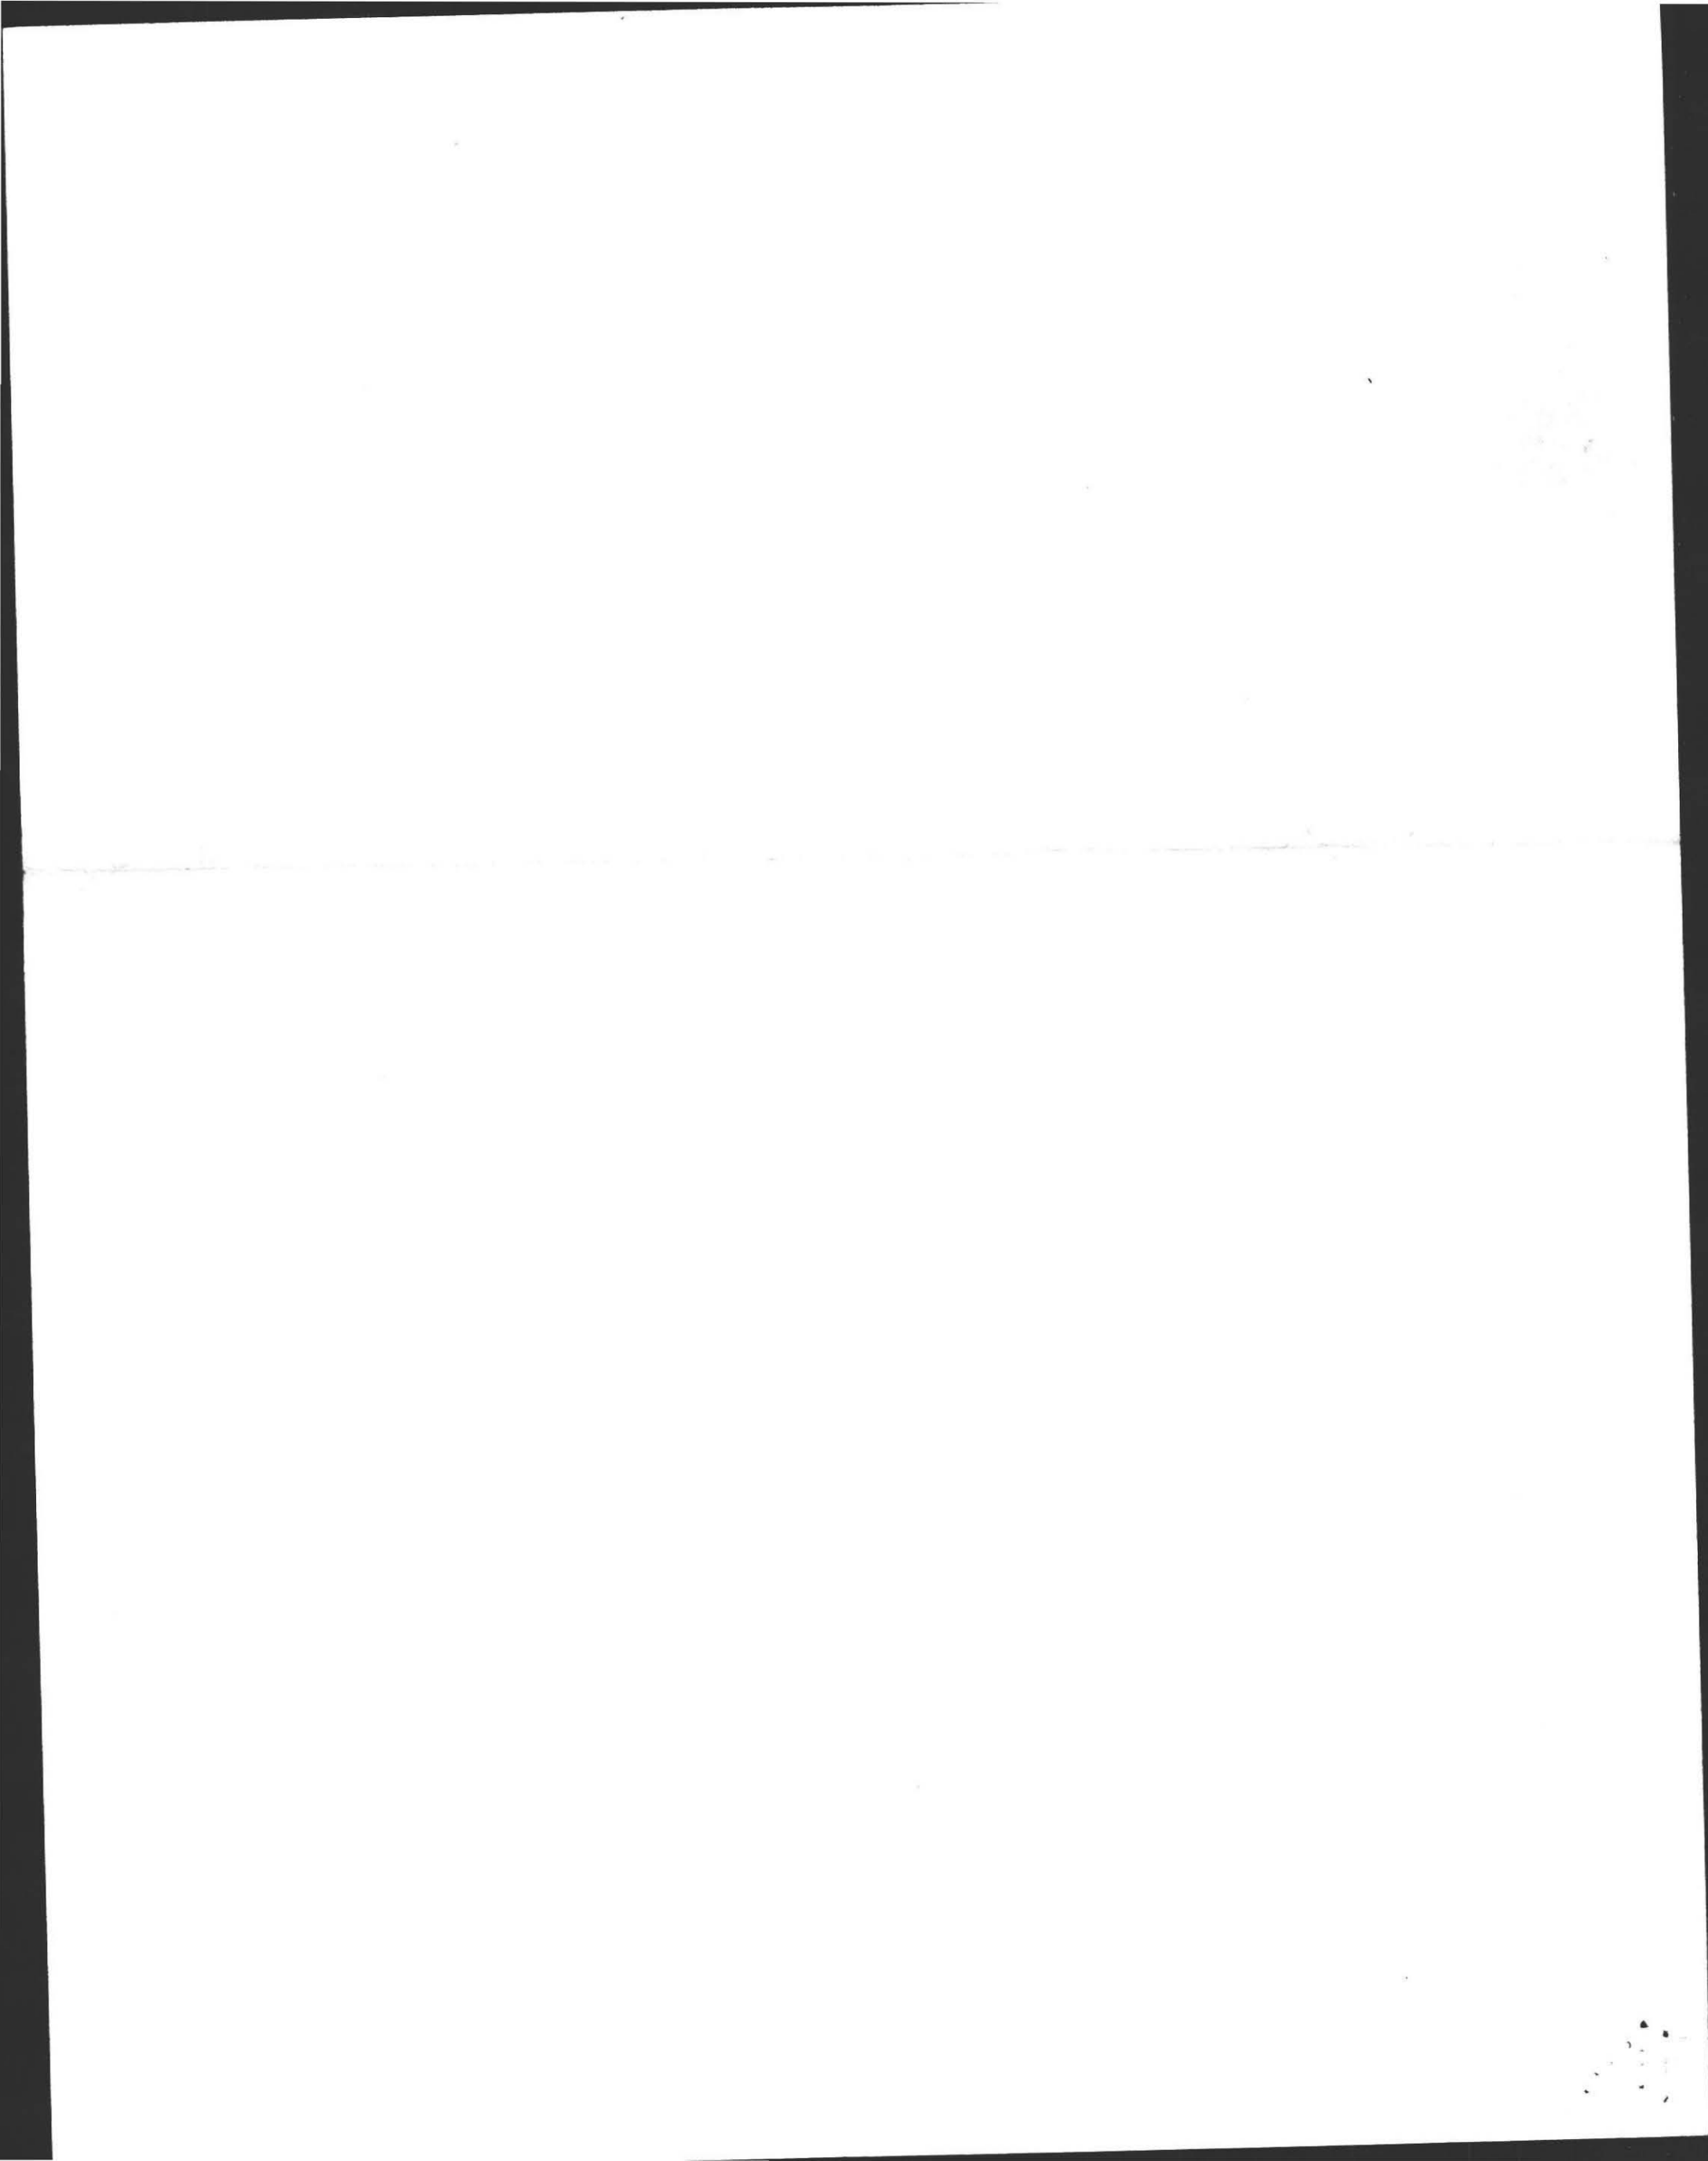

BOARD OF HEALTH
TOWN OF AMHERST, MASSACHUSETTS

Important Information Regarding Your Private Sewage Disposal System

DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

SHUTESBURY ROAD

Owner FIL + JURATE VALIUNAS Address 132 Village Park

Installer RIVER DRIVE ETC Address River Dr., NADLEY

Date Installation Inspected and Approved 8/22/85


Description of System: Tank Capacity: 1000 GALLON

Leach Field (X) Bed () Seepage Pit () Square Feet: 312 ^{Bottom} 312 ^{Side}

Garbage Grinder Yes () No (X) No. Bedrooms: 3 No. People 6

As - BUILT PLAN:

SHUTESBURY ROAD

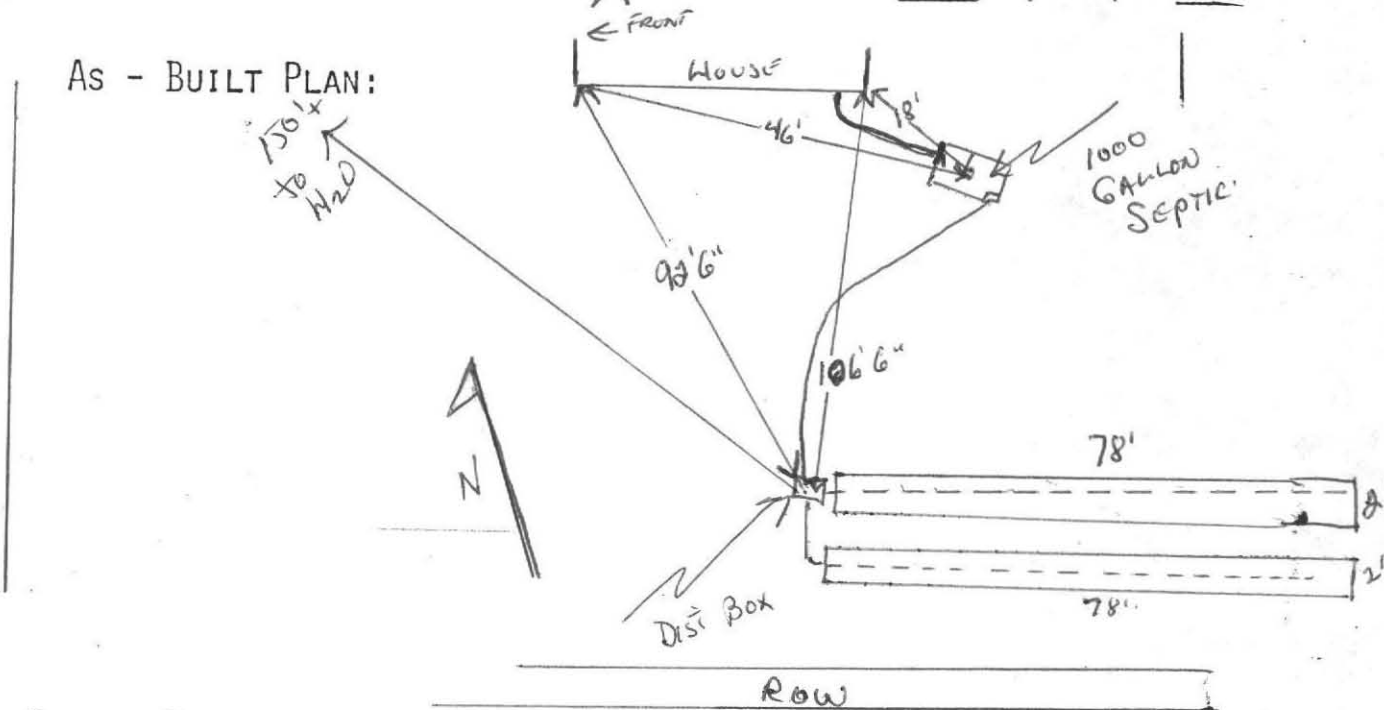

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

