


297 SATESBURY RD

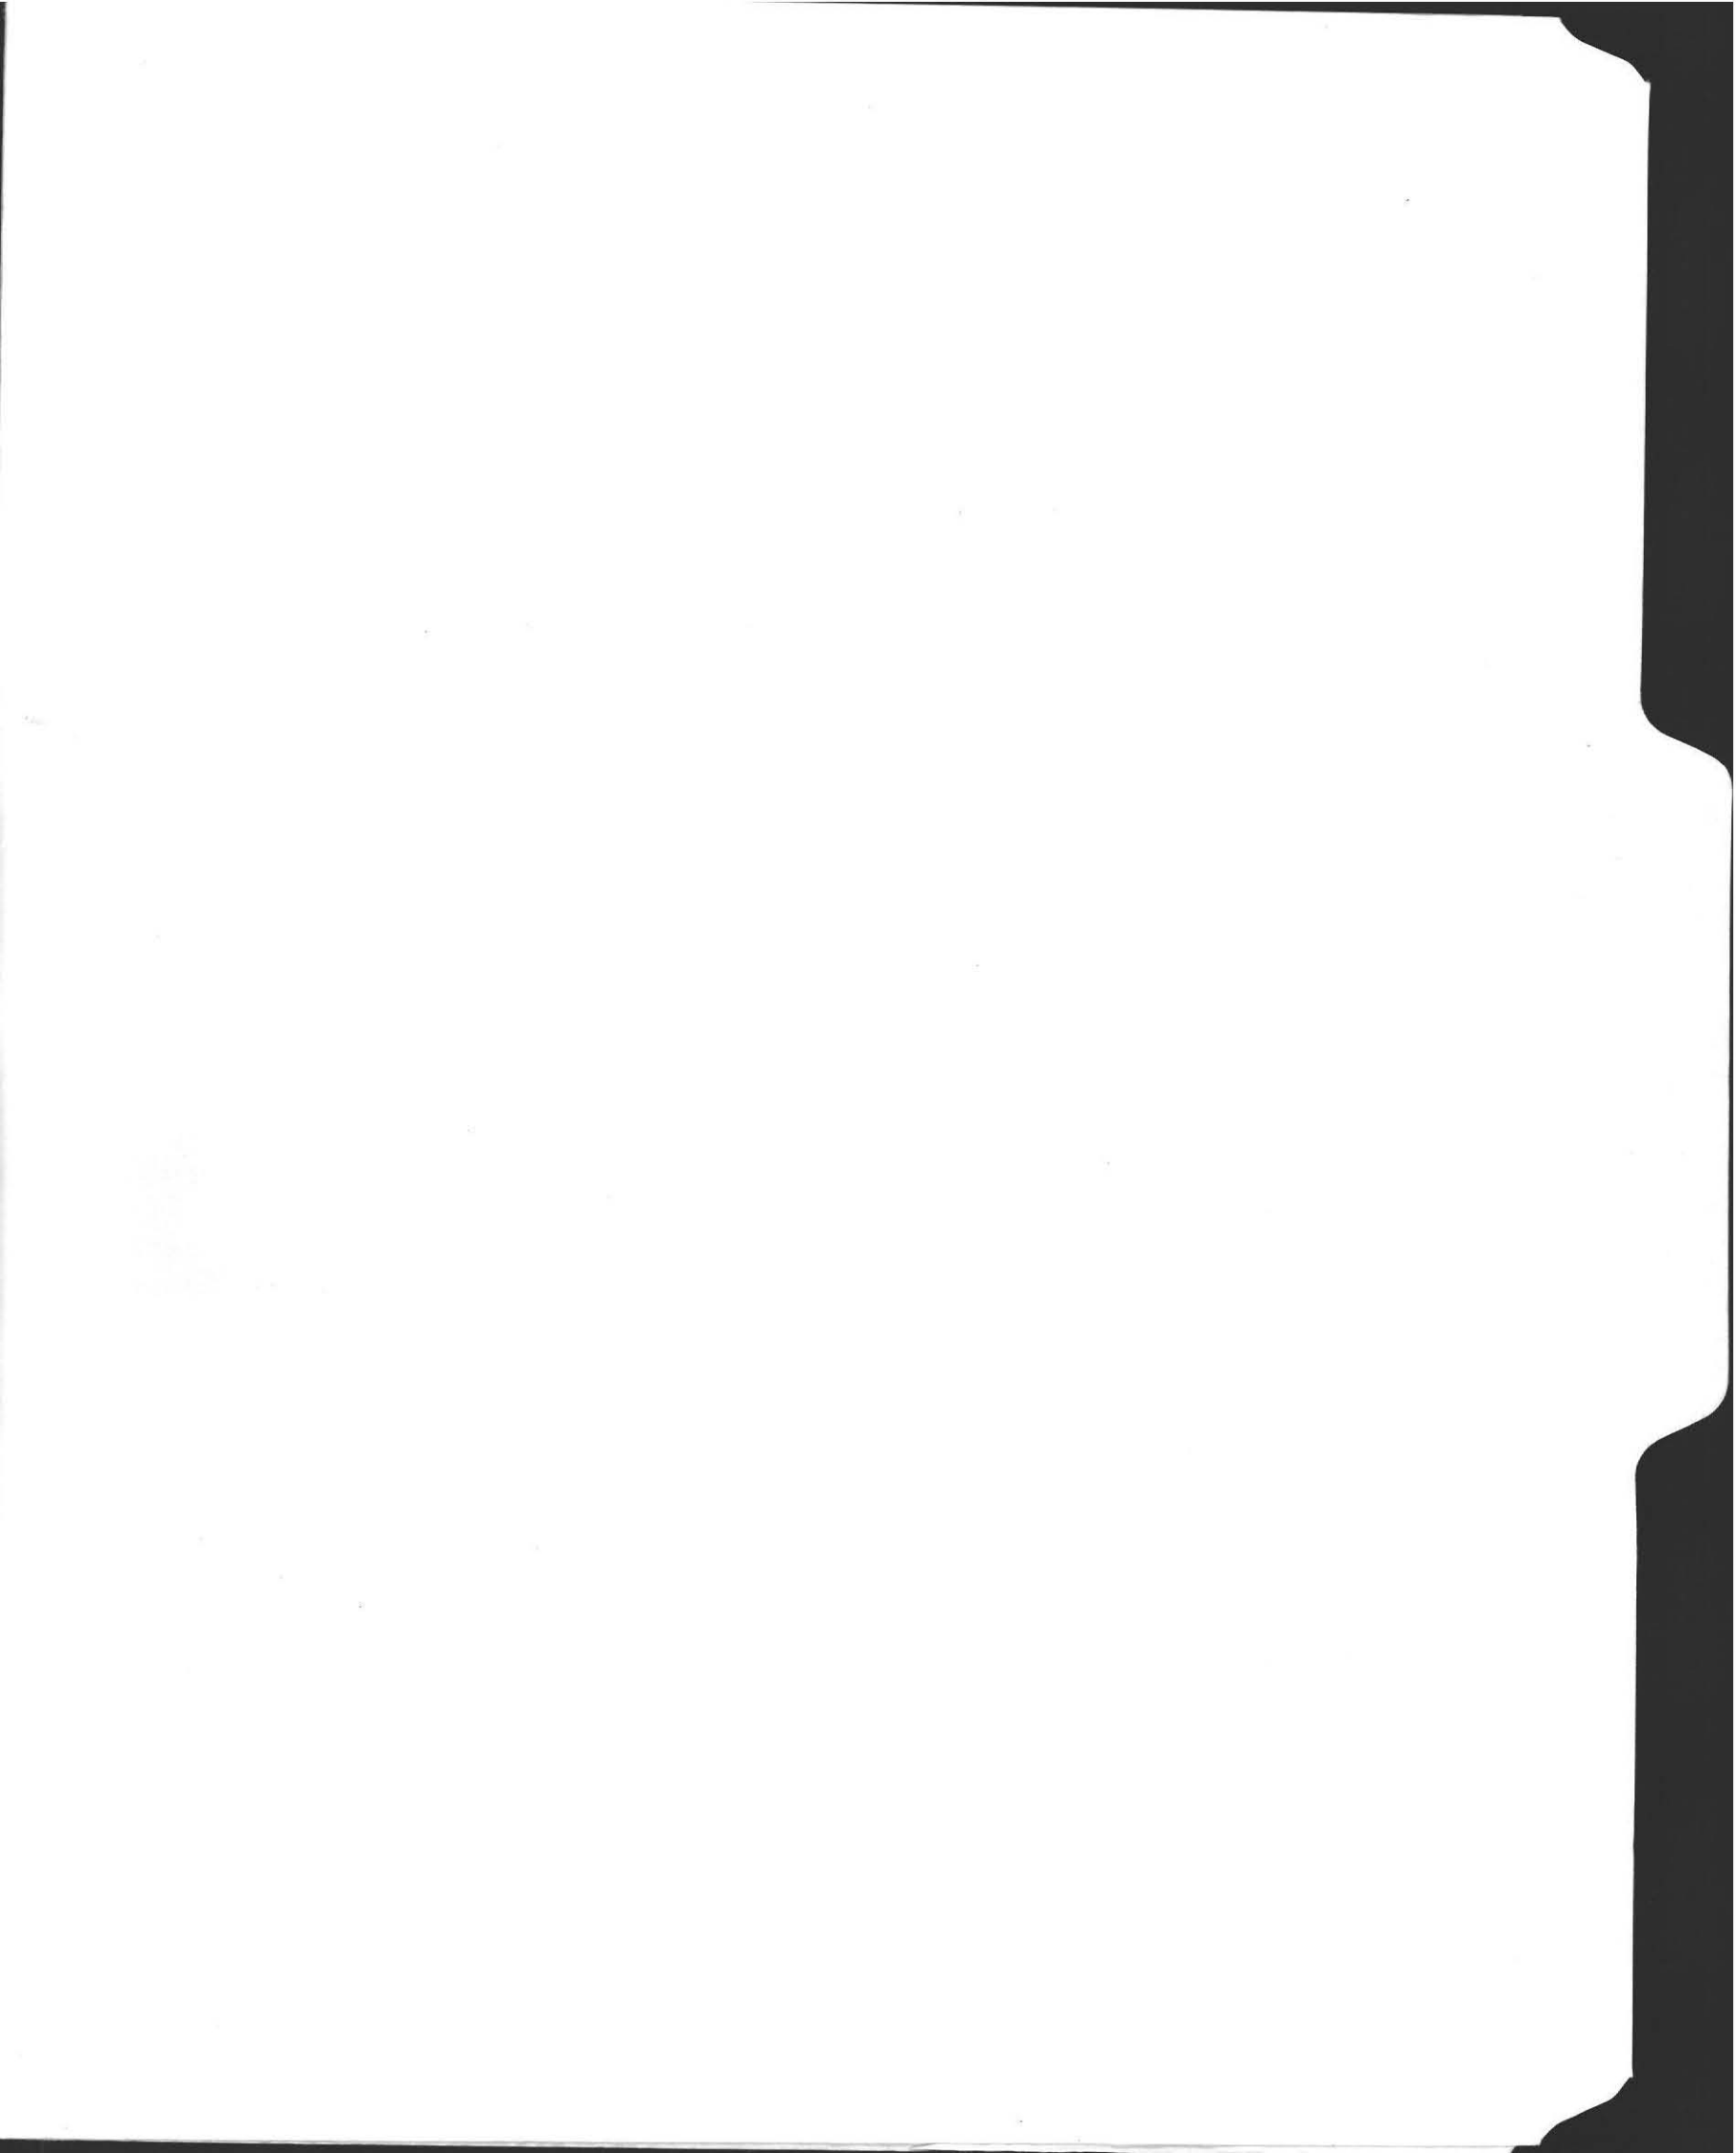

**April 2013  
INVOICE**

**AMHERST PUBLIC HEALTH DEPARTMENT**

Bangs Community Center  
70 Boltwood Walk  
Amherst, MA 01002


**DATE:** April 30, 2013

**TO** Charles Nunn & Sheila Patek  
297 Shutesbury Road  
Amherst, MA, 01002

**RE: Invoice for** Title 5 Witness Fee  
327 Shay Street *297 Shutesbury Road*  
Services provided by Edmund Smith

**PAYMENT TERMS:** I Paid/thank you

QUANTITY	DESCRIPTION	UNIT PRICE	LINE TOTAL
1.00	Title 5 witness (passed) performed 4/30/2013	\$ 200.00	\$ 200.00
	PAID 4/30/2013 CHECK # 1250 THANK YOU	(200.00)	\$ (200.00)
		SUBTOTAL	\$ -
		SALES TAX	
		TOTAL	\$ -

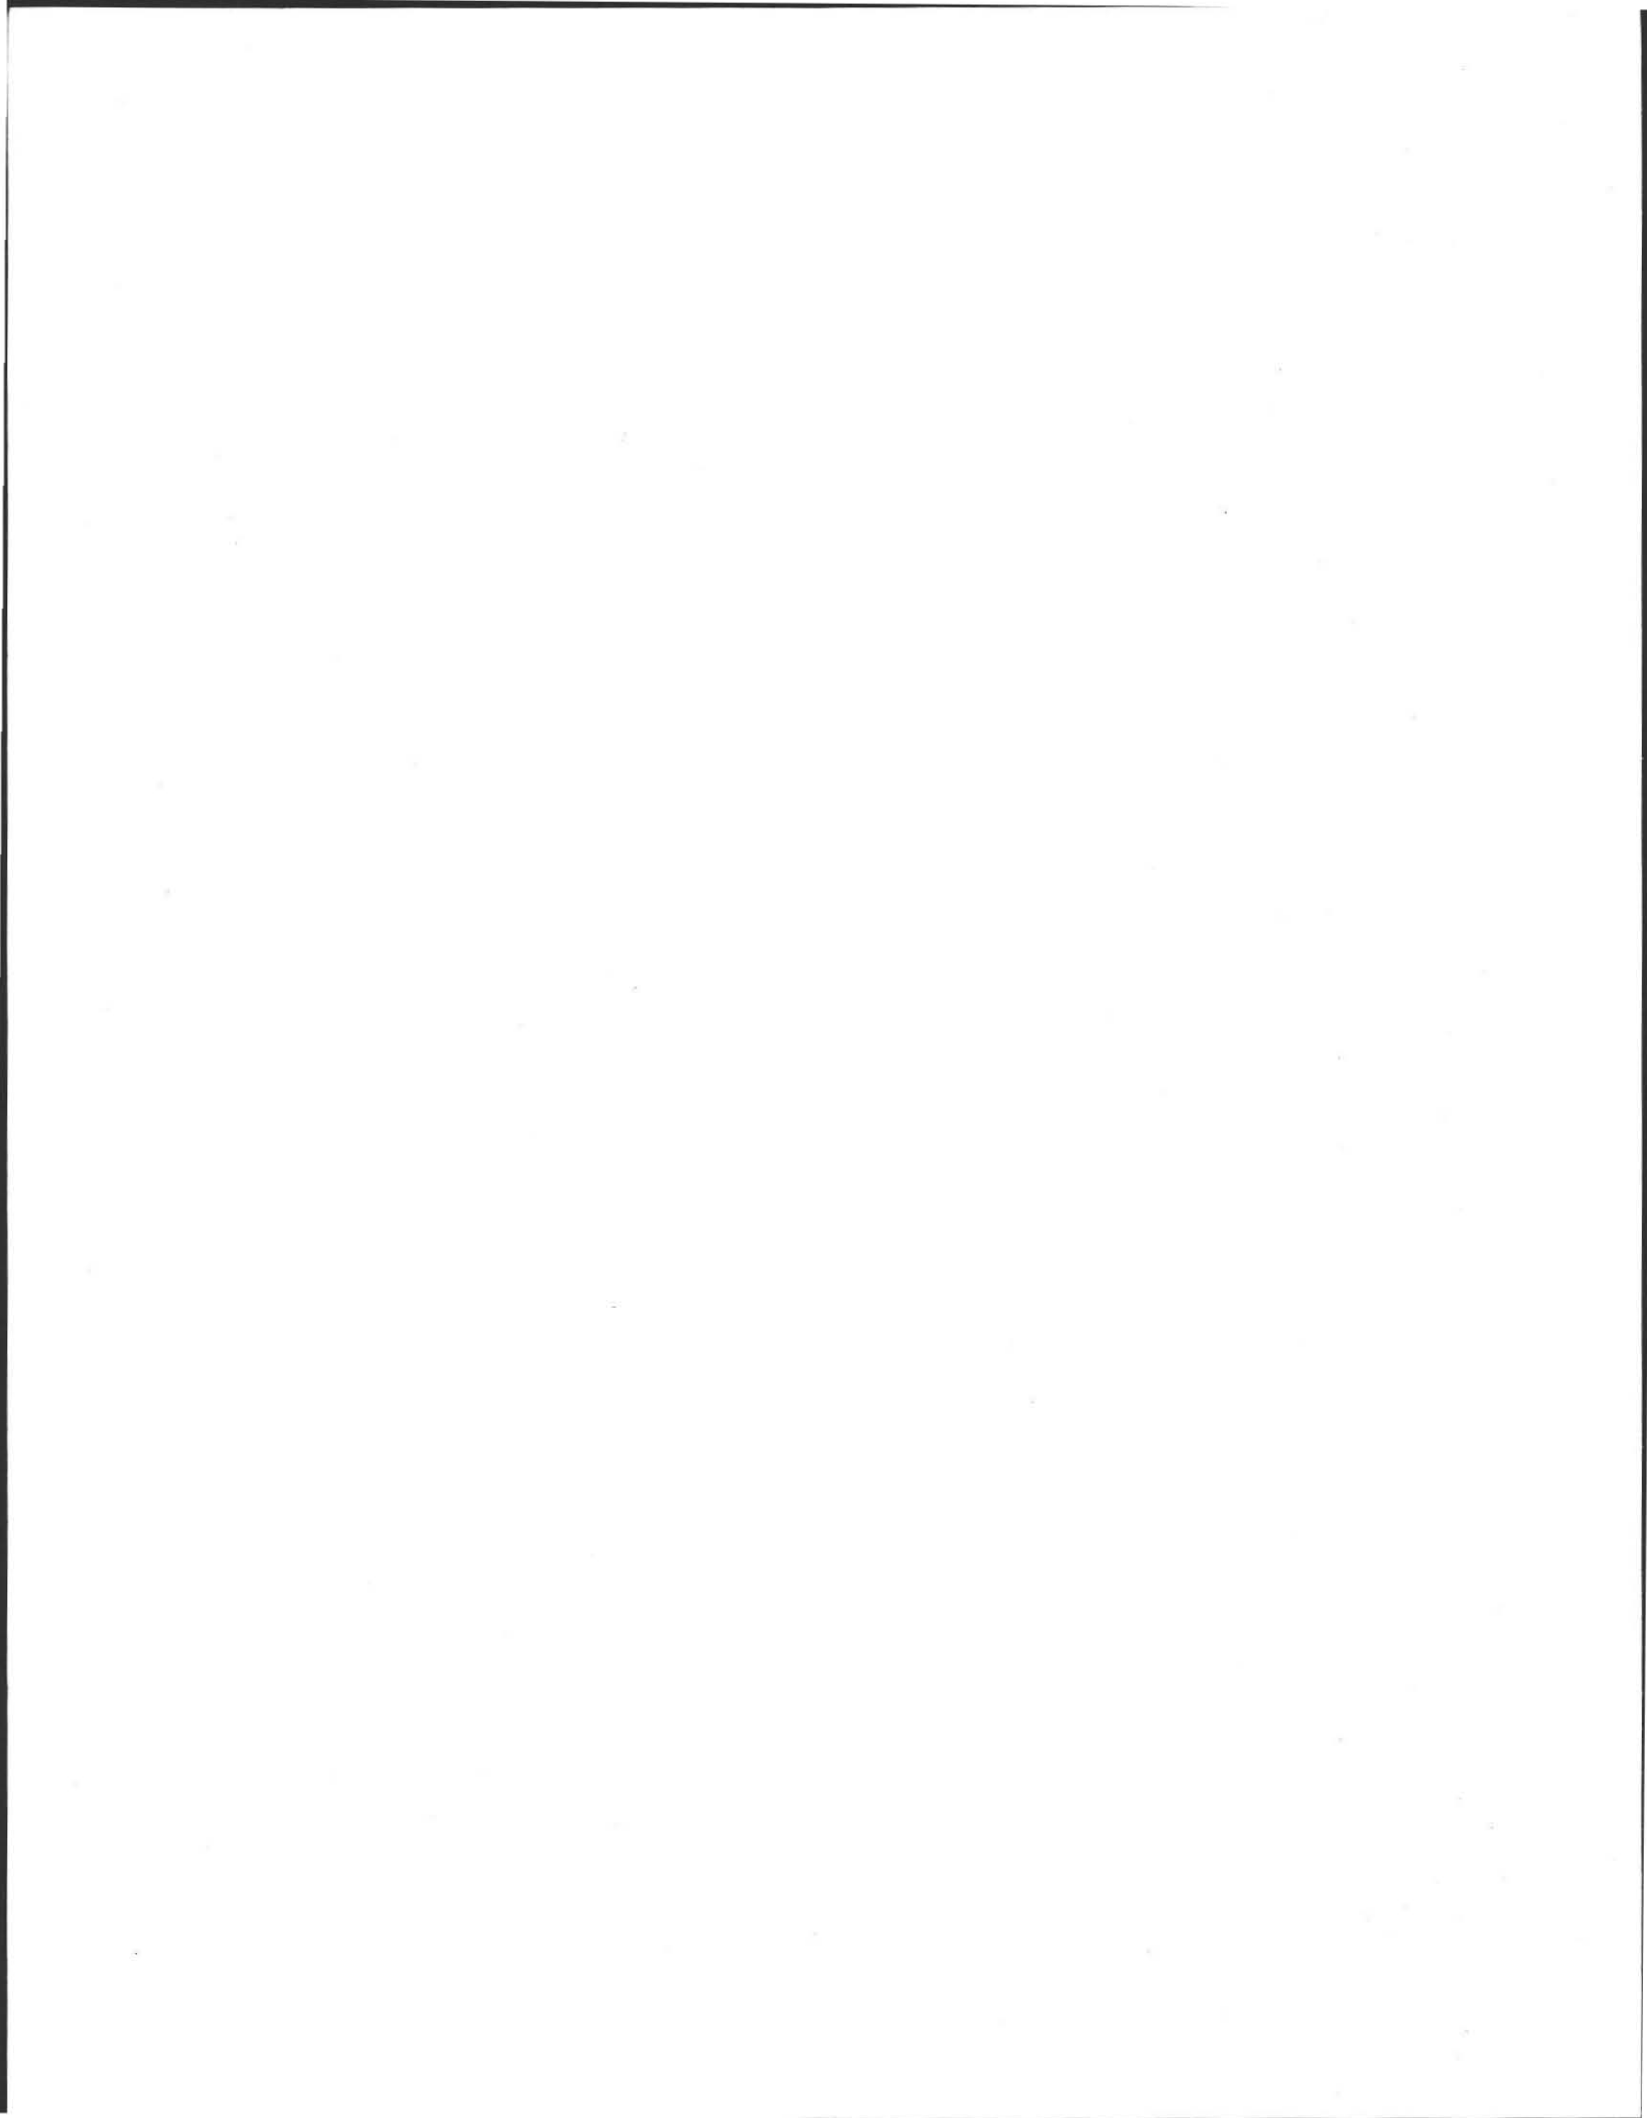

4.30.13

297 Shuterbury Road

W/ARTH WEISS

- needs new I-Box (backflow into box when pumped)
- camera'd 3 lines - 2 have normal appearance (some effluent in bottom of pipe)

paid \$200

4. 11. 12

1000 - 1000

1000 - 1000

1000 - 1000 (1000 - 1000)

1000 - 1000

1000 - 1000 (1000 - 1000)

1000 - 1000

1000 - 1000



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

RECEIVED  
4-06-09

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

*EB witnessed*

Owner information is required for every page.

Inspection results must be submitted on this form. Inspection forms may not be altered in any way.

**Important:**  
When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



## A. General Information

1. Inspector:

Alan E. Weiss

Name of Inspector

Cold Spring Environmental Consultants Inc.

Company Name

350 Old Enfield Road

Company Address

Belchertown

City/Town

MA

State

01007

Zip Code

413.323.5957

Telephone Number

License Number

## B. Certification

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of the inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on site sewage disposal systems. **I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000).** The system:

Passes

Conditionally Passes

Fails

Needs Further Evaluation by the Local Approving Authority

Inspector's Signature

04.01.2009

Date

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

**\*\*\*\*This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same or different conditions of use.**

1994





# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner information is required for every page.

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

## B. Certification (cont.)

Inspection Summary: Check A,B,C,D or E / **always** complete all of Section D

### A) System Passes:

- I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments:

All levels were good at inspection, system is 24+/- years old. Tank pumped, (D. box, & S. tank had good levels and no indication of past high staining or ponding. Tank had baffles built in & was pumped.

### B) System Conditionally Passes:

- One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Answer yes, no or not determined (Y, N, ND) in the  for the following statements. If "not determined," please explain.

- The septic tank is metal and over 20 years old\* **or** the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health.

\* A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

ND Explain:

---

---

- Observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System will pass inspection if (with approval of Board of Health):

broken pipe(s) are replaced

obstruction is removed





# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner information is required for every page.

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

## B. Certification (cont.)

### B) System Conditionally Passes (cont.):

- distribution box is leveled or replaced

ND Explain:

---

---

- The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

- broken pipe(s) are replaced

- obstruction is removed

ND Explain:

---

---

### C) Further Evaluation is Required by the Board of Health:

- Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

**1. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:**

- Cesspool or privy is within 50 feet of a surface water


- Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

**2. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:**

- The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.

- The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.

- The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.

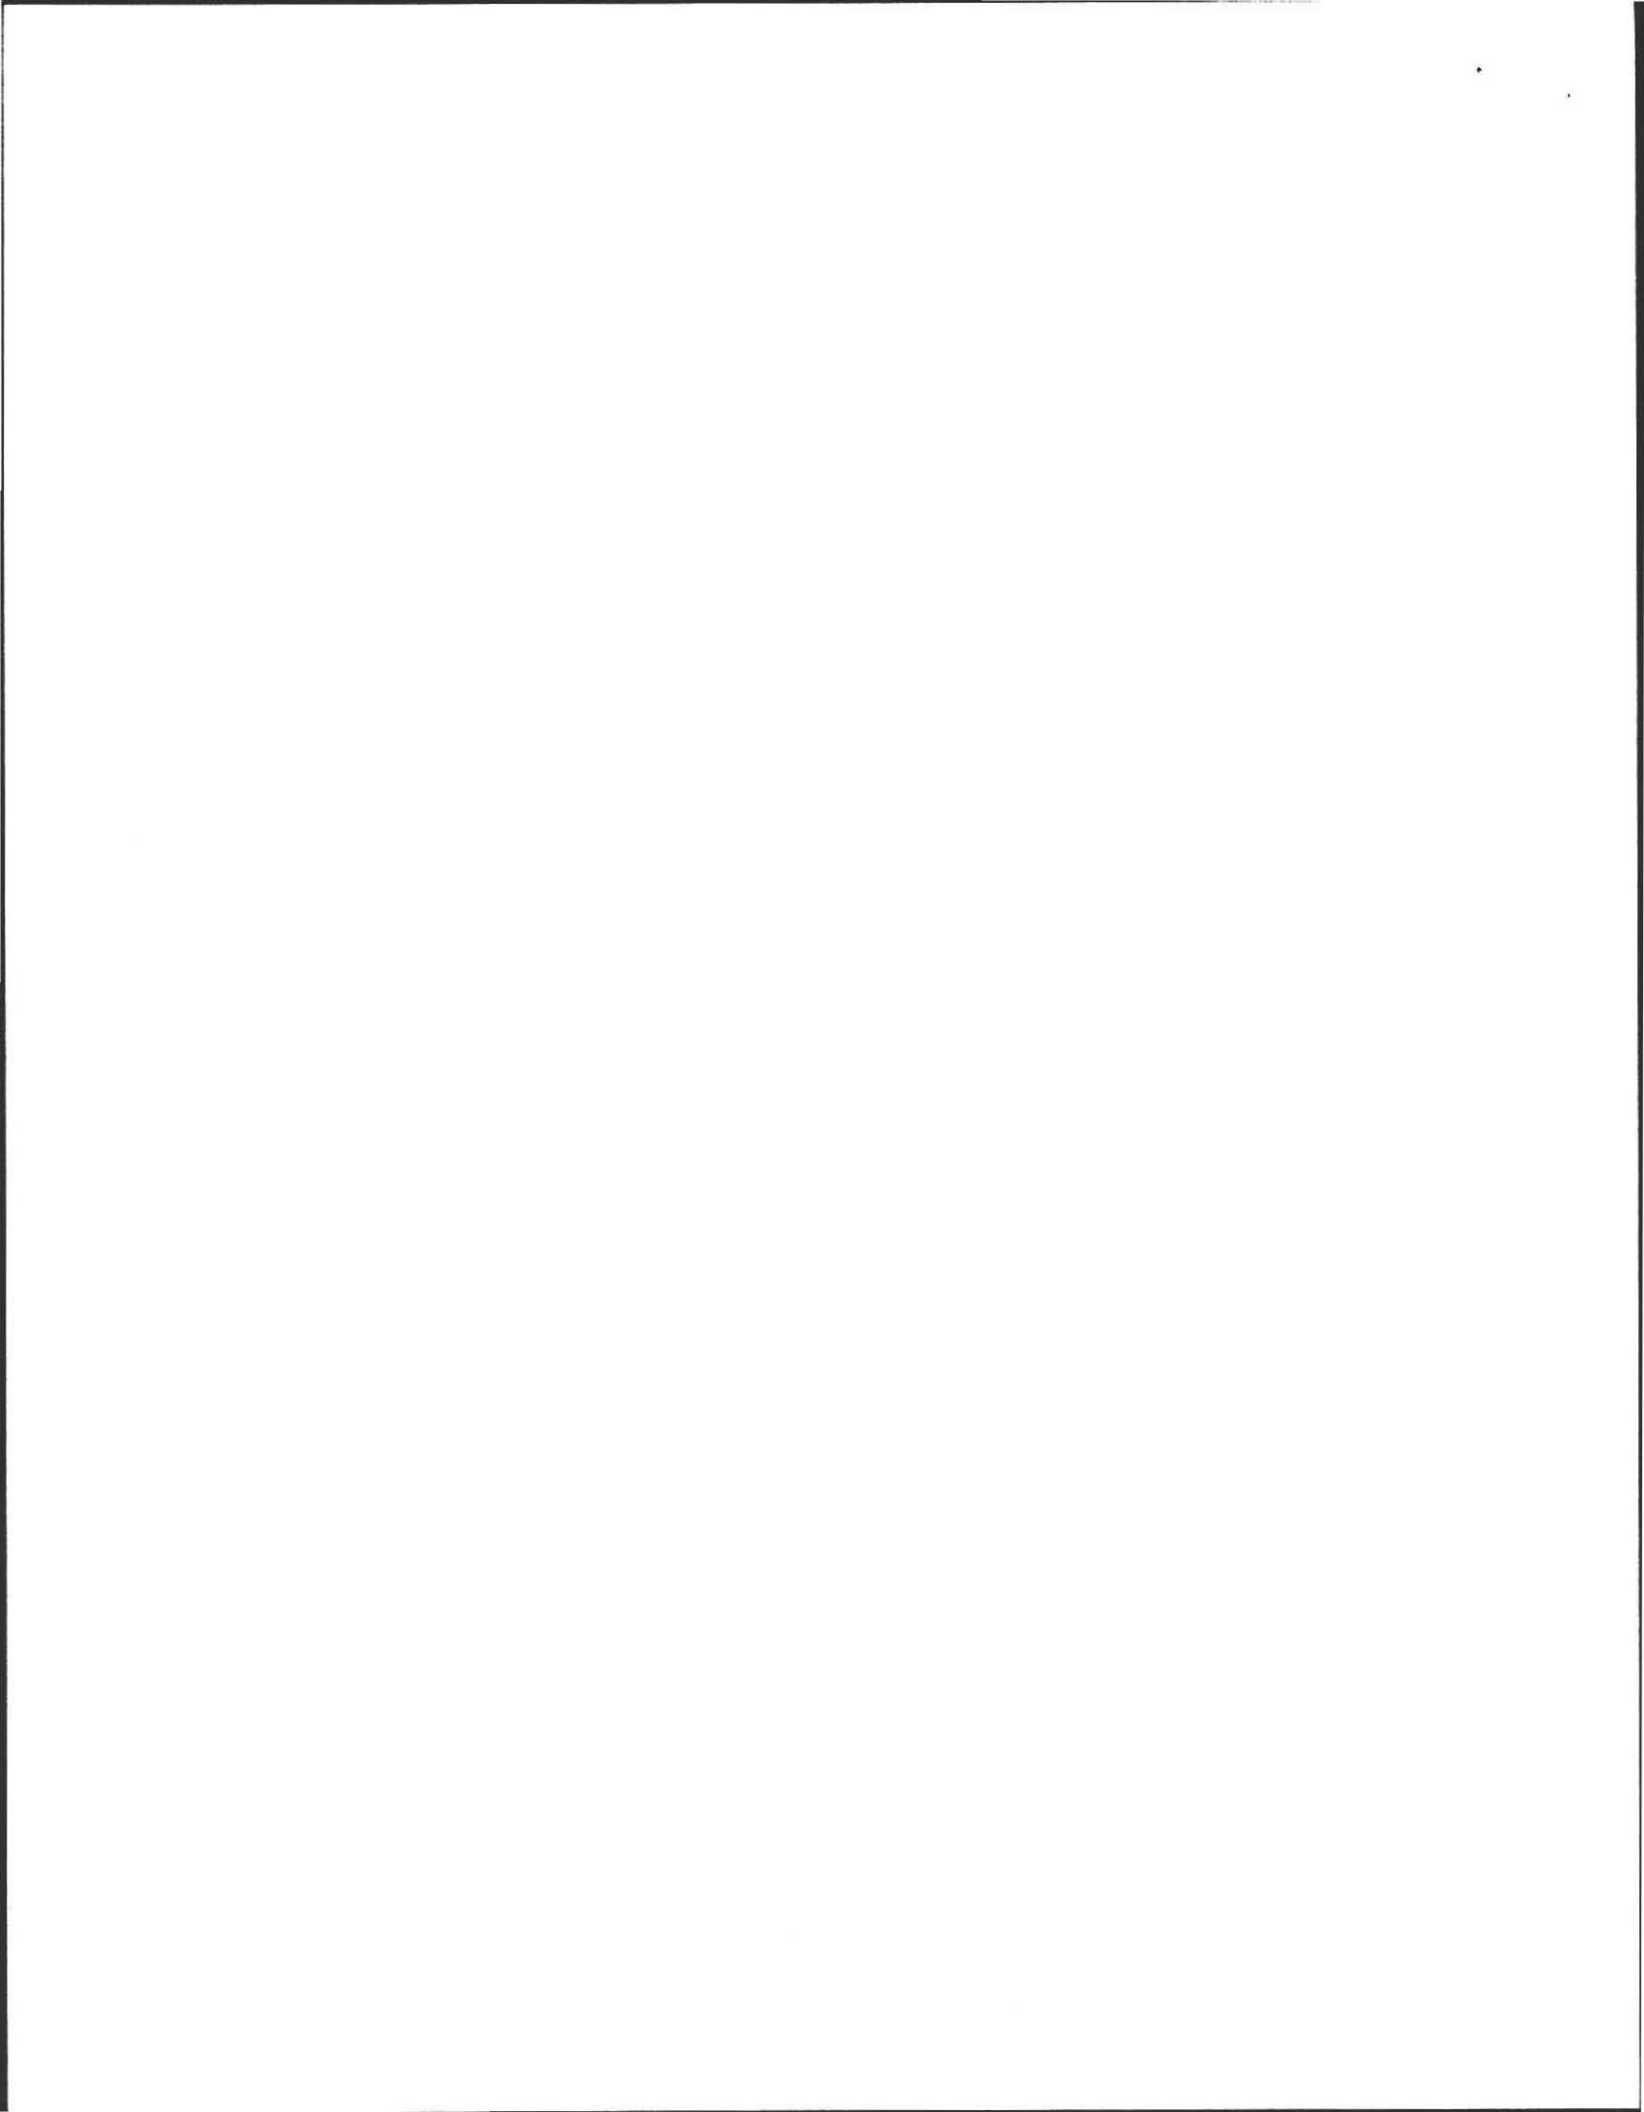



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner information is required for every page.

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

## B. Certification (cont.)

### C) Further Evaluation is Required by the Board of Health (cont.):

- The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well\*\*.

Method used to determine distance: Measured

\*\* This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria indicates absent and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

3. Other:

---



---




---

### D) System Failure Criteria Applicable to All Systems:

You must indicate "Yes" or "No" to each of the following for all inspections:

- | Yes                      | No                                  |   |
|--------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool                                     |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool     |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool                     |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Liquid depth in cesspool is less than 6" below invert or available volume is less than 1/2 day flow                                 |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Required pumping more than 4 times in the last year <b>NOT</b> due to clogged or obstructed pipe(s). Number of times pumped: _____. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of the SAS, cesspool or privy is below high ground water elevation.   |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply.               |

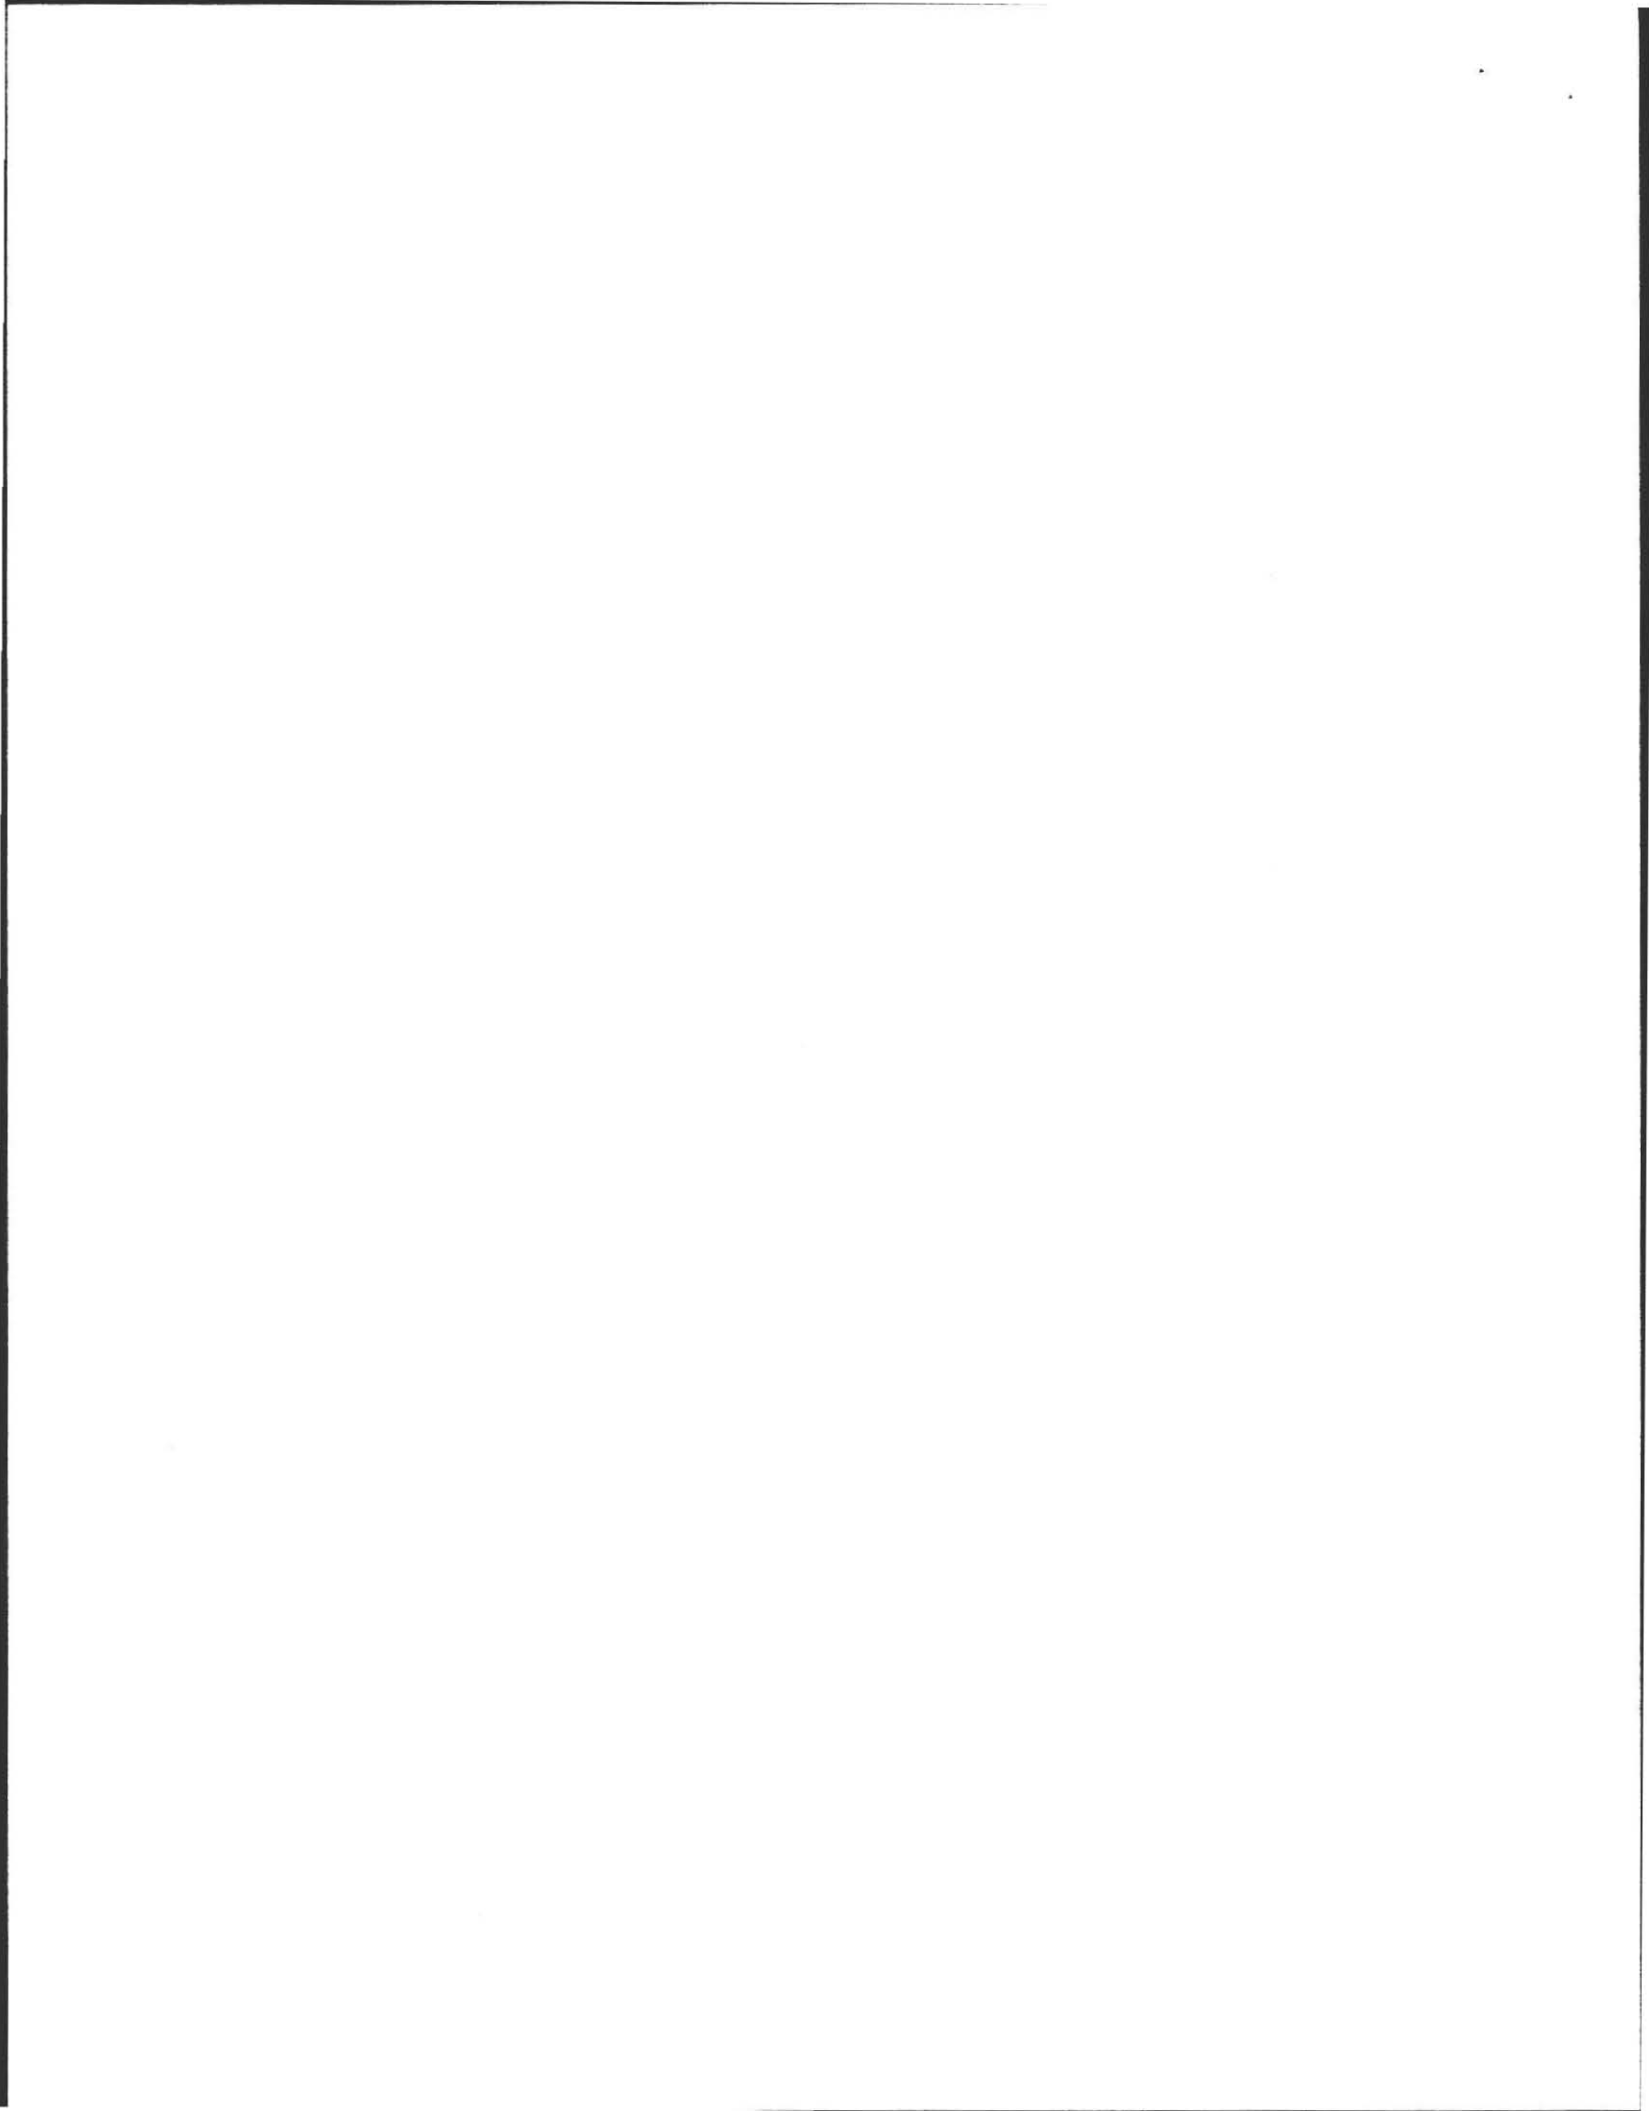



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## B. Certification (cont.)

### D) System Failure Criteria Applicable to All Systems (cont.):

Yes No

Any portion of a cesspool or privy is within a Zone 1 of a public well.

Any portion of a cesspool or privy is within 50 feet of a private water supply well.

Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. **[This system passes if the well water analysis, performed at a DEP certified laboratory, for fecal coliform bacteria indicates absent and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis and chain of custody must be attached to this form.]**

The system is a cesspool serving a facility with a design flow of 2000gpd-10,000gpd.

**The system fails.** I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure.

### E) Large Systems: To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.

For large systems, you must indicate either "yes" or "no" to each of the following, in addition to the questions in Section D.


Yes No

the system is within 400 feet of a surface drinking water supply

the system is within 200 feet of a tributary to a surface drinking water supply

the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area - IWPA) or a mapped Zone II of a public water supply well

If you have answered "yes" to any question in Section E the system is considered a significant threat, or answered "yes" in Section D above the large system has failed. The owner or operator of any large system considered a significant threat under Section E or failed under Section D shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

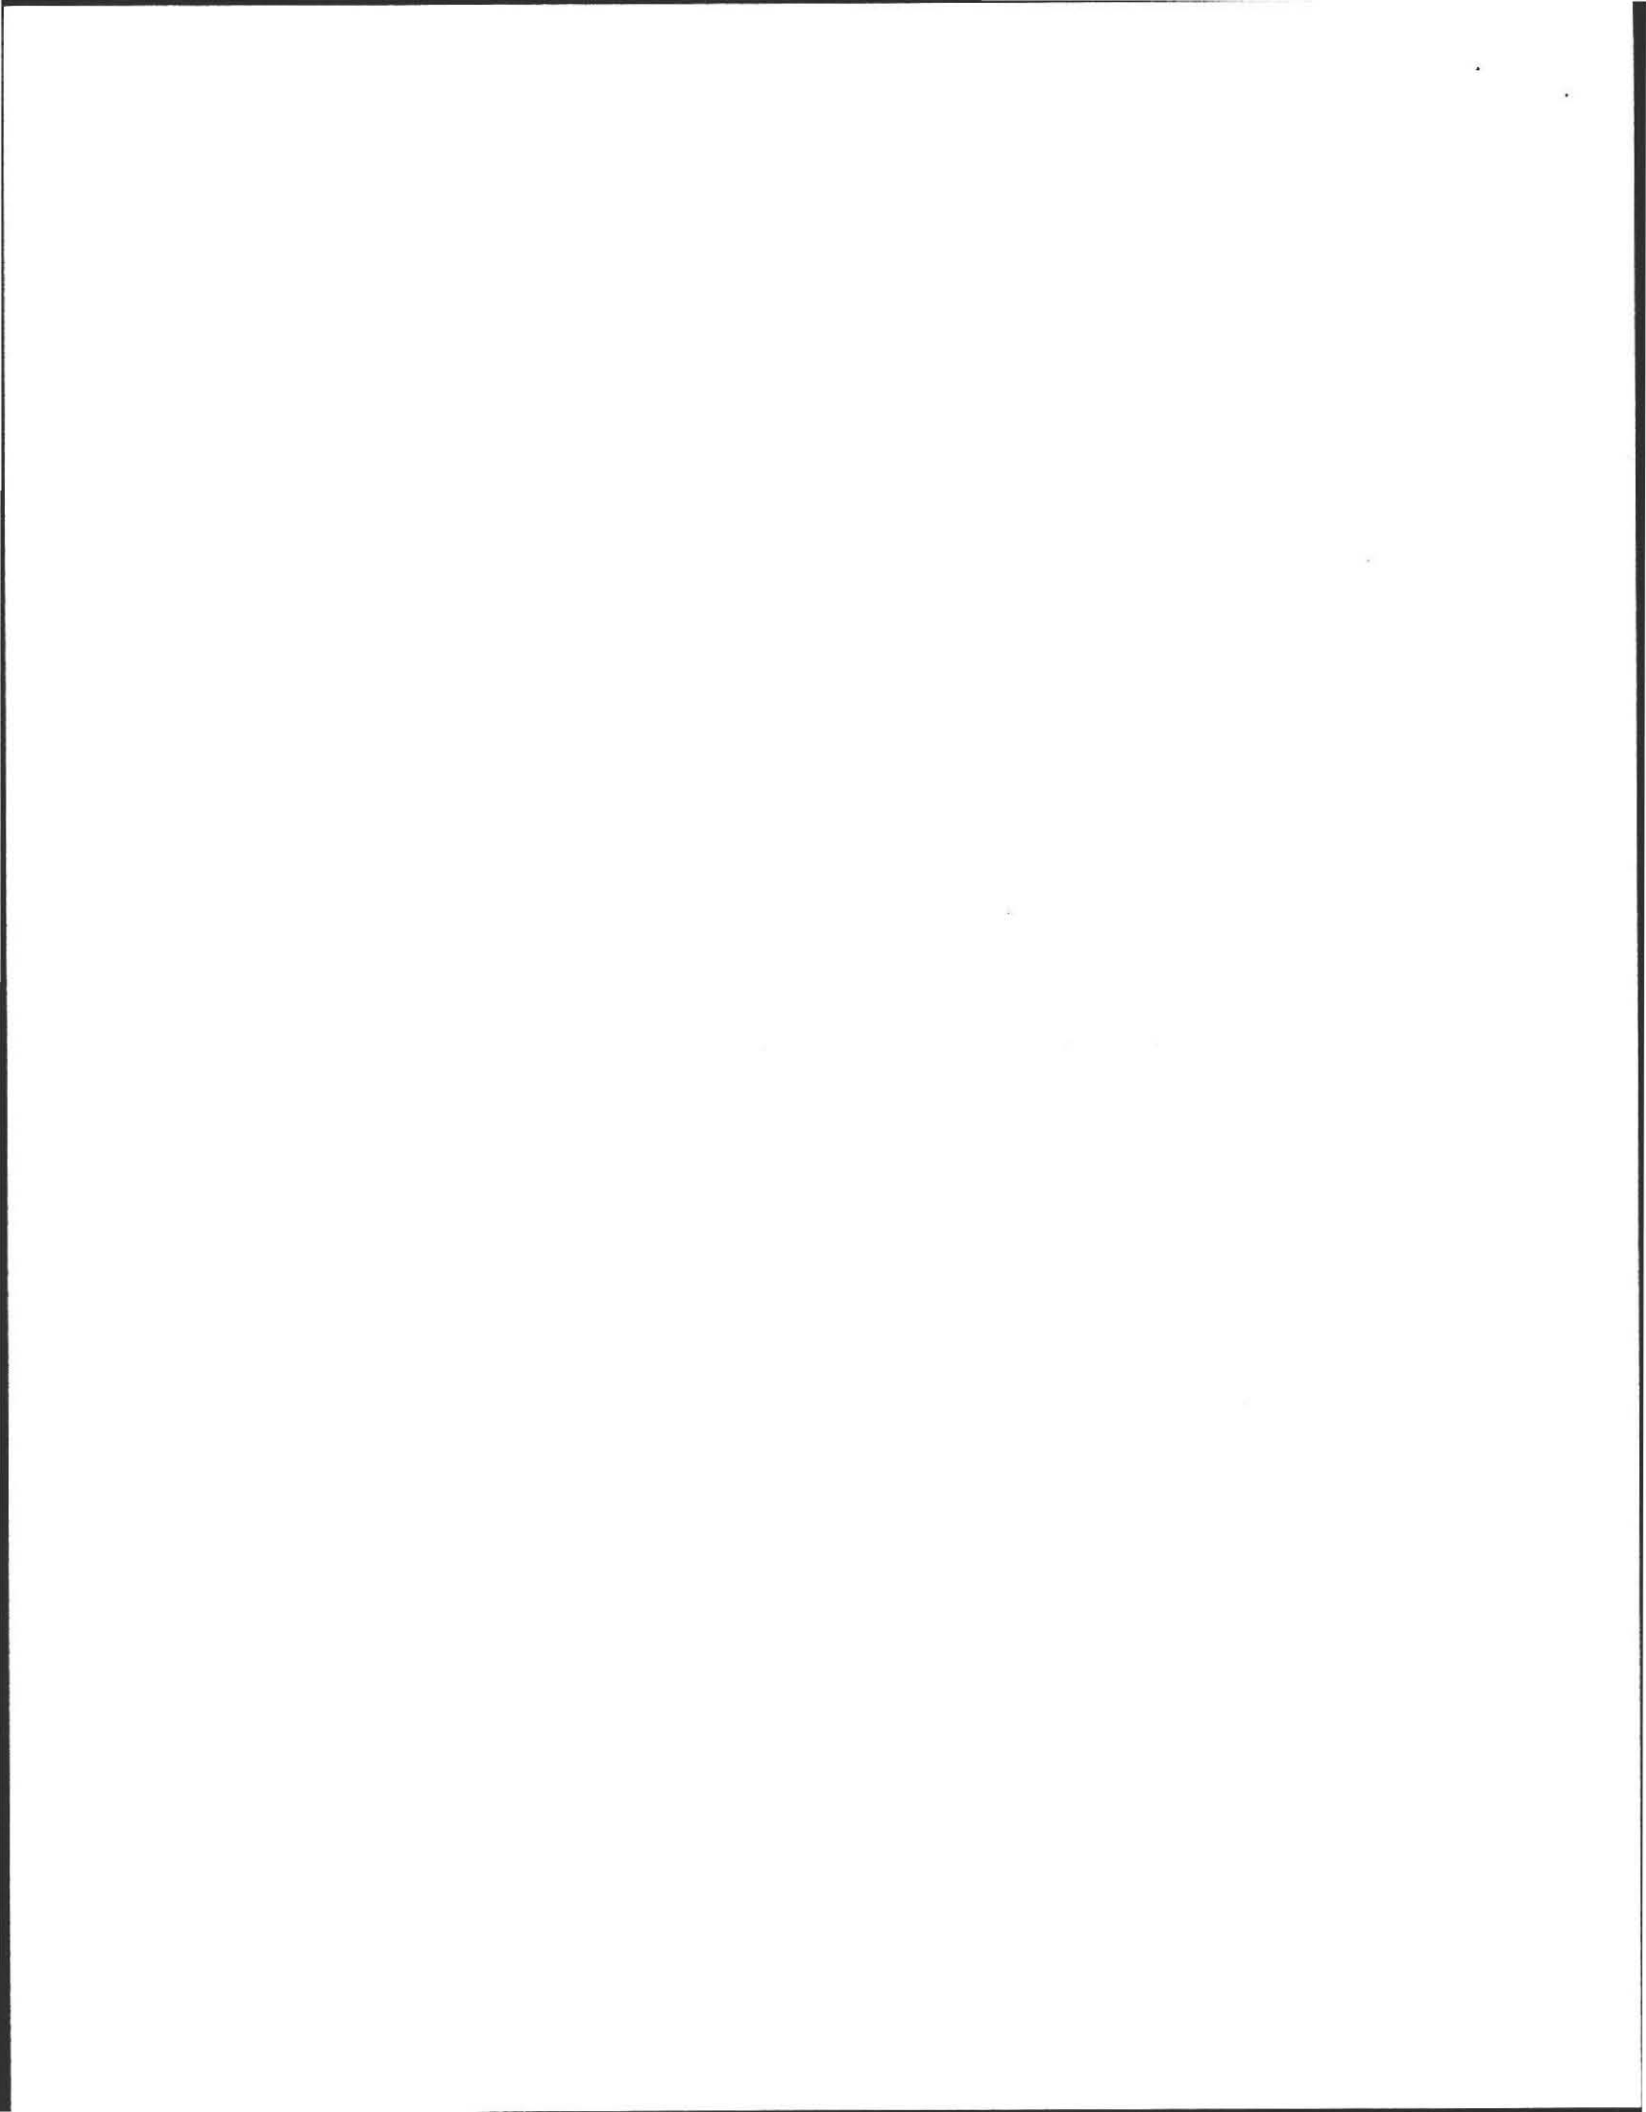





# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.


## C. Checklist

Check if the following have been done. You **must** indicate "yes" or "no" as to each of the following:

- | Yes                                 | No                                  |   |
|-------------------------------------|-------------------------------------|---|
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Pumping information was provided by the owner, occupant, or Board of Health   |
| <input type="checkbox"/>            | <input checked="" type="checkbox"/> | Were any of the system components pumped out in the previous two weeks?   |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Has the system received normal flows in the previous two week period?   |
| <input type="checkbox"/>            | <input checked="" type="checkbox"/> | Have large volumes of water been introduced to the system recently or as part of this inspection?   |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were as built plans of the system obtained and examined? (If they were not available note as N/A)   |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Was the facility or dwelling inspected for signs of sewage back up?   |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Was the site inspected for signs of break out?  |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were all system components, excluding the SAS, located on site?   |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum? |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems?   |

The **size and location of the Soil Absorption System (SAS)** on the site has been determined based on:

- |                                     |                          |  |
|-------------------------------------|--------------------------|--|
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | Existing information. For example, a plan at the Board of Health.  |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(5)] |

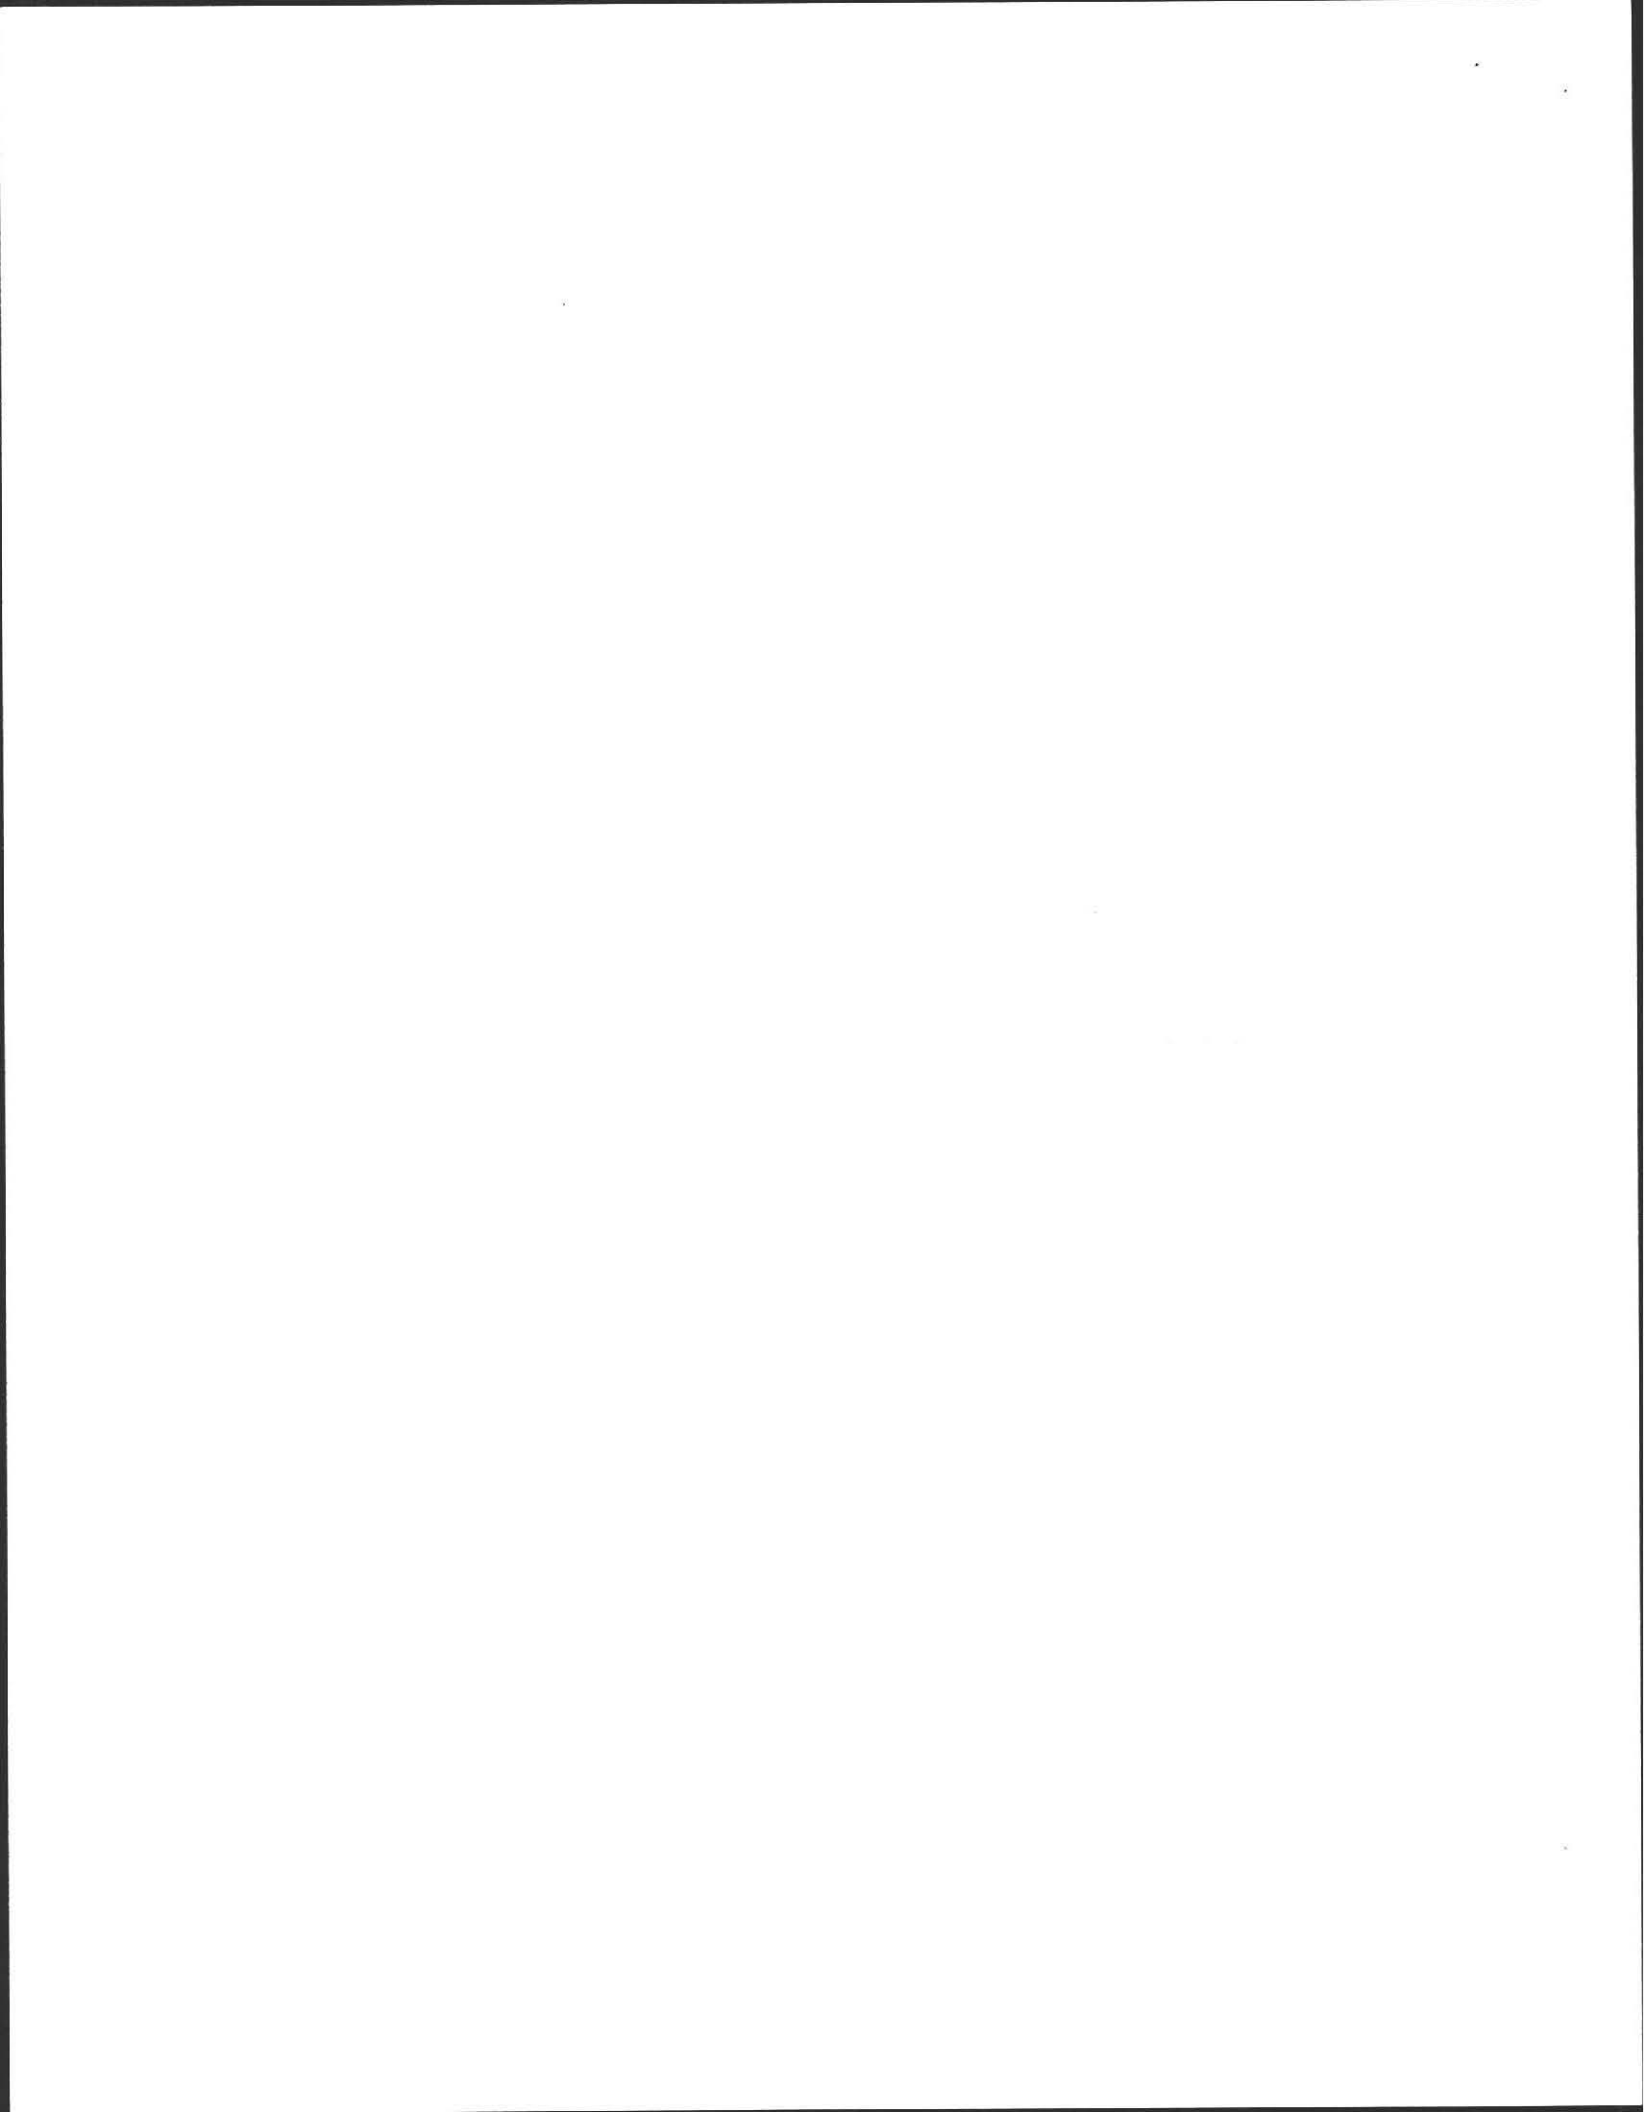



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA  
State

01002  
Zip Code

04.01.2009  
Date of Inspection

Owner information is required for every page.

## D. System Information

### Residential Flow Conditions:

Number of bedrooms (design): 3 w. disp. Number of bedrooms (actual): 3

DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): 525

Number of current residents: 4

Does residence have a garbage grinder?  Yes  No

Is laundry on a separate sewage system? [if **yes** separate inspection required]  Yes  No

Laundry system inspected?  Yes  No

Seasonal use?  Yes  No

Water meter readings, if available (last 2 years usage (gpd)): N/A

Sump pump?  Yes  No

Last date of occupancy: current  
Date

### Commercial/Industrial Flow Conditions:

Type of Establishment: N/A

Design flow (based on 310 CMR 15.203): N/A  
Gallons per day (gpd)

Basis of design flow (seats/persons/sq.ft., etc.): N/A

Grease trap present?  Yes  No


Industrial waste holding tank present?  Yes  No

Non-sanitary waste discharged to the Title 5 system?  Yes  No

Water meter readings, if available: N/A

Last date of occupancy/use: N/A  
Date

Other (describe): N/A

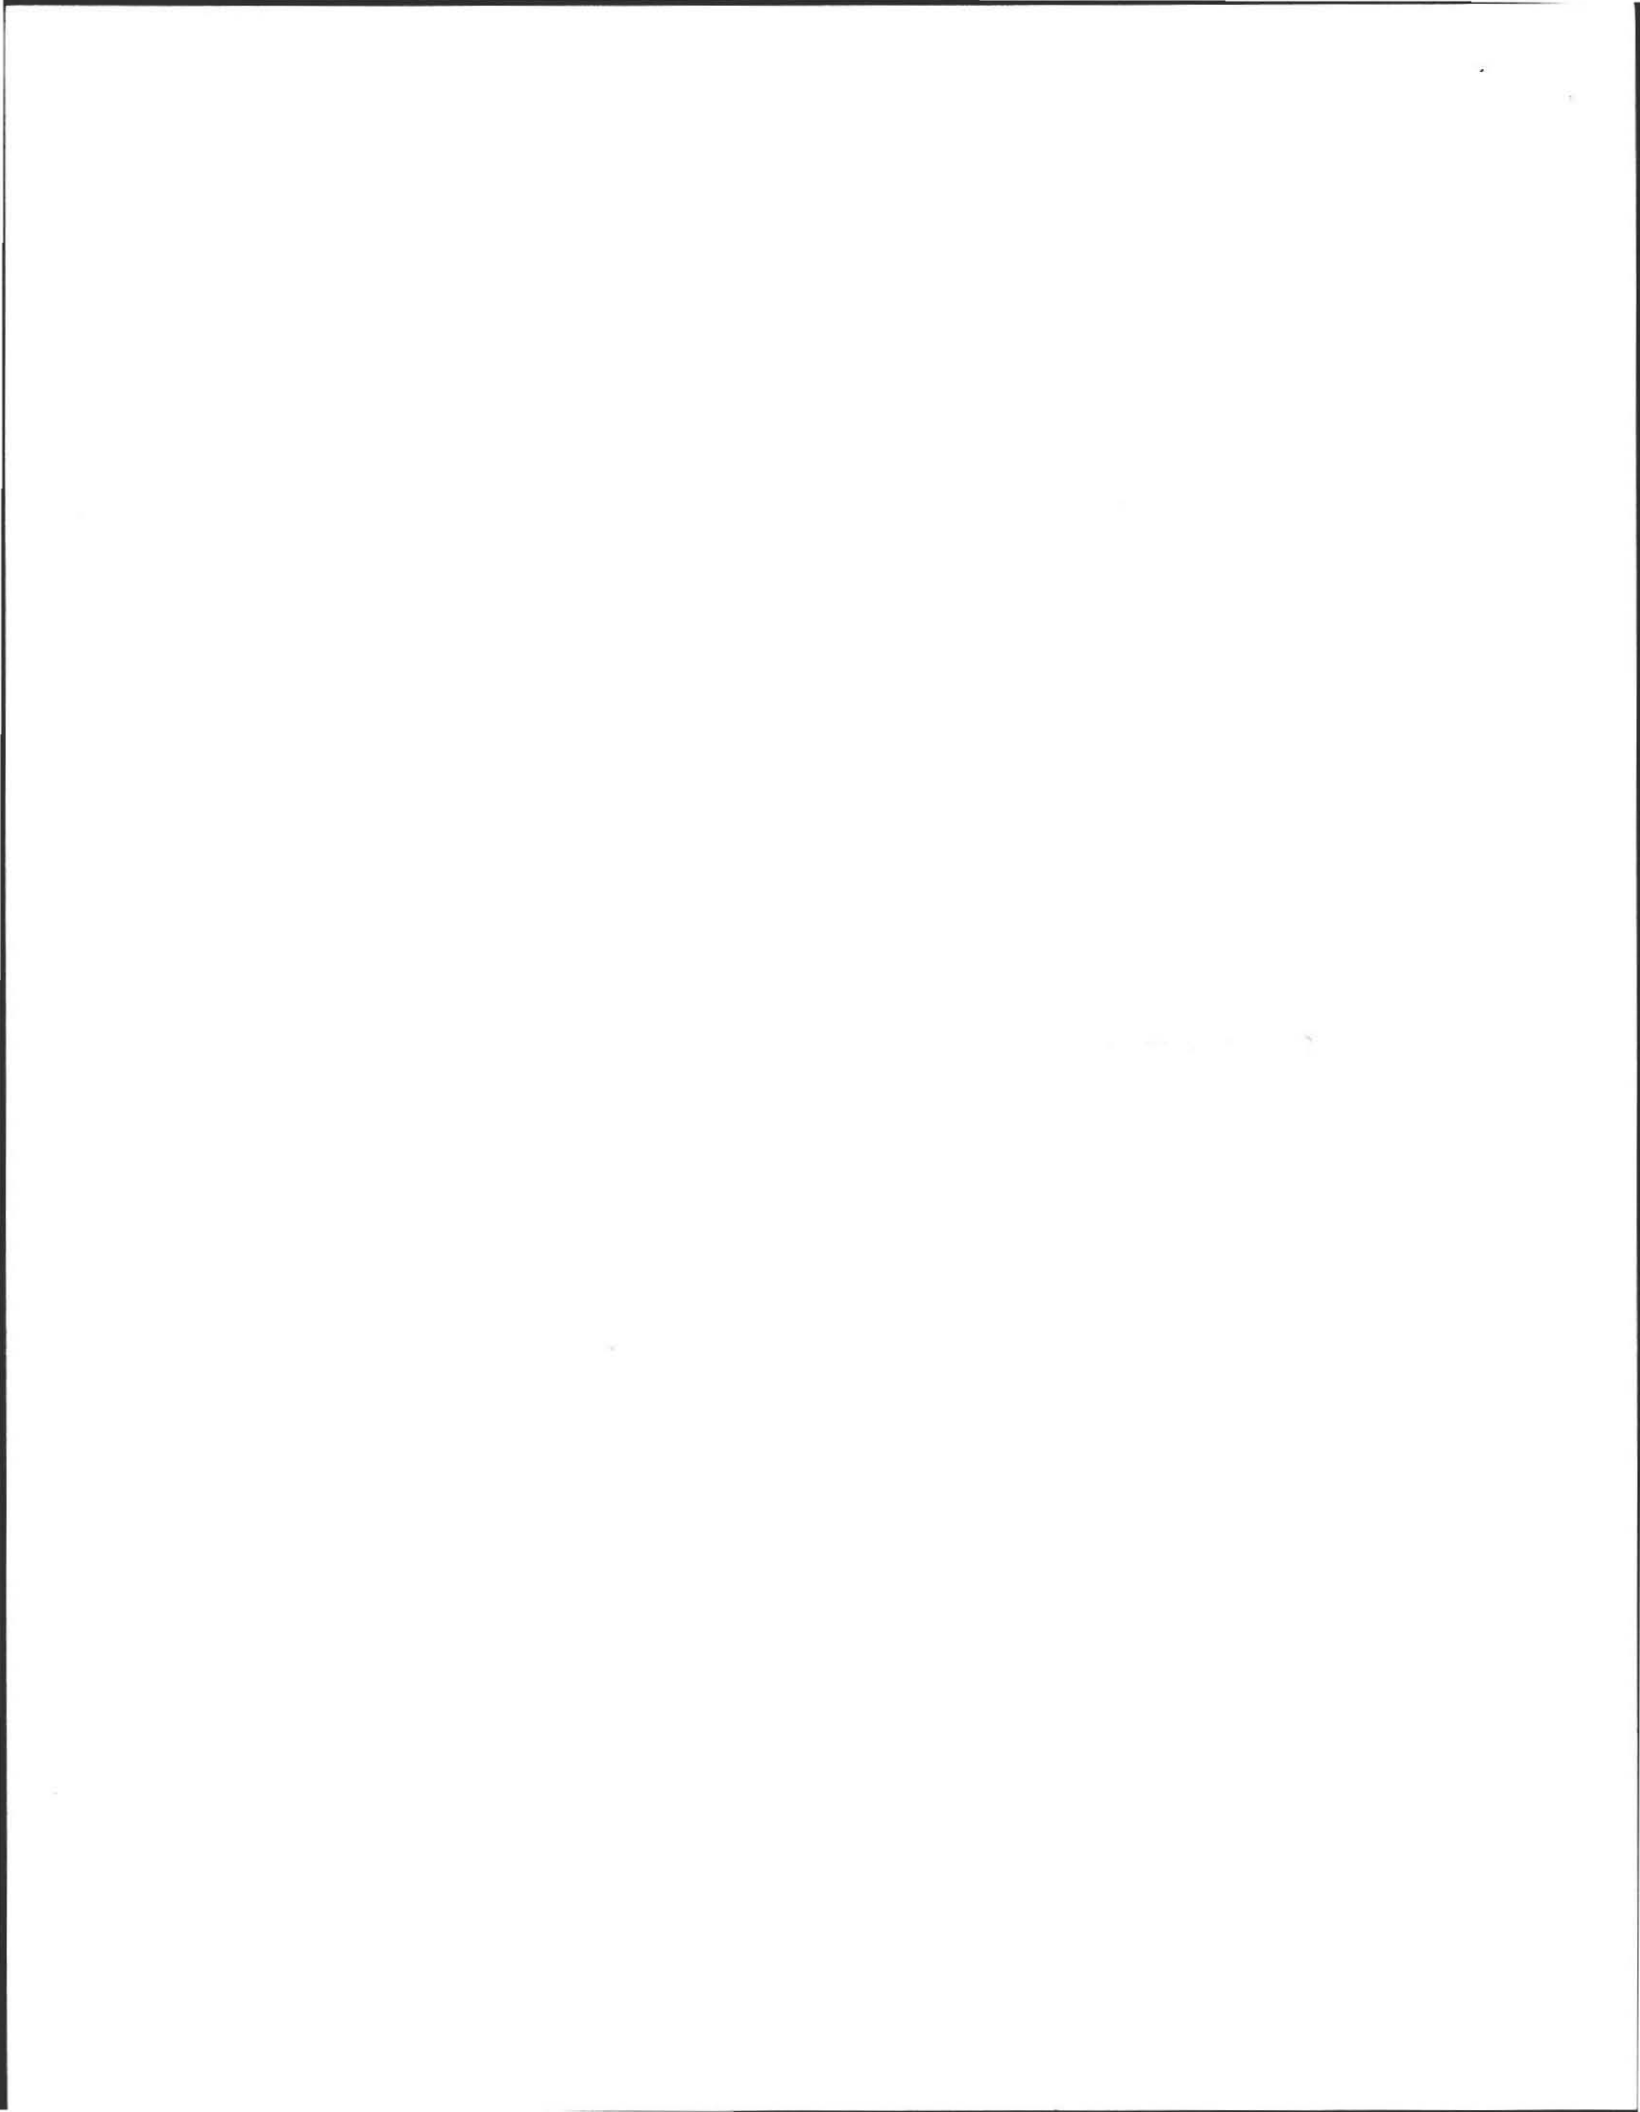



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner information is required for every page.

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

## D. System Information (cont.)

### General Information

#### Pumping Records:

Source of information:

Owner: (10/05)

Was system pumped as part of the inspection?

Yes  No

If yes, volume pumped:

1500 g  
gallons

How was quantity pumped determined?

pumper

Reason for pumping:

T-5

#### Type of System:


- Septic tank, distribution box, soil absorption system
- Single cesspool
- Overflow cesspool
- Privy
- Shared system (yes or no) (if yes, attach previous inspection records, if any)
- Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner)
- Tight tank. Attach a copy of the DEP approval.
- Other (describe):

Approximate age of all components, date installed (if known) and source of information:

24+/- Years

Were sewage odors detected when arriving at the site?

Yes  No

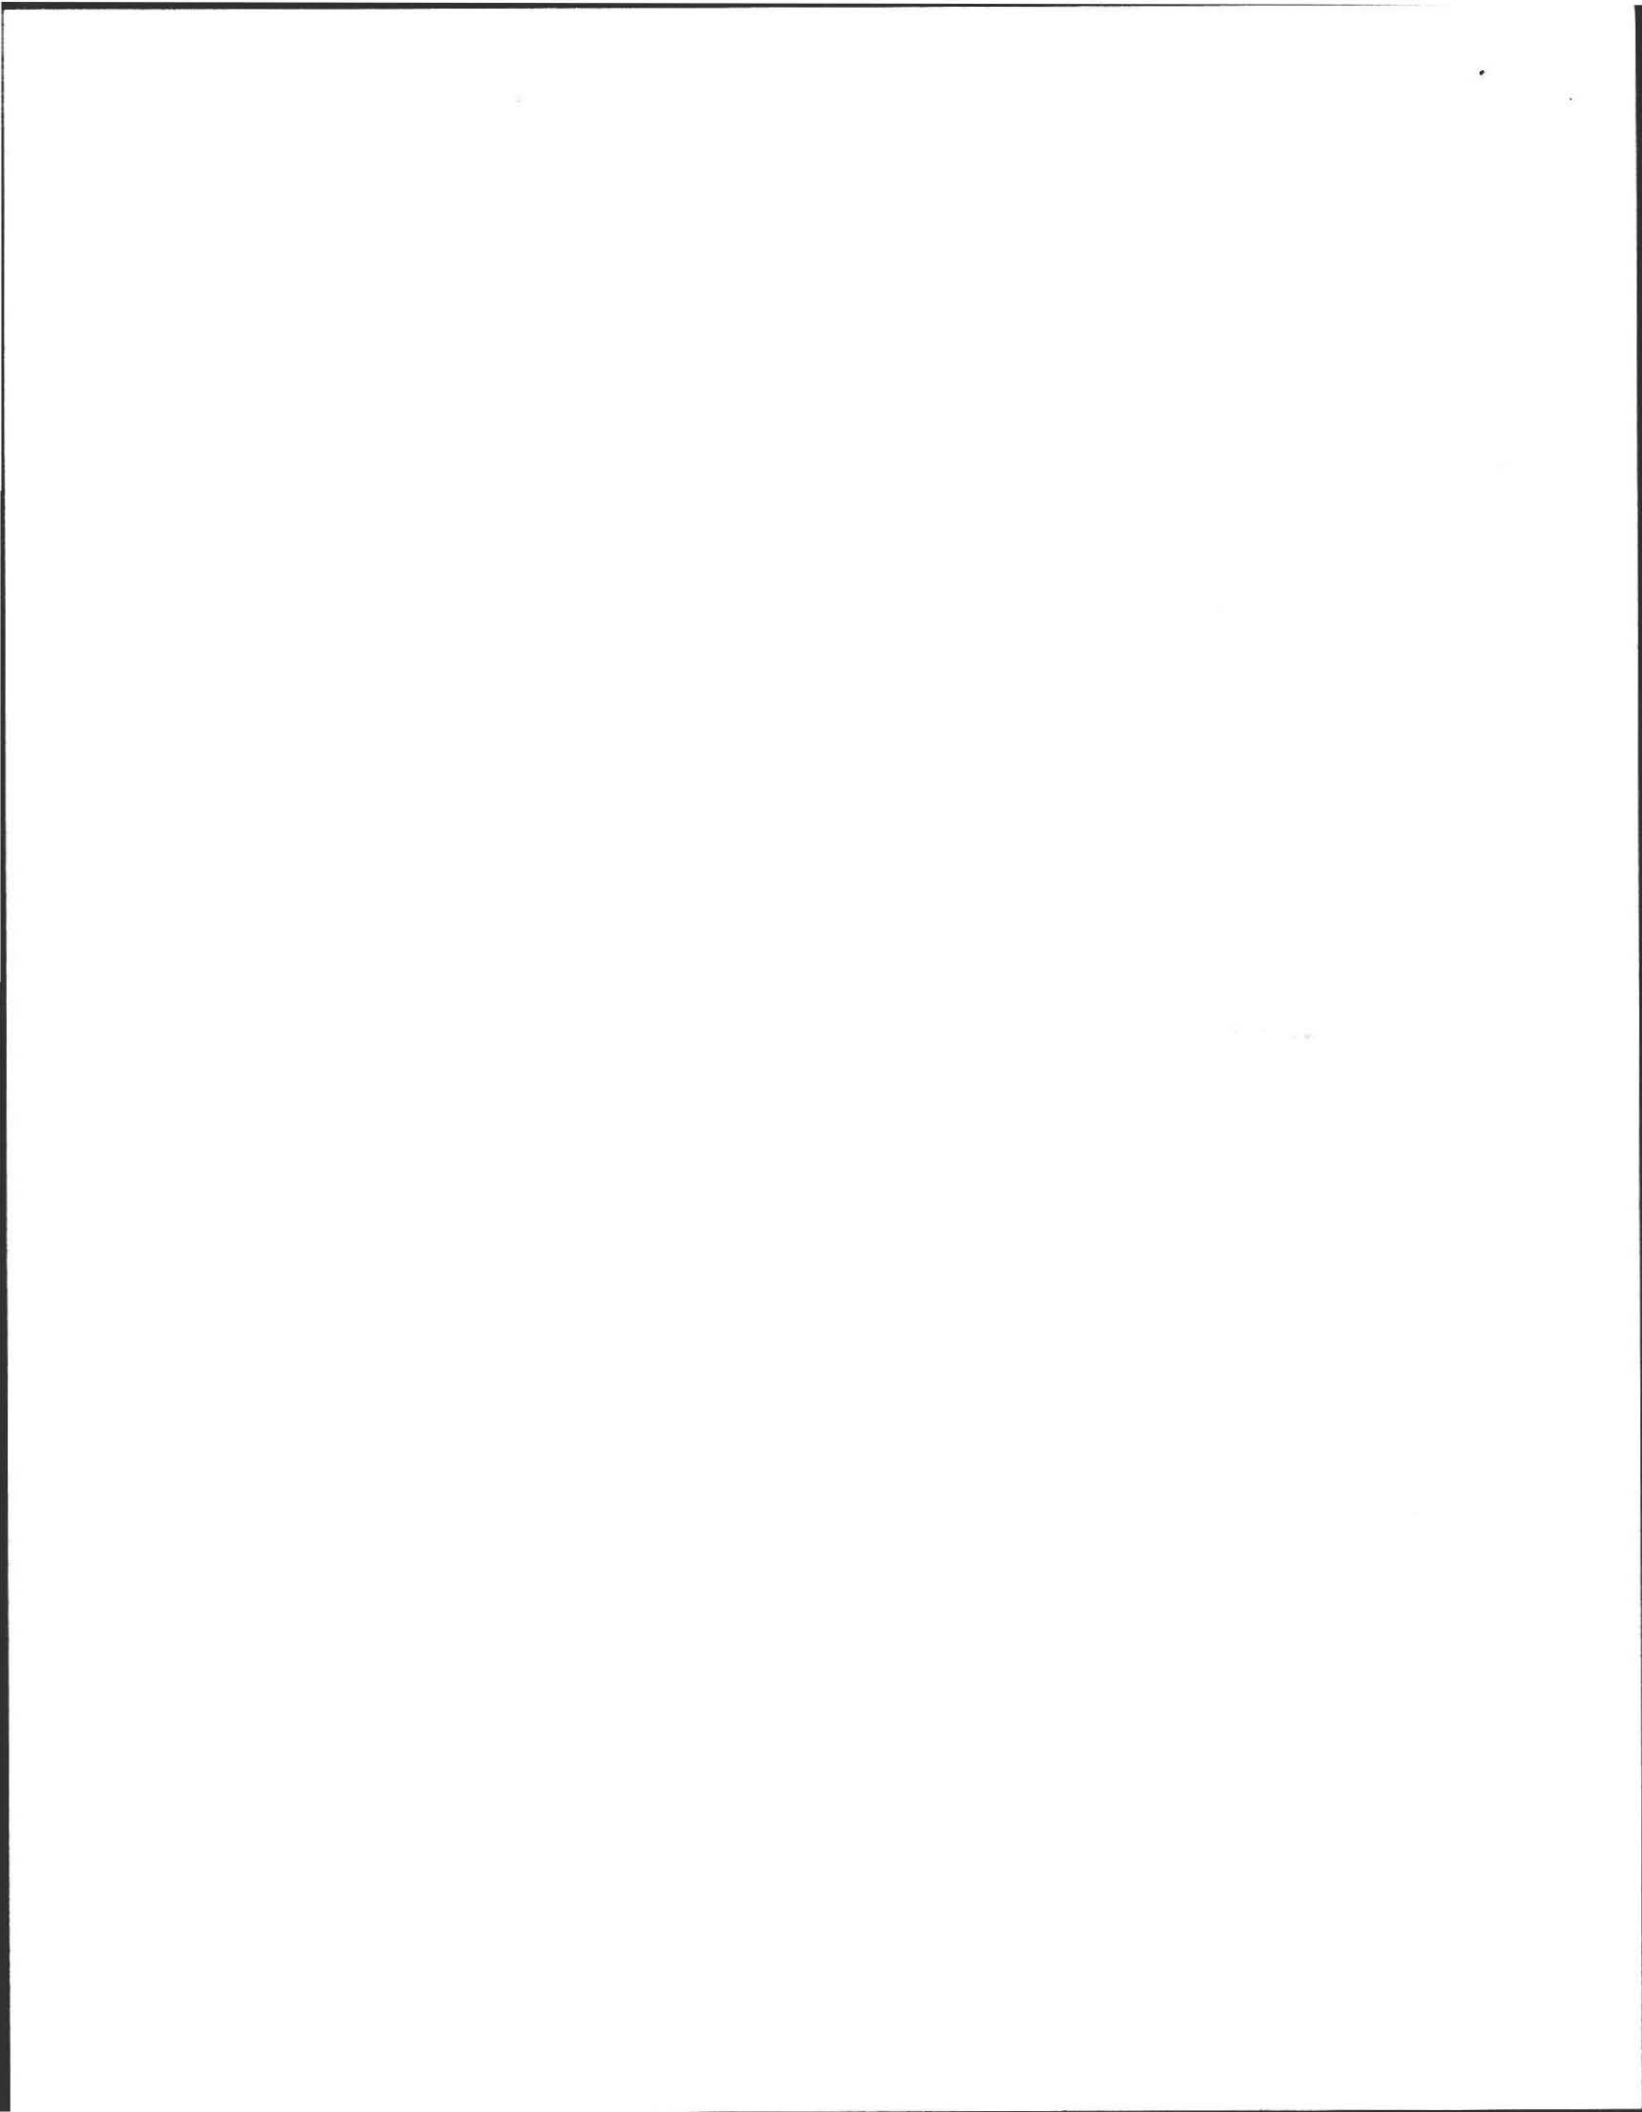



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## D. System Information (cont.)

### Building Sewer (locate on site plan):

Depth below grade:

.8'  
feet

Material of construction:

cast iron

40 PVC

other (explain):

Distance from private water supply well or suction line:

10'  
feet

Comments (on condition of joints, venting, evidence of leakage, etc.):

### Septic Tank (locate on site plan):

Depth below grade:

1.'

Material of construction:

concrete

metal

fiberglass

polyethylene

other (explain)

If tank is metal, list age:

years

Is age confirmed by a Certificate of Compliance? (attach a copy of certificate)

Yes  No

Dimensions:

10.5'X5.5'X4.5'

Sludge depth:

4"

Distance from top of sludge to bottom of outlet tee or baffle

40"

Scum thickness

4"

Distance from top of scum to top of outlet tee or baffle


9"

Distance from bottom of scum to bottom of outlet tee or baffle

12"

How were dimensions determined?

Measured

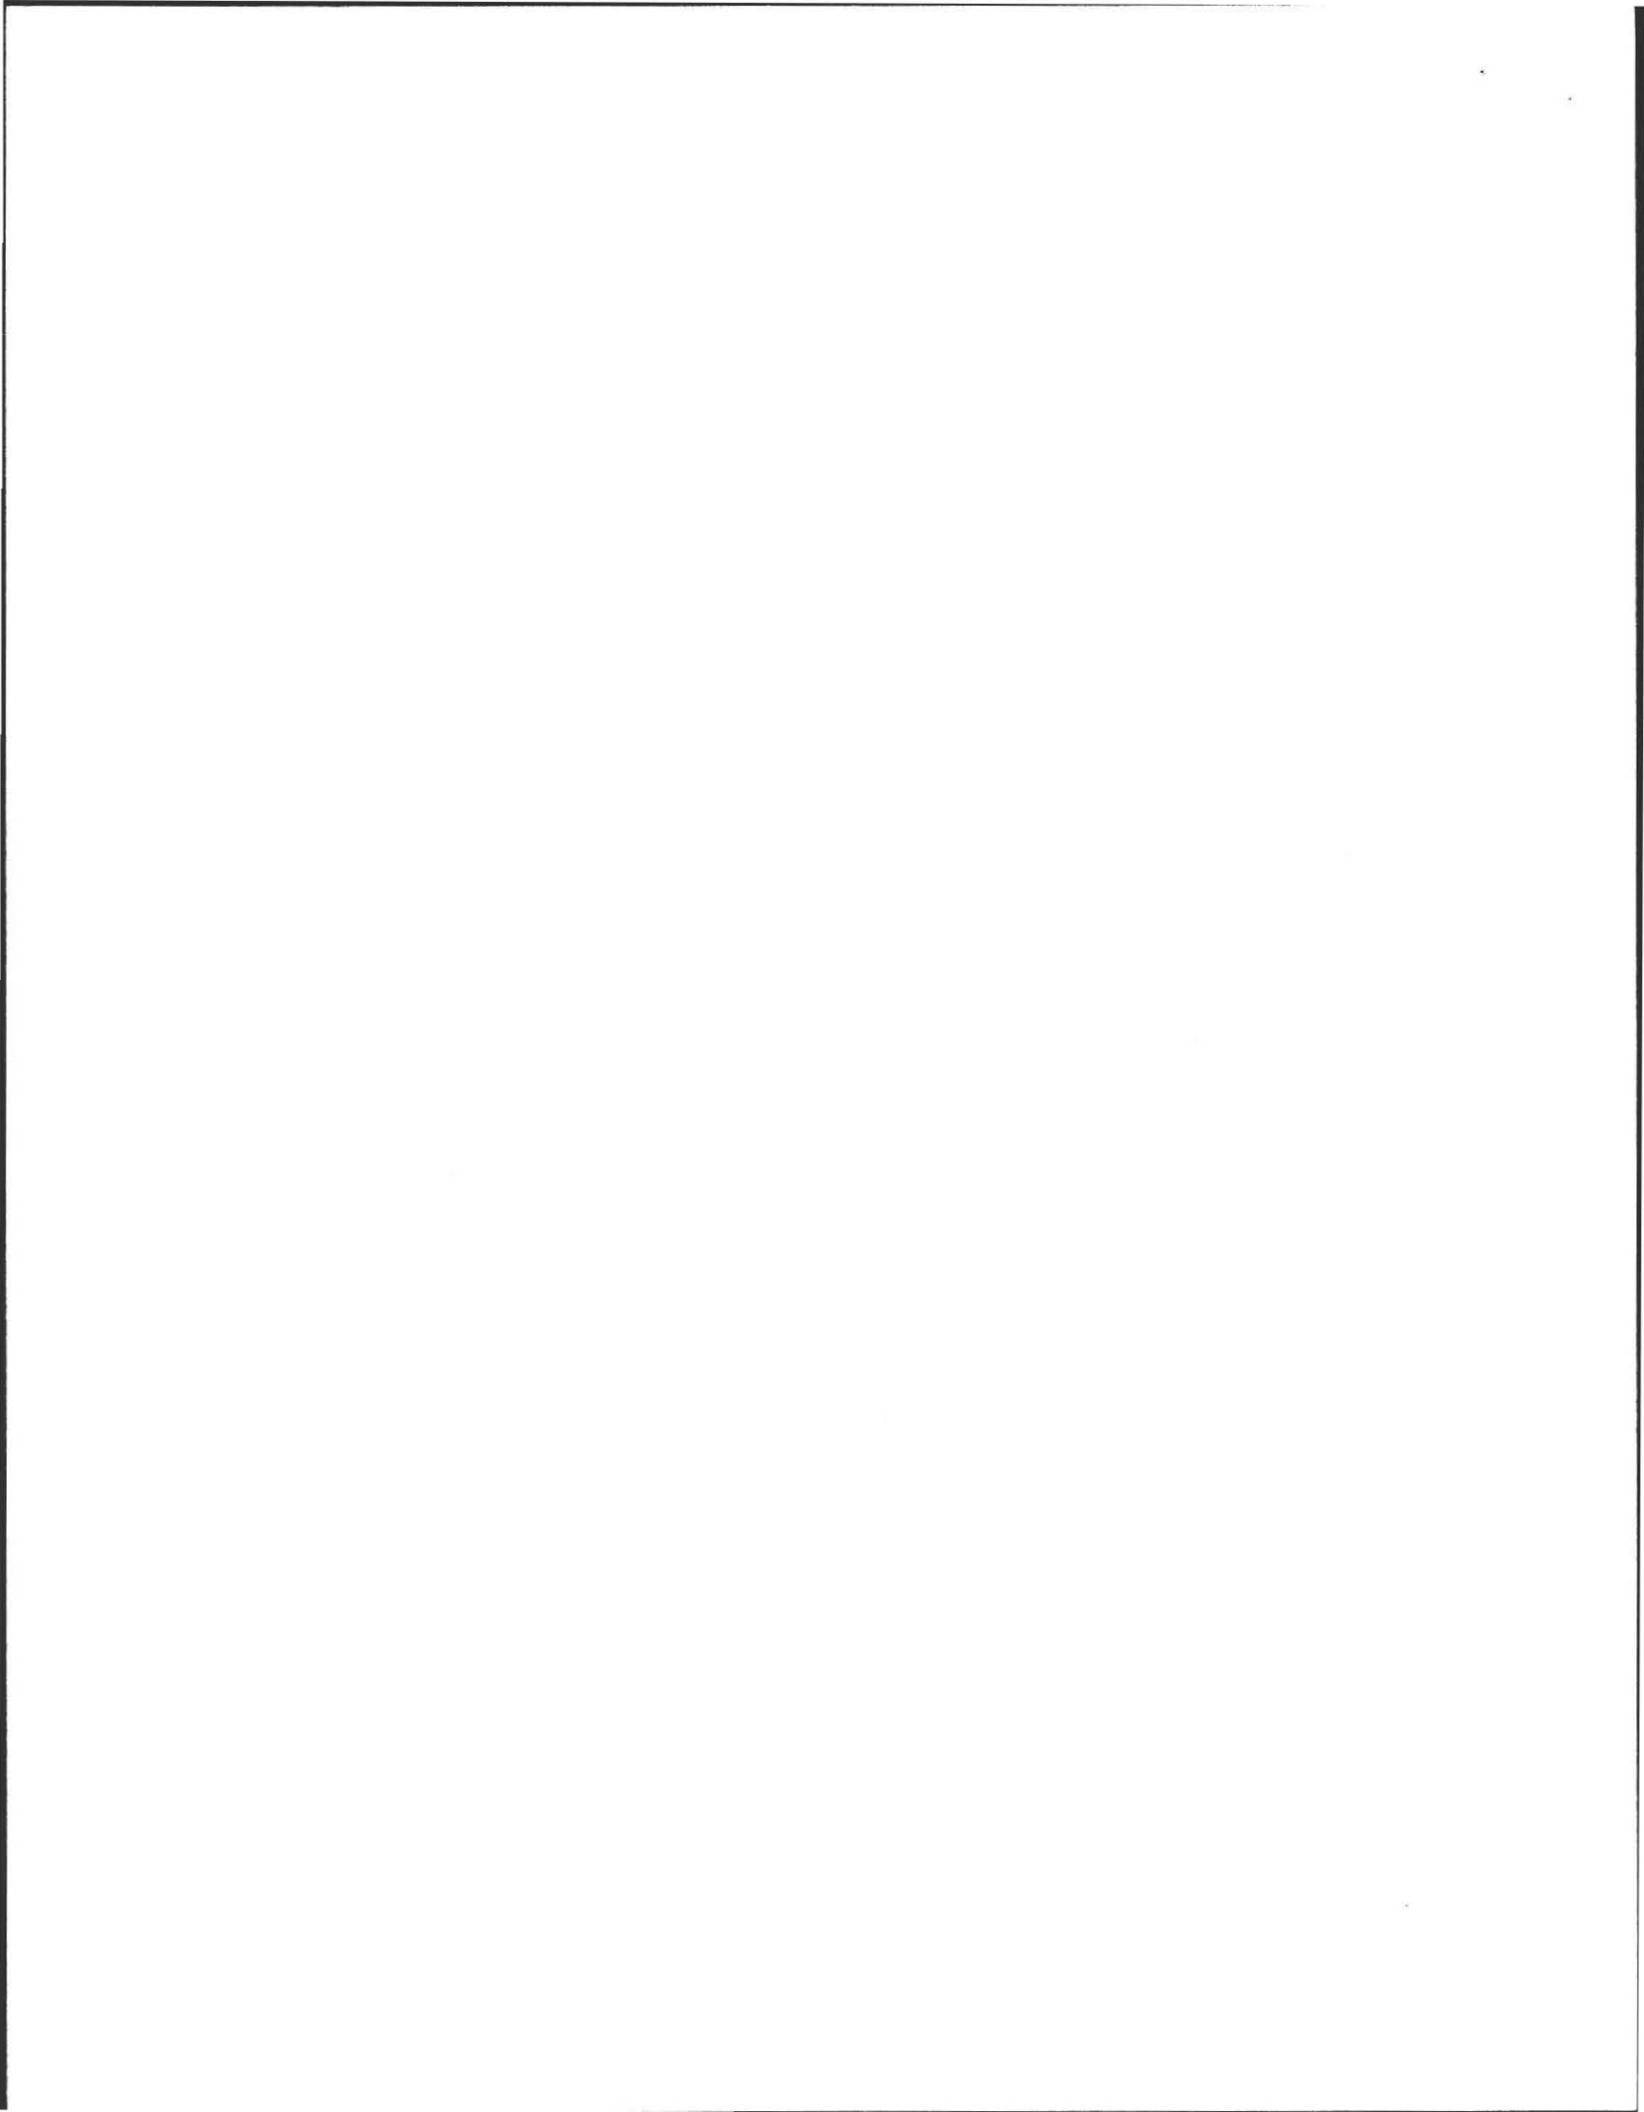





# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## D. System Information (cont.)

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

Tank levels good. Structural integrity appeared good at time of inspection. (baffles in place), Tank should be pumped (DEP recommends every 2-3 years).

### Grease Trap (locate on site plan):

Depth below grade:

N/A  
feet

Material of construction:

concrete

metal

fiberglass

polyethylene

other (explain):

Dimensions:

N/A

Scum thickness

N/A

Distance from top of scum to top of outlet tee or baffle

N/A

Distance from bottom of scum to bottom of outlet tee or baffle

N/A

Date of last pumping:

N/A  
Date

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

N/A

### Tight or Holding Tank (tank must be pumped at time of inspection) (locate on site plan):

Depth below grade:

N/A

Material of construction:

concrete

metal

fiberglass

polyethylene

other (explain):

N/A





Commonwealth of Massachusetts

Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA  
State

01002  
Zip Code

04.01.2009  
Date of Inspection

Owner information is required for every page.

D. System Information (cont.)

Tight or Holding Tank (cont.)

Dimensions: N/A

Capacity: N/A  
gallons

Design Flow: N/A  
gallons per day

Alarm present:  Yes  No

Alarm level: N/A Alarm in working order:  Yes  No

Date of last pumping: N/A  
Date

Comments (condition of alarm and float switches, etc.):  
N/A

\* Attach copy of current pumping contract (required). Is copy attached?  Yes  No

Distribution Box (if present must be opened) (locate on site plan):

Depth of liquid level above outlet invert @ Inv. level good. 14" down


Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.):

Good condition.

Pump Chamber (locate on site plan):

Pumps in working order:  Yes  No

Alarms in working order:  Yes  No

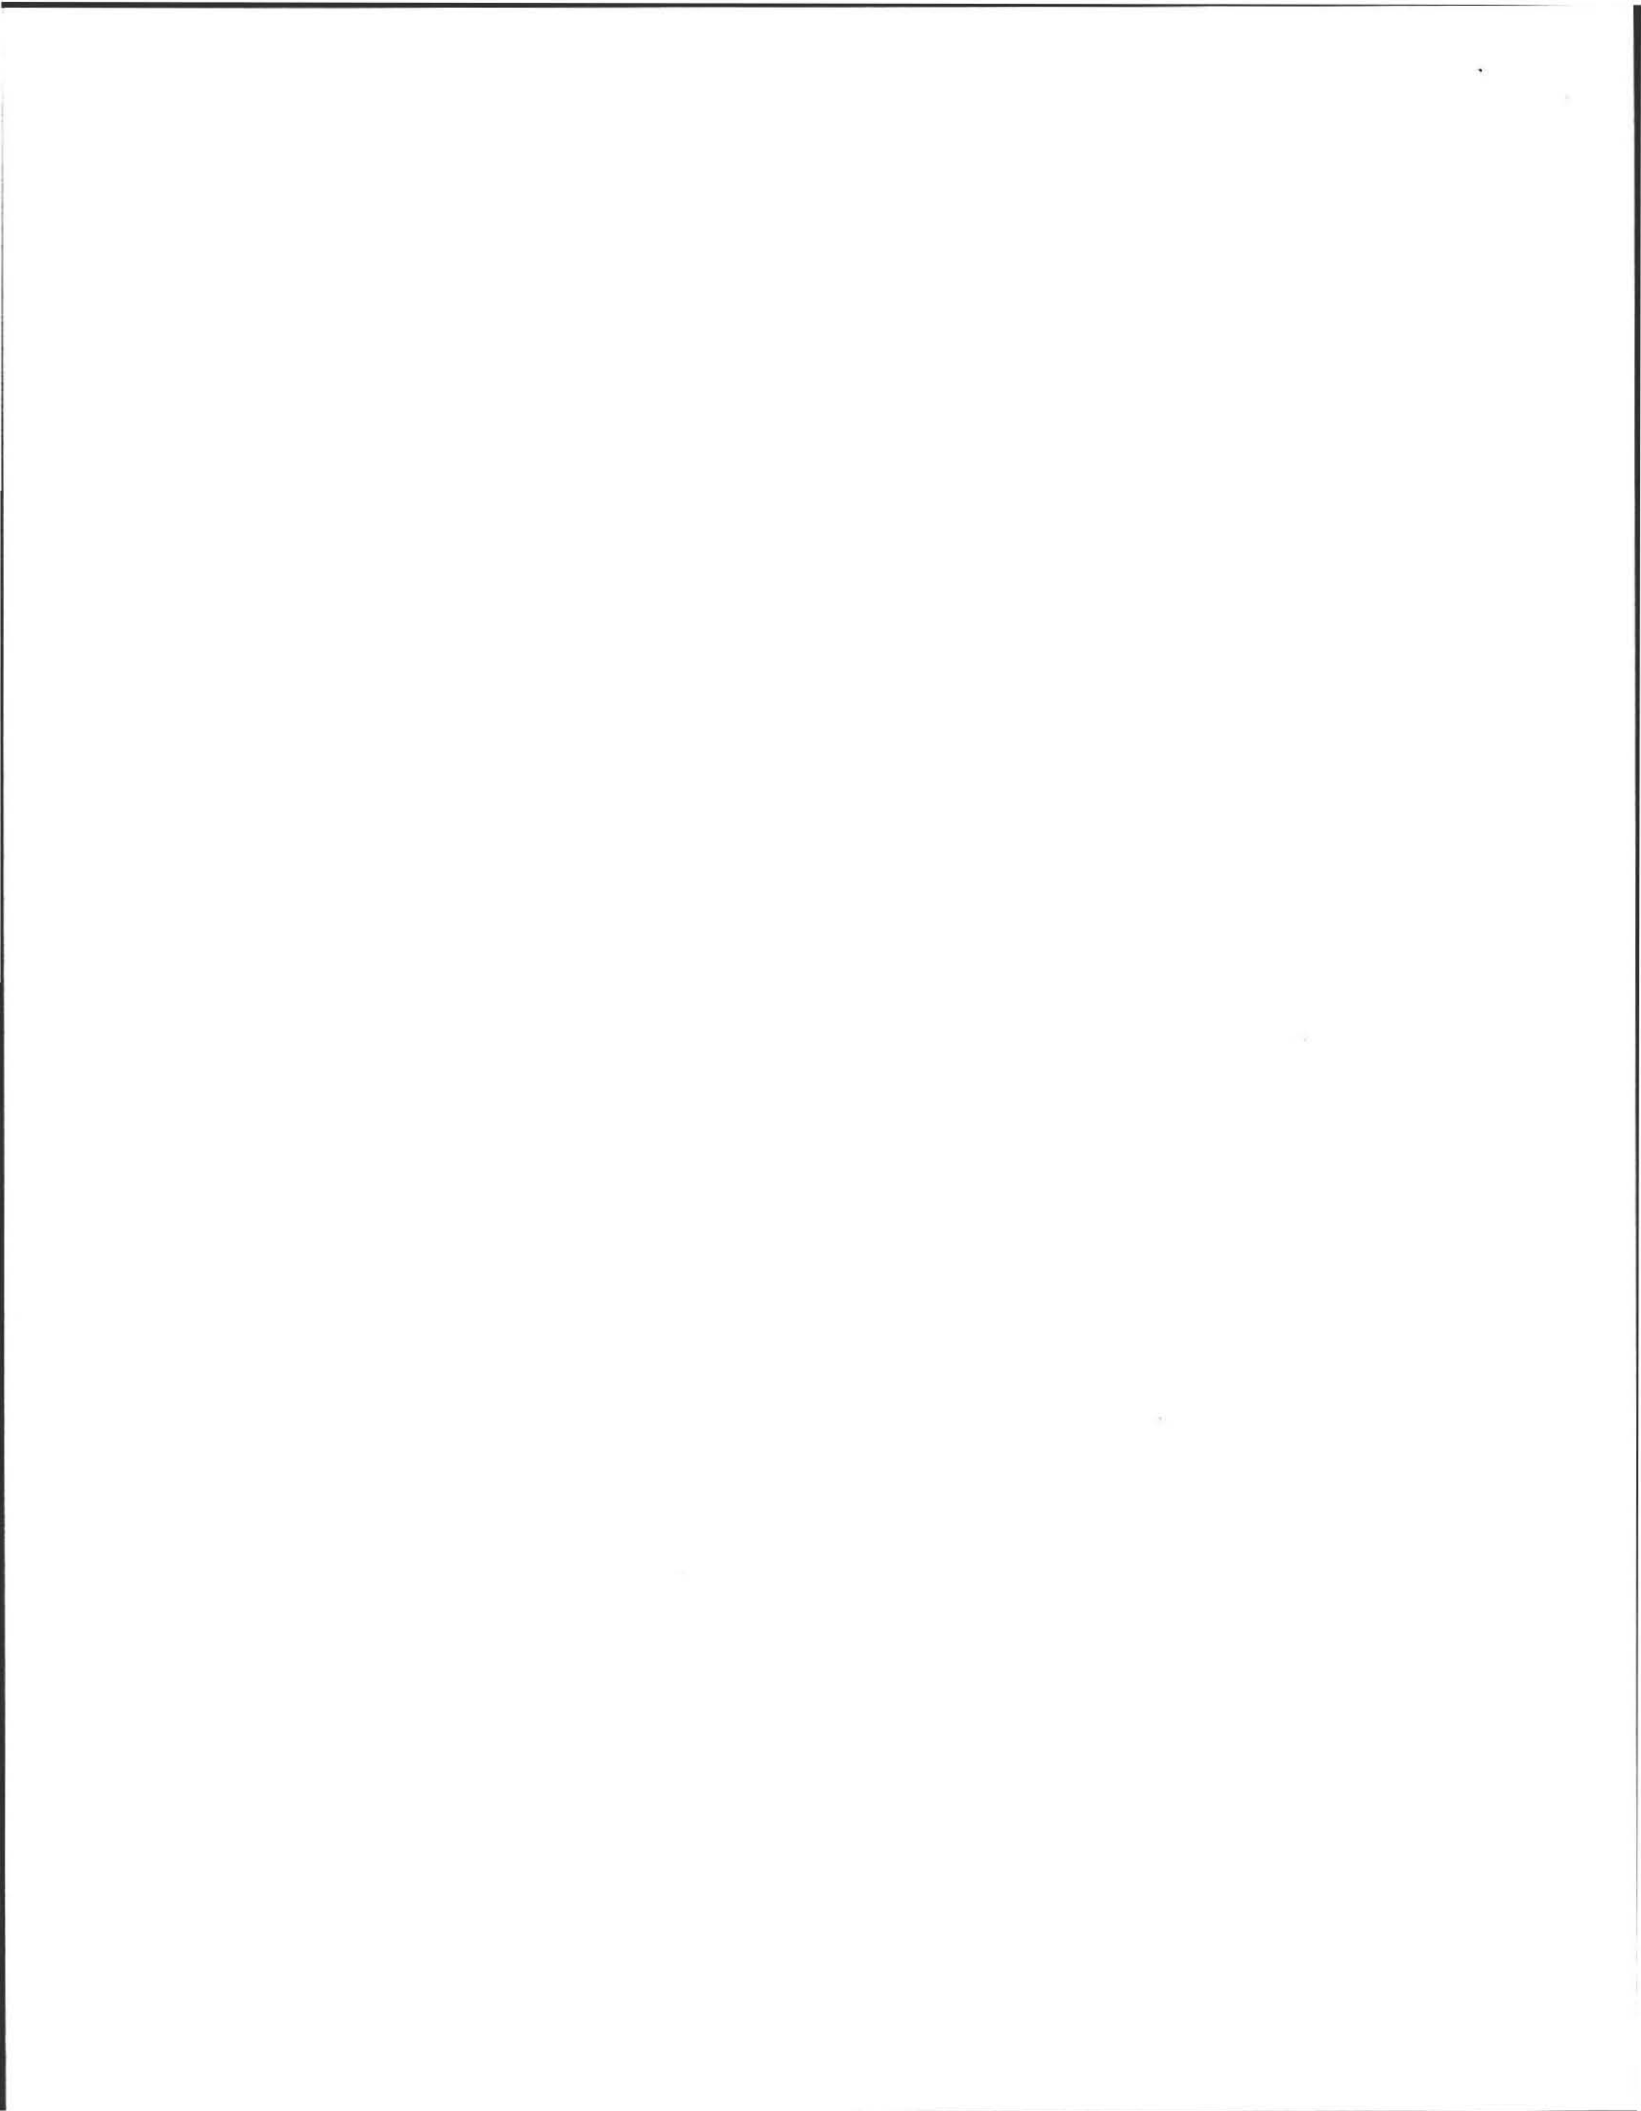



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## D. System Information (cont.)

Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.):

\_\_\_\_\_  
\_\_\_\_\_

**Soil Absorption System (SAS)** (locate on site plan, excavation not required):

If SAS not located, explain why:

3 lines noted out of D. box (size: 2' wx 1.2' d x 25' +/- trenches)

\_\_\_\_\_


Type:

- leaching pits number: \_\_\_\_\_
- leaching chambers number: \_\_\_\_\_
- leaching galleries number: \_\_\_\_\_
- leaching trenches number, length: 3 @ 2' x 25'
- leaching fields number, dimensions: \_\_\_\_\_
- overflow cesspool number: \_\_\_\_\_
- innovative/alternative system

Type/name of technology: \_\_\_\_\_

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.):

No evidence of hydraulic failure, soil at top good no stone staining. (No standing liquid in stone). Box ok.

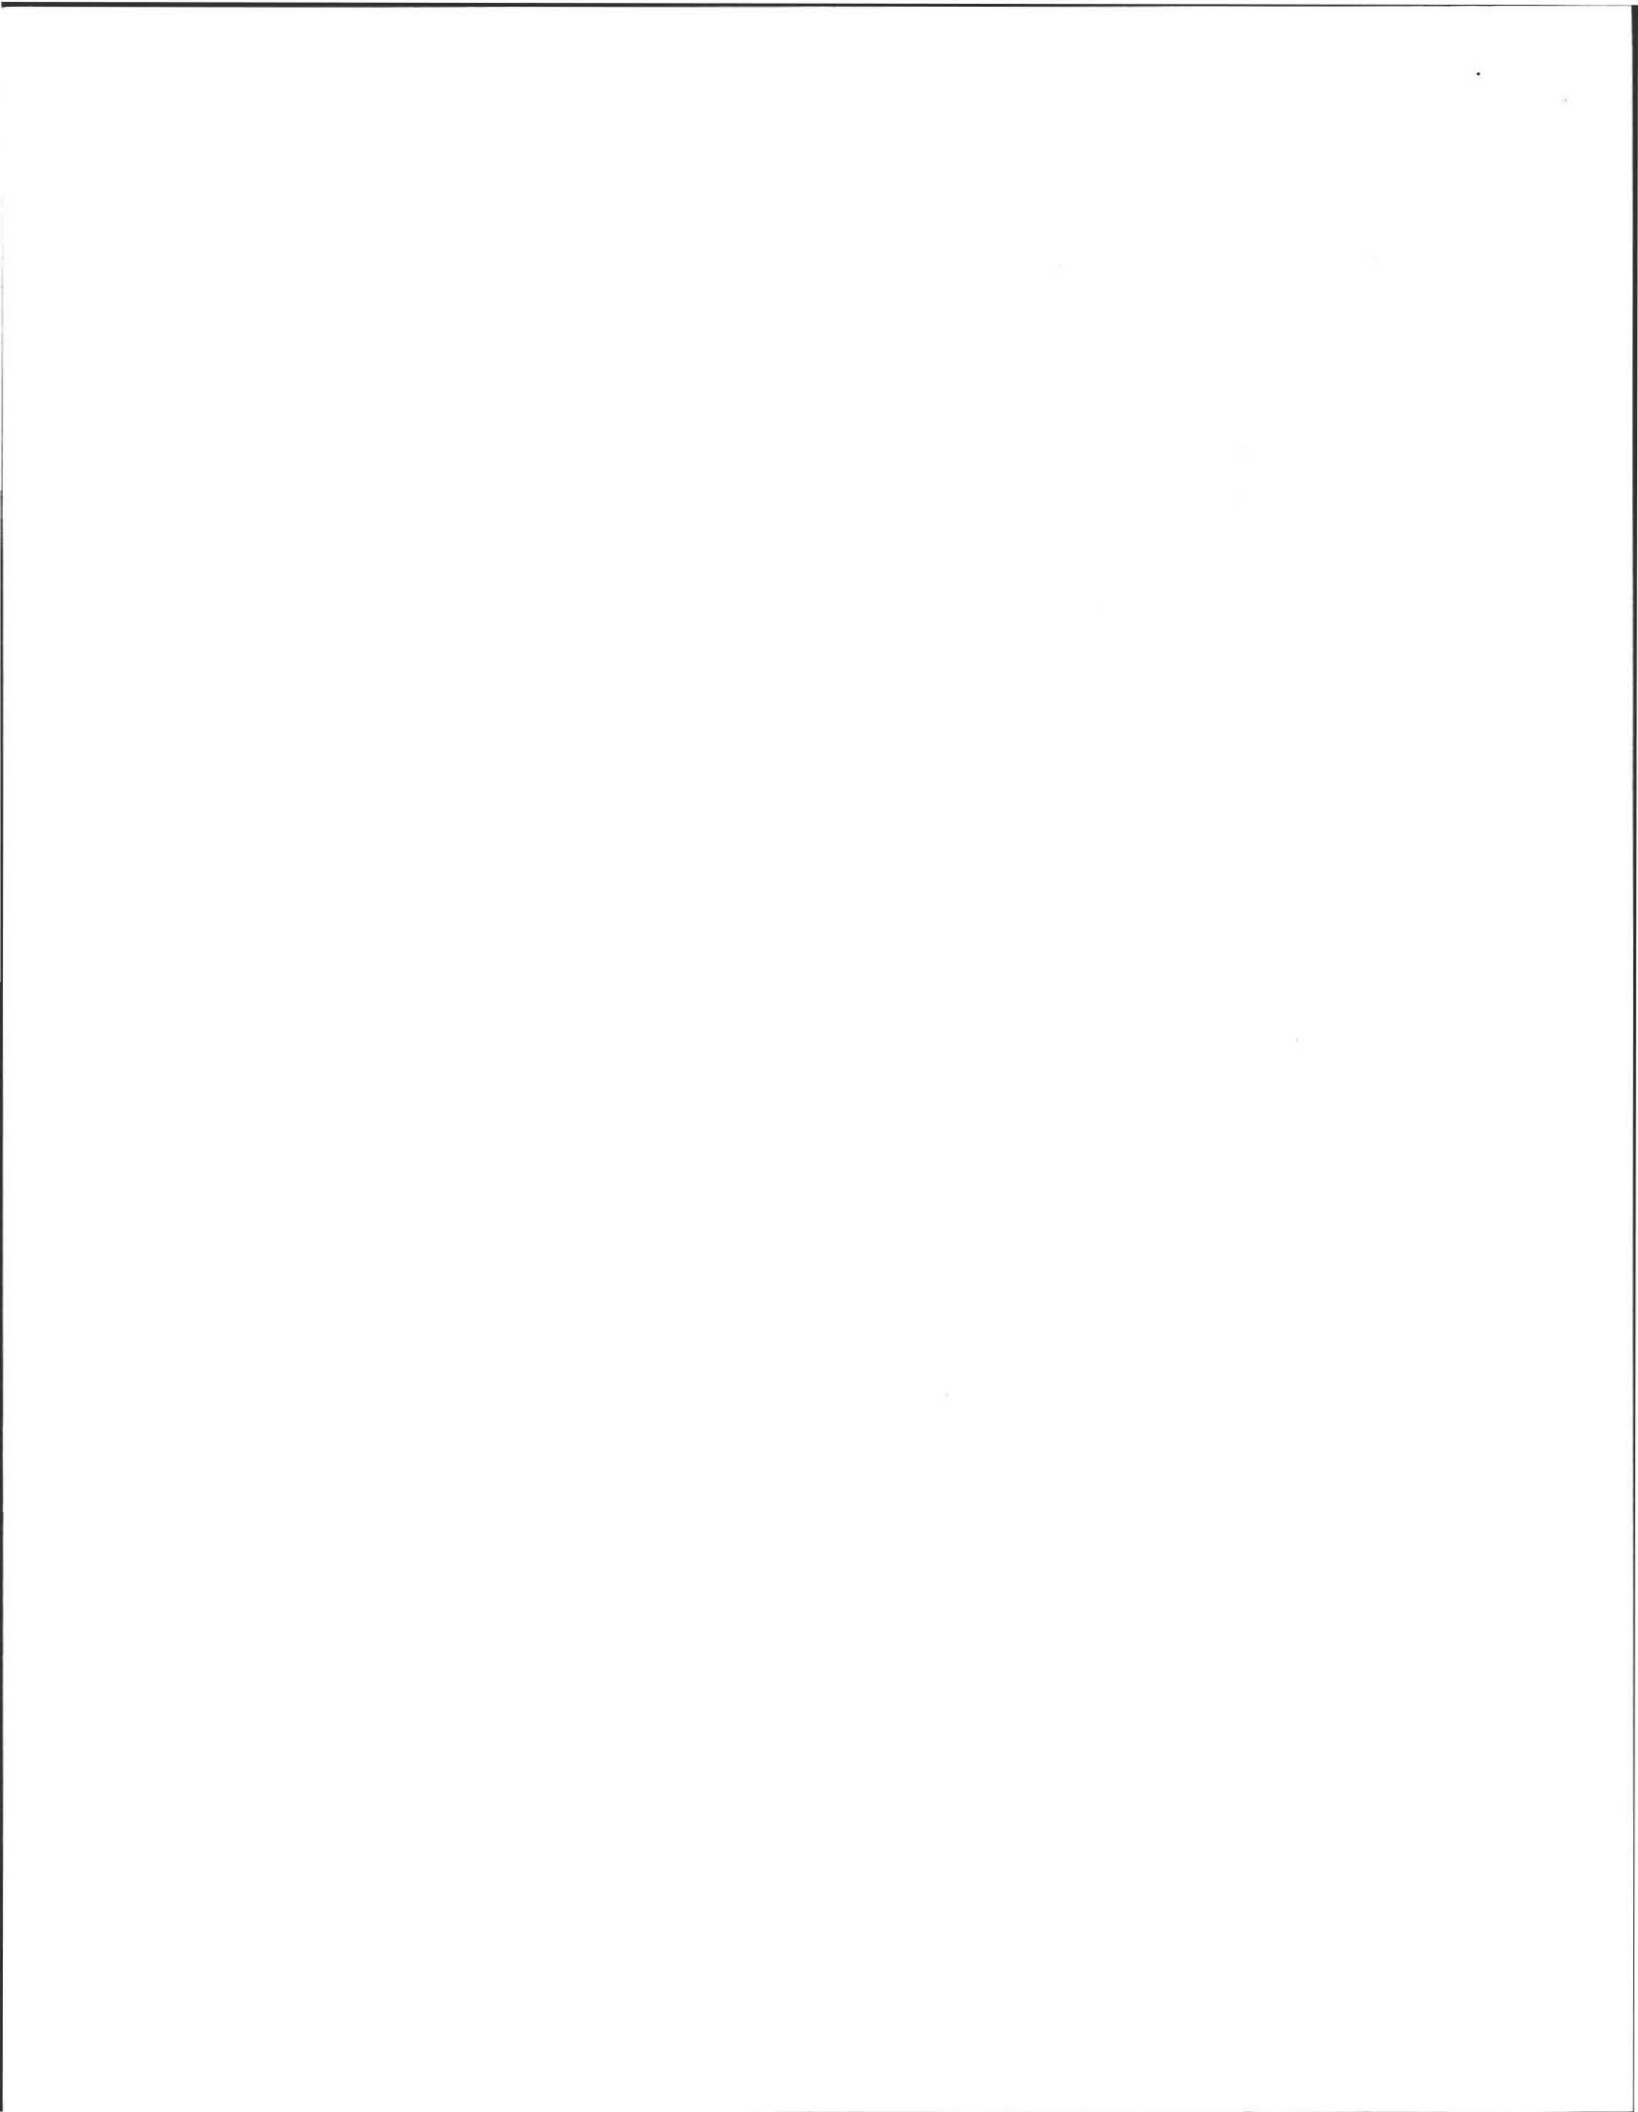



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## D. System Information (cont.)

**Cesspools** (cesspool must be pumped as part of inspection) (locate on site plan):

Number and configuration \_\_\_\_\_

Depth – top of liquid to inlet invert \_\_\_\_\_

Depth of solids layer \_\_\_\_\_

Depth of scum layer \_\_\_\_\_

Dimensions of cesspool \_\_\_\_\_

Materials of construction \_\_\_\_\_

Indication of groundwater inflow

Yes

No

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

\_\_\_\_\_  
\_\_\_\_\_

**Privy** (locate on site plan):

Materials of construction:

N/A

Dimensions

N/A


Depth of solids

N/A

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

N/A

\_\_\_\_\_

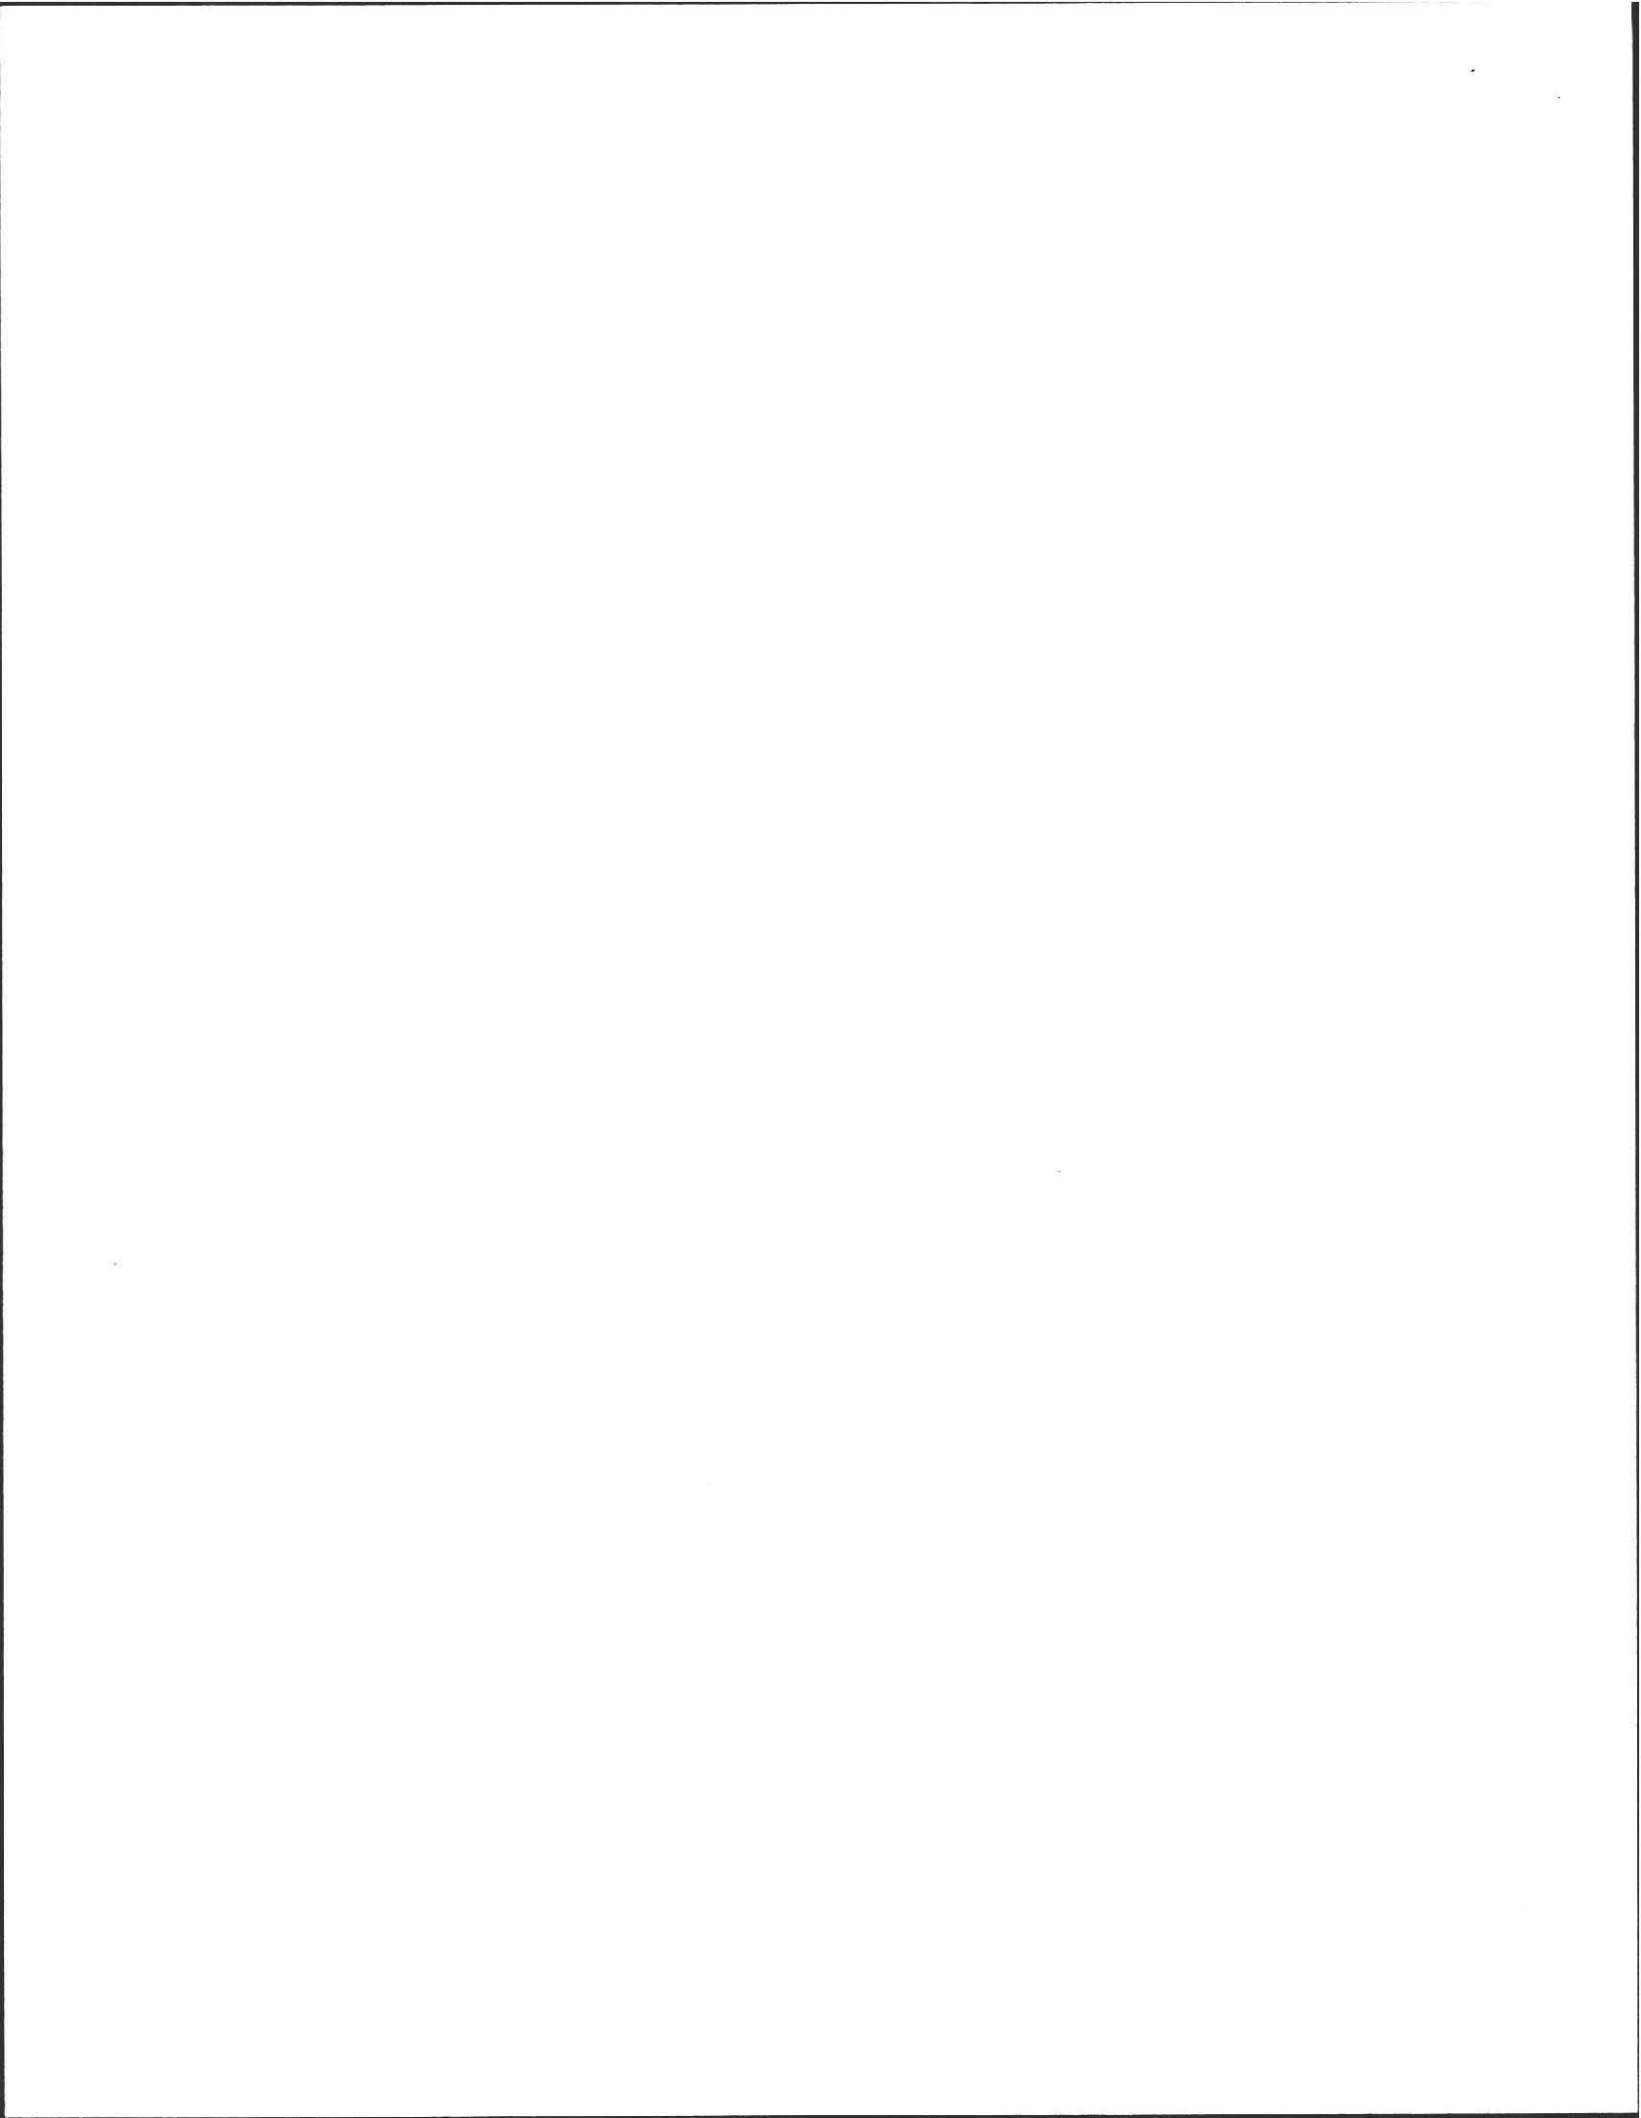





Commonwealth of Massachusetts  
**Title 5 Official Inspection Form**  
 Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road  
 Property Address

John Sykowski  
 Owner's Name


Amherst MA 01002  
 City/Town State Zip Code


04.01.2009  
 Date of Inspection

Owner information is required for every page.

**D. System Information (cont.)**

Sketch Of Sewage Disposal System: Provide a sketch of the sewage disposal system including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building.

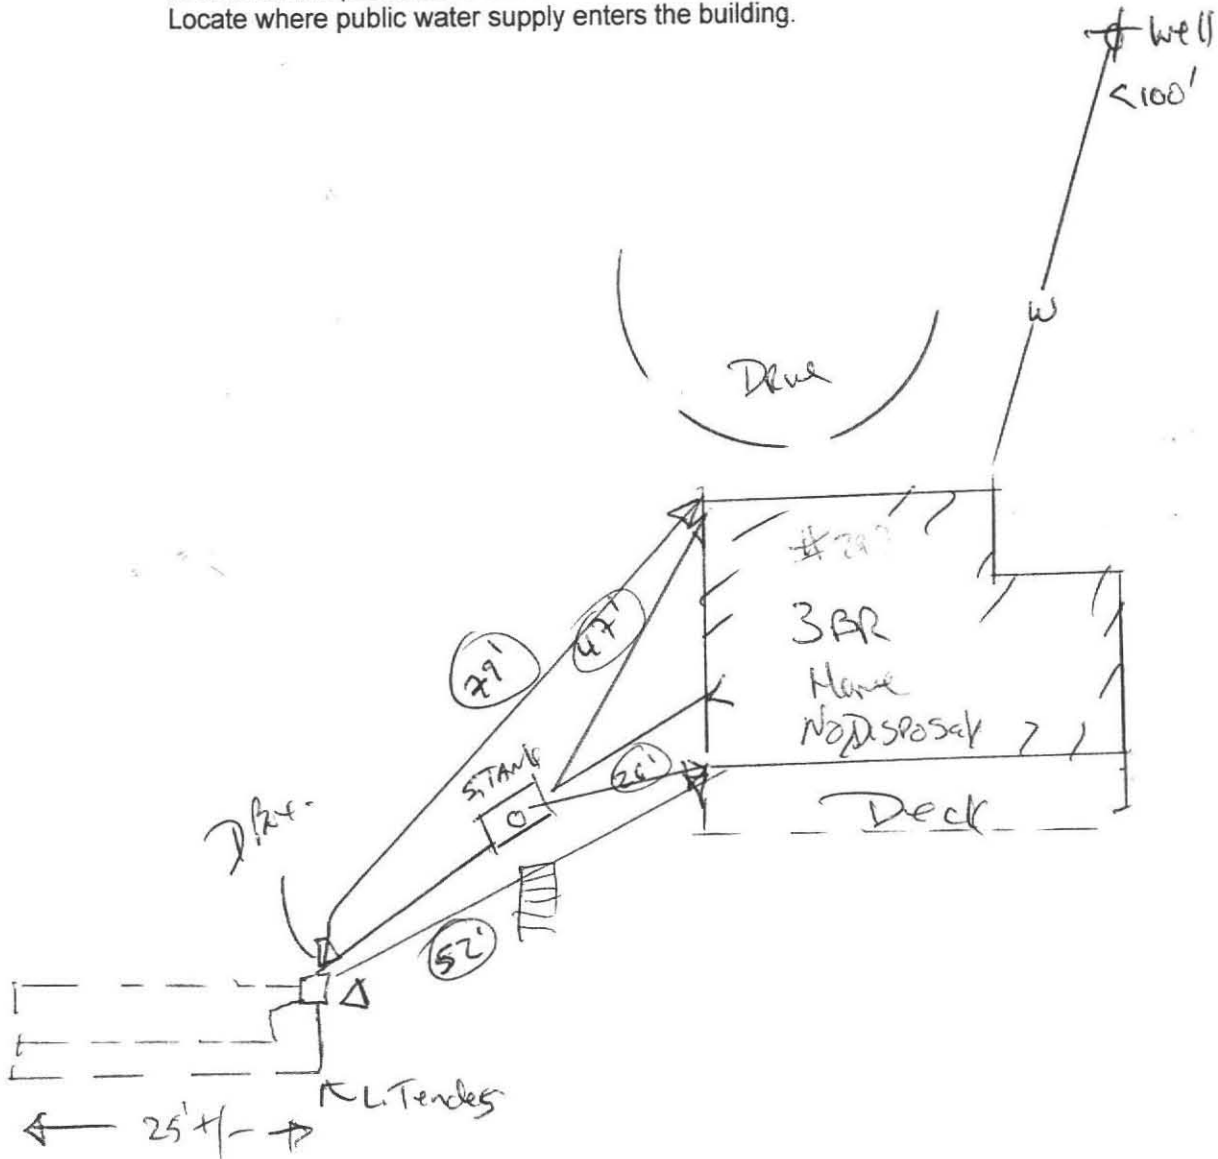

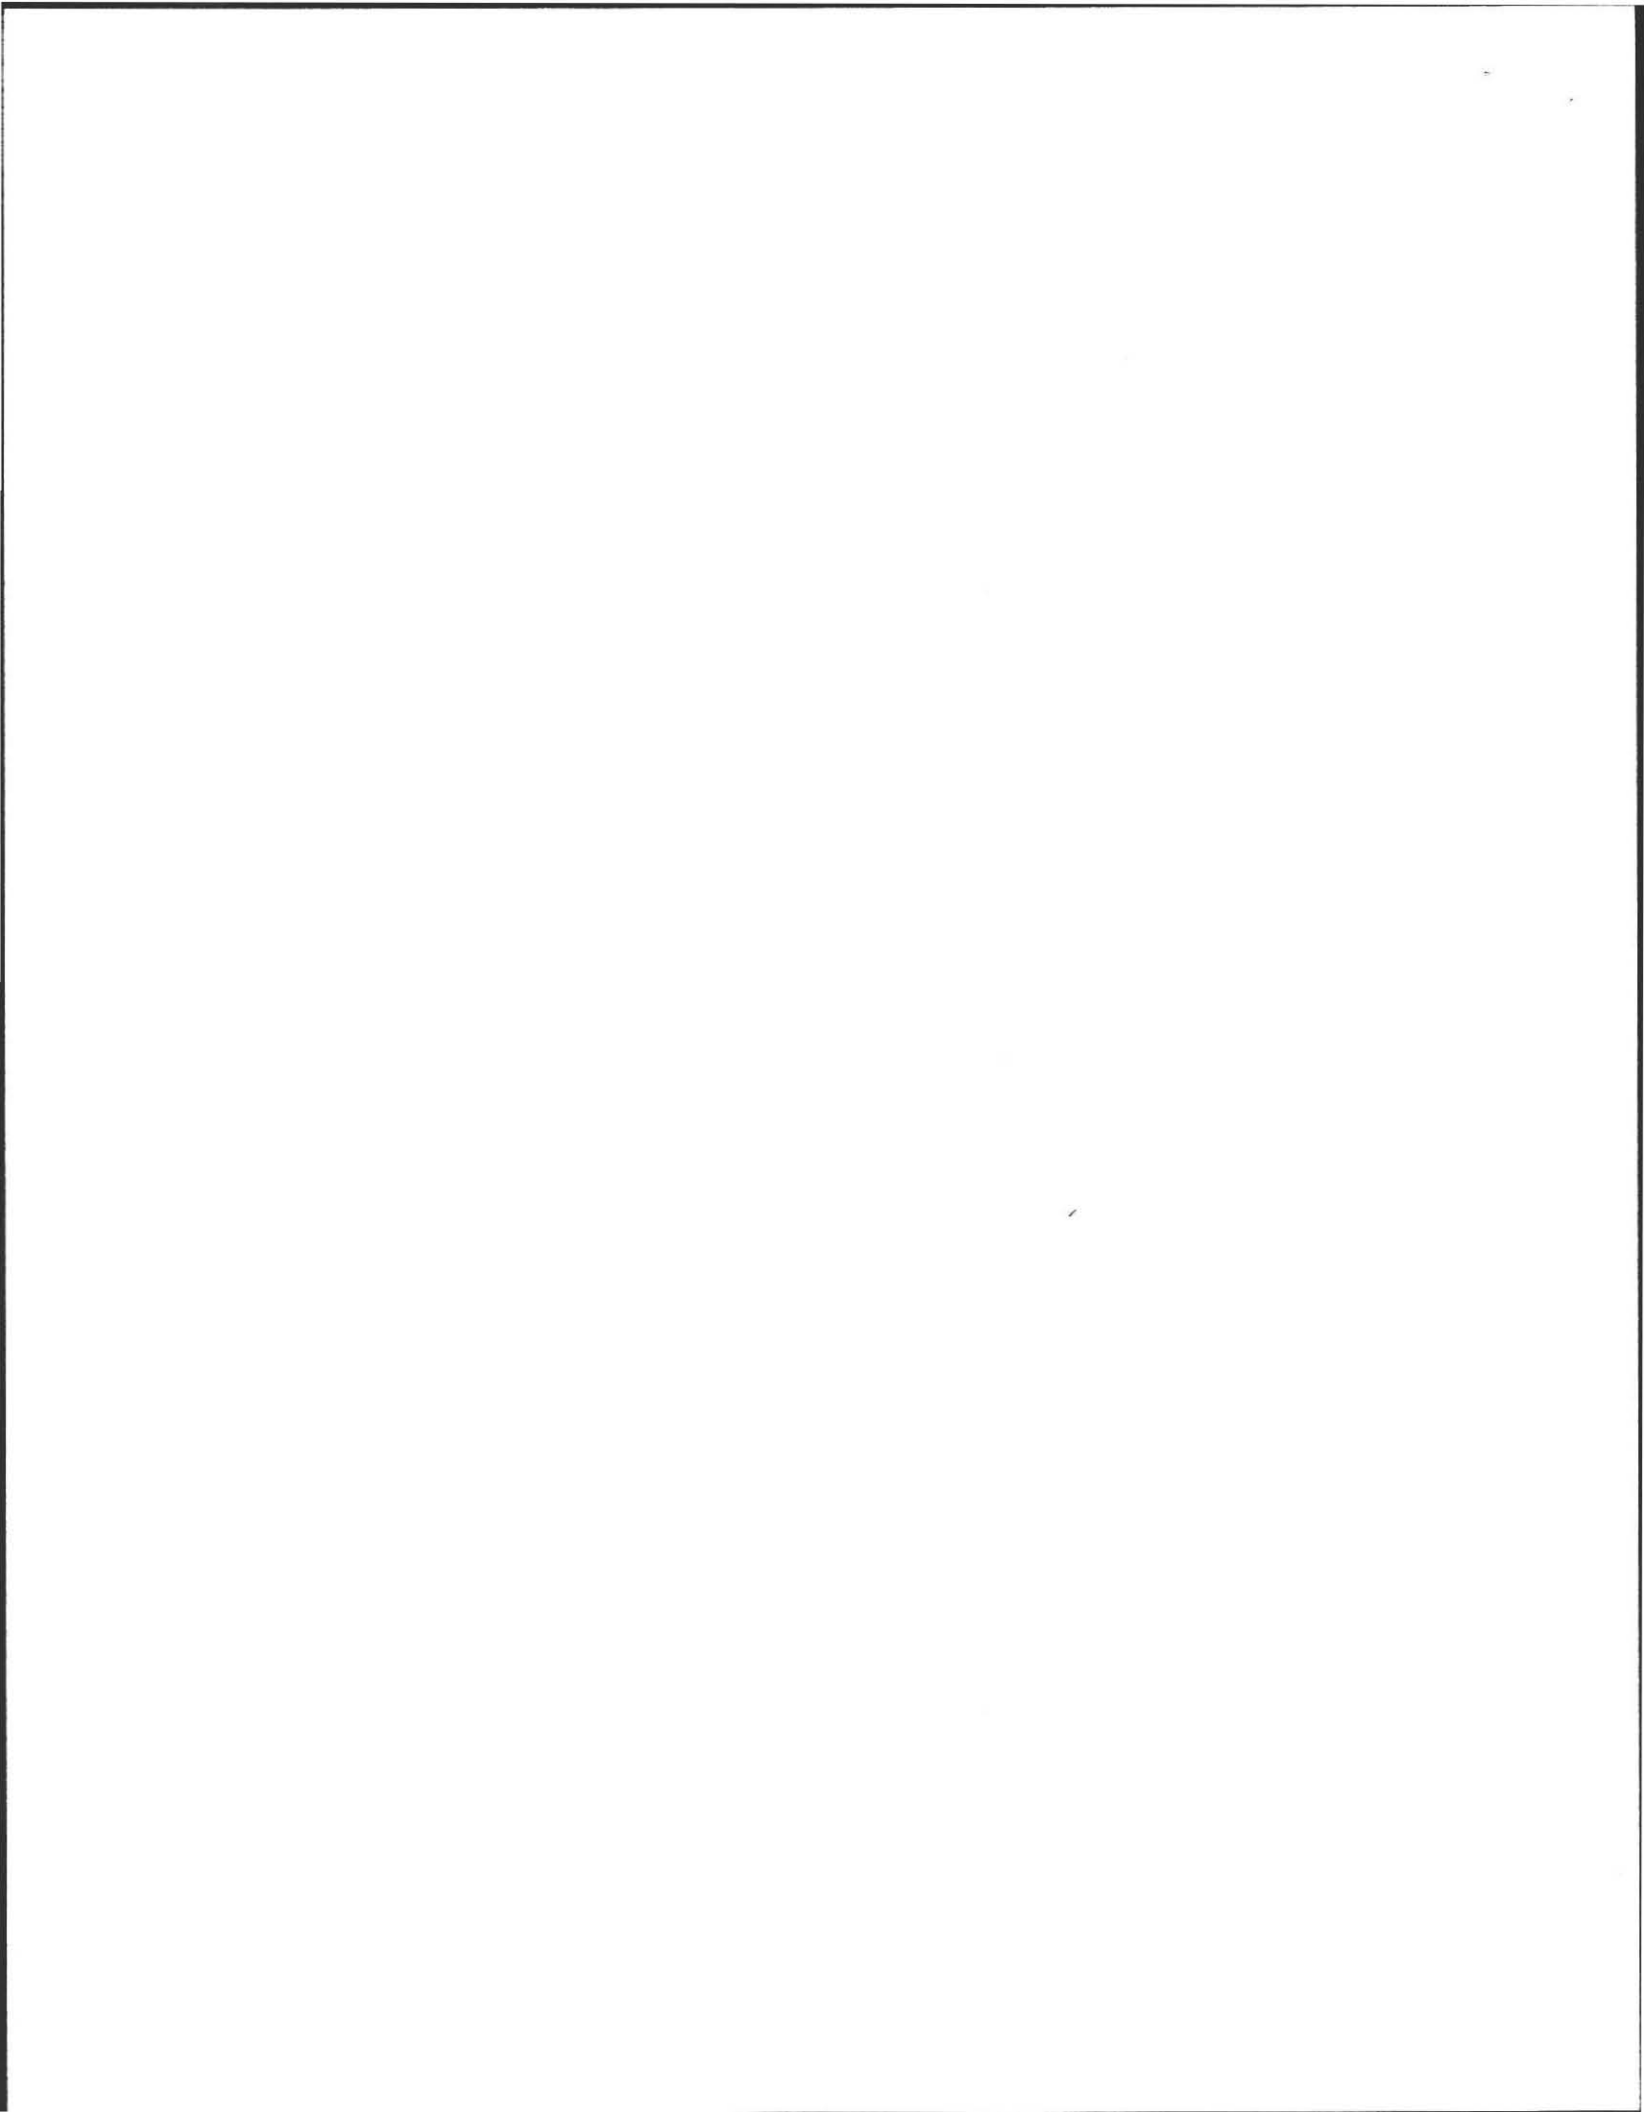



# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

297 Shutesbury Road

Property Address

John Sykowski

Owner's Name

Amherst

City/Town

MA

State

01002

Zip Code

04.01.2009

Date of Inspection

Owner information is required for every page.

## D. System Information (cont.)

### Site Exam:

Check Slope

Surface water

Check cellar

Shallow wells

Estimated depth to ground water:

4-5'+ ( records, perc. 1984, Filios and Sieruta T-5, 2000)

Please indicate all methods used to determine the high ground water elevation:

Obtained from system design plans on record

If checked, date of design plan reviewed: n/A  
Date

Observed site (abutting property/observation hole within 150 feet of SAS)


Checked with local Board of Health - explain:  
\_\_\_\_\_

Checked with local excavators, installers - (attach documentation)

Accessed USGS database - explain:  
\_\_\_\_\_

You **must** describe how you established the high ground water elevation:

Records attached  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

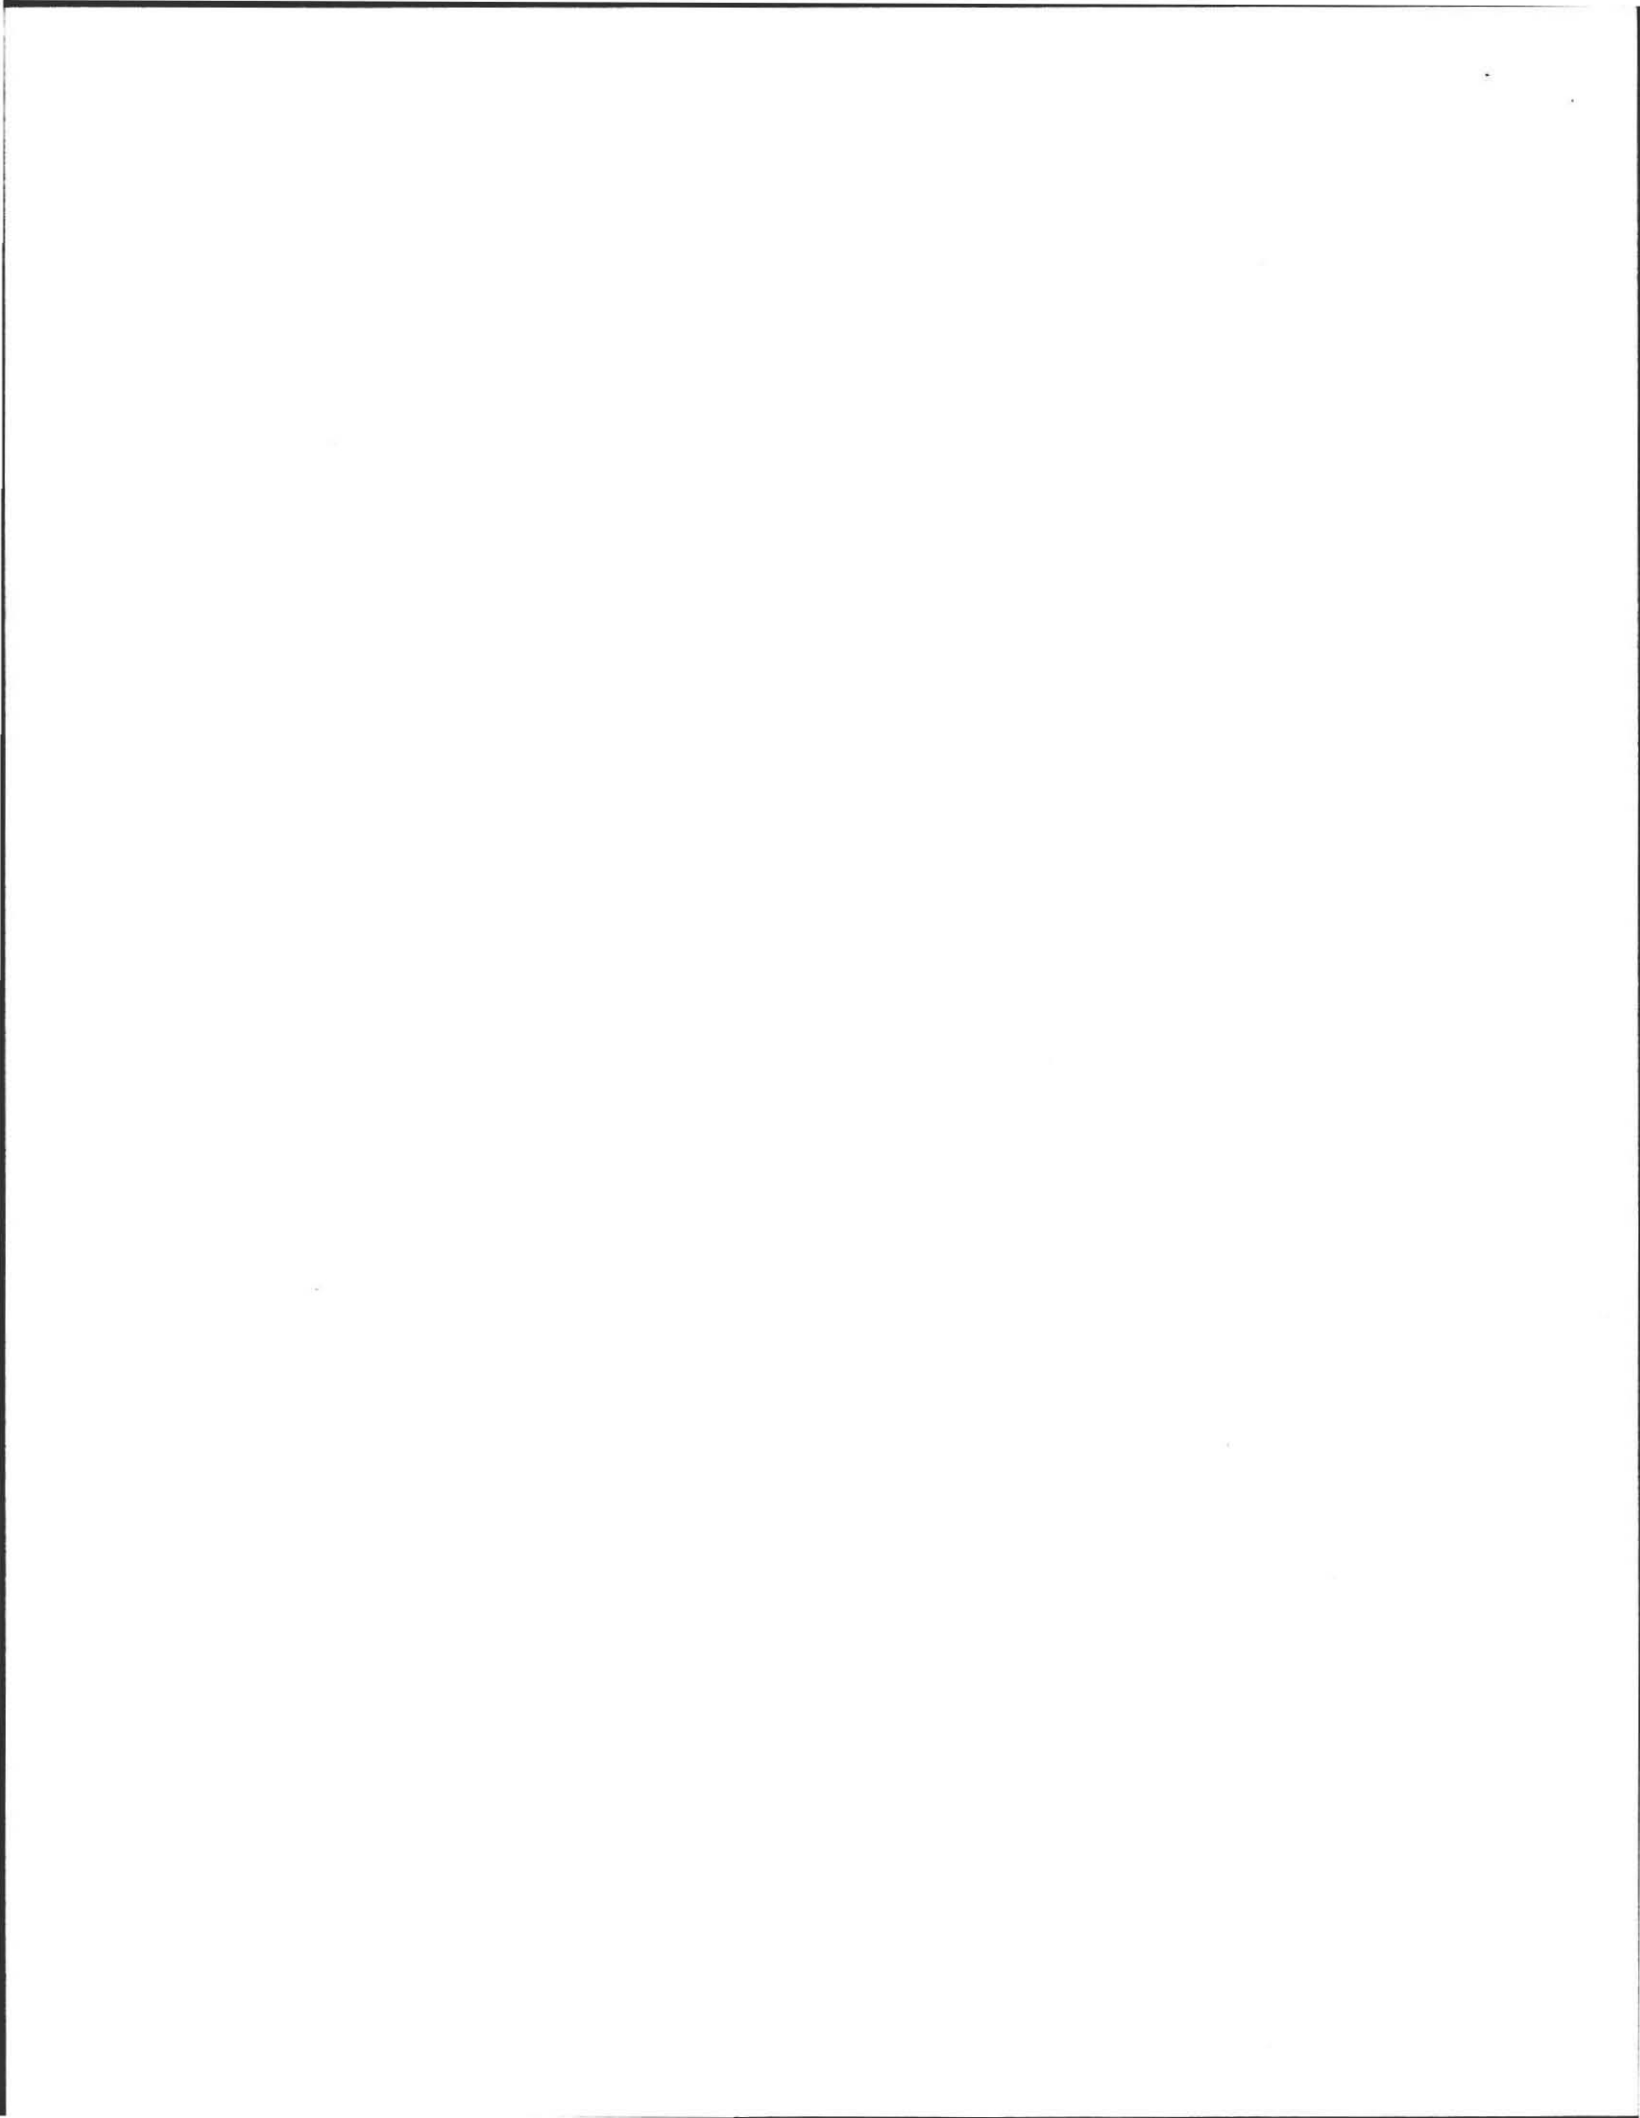

SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM  
PART C

G. Donnelly SYSTEM INFORMATION (continued)

Property Address: 297 SHULESBURY RD  
Owner: AMHERST, MASS 01002  
Date of Inspection: 3/21/00

Depth to Groundwater 4 Feet

Please Indicate all the methods used to determine High-Groundwater Elevation:

- Obtained from Design Plans on record
- Observation of Site (Abutting property, observation hole, basement sump etc.)
- Determine it from local conditions
- Check with local Board of health

- DNA Check FEMA Maps
- DNA Check pumping records
- Check local excavators, installers

DNA Use USGS Data

Describe in your own words how you established the High Groundwater Elevation. (Must be completed)


TEST PIT DUG AT SITE

0-8 Ap SANDY LOAM OTS  
104R4-2 TOP SOIL

8-16 Bw SANDY LOAM SANDY  
104R5-4 SUB SOIL


16-96 C1 sandy loam SANDY gravel  
104R4-4 till slightly  
FIRM

Stopped hole @ 96"  
NO H2O  
No weeping  
mottling @ 80" & HWT 80"



3/21/00 WSS





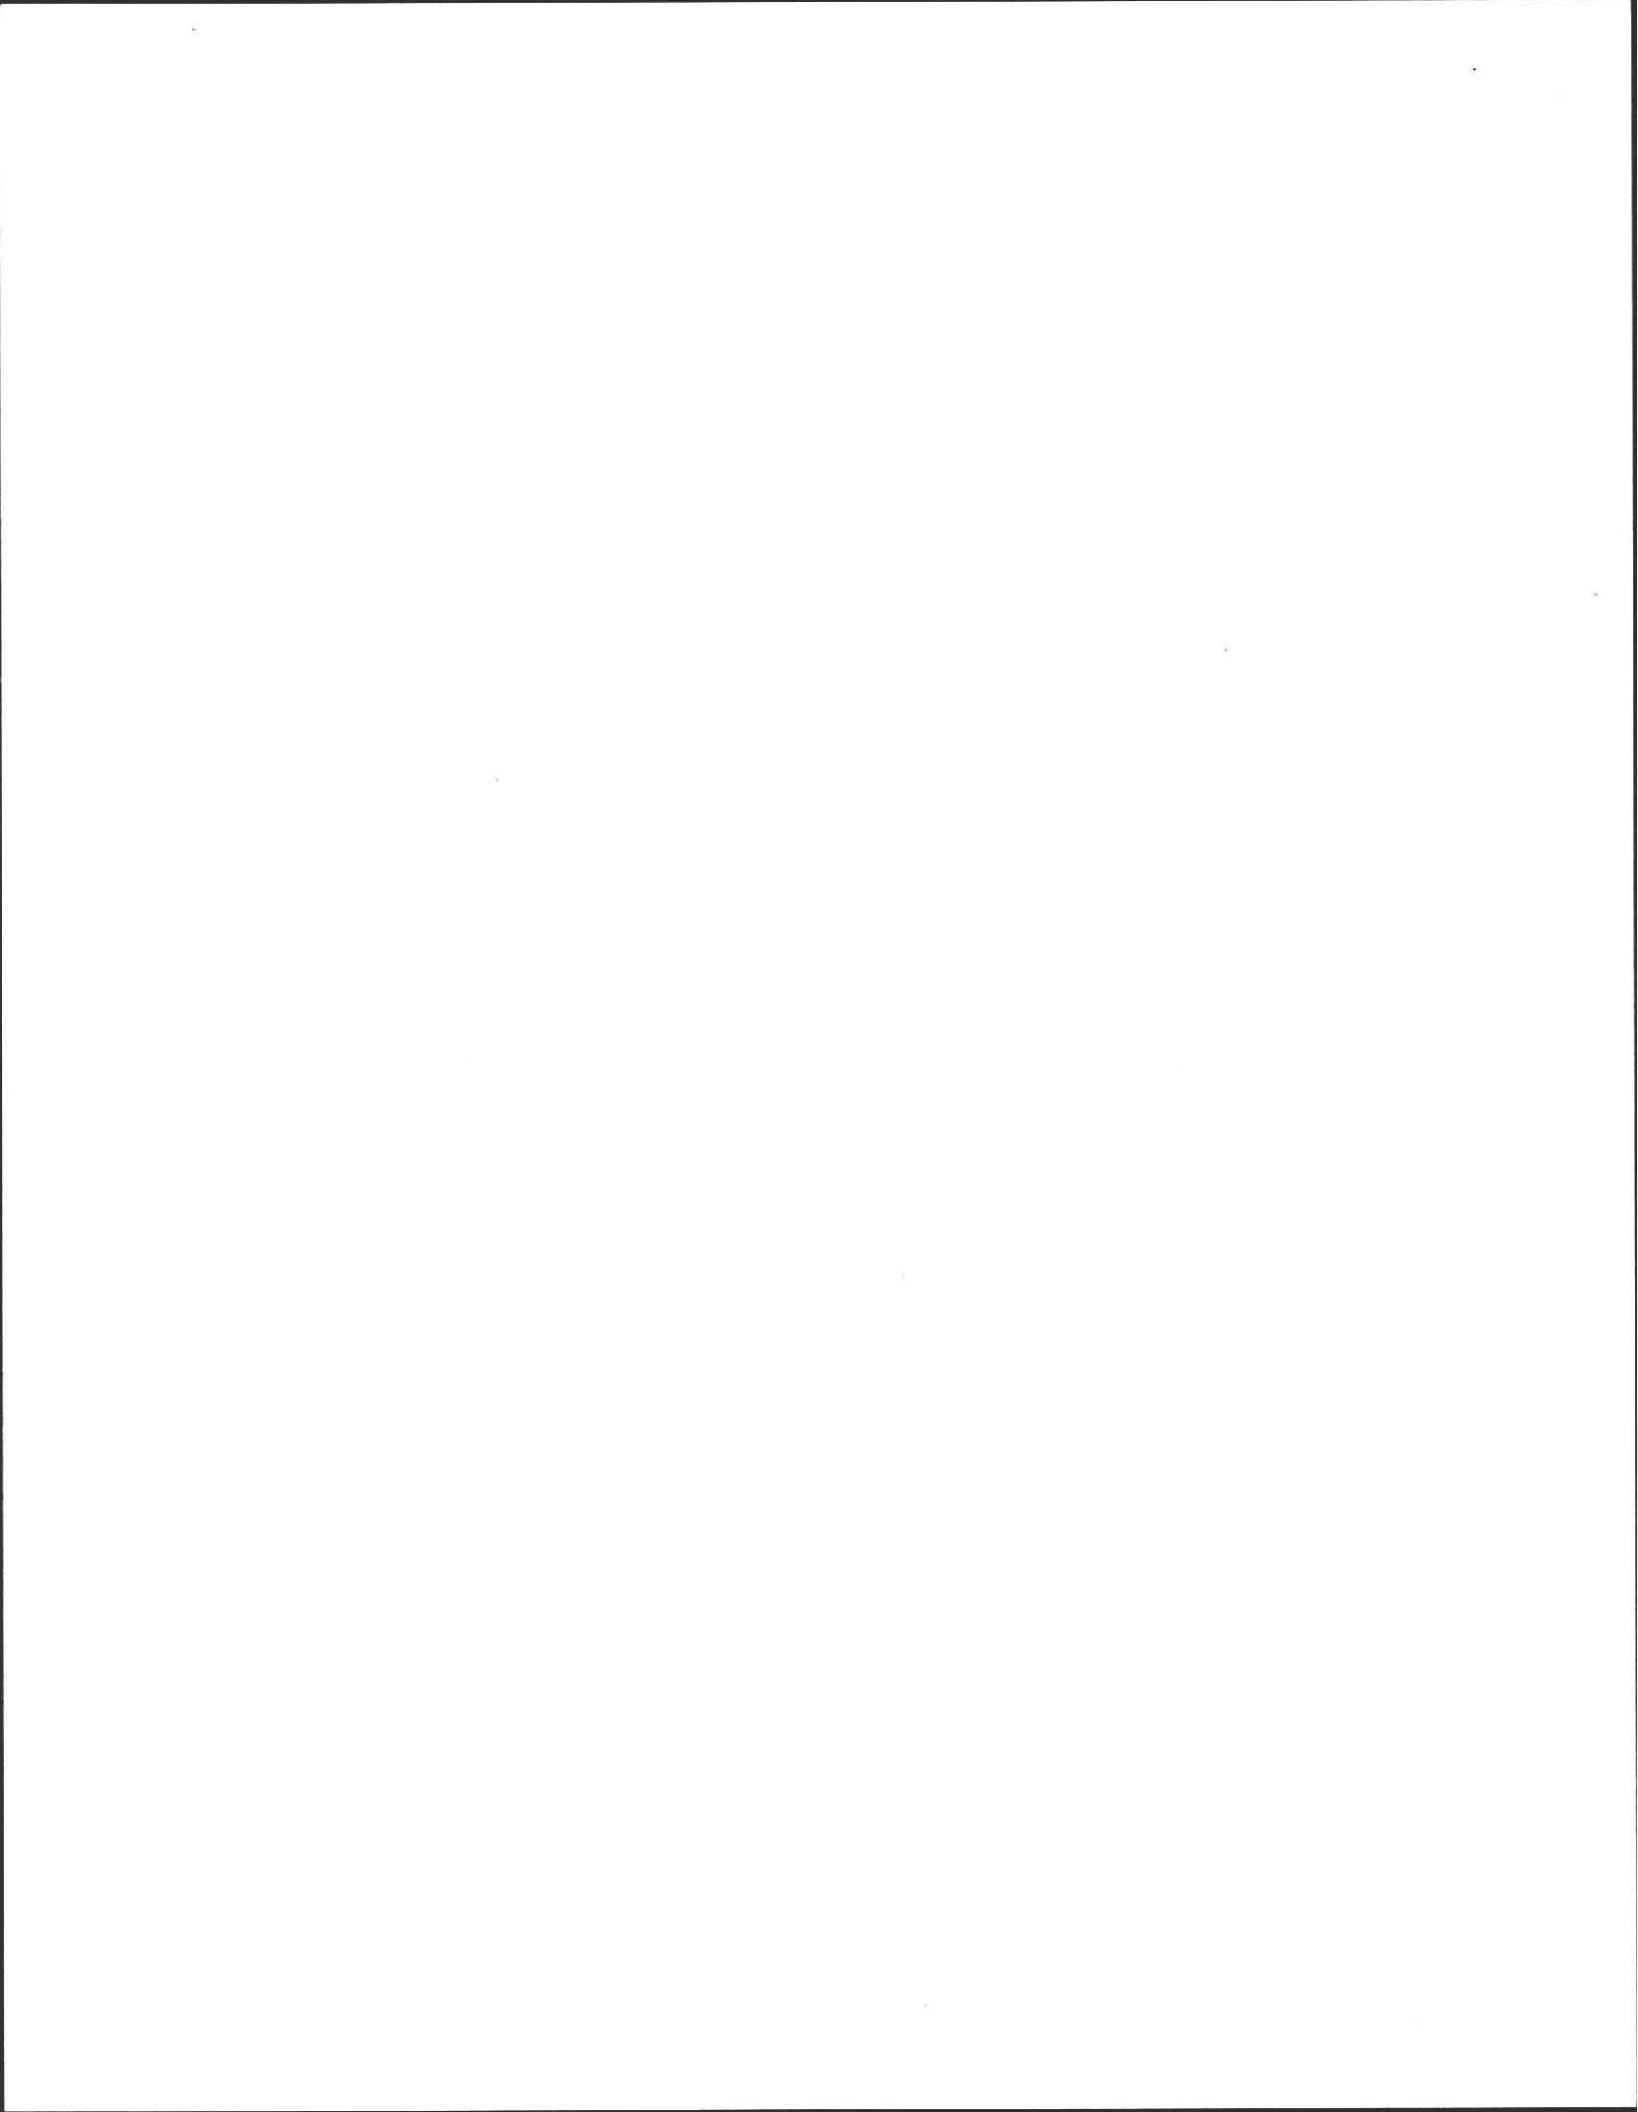

# PROFILE OF SEPTIC SYSTEM

FOR: VAN STODDARD  
157 CAVE HILL RD.  
LEVERETT, MA.

BY: FREDERICK FILIOS  
MARCH 1985  
SCALE: HOR. 1" = 10'; VERT. 1" = 3'

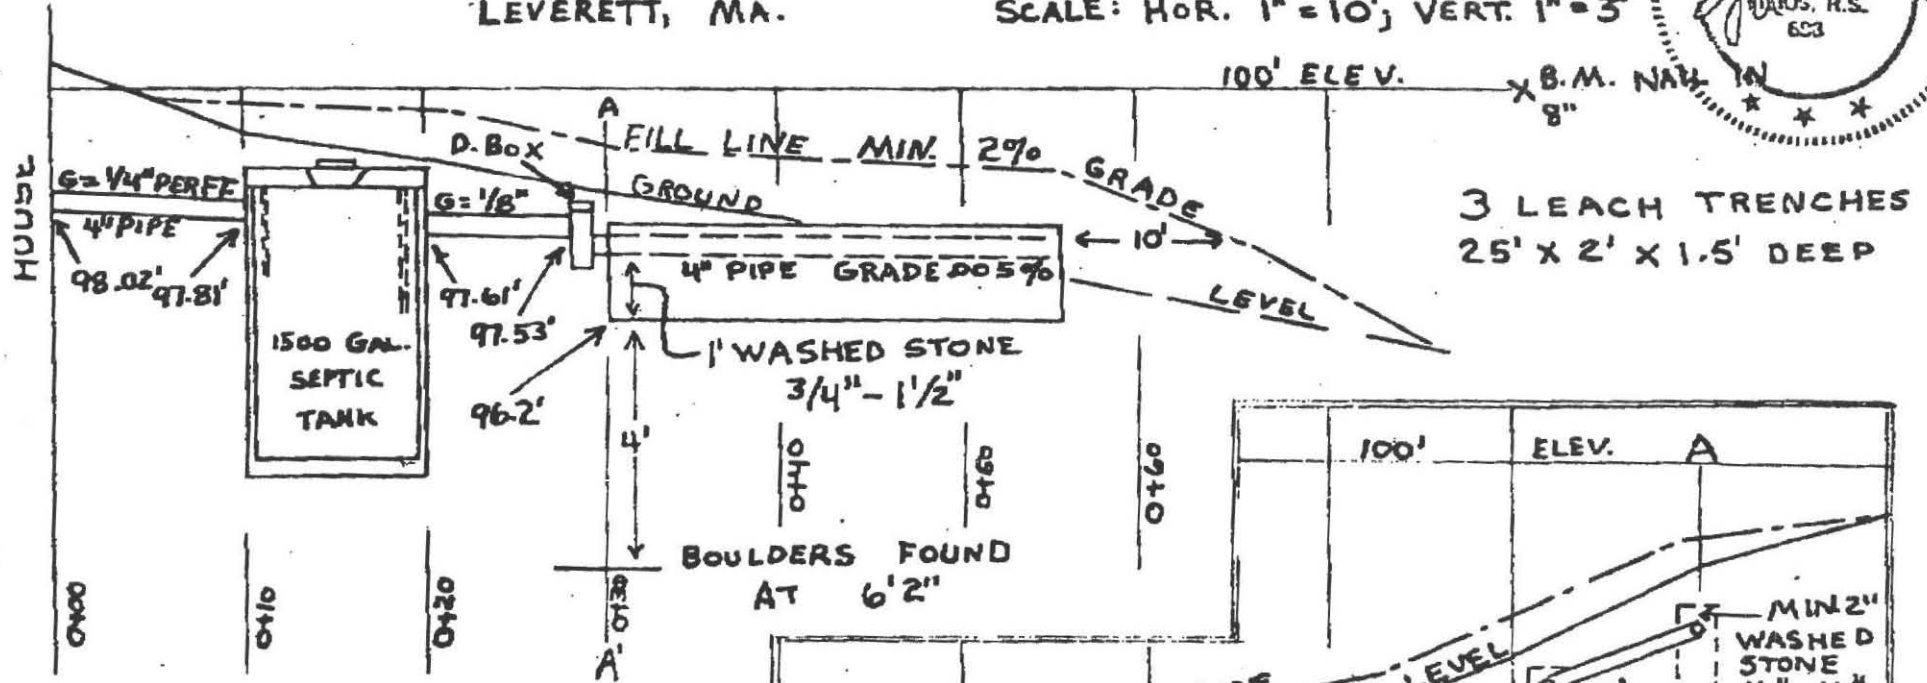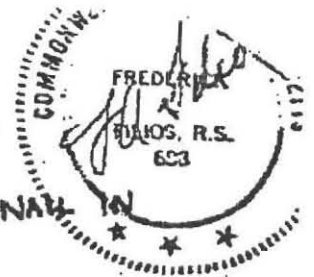



## CALCULATIONS:

3 BDRMS @ 110 = 330 + GARBAGE GRINDER = 495  
495 GALS. REQ. PERC. RATE @ 2 MIN./IN.  
SIDES: 25' X 2 SIDES X 2.5 GALS. PER S.F. = 125 GALS.  
BTM: 25' X 2' WIDE X 1 GAL. PER S.F. = 50 GALS.  
125 + 50 = 175 X 3 TRENCHES = 525 GALS.

## SPECIFICATIONS:

ALL MATERIALS AND CONSTRUCTION  
WILL BE IN ACCORDANCE WITH COMM.  
OF MASS. D.E.Q.E. STATE ENVIRON-  
MENTAL CODE TITLE 5.

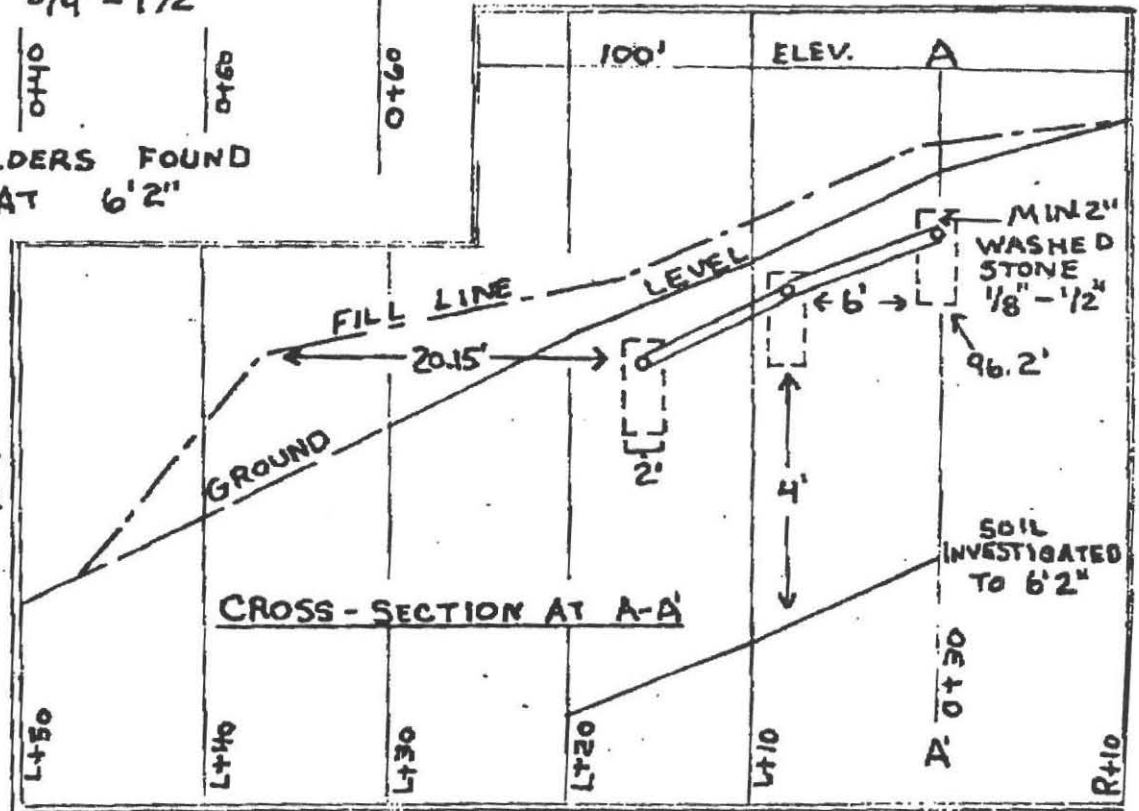

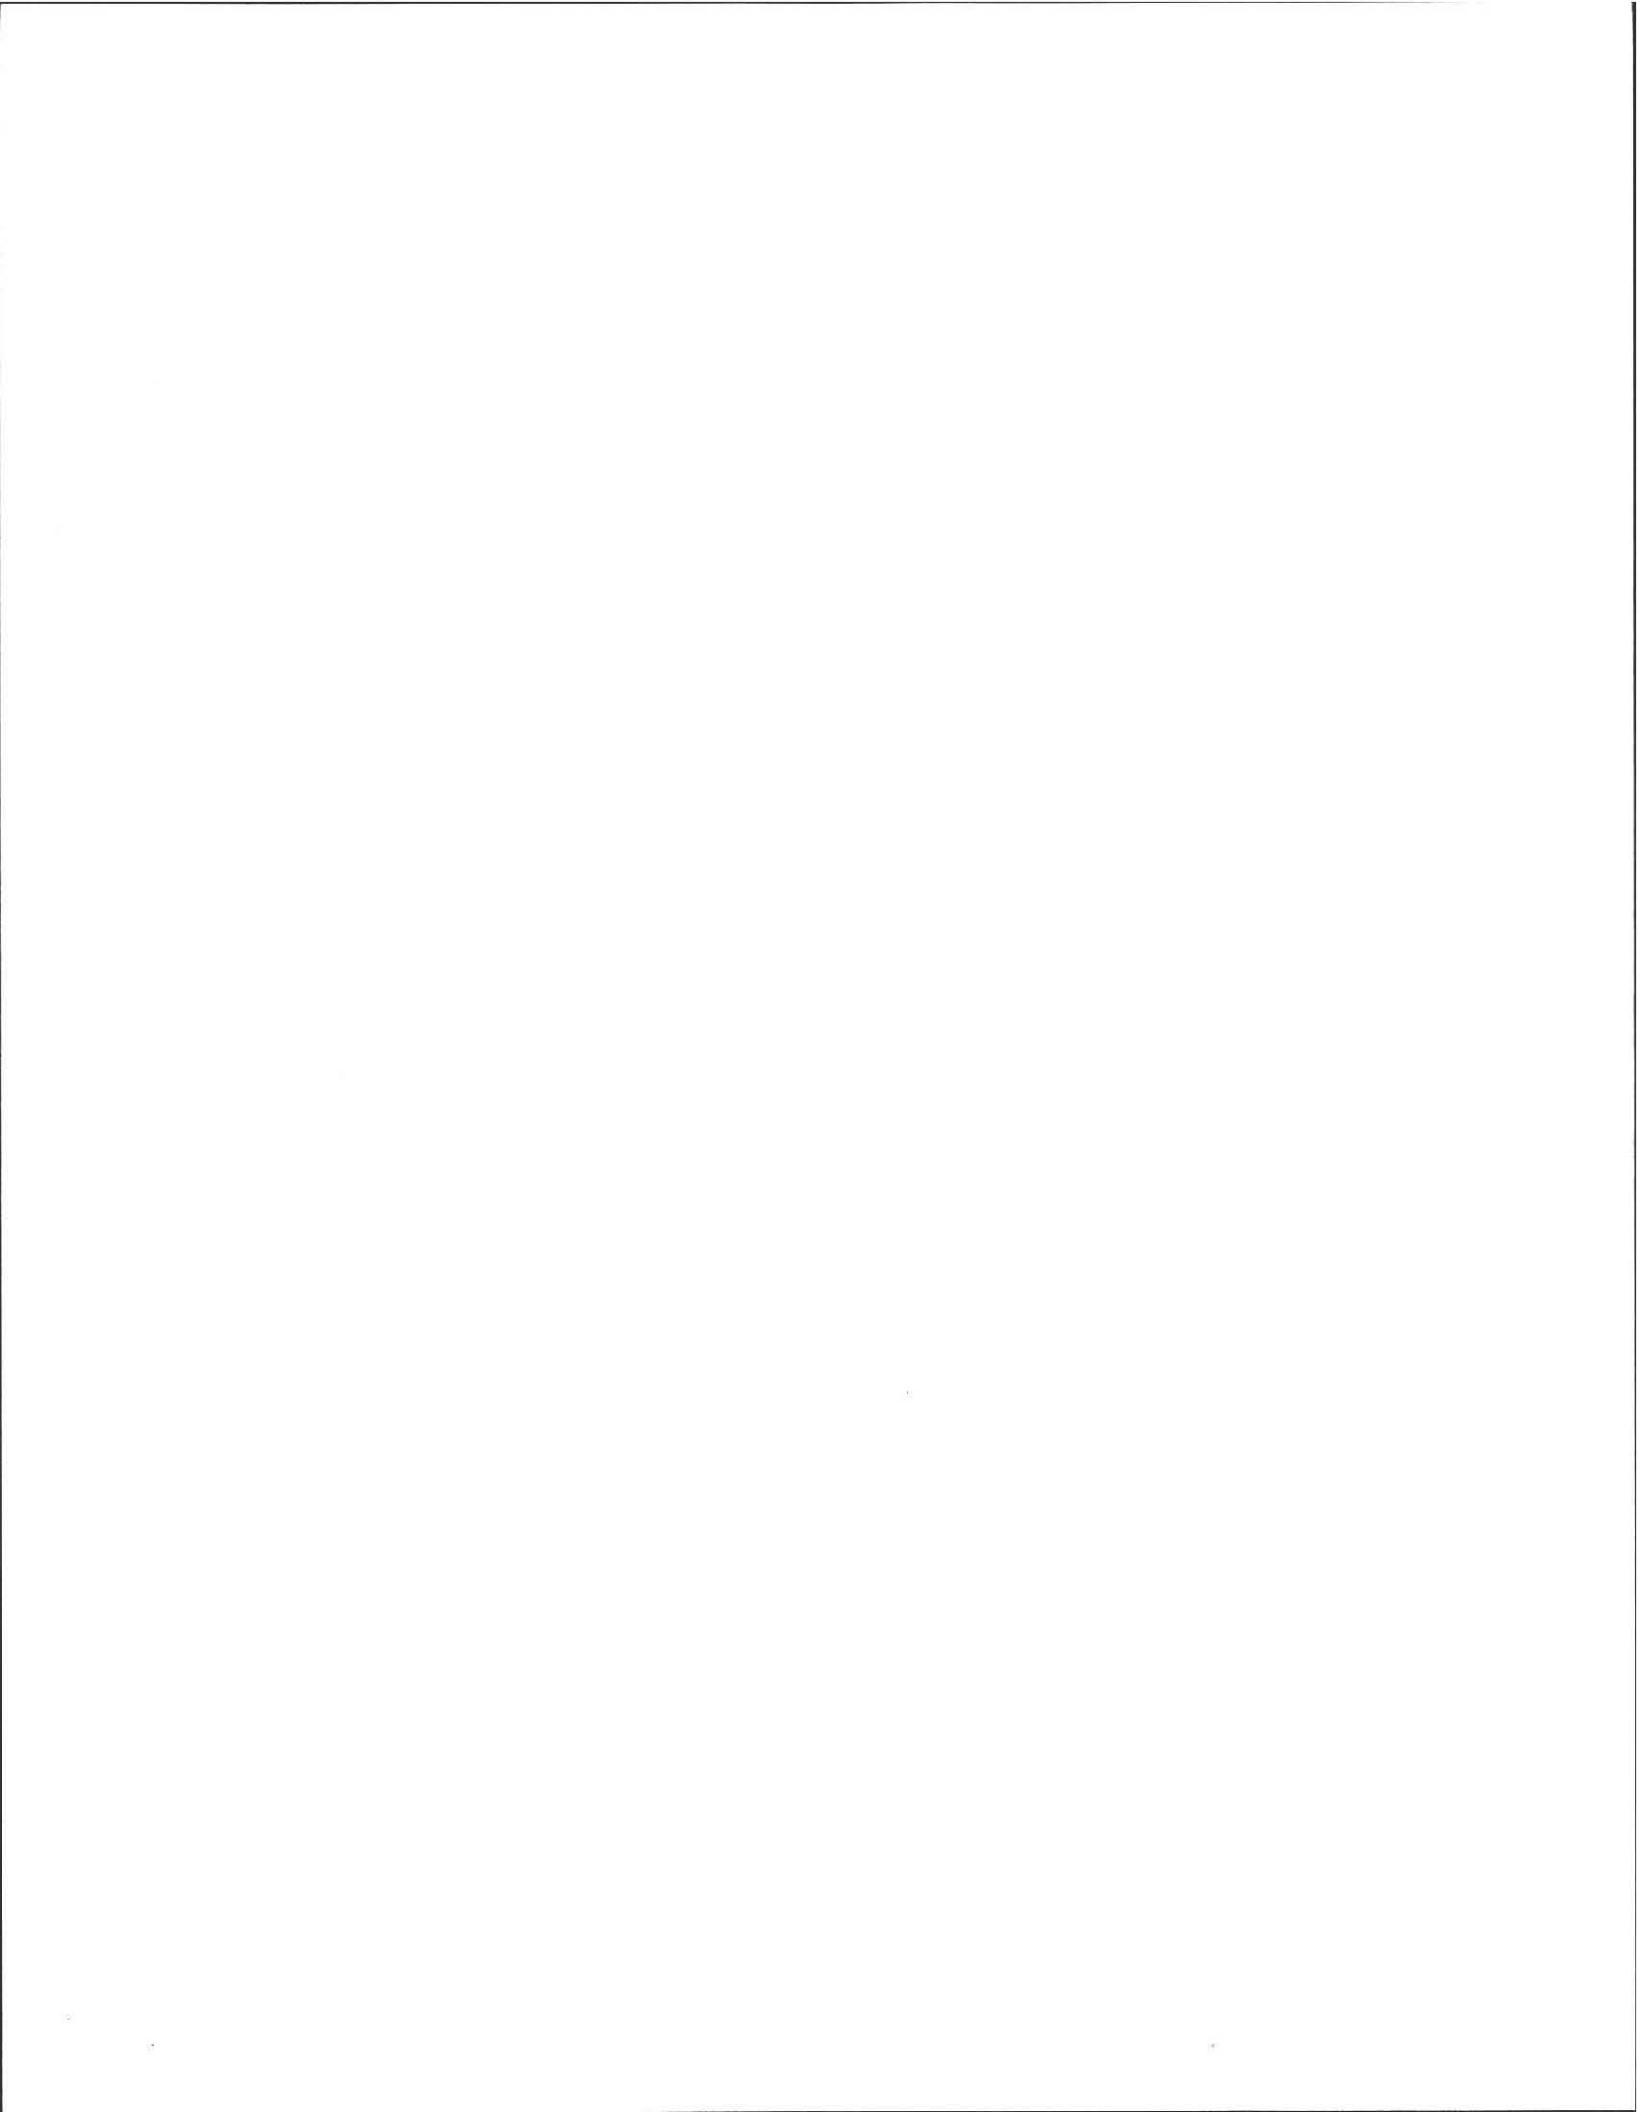



env copy



COMMONWEALTH OF MASSACHUSETTS  
EXECUTIVE OFFICE OF ENVIRONMENTAL AFFAIRS  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
ONE WINTER STREET, BOSTON MA 02108 (617) 292-6600

TRUDY COXE  
Secretary

DAVID B. STRUBS  
Commissioner

ARGEO PAUL CELLUCCI  
Governor

SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM

PART A  
CERTIFICATION

Property Address: GARY DONNELLY  
297 514UTESBURY RD  
AMHERST MA Name of Owner: GARY DONNELLY  
Address of Owner: 297 514UTES BURY RD  
Date of Inspection: \_\_\_\_\_  
Name of Inspector: (Please Print) WILLIAM J SIERUTA AMHERST, MA 01002  
I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000)  
Company Name: SIERUTA ENGINEERING  
Mailing Address: 46 UPLAND RD.  
Telephone Number: HOLYOKE, MASS

CERTIFICATION STATEMENT

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on-site sewage disposal systems. The system:


- Passes
- Conditionally Passes
- Needs Further Evaluation By the Local Approving Authority
- Fails

Inspector's Signature: William J Sieruta Date: 3/21/00

The System Inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within thirty (30) days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the Department of Environmental Protection. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.


NOTES AND COMMENTS



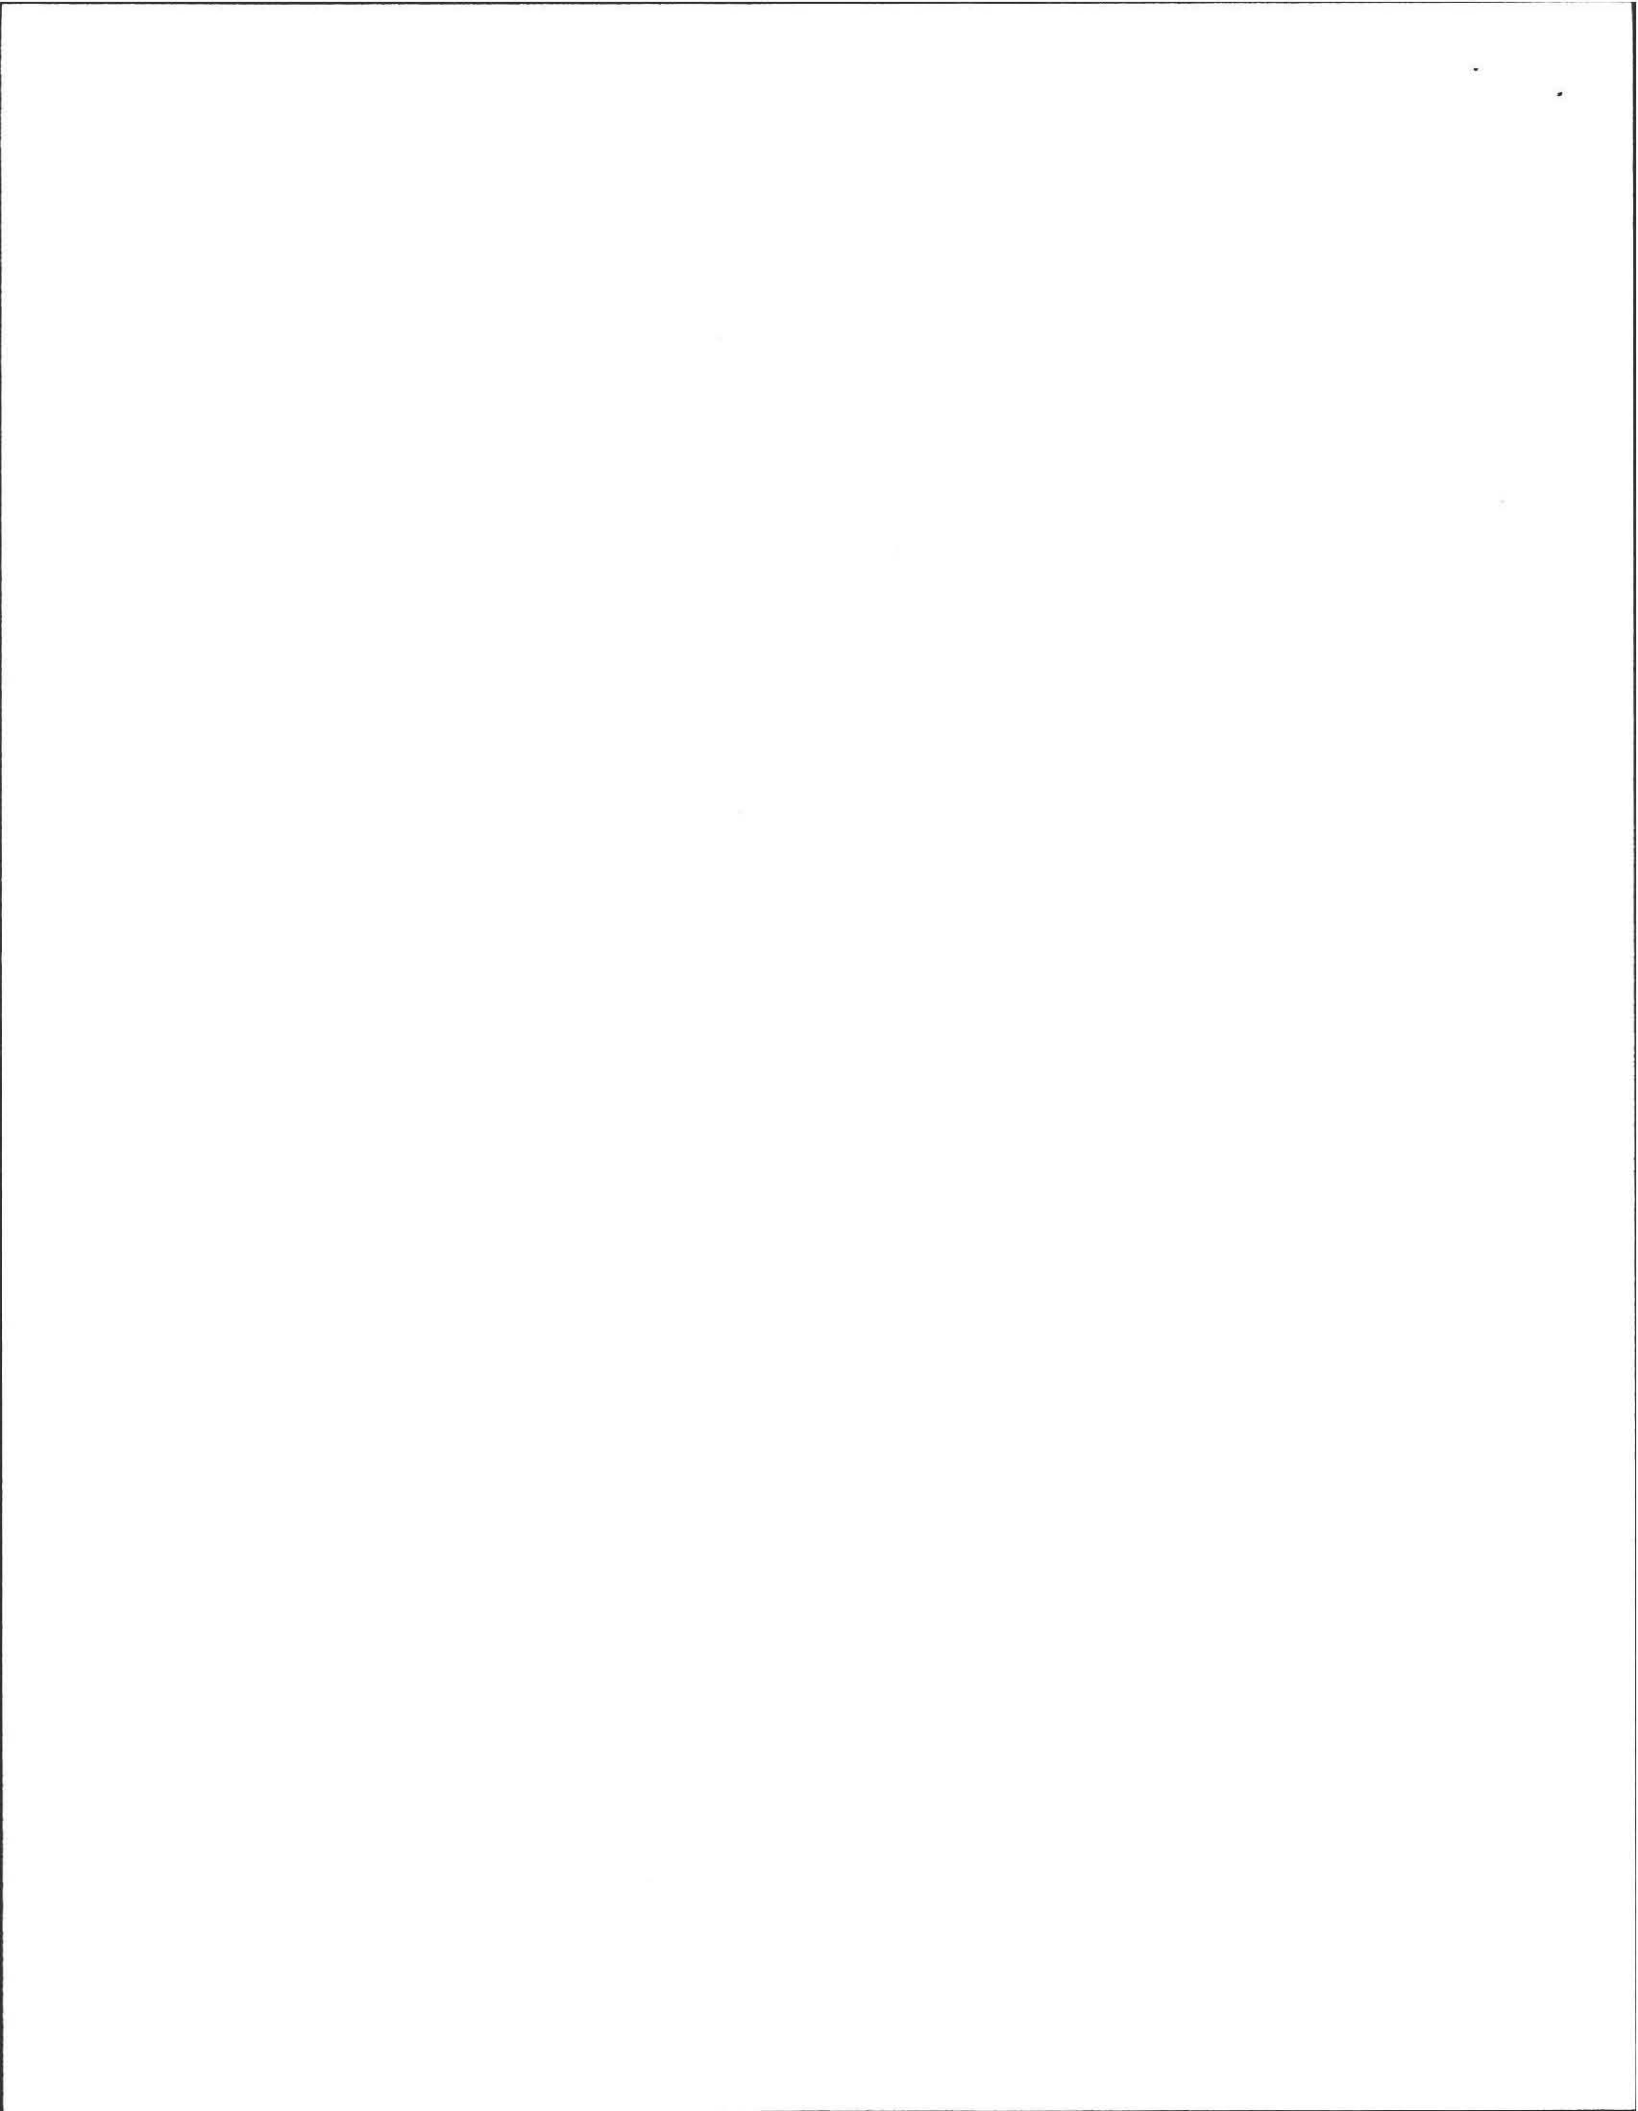




Septic Area  
297 Shutesbury Road  
Amherst, MA  
04.01.2009

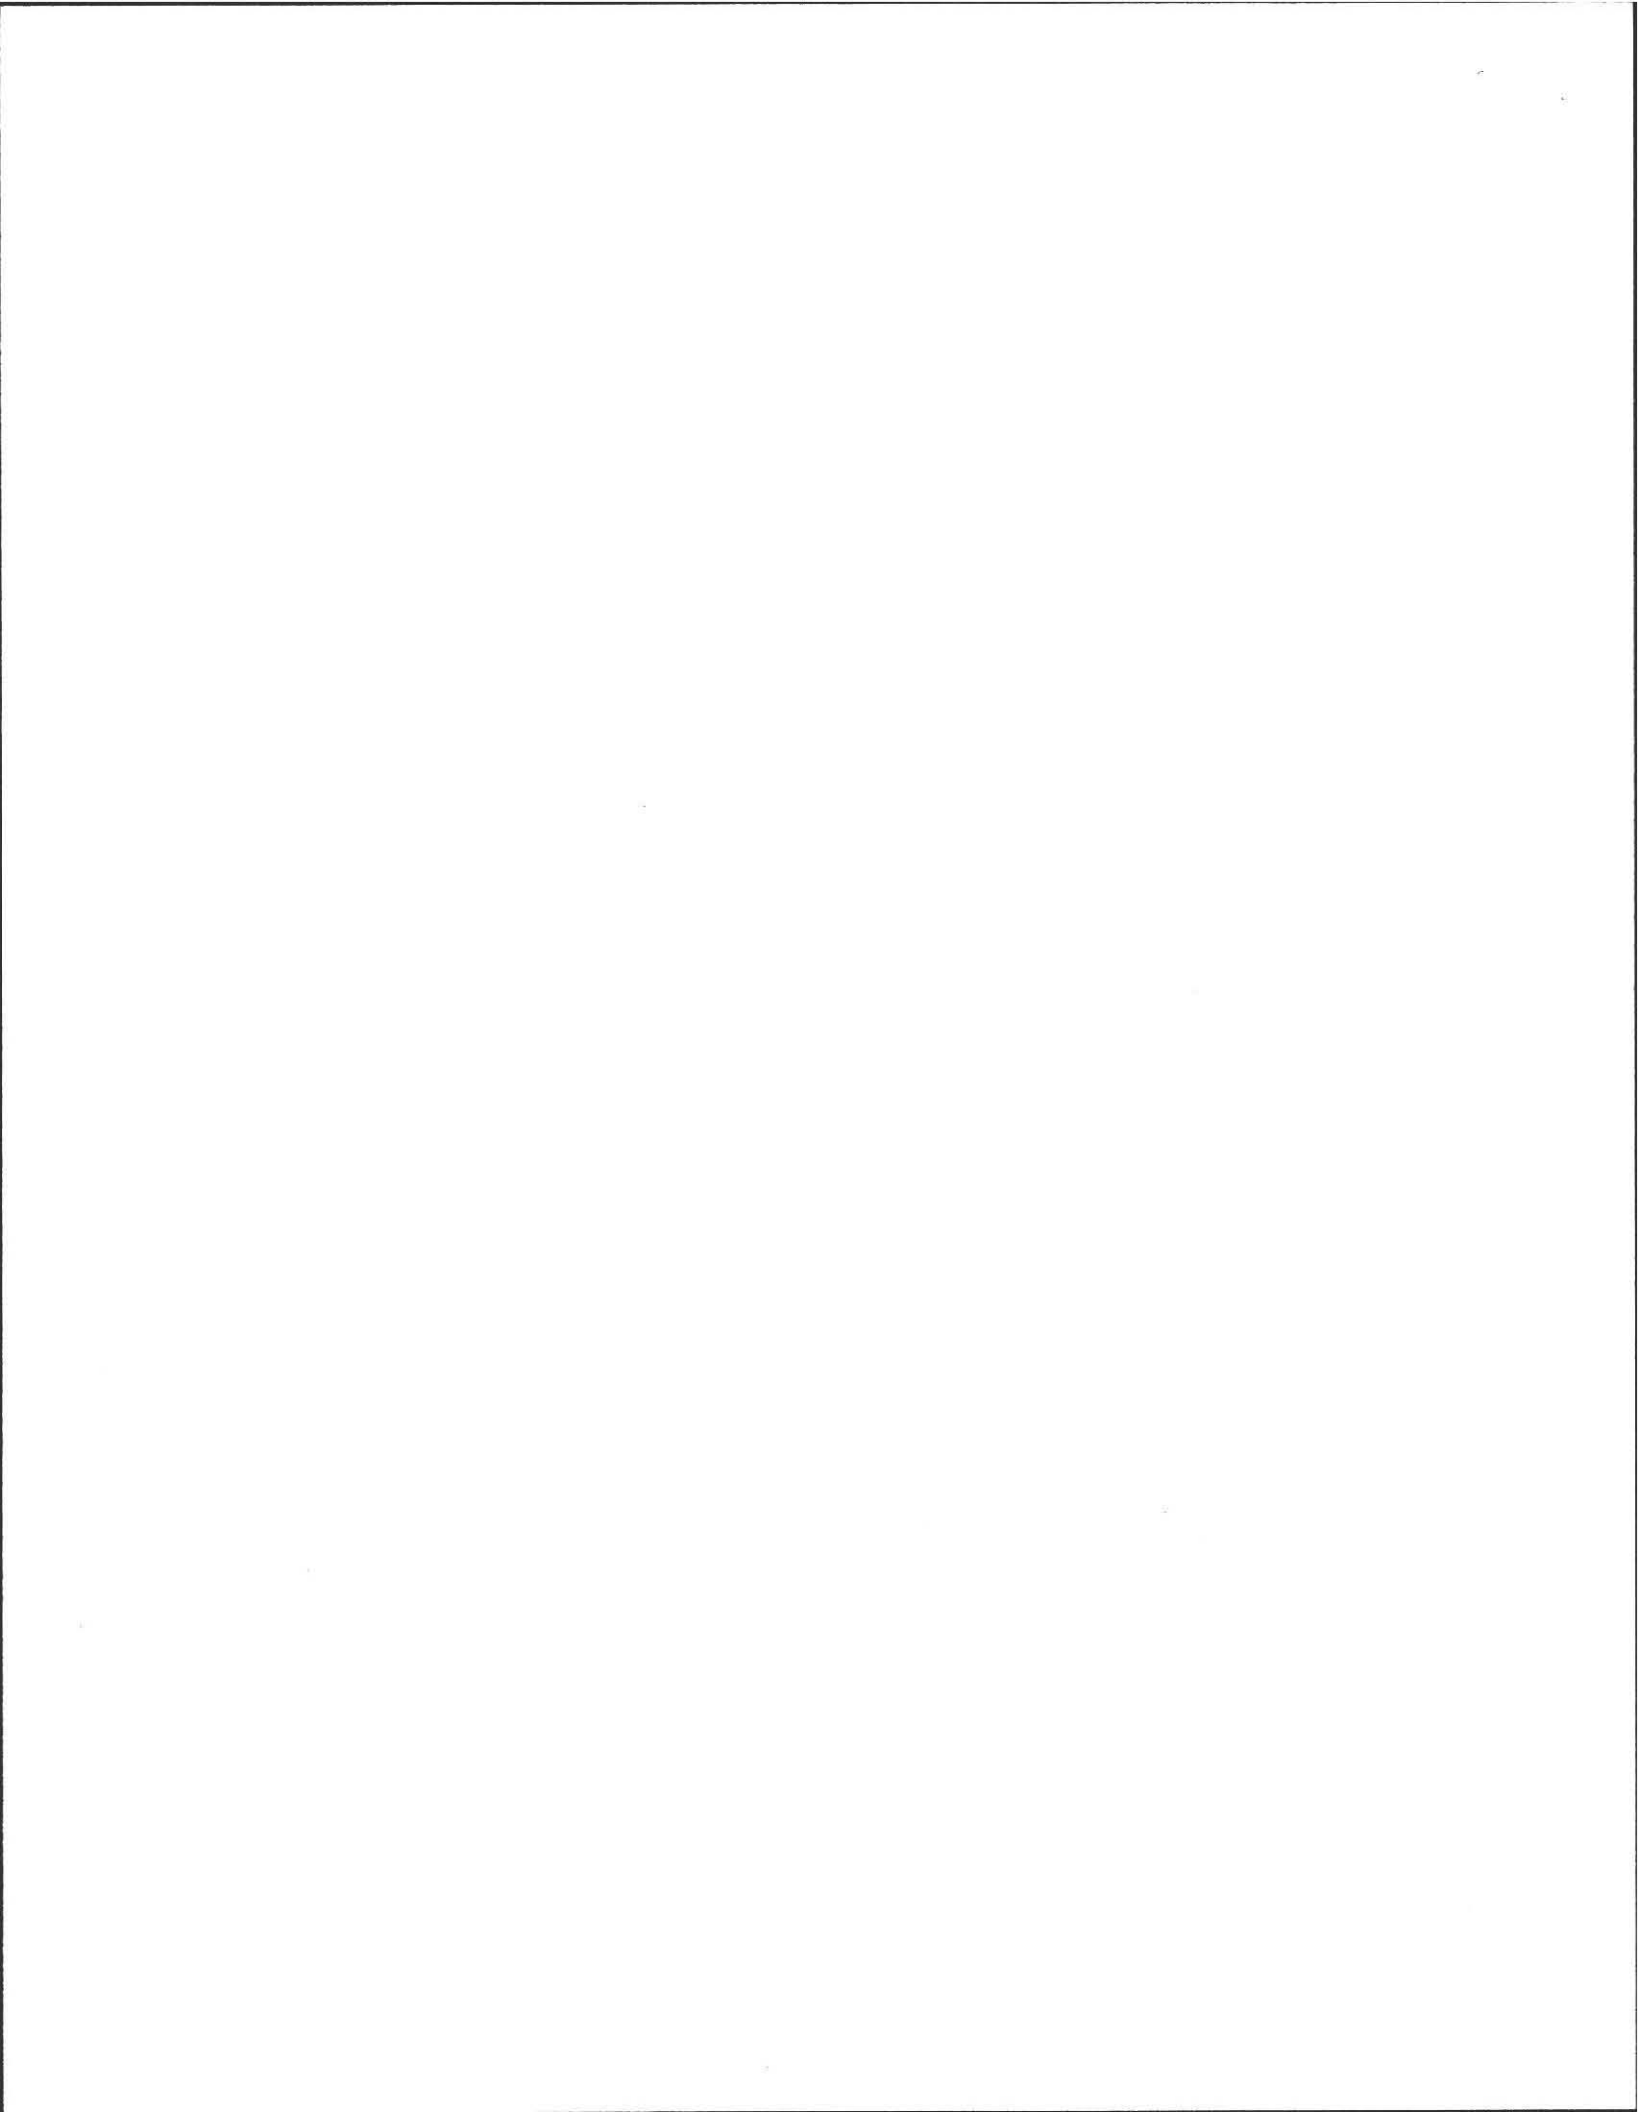



Tank Outlet baffle  
297 Shutesbury Road  
Amherst, MA  
04.01.2009

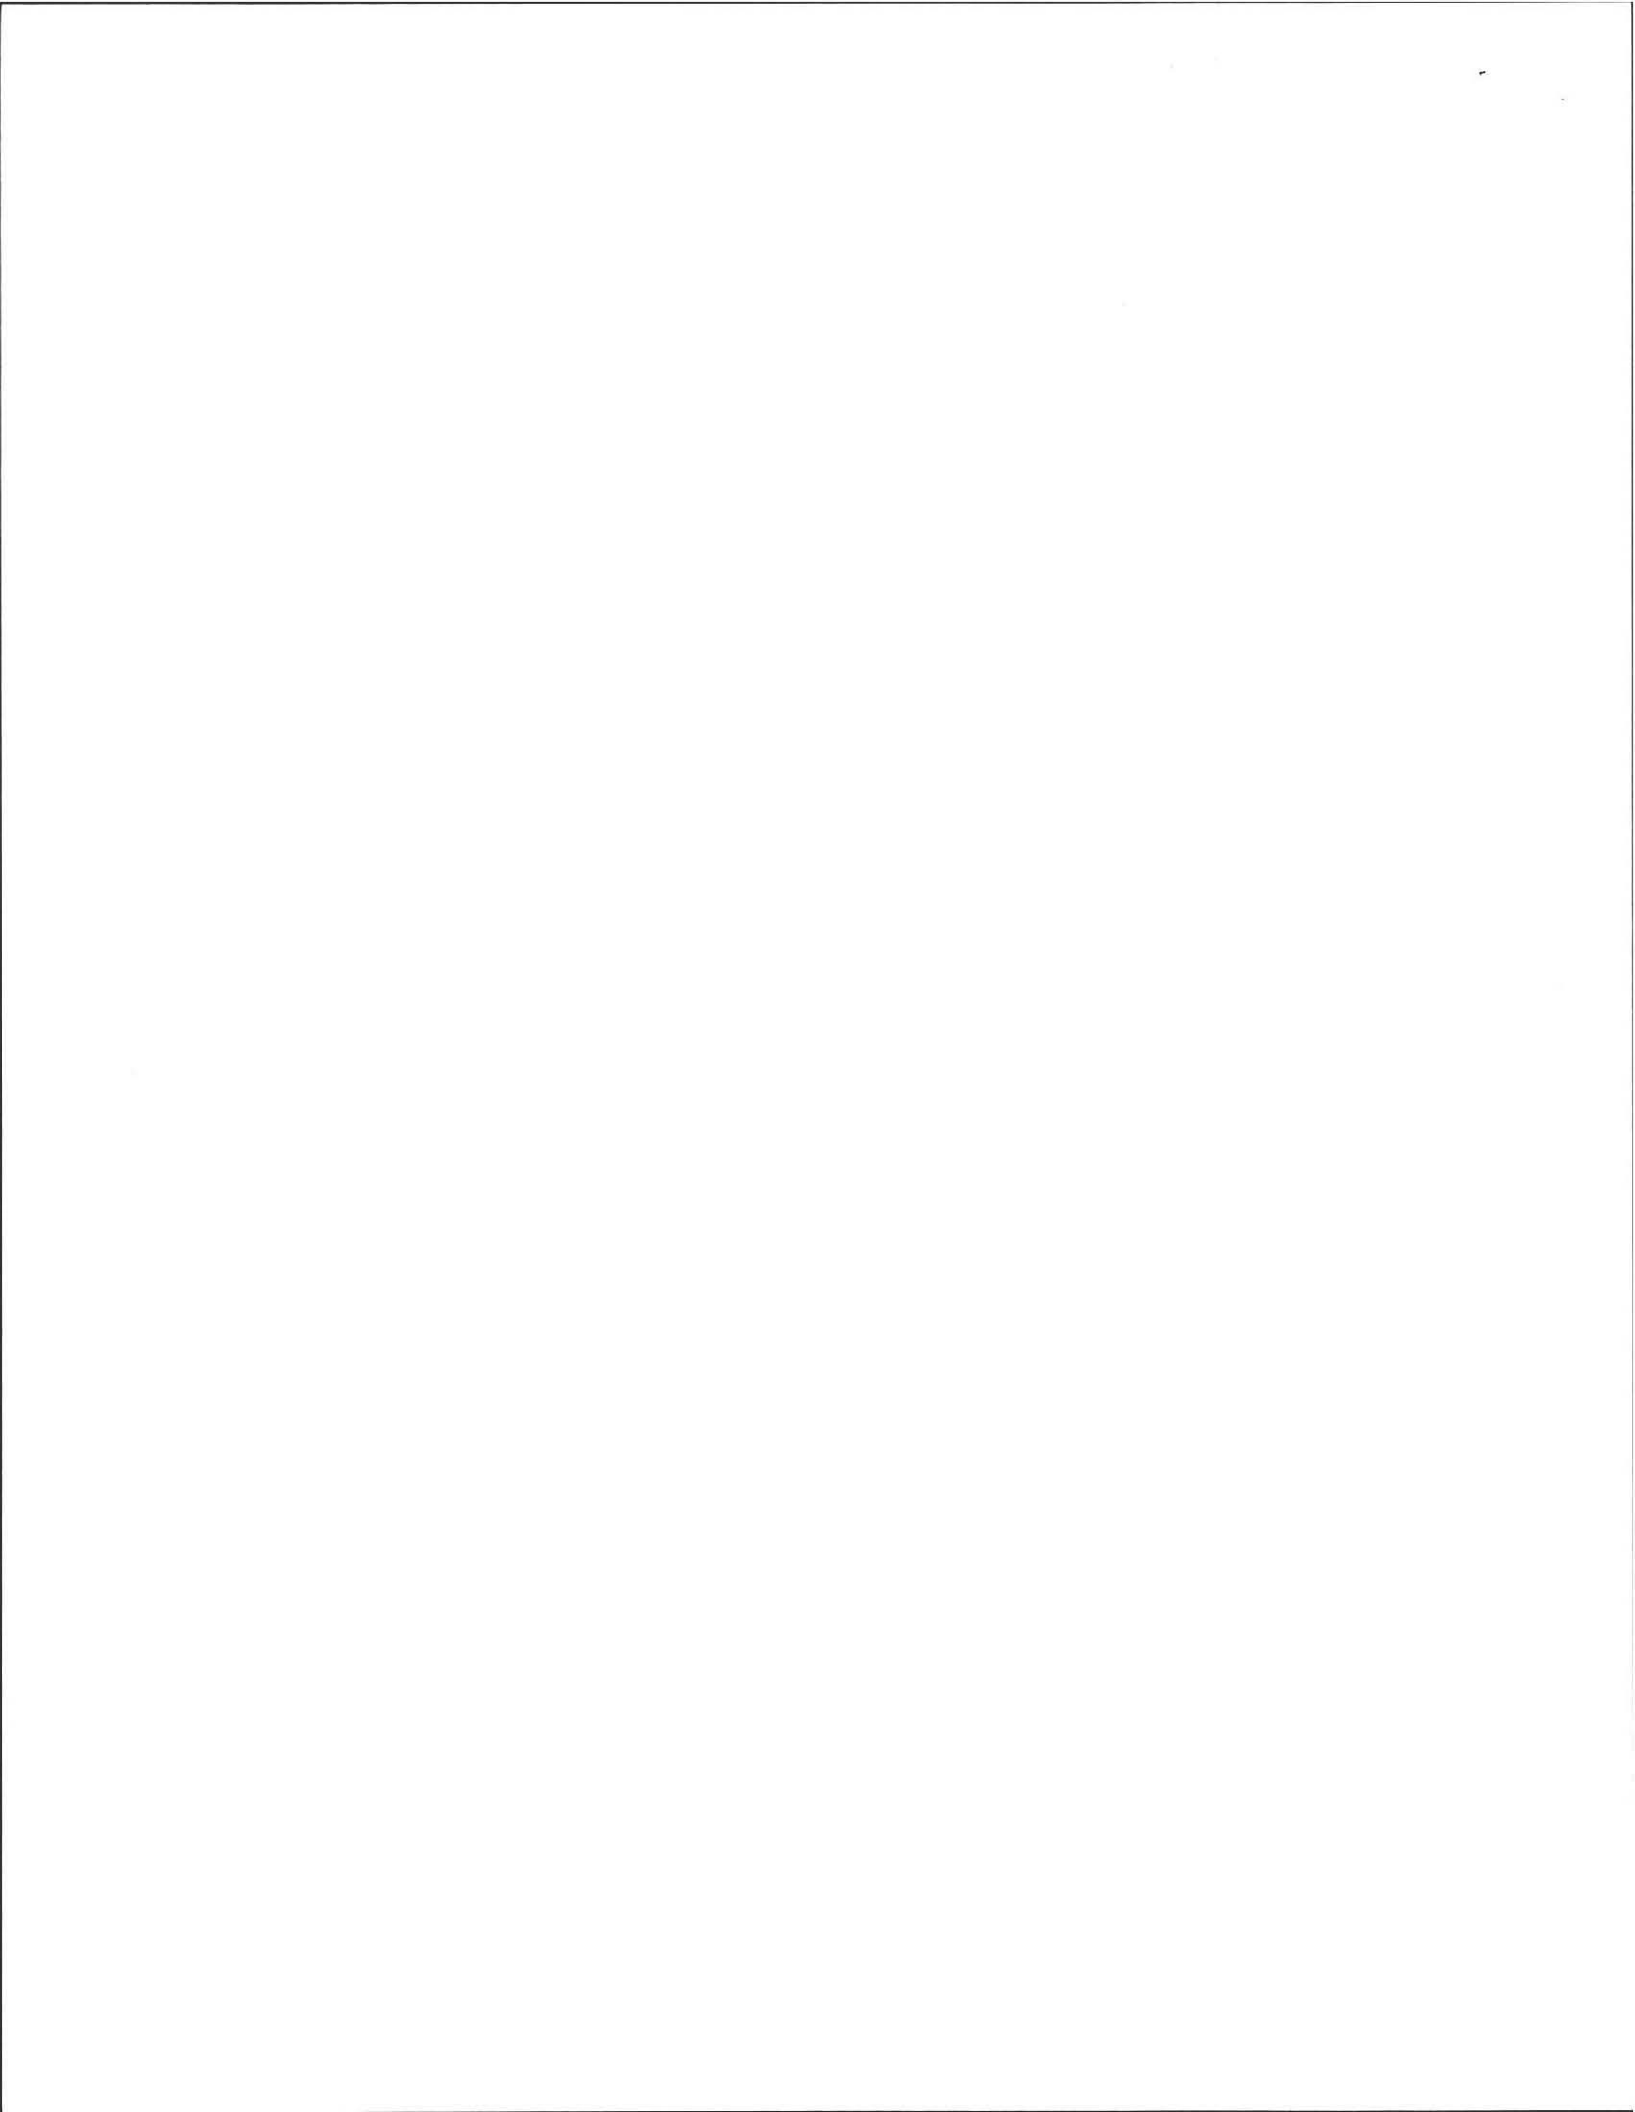



Dist Box (then pumped)  
297 Shutesbury Road  
Amherst, MA  
04.01.2009

