

605 Station Road
Lora + Robert Simon



COPY

TITLE 5
OFFICIAL INSPECTION FOR - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM FORM
PART A
CERTIFICATION

Property Address: 605 Station Road, Amherst, MA
Owner's Name: Lara Simon
Address: 605 Station Road
Amherst, MA 01002
Date of Inspection: October 19, 2004

Name of Inspector: Alan E. Weiss, R.S # 933
Company Name: Cold Spring Environmental Inc.
Mailing Address: 350 Old Enfield Road
Belchertown, Massachusetts 01007
Telephone Number: (413) 323-5957 fax: 413-323-4916

CERTIFICATION STATEMENT

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of the inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on site sewage disposal systems. I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000). The system:

- XX Passes
- Conditionally Passes
- Needs Further Evaluation by the Local Approving Authority
- Fails

Inspector's Signature: [Signature] Date: **October 19, 2004**

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

Notes and Comments:

1 person is now living in home. The D. box was replaced and inspected by inspector and Health Dept Agent. SAS is 40+/- years old. Septic tank was pumped & has inlet baffle & outlet baffle. We do not recommend garbage disposals on the kitchen sink.

******This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same different conditions of use.**

NOTE system 38yr old
1 lot 40
MKS - Simon

10/10/10

Dear Sir,
I am writing to you regarding the matter of the
contract for the supply of goods to the
Government of India.

The contract was entered into on the 1st day of
January 1910, and the goods were delivered
on the 15th day of the same month. The
contract was for the supply of 1000
units of goods, and the price was fixed
at Rs. 1000000.

The goods were delivered in accordance with
the terms of the contract, and the price
was paid to me on the 31st day of
January 1910. I am writing to you to
inform you of the above facts.

I am, Sir, very respectfully,
Your obedient servant,
[Signature]

I am writing to you regarding the matter of the
contract for the supply of goods to the
Government of India. The contract was
entered into on the 1st day of January
1910, and the goods were delivered on
the 15th day of the same month.

The contract was for the supply of 1000
units of goods, and the price was fixed
at Rs. 1000000. The goods were
delivered in accordance with the terms
of the contract, and the price was
paid to me on the 31st day of
January 1910.

I am writing to you to inform you of the
above facts. I am, Sir, very
respectfully,
Your obedient servant,
[Signature]

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 605 Station Rd.

Owner: SIMON

Date of Inspection: 10/7/04

Inspection Summary: Check A,B,C,D or E / ALWAYS complete all of Section D

A. System Passes:

No I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments:

B. System Conditionally Passes:

yes One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Answer yes, no or not determined (Y,N,ND) in the ____ for the following statements. If "not determined" please explain.

____ The septic tank is metal and over 20 years old* or the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health.

*A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

ND explain:

yes Observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System ~~will~~ ^{may} pass inspection if (with approval of Board of Health):


- broken pipe(s) are replaced
- obstruction is removed
- distribution box is leveled or replaced

ND explain:

____ The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

- broken pipe(s) are replaced
- obstruction is removed

ND explain:

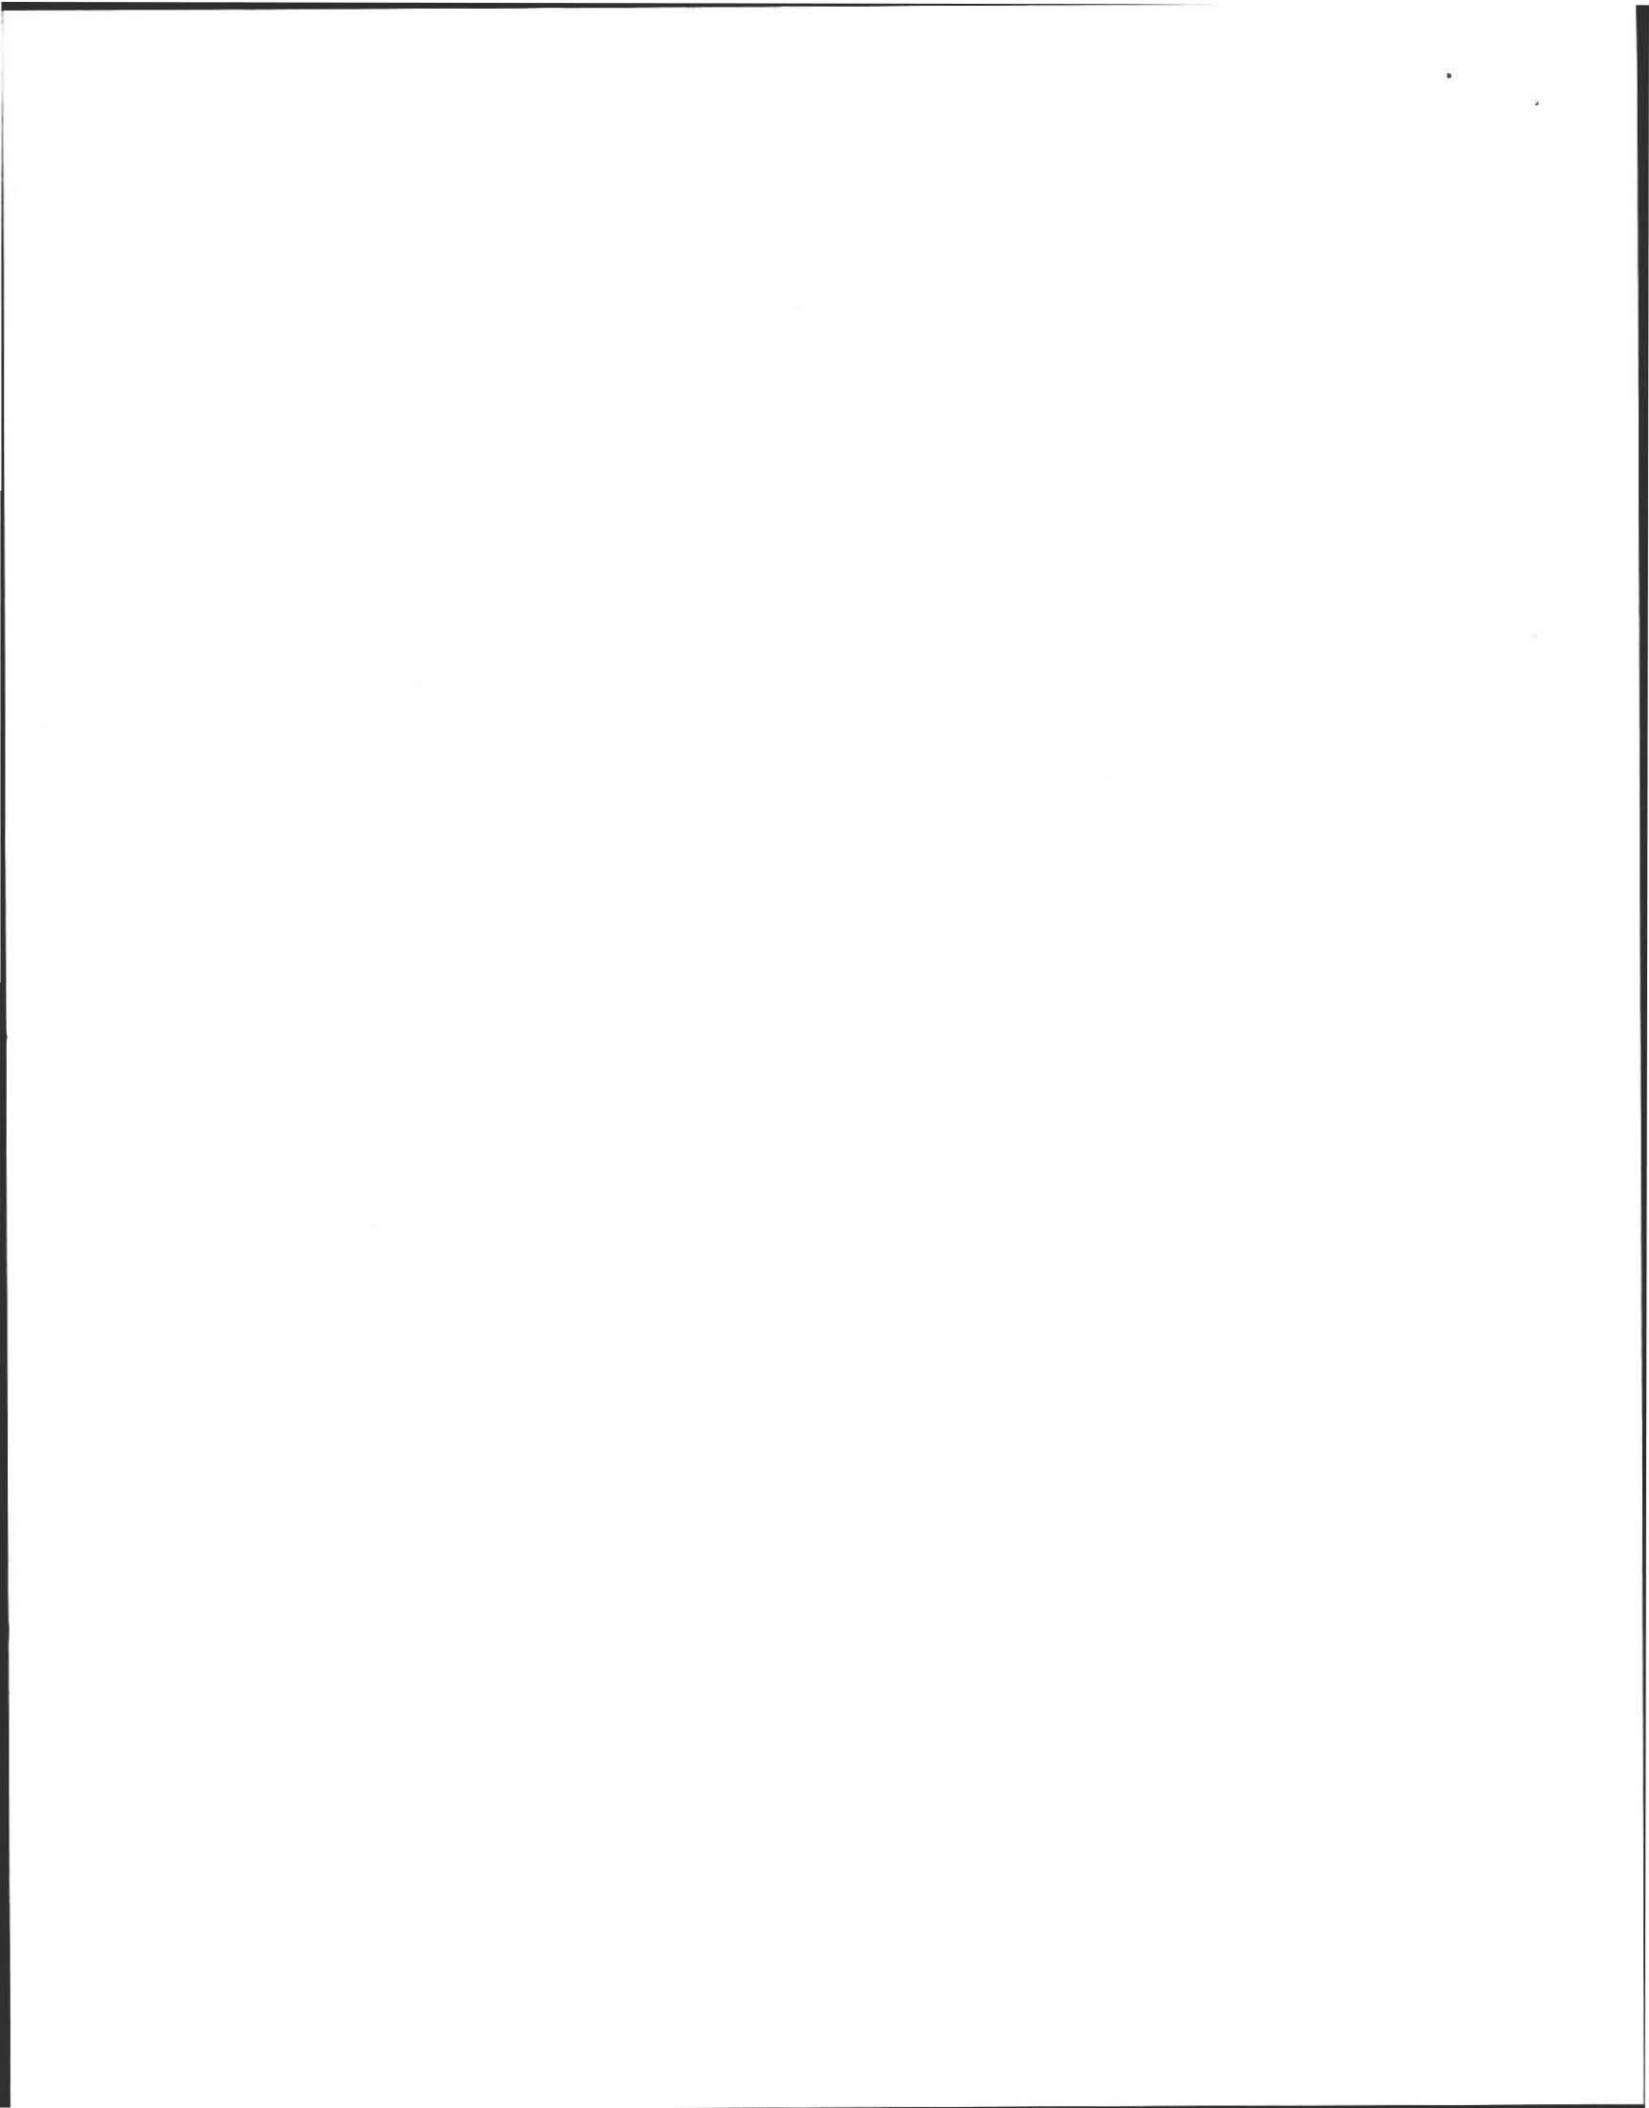

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM

PART A
CERTIFICATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/2/04

C. Further Evaluation is Required by the Board of Health:

No Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

1. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:

- Cesspool or privy is within 50 feet of a surface water
- Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

2. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:

The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.


The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.

The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.

The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well**. Method used to determine distance _____

**This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

3. Other:

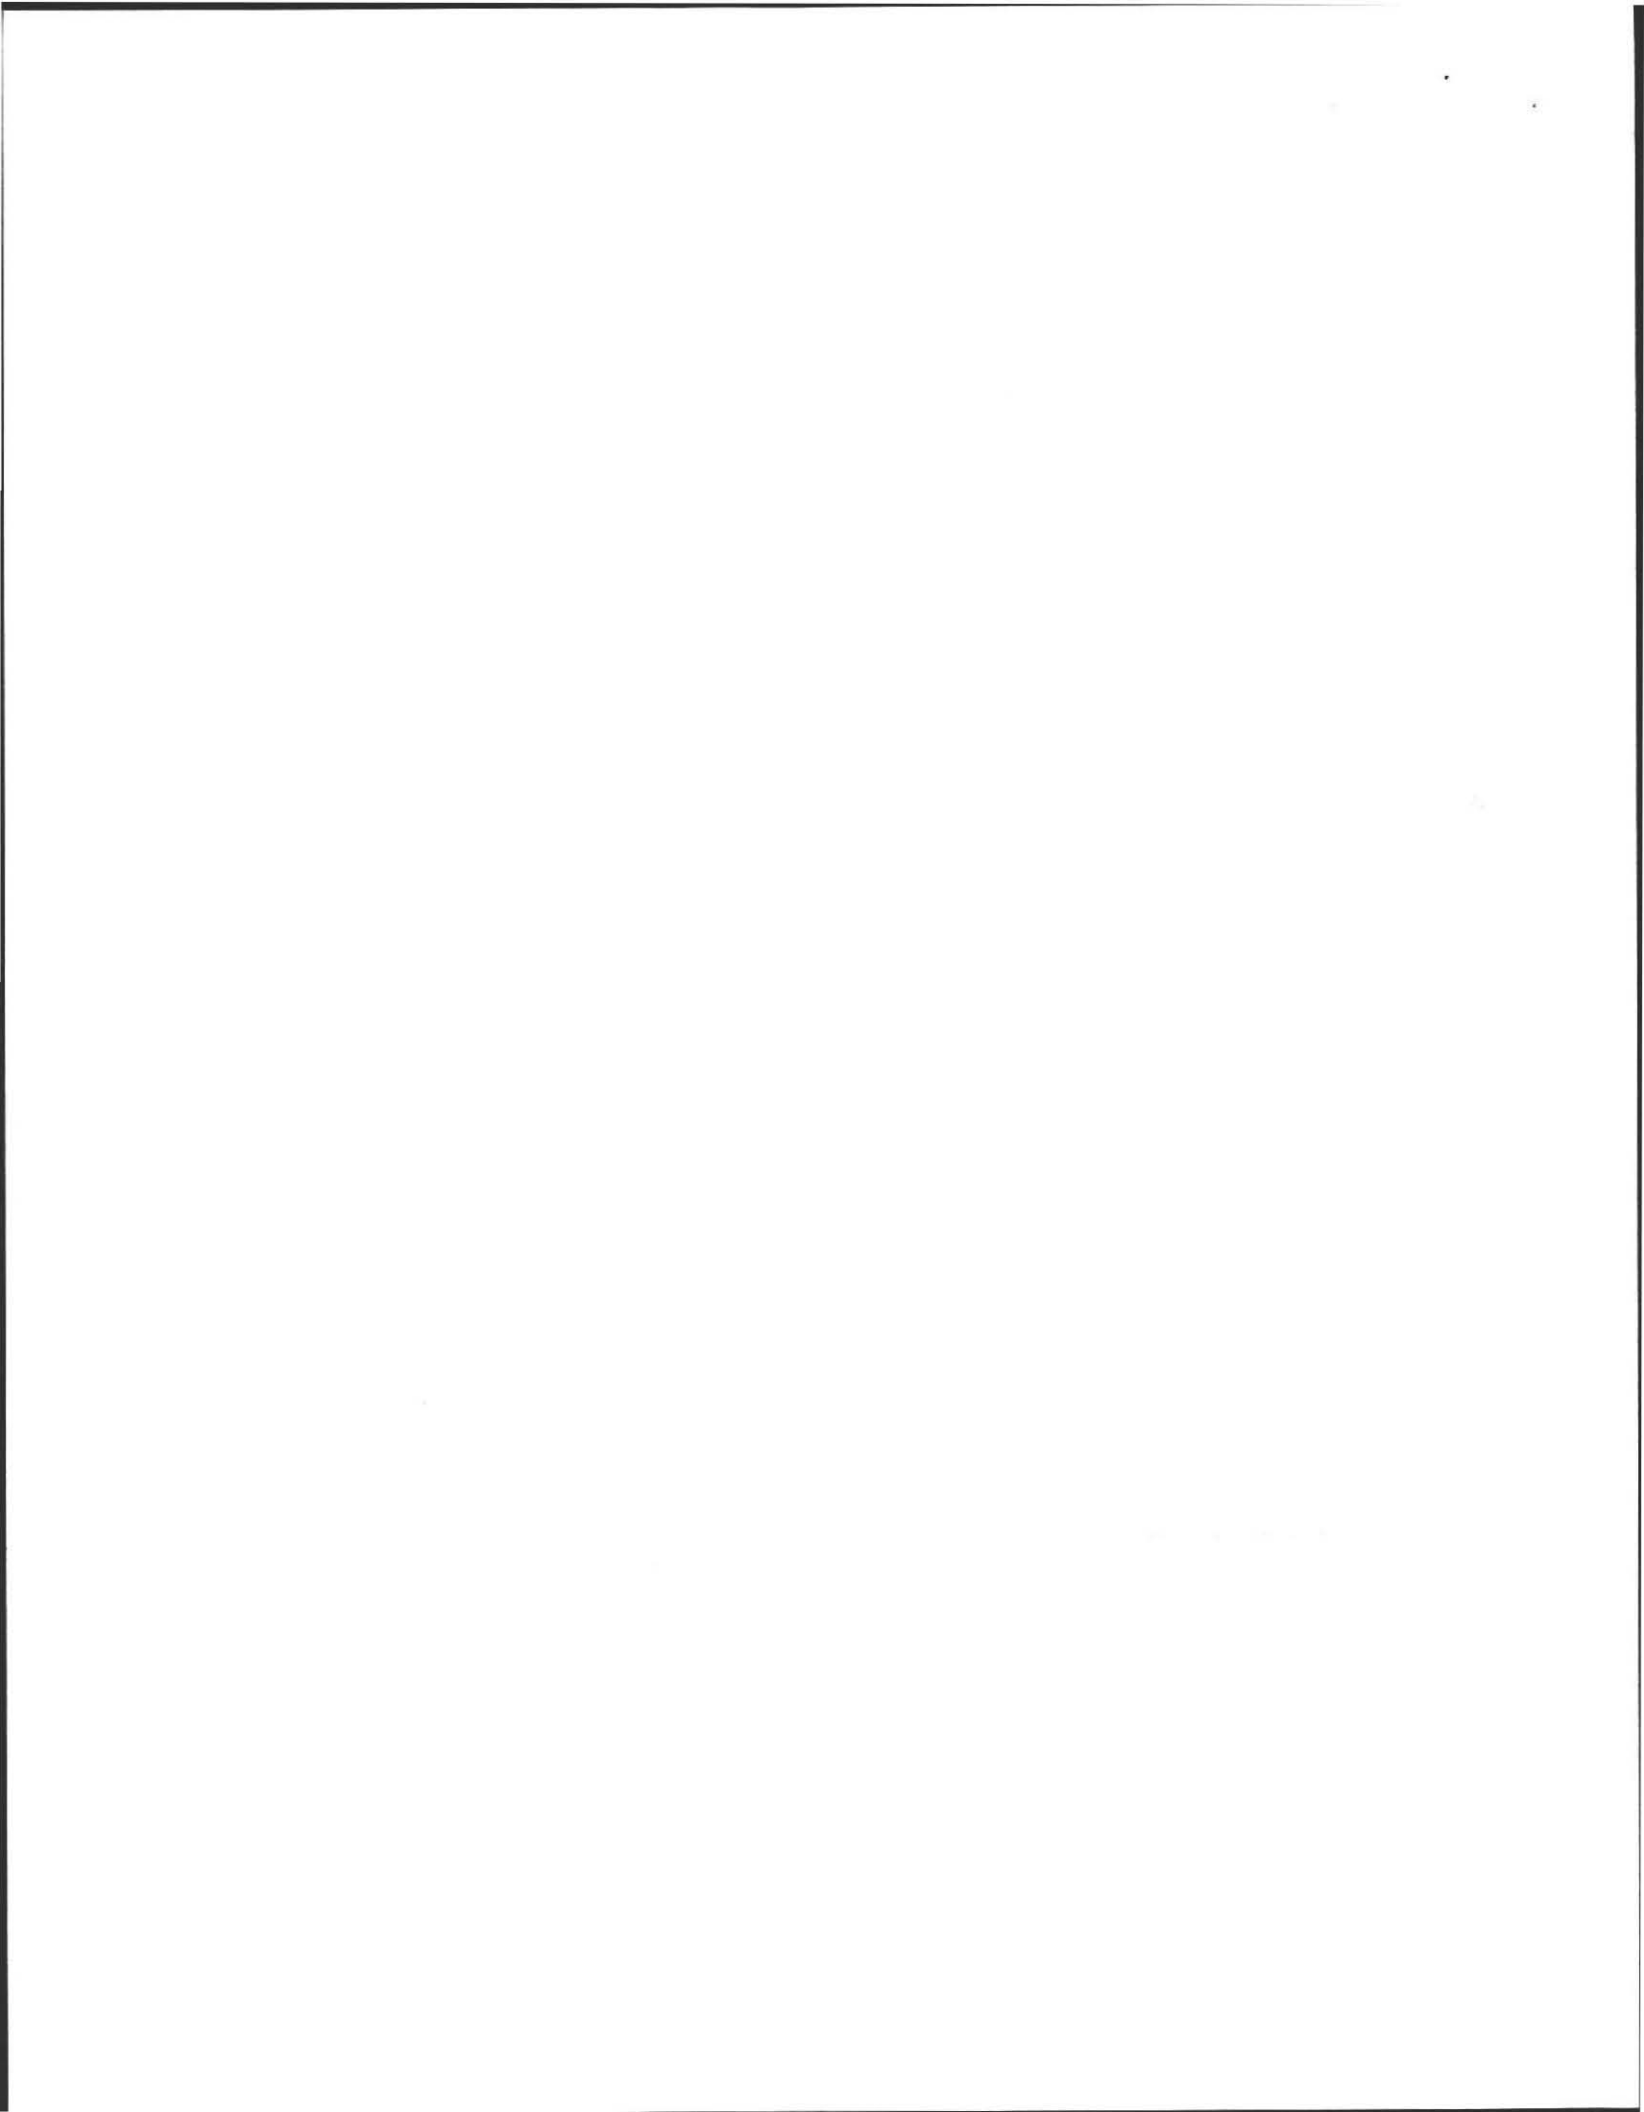

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: _____

D. System Failure Criteria applicable to all systems:

You must indicate "yes" or "no" to each of the following for all inspections:

- | Yes | No | |
|--------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Liquid depth in cesspool is less than 6" below invert or available volume is less than 1/2 day flow |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Required pumping more than 4 times in the last year NOT due to clogged or obstructed pipe(s). Number of times pumped _____. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of the SAS, cesspool or privy is below high ground water elevation. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within a Zone 1 of a public well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within 50 feet of a private water supply well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. [This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.] |

No (Yes No) The system fails. I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure.

E. Large Systems:


To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.

You must indicate either "yes" or "no" to each of the following:

(The following criteria apply to large systems in addition to the criteria above)

- | yes | no | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 400 feet of a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 200 feet of a tributary to a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area – IWPA) or a mapped Zone II of a public water supply well |

If you have answered "yes" to any question in Section E the system is considered a significant threat, or answered "yes" in Section D above the large system has failed. The owner or operator of any large system considered a significant threat under Section E or failed under Section D shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

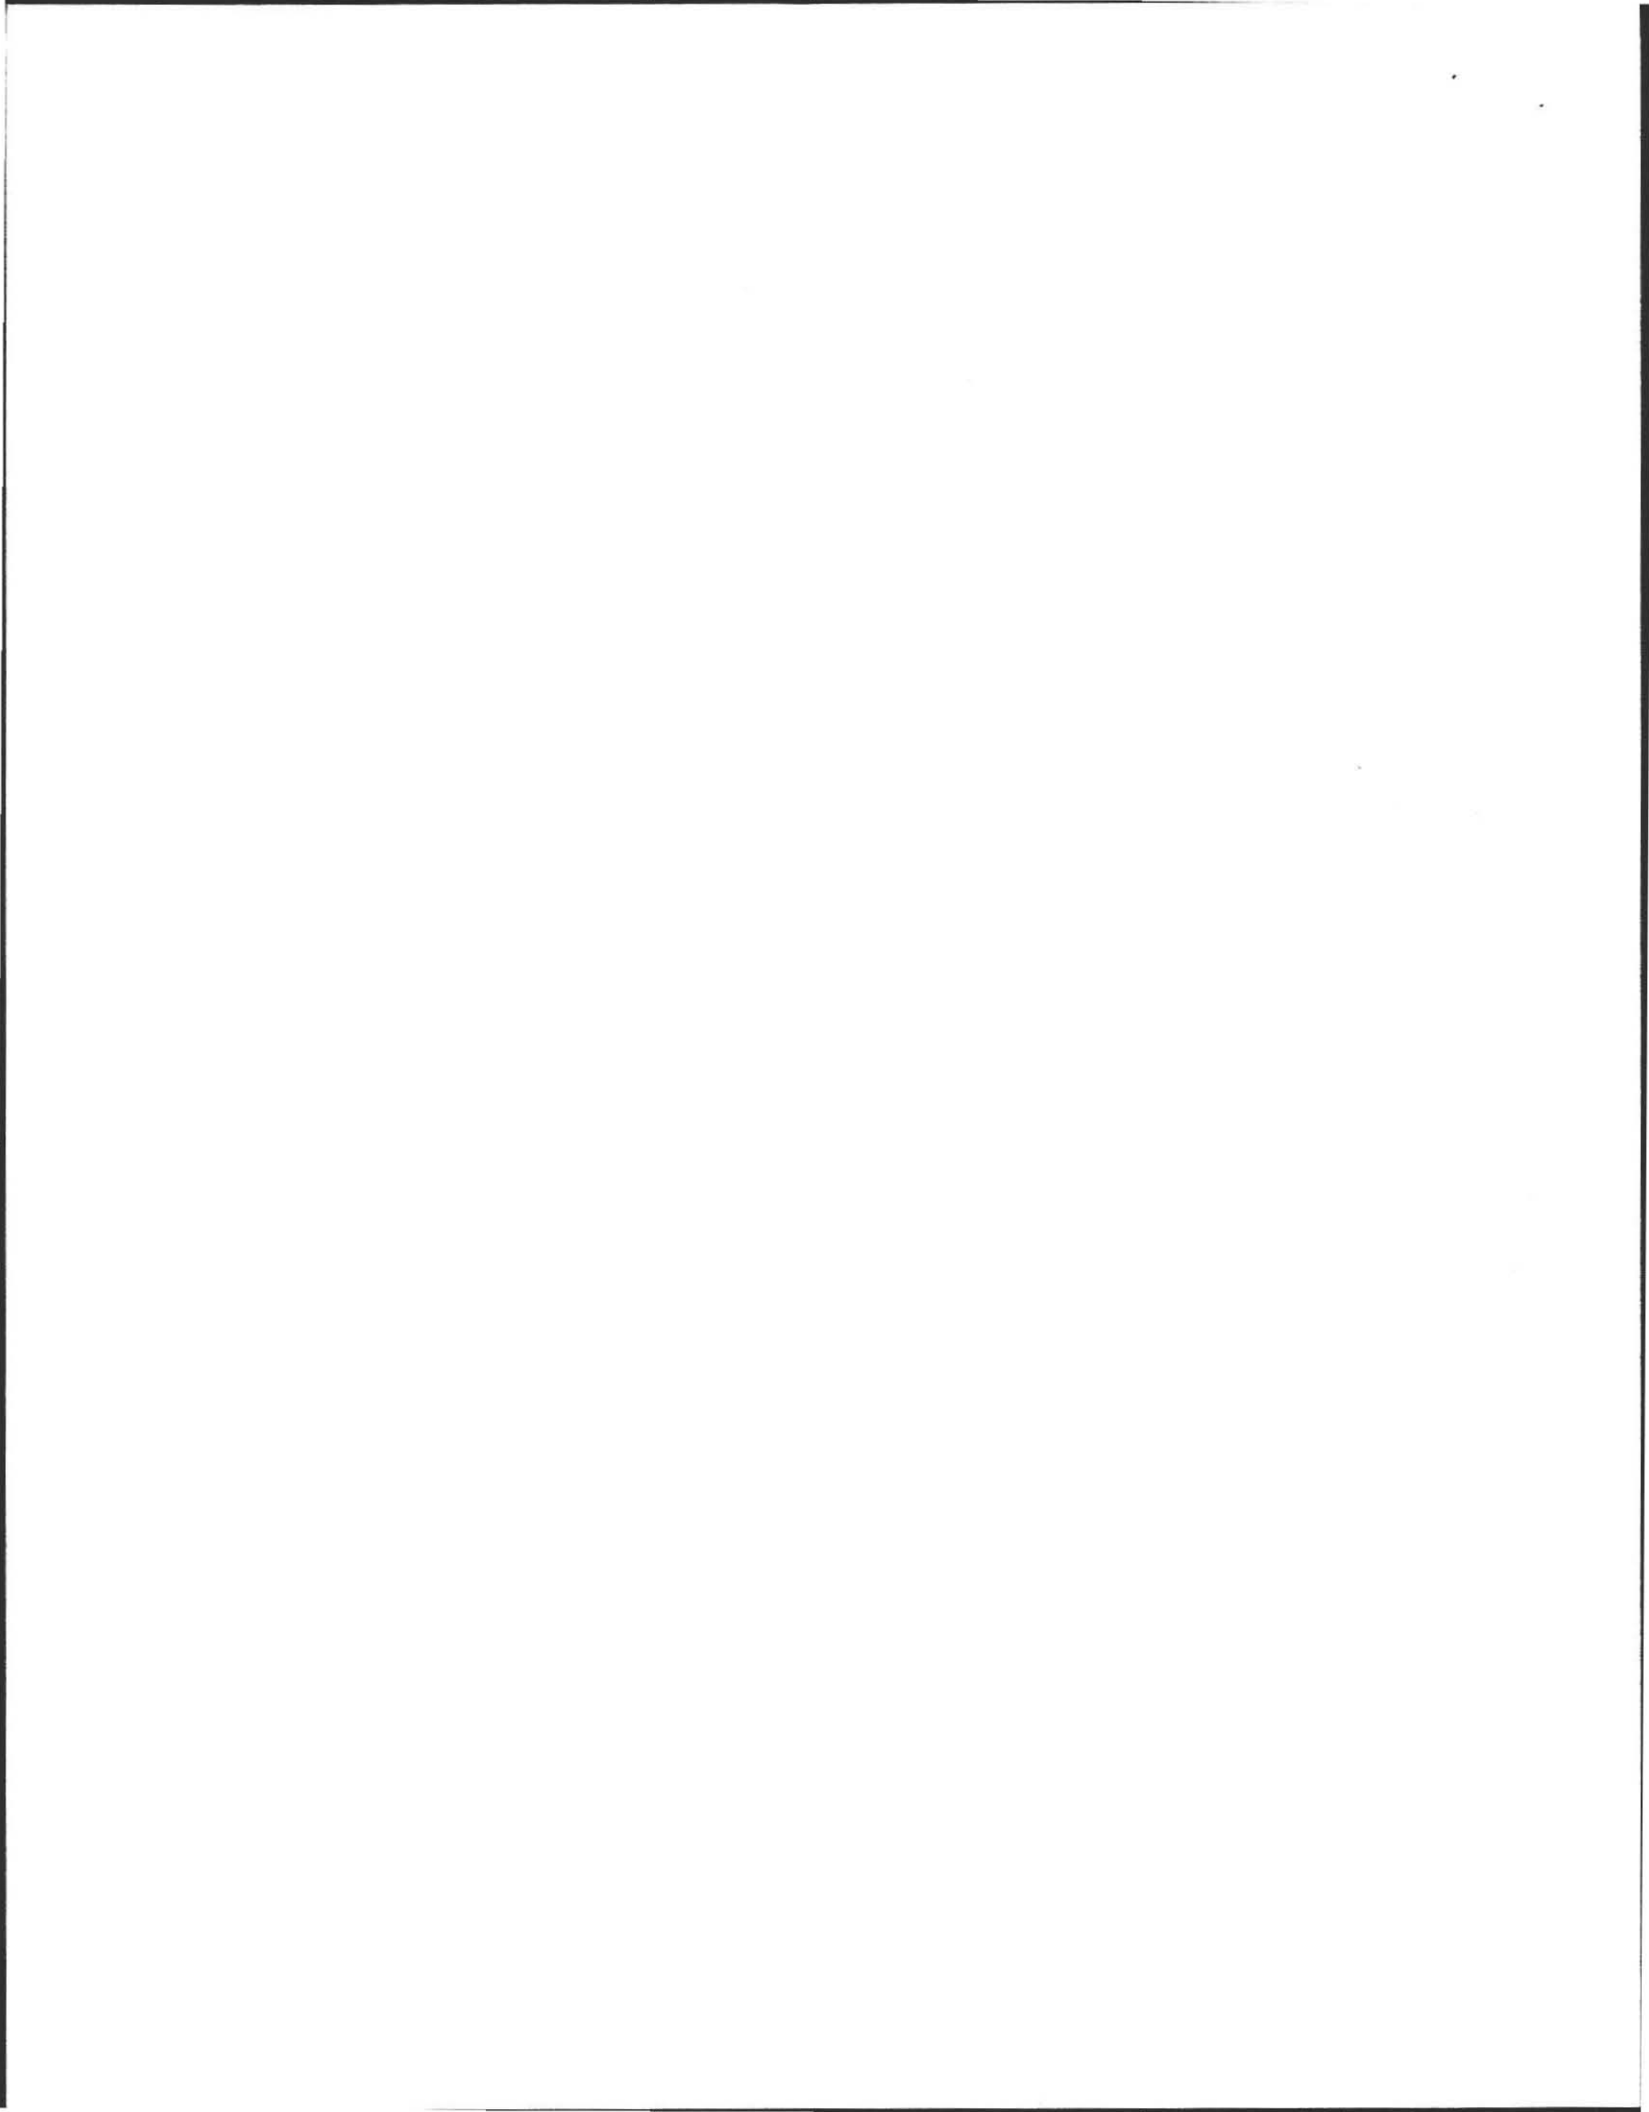

**OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART B
CHECKLIST**

Property Address: 605 Station RD

Owner: S.M.?

Date of Inspection: 10/17/01

Check if the following have been done. You must indicate "yes" or "no" as to each of the following:

Yes No

YES Pumping information was provided by the owner, occupant, or Board of Health

NO Were any of the system components pumped out in the previous two weeks ?

YES Has the system received normal flows in the previous two week period ?

NO Have large volumes of water been introduced to the system recently or as part of this inspection ?

NA Were as built plans of the system obtained and examined? (If they were not available note as N/A)

YES Was the facility or dwelling inspected for signs of sewage back up ?

YES Was the site inspected for signs of break out ?

YES Were all system components, excluding the SAS, located on site ?


YES Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum ?

YES Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems ?

The size and location of the Soil Absorption System (SAS) on the site has been determined based on:

NA Existing information. For example, a plan at the Board of Health.

YES Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(3)(b)]

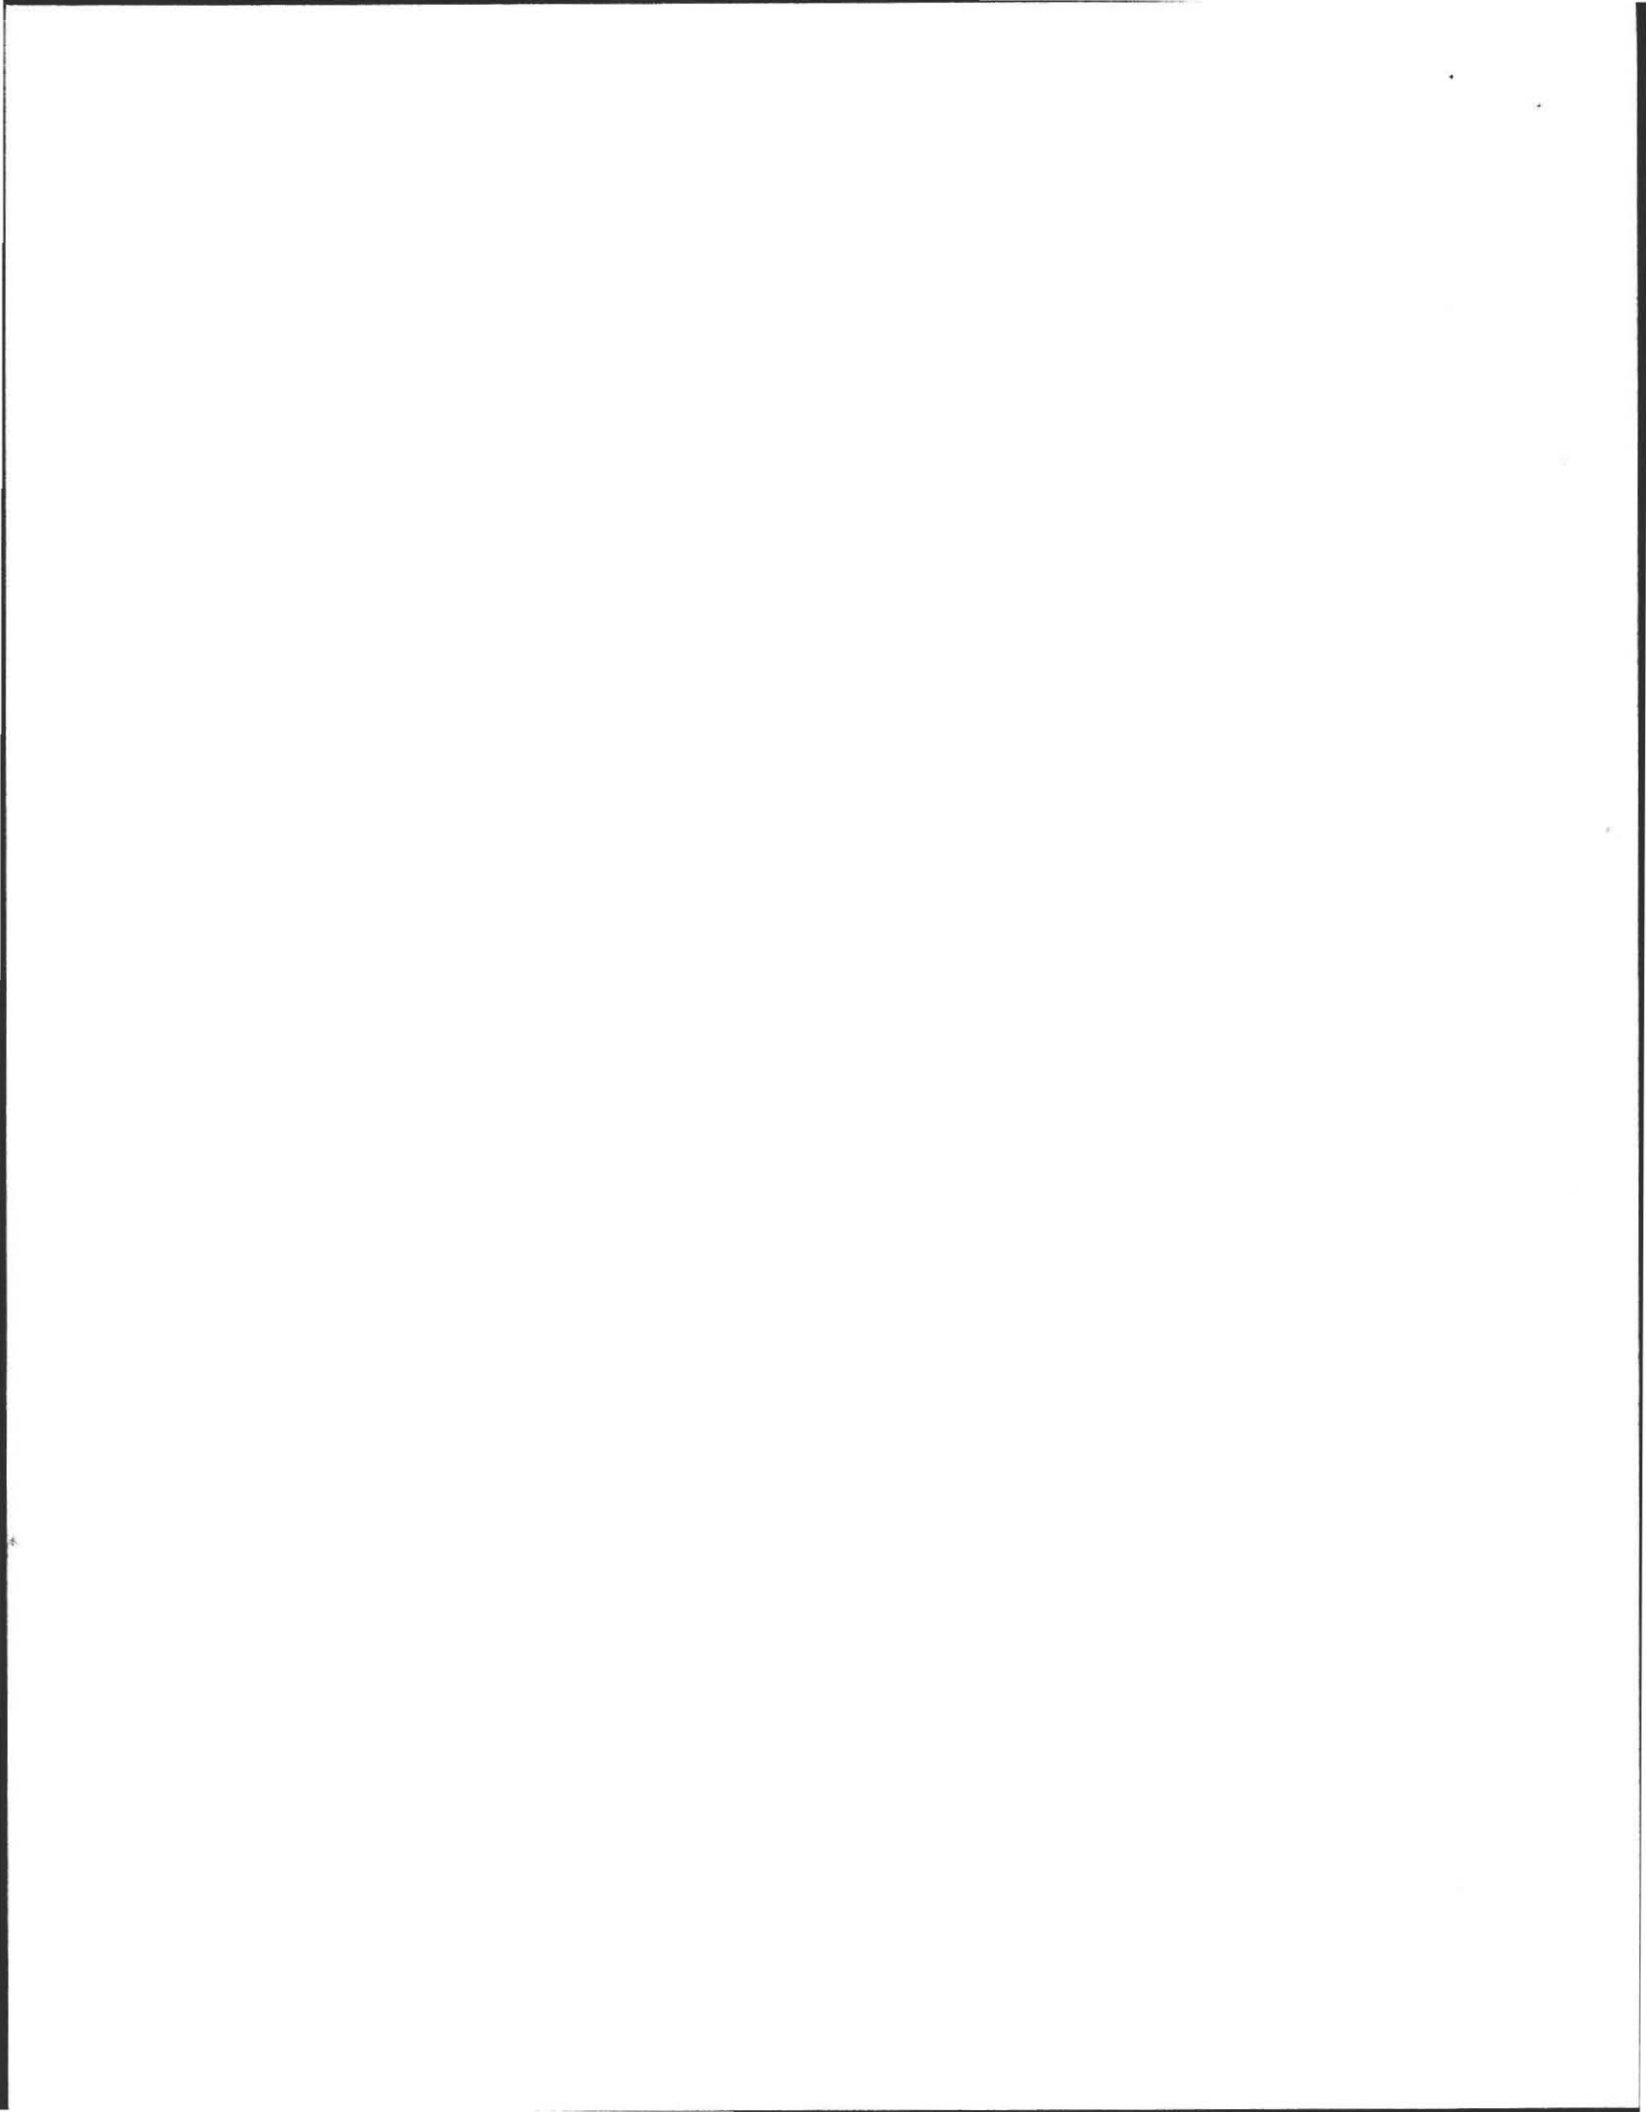

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/7/04

FLOW CONDITIONS

RESIDENTIAL

Number of bedrooms (design): 3 Number of bedrooms (actual): 3
DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): _____
Number of current residents: 1
Does residence have a garbage grinder (yes or no): yes not recommended
Is laundry on a separate sewage system (yes or no): No [if yes separate inspection required]
Laundry system inspected (yes or no): -
Seasonal use: (yes or no): No
Water meter readings, if available (last 2 years usage (gpd)): N/A
Sump pump (yes or no): No
Last date of occupancy: Current (1 person)

COMMERCIAL/INDUSTRIAL

Type of establishment: _____
Design flow (based on 310 CMR 15.203): _____ gpd
Basis of design flow (seats/persons/sqft, etc.): _____
Grease trap present (yes or no): _____
Industrial waste holding tank present (yes or no): _____
Non-sanitary waste discharged to the Title 5 system (yes or no): _____
Water meter readings, if available: _____
Last date of occupancy/use: _____

OTHER (describe): _____

GENERAL INFORMATION

Pumping Records


Source of information: _____
Was system pumped as part of the inspection (yes or no): _____
If yes, volume pumped: 1000 gallons -- How was quantity pumped determined? Mess.
Reason for pumping: _____

TYPE OF SYSTEM

- Septic tank, distribution box, soil absorption system
- Single cesspool
- Overflow cesspool
- Privy
- Shared system (yes or no) (if yes, attach previous inspection records, if any)
- Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner)
- Tight tank Attach a copy of the DEP approval
- Other (describe): _____

Approximate age of all components, date installed (if known) and source of information:
40 years

Were sewage odors detected when arriving at the site (yes or no): No

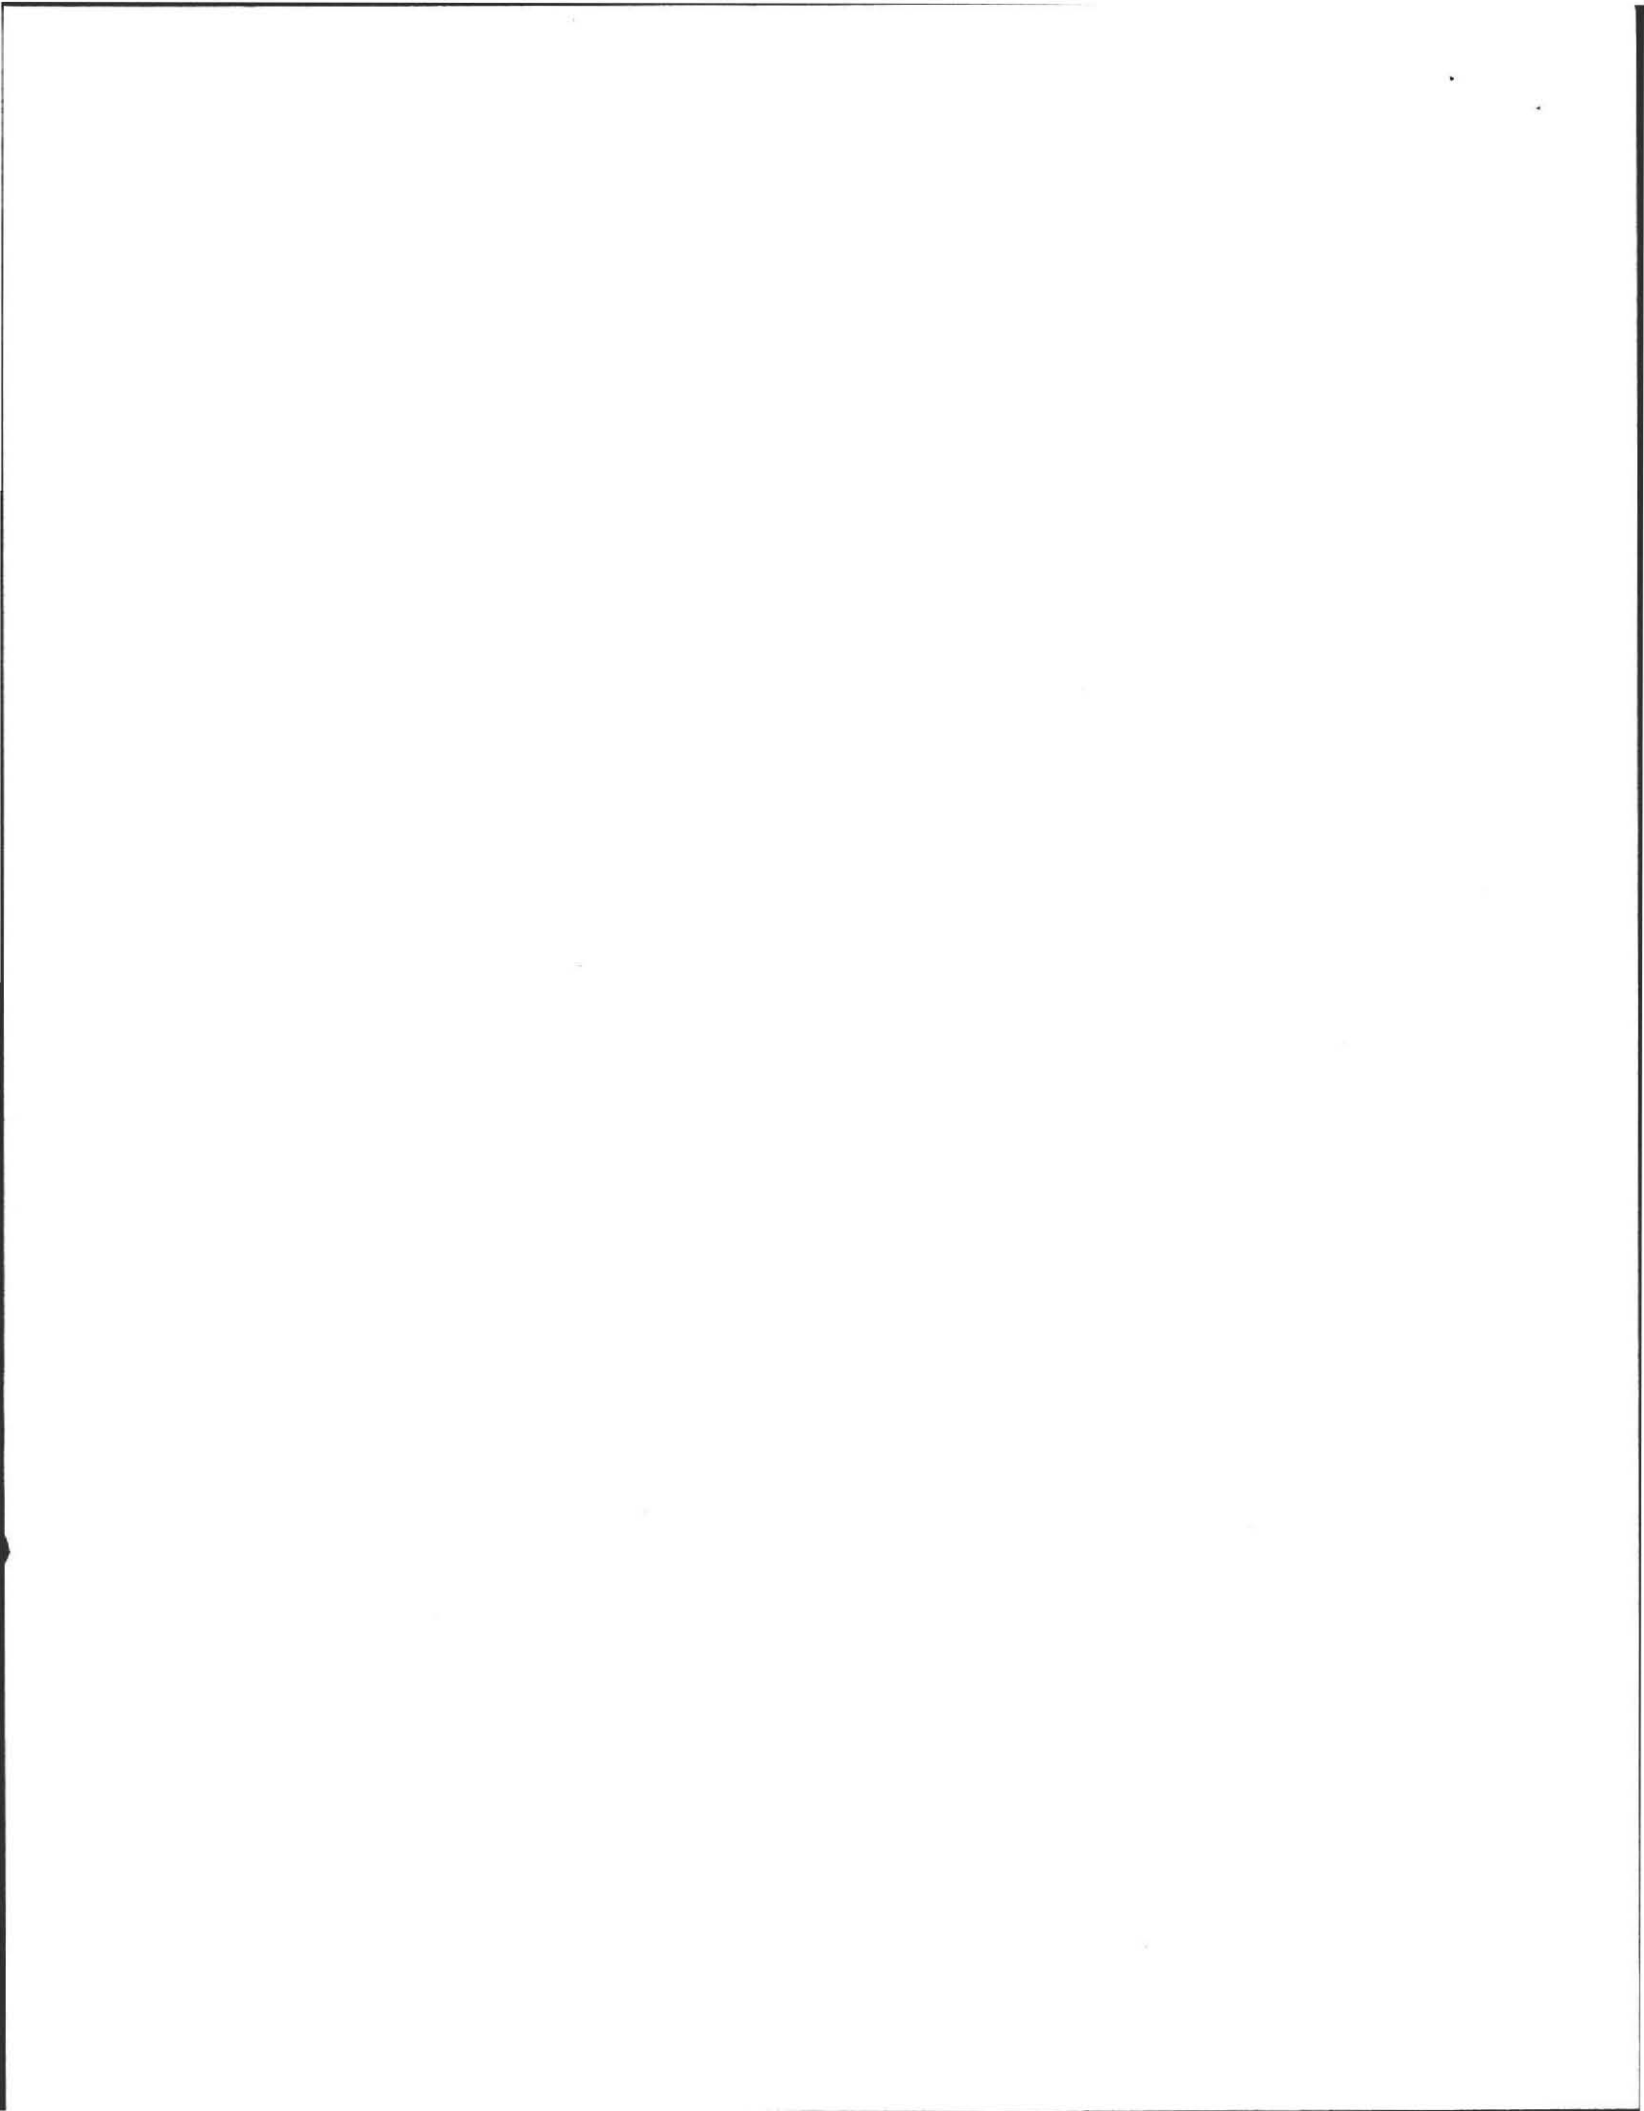

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM

PART C

SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd

Owner: Simon

Date of Inspection: 10/7/04

BUILDING SEWER (locate on site plan)

Depth below grade: 12"

Materials of construction: cast iron 40 PVC other (explain): _____

Distance from private water supply well or suction line: 10'

Comments (on condition of joints, venting, evidence of leakage, etc.):

OK.

SEPTIC TANK: Yes (locate on site plan)

Depth below grade: 12"

Material of construction: concrete metal fiberglass polyethylene
 other(explain) _____

If tank is metal list age: ____ Is age confirmed by a Certificate of Compliance (yes or no): ____ (attach a copy of certificate)

Dimensions: 8' x 4' x 4'

Sludge depth: 6"

Distance from top of sludge to bottom of outlet tee or baffle: 36"

Scum thickness: 4"

Distance from top of scum to top of outlet tee or baffle: 4"

Distance from bottom of scum to bottom of outlet tee or baffle: 12"

How were dimensions determined: MEAS.

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

OK condition, baffles built in. Levels OK.

GREASE TRAP: No (locate on site plan)

Depth below grade: ____

Material of construction: concrete metal fiberglass polyethylene other (explain): _____

Dimensions: _____


Scum thickness: _____

Distance from top of scum to top of outlet tee or baffle: _____

Distance from bottom of scum to bottom of outlet tee or baffle: _____

Date of last pumping: _____

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

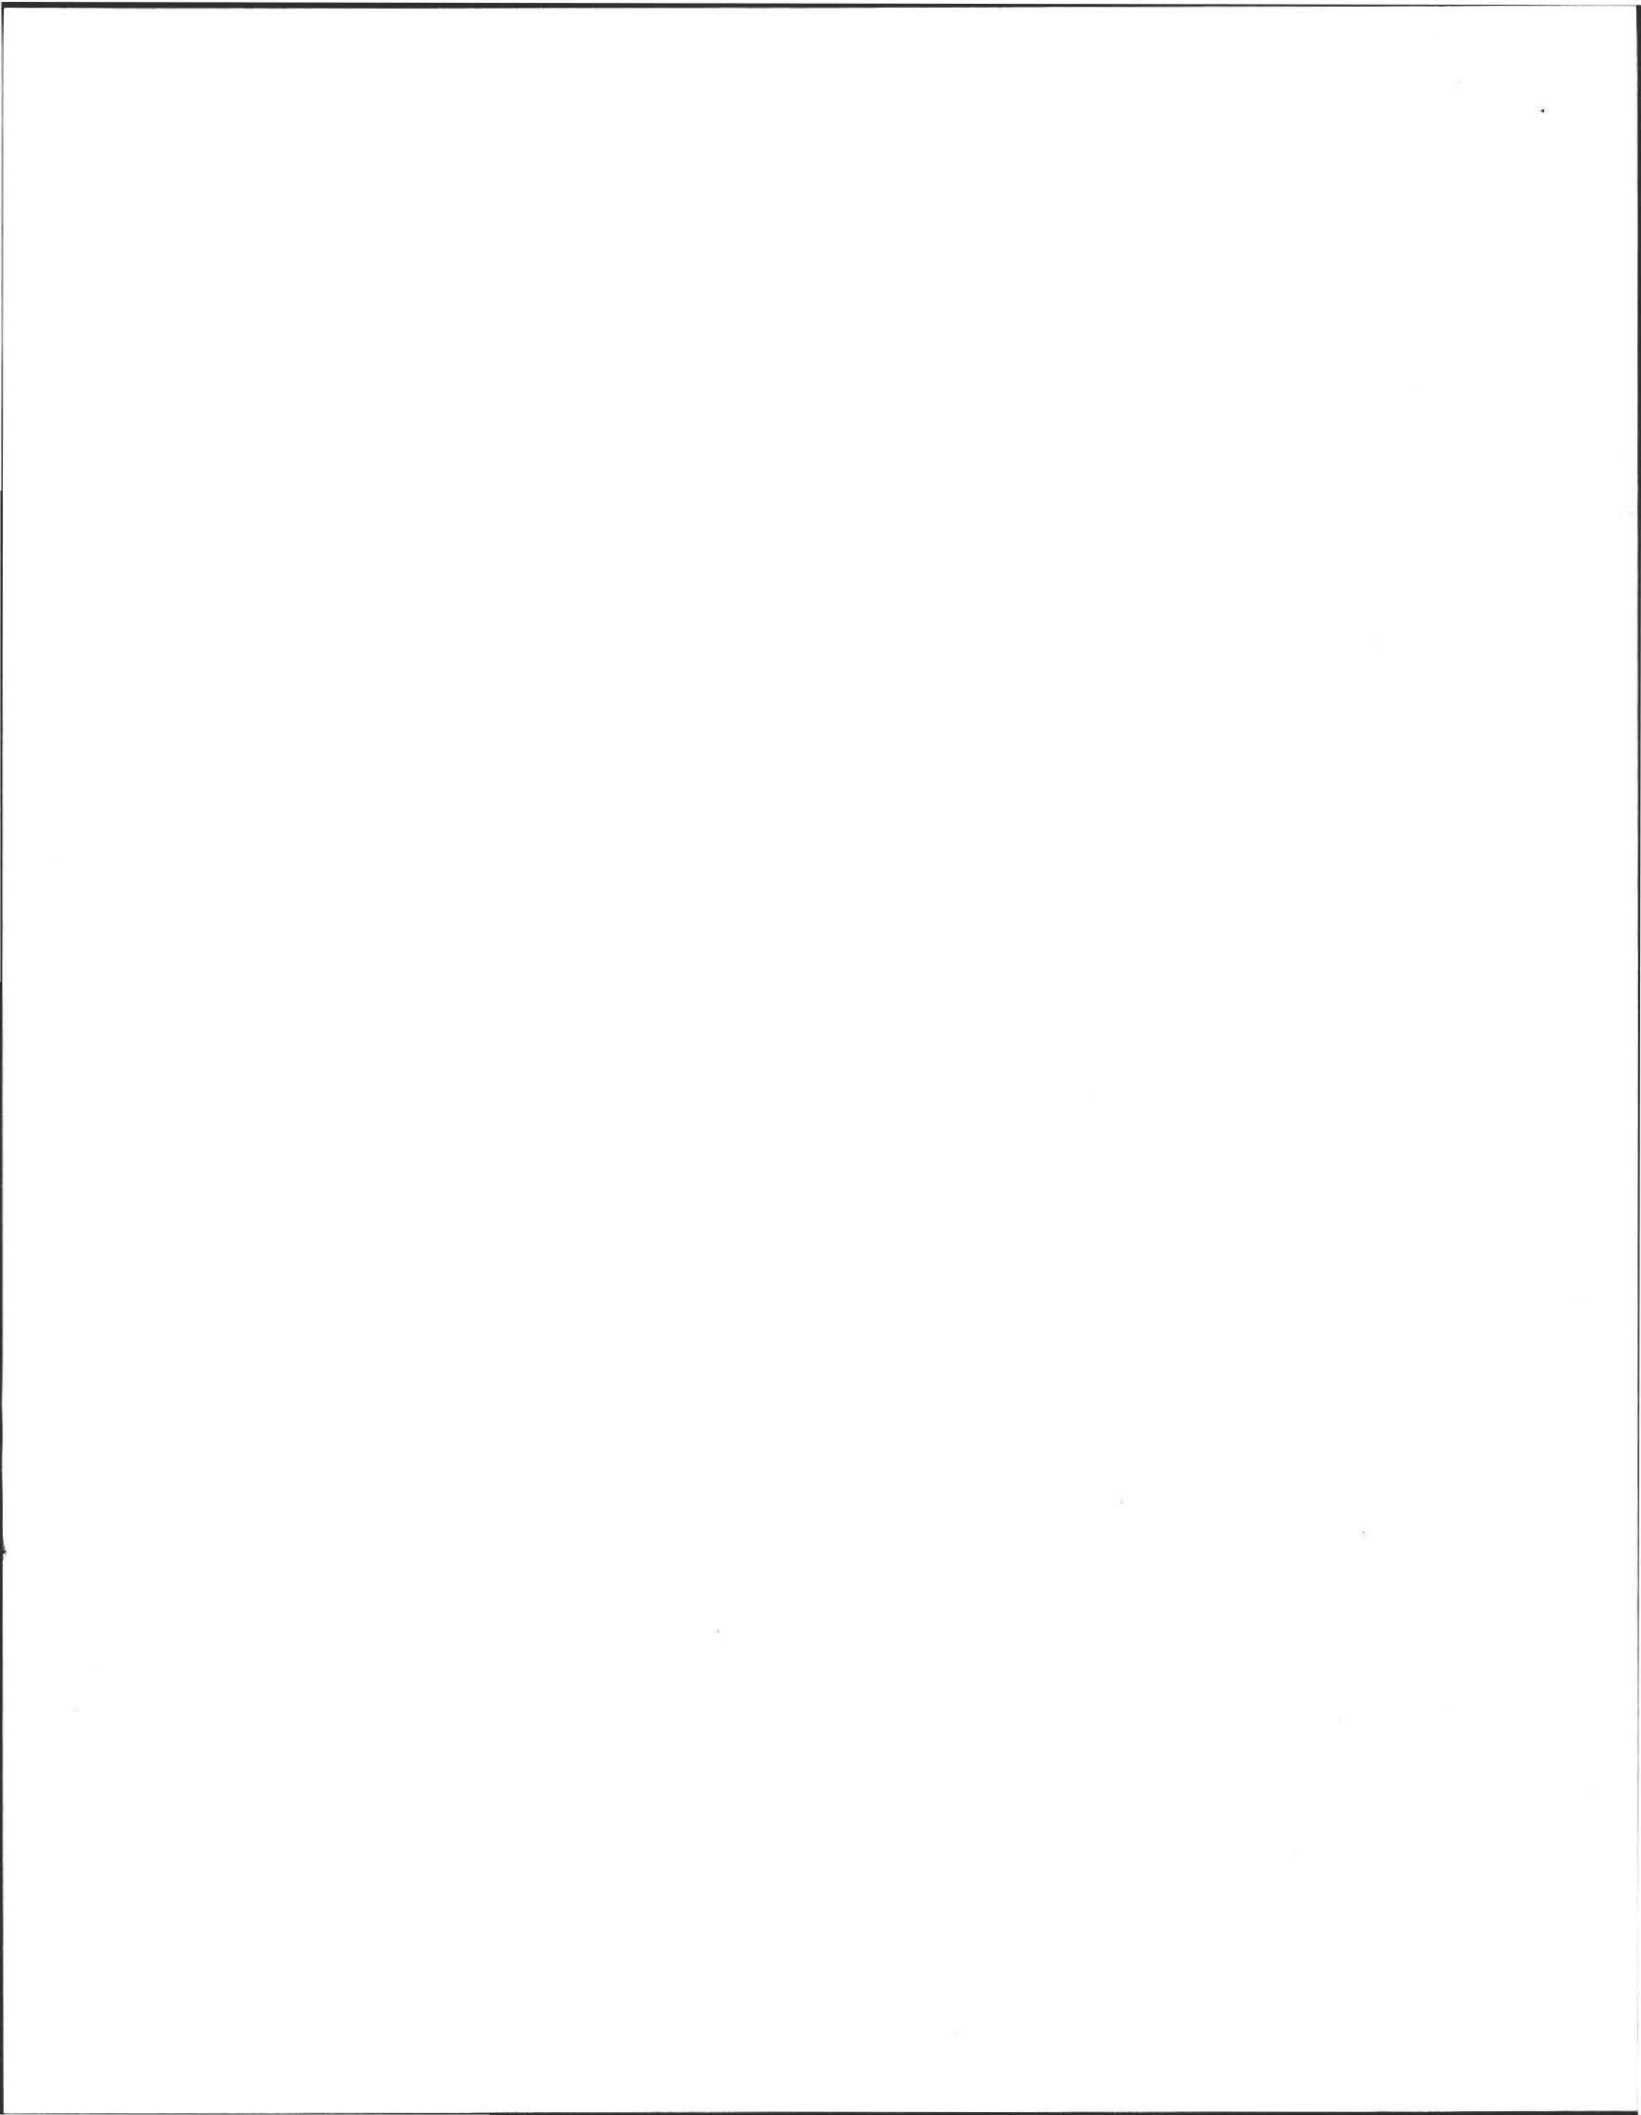

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/7/04

TIGHT or HOLDING TANK: No (tank must be pumped at time of inspection)(locate on site plan)

Depth below grade: _____

Material of construction: _____ concrete _____ metal _____ fiberglass _____ polyethylene _____ other(explain): _____

Dimensions: _____

Capacity: _____ gallons

Design Flow: _____ gallons/day

Alarm present (yes or no): _____

Alarm level: _____ Alarm in working order (yes or no): _____

Date of last pumping: _____

Comments (condition of alarm and float switches, etc.): _____

DISTRIBUTION BOX: Yes (if present must be opened)(locate on site plan)

Depth of liquid level above outlet invert: e.i.n.o.

Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.):


Soft, needs replacement, replaced 10/19/04 (Au) OK.

PUMP CHAMBER: No (locate on site plan)

Pumps in working order (yes or no): _____

Alarms in working order (yes or no): _____

Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.): _____

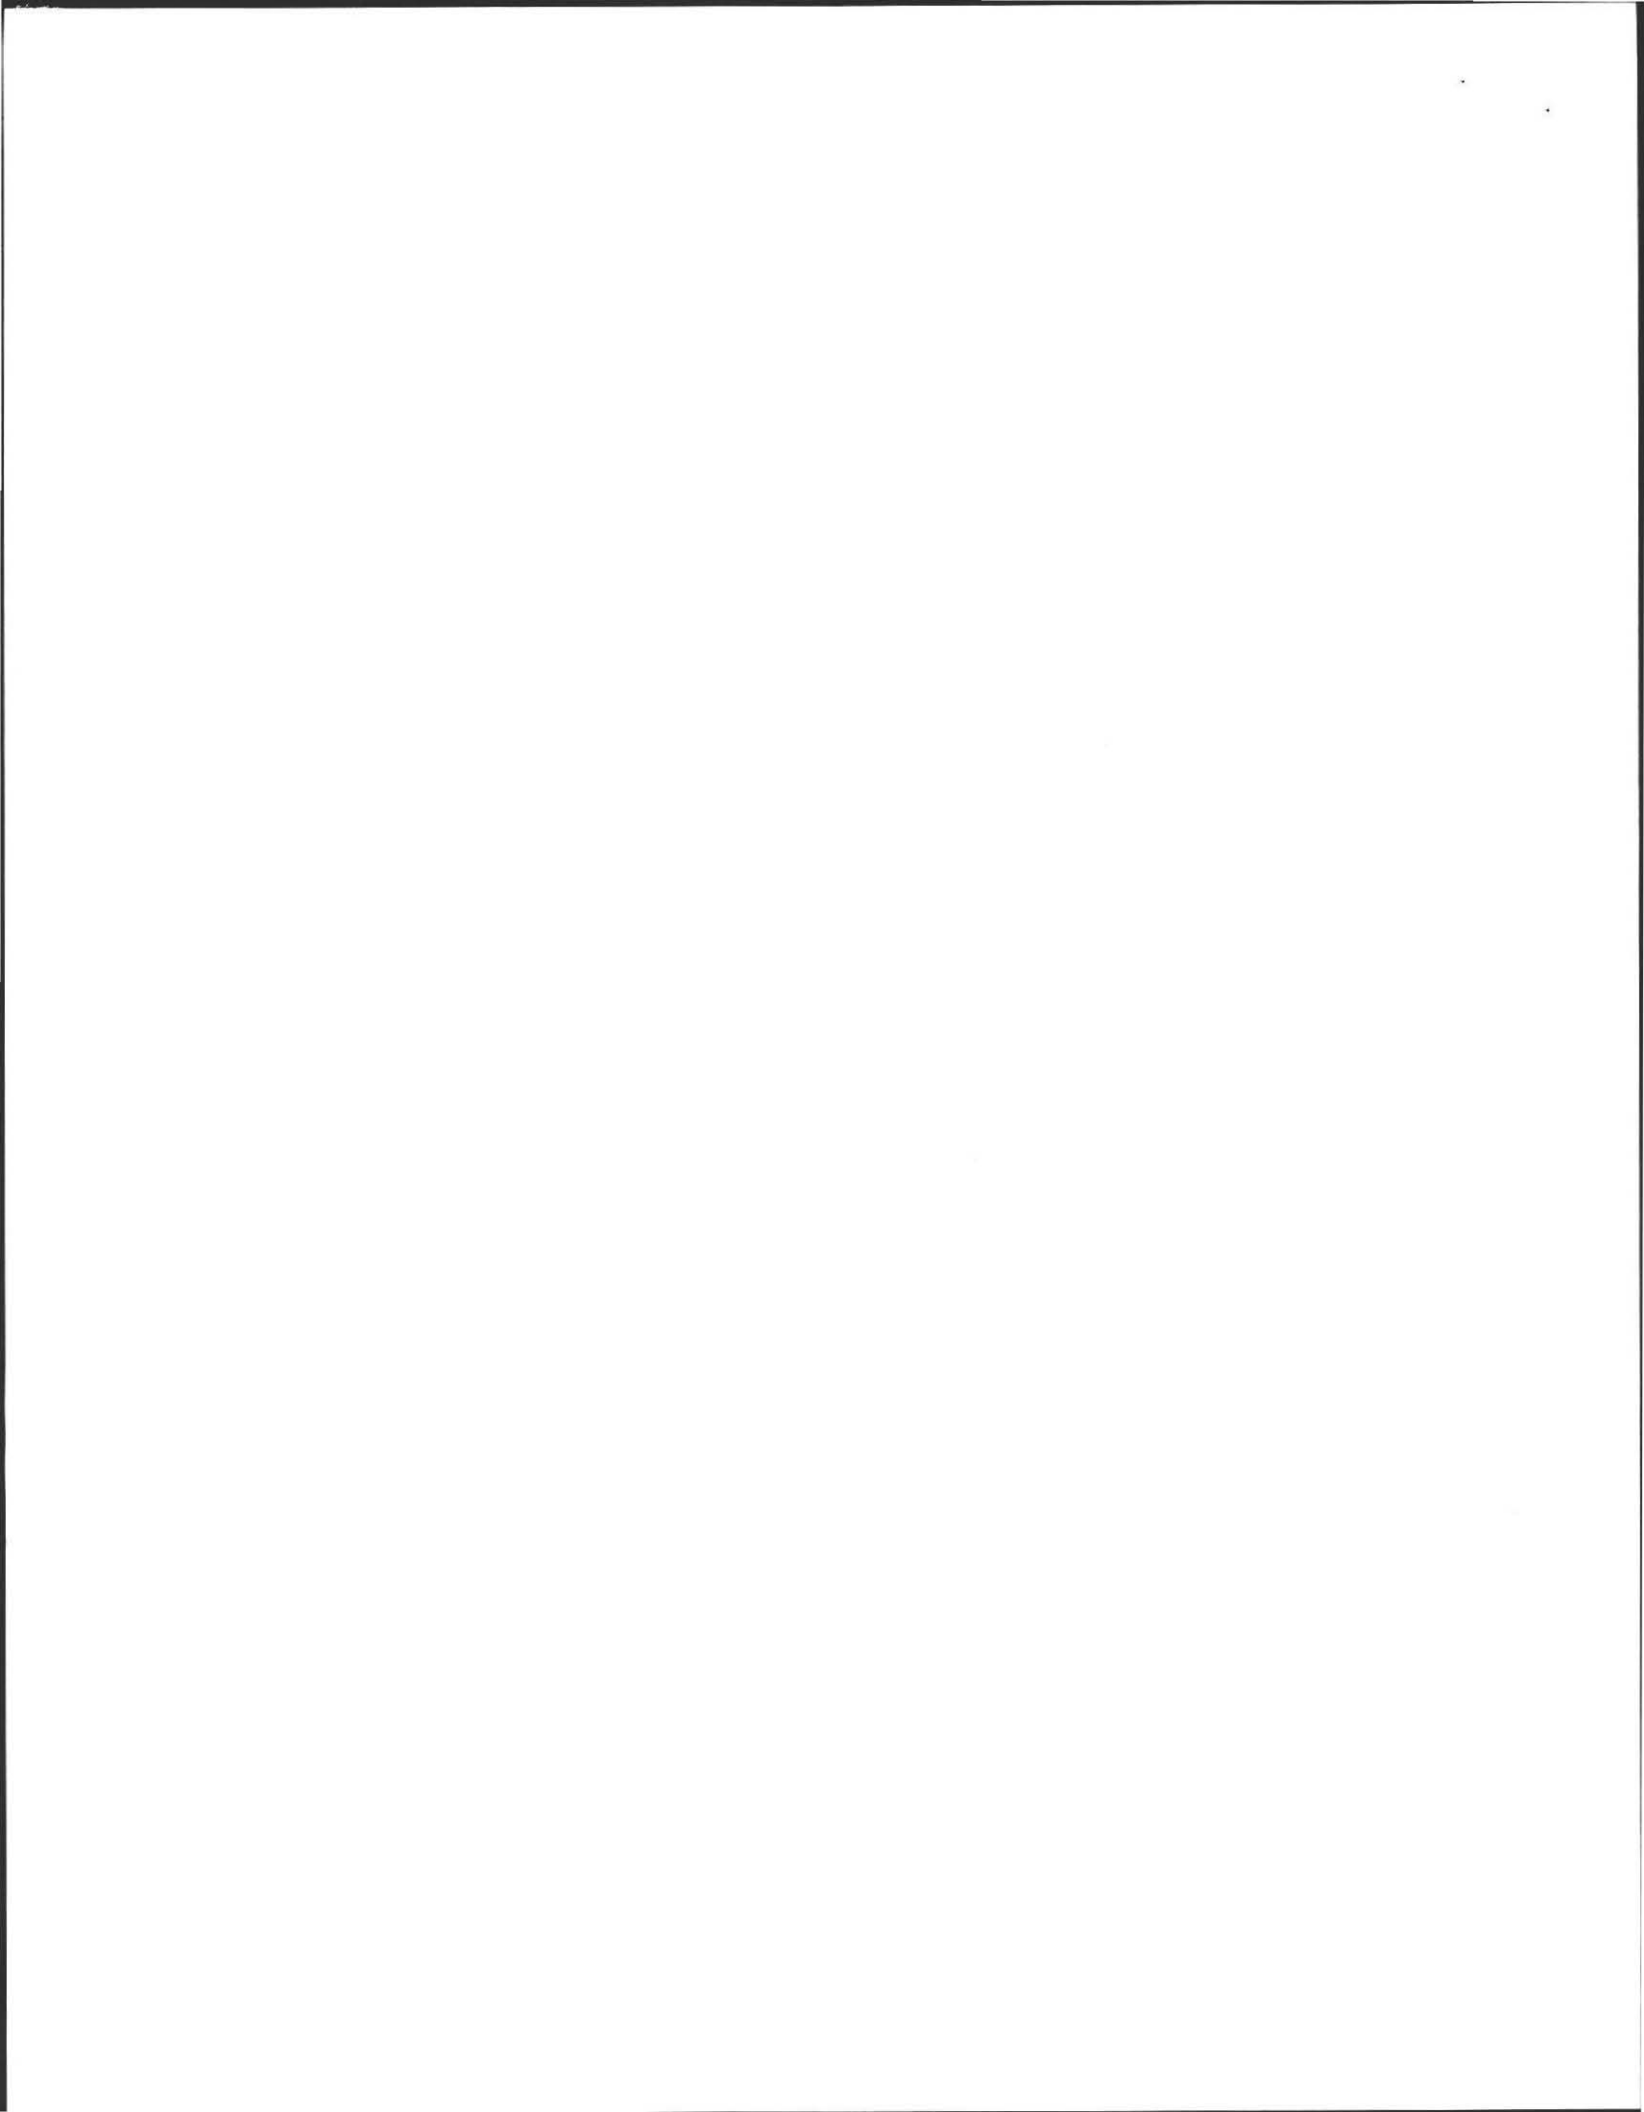

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: SIMON

Date of Inspection: 10/7/04

SOIL ABSORPTION SYSTEM (SAS): Yes (locate on site plan, excavation not required)

If SAS not located explain why:

Type

___ leaching pits, number: ___

___ leaching chambers, number: ___

___ leaching galleries, number: ___

___ leaching trenches, number, length: ___

1 leaching fields, number, dimensions: 30' L x 20' W +/-

___ overflow cesspool, number: ___

___ innovative/alternative system Type/name of technology: _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.):

No signs of failure noted

CESSPOOLS: No (cesspool must be pumped as part of inspection)(locate on site plan)

Number and configuration: _____

Depth – top of liquid to inlet invert: _____

Depth of solids layer: _____

Depth of scum layer: _____

Dimensions of cesspool: _____

Materials of construction: _____

Indication of groundwater inflow (yes or no): _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):


PRIVY: No (locate on site plan)

Materials of construction: _____

Dimensions: _____

Depth of solids: _____

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

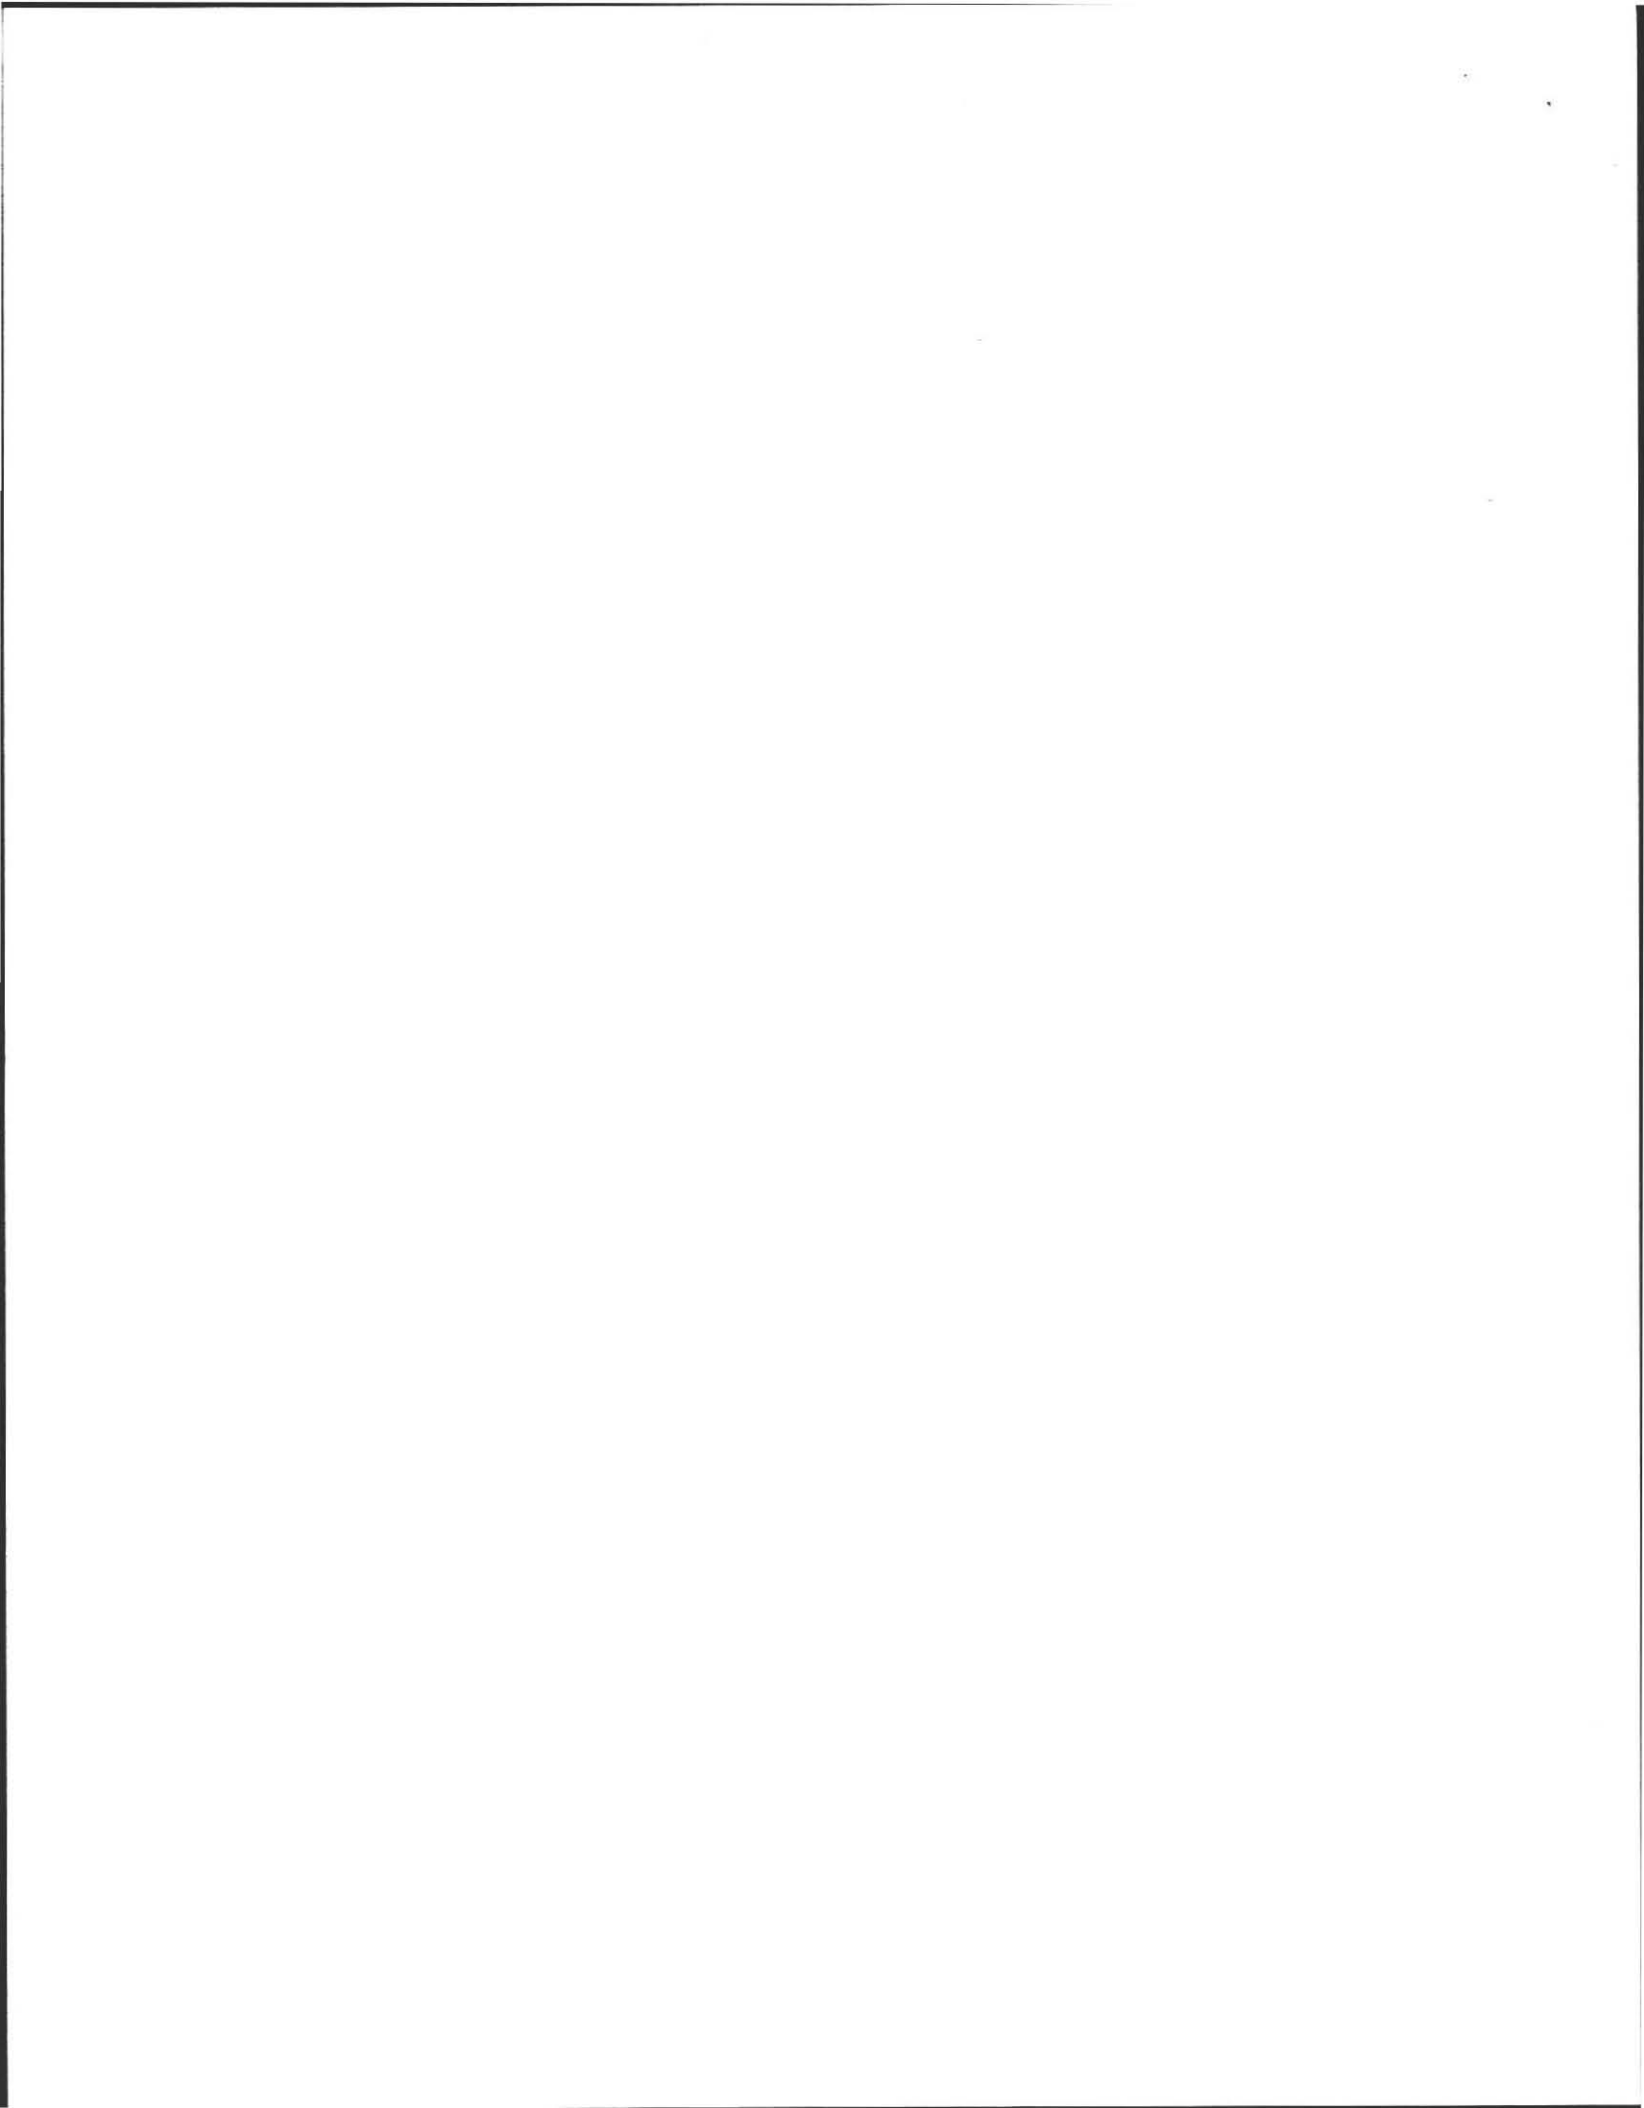

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.


Owner: Simon

Date of Inspection: 10/7/04

SKETCH OF SEWAGE DISPOSAL SYSTEM

Provide a sketch of the sewage disposal system including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building.

See Attached D. Box replacement sketch.

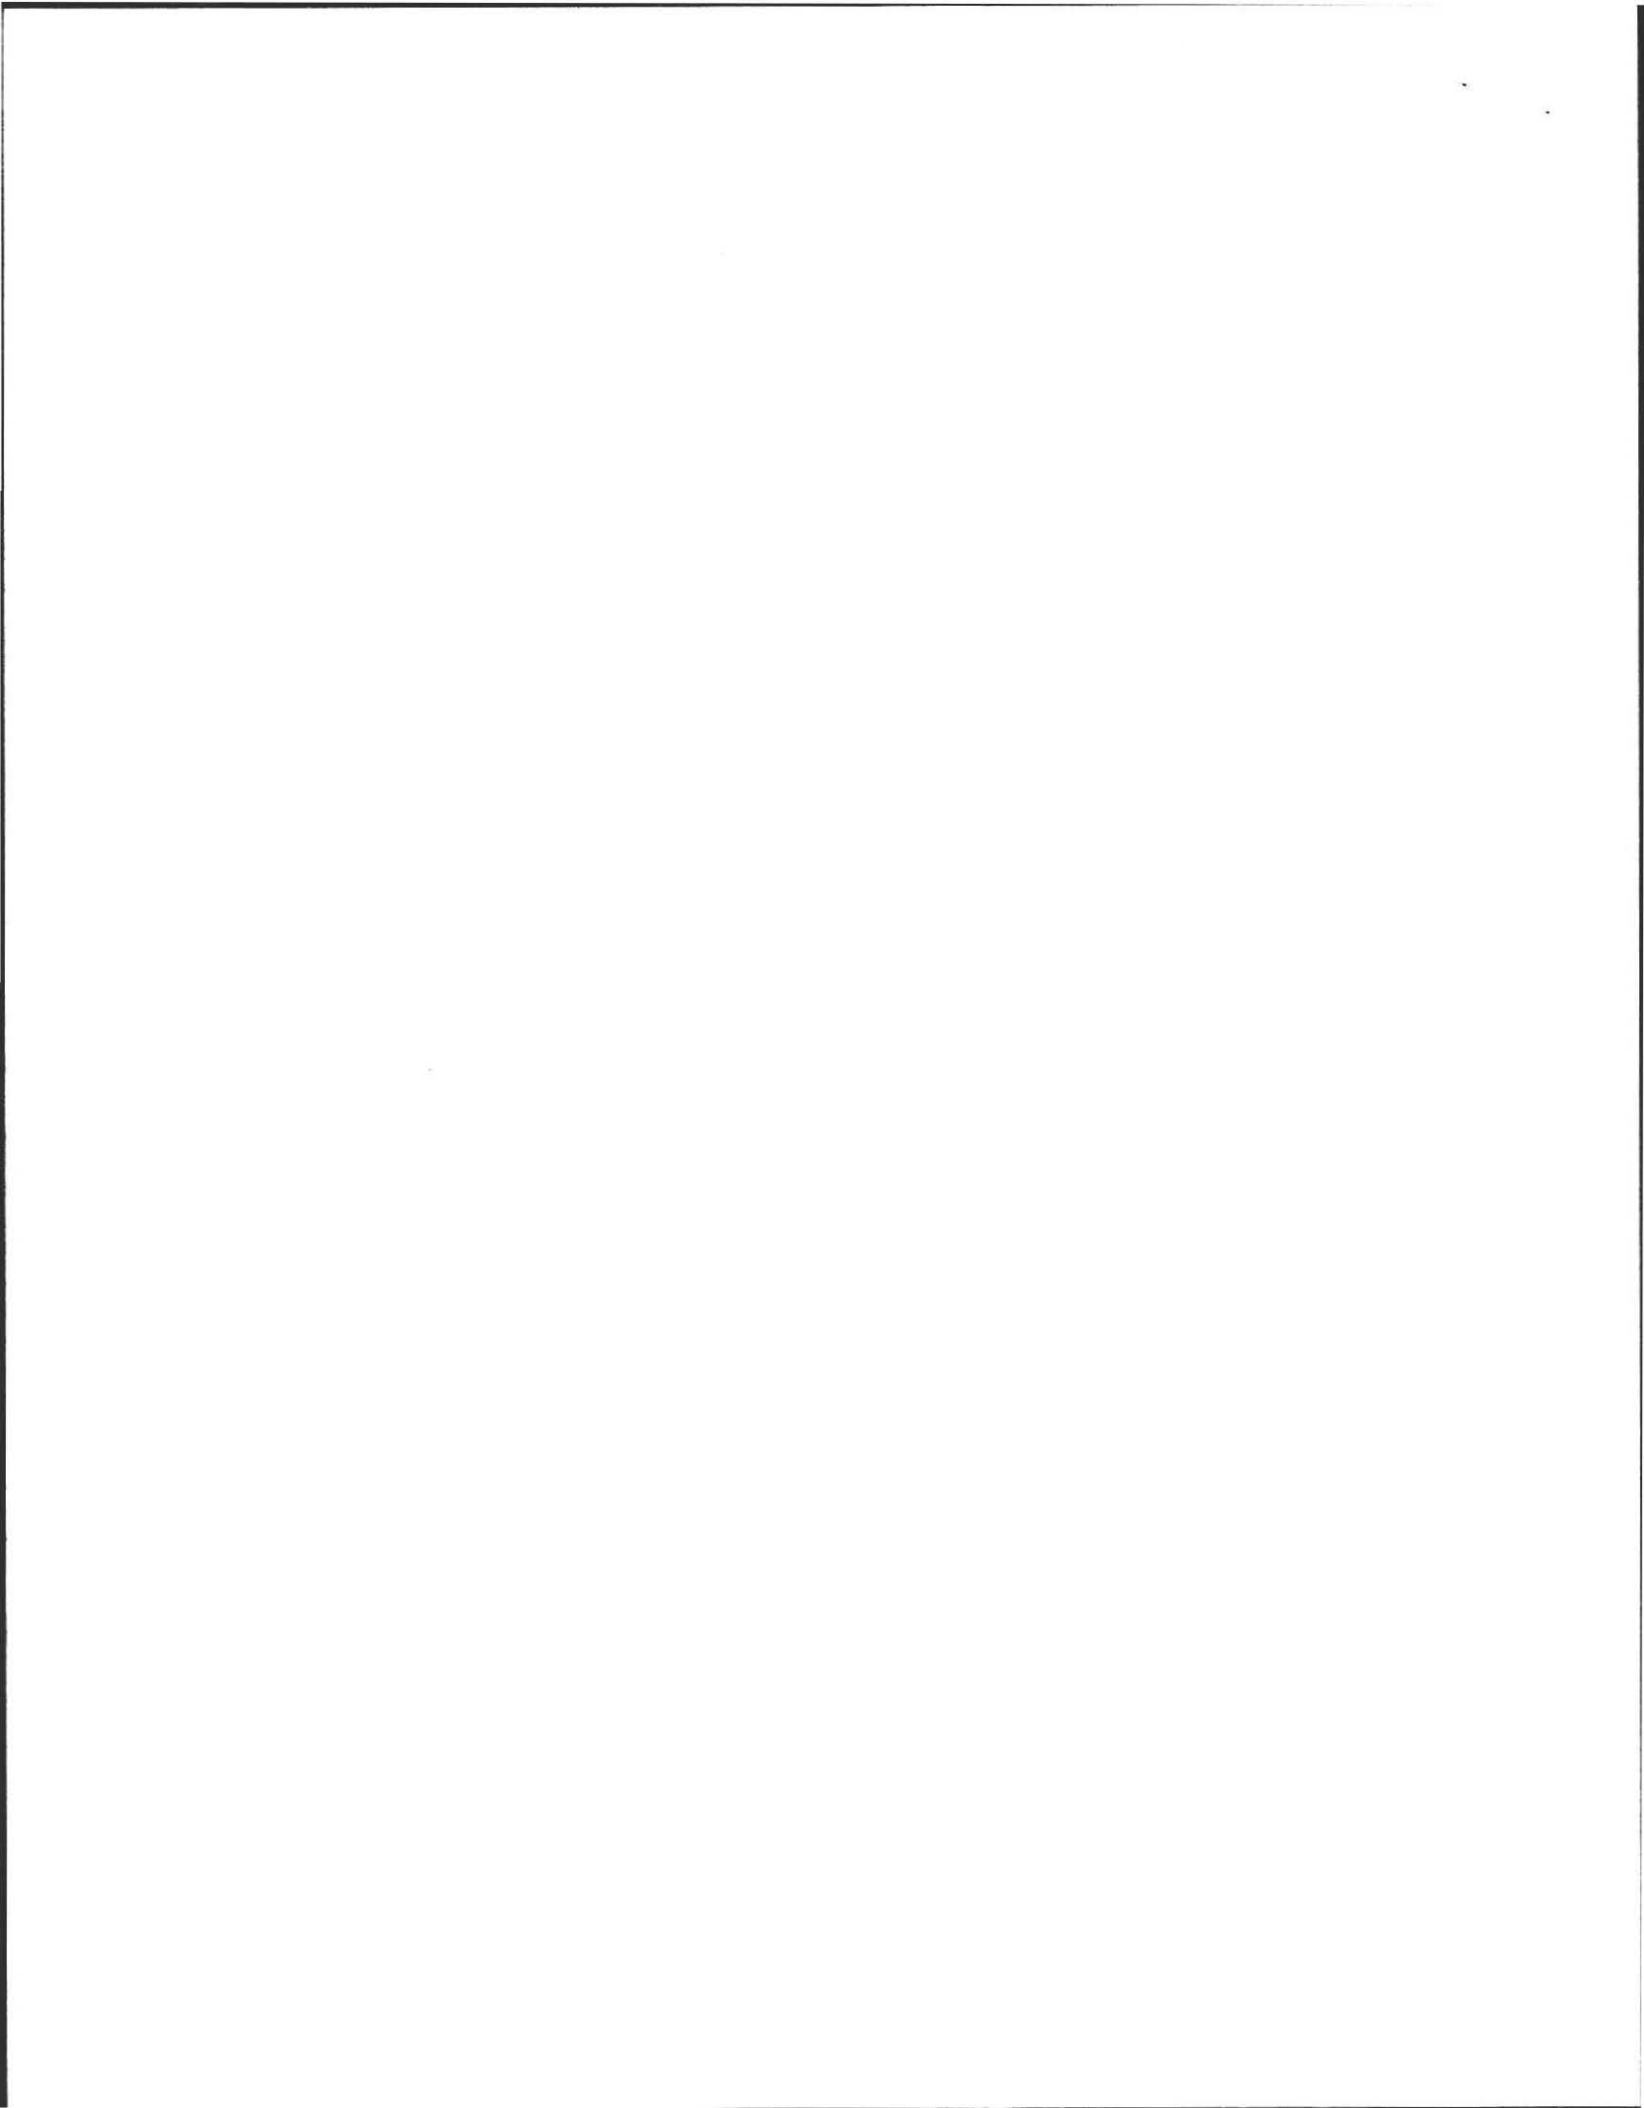

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM

PART C

SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/17/04

SITE EXAM

Slope

Surface water

Check cellar

Shallow wells


Estimated depth to ground water 4' feet

Please indicate (check) all methods used to determine the high ground water elevation:

- Obtained from system design plans on record - If checked, date of design plan reviewed: _____
- Observed site (abutting property/observation hole within 150 feet of SAS)
- Checked with local Board of Health-explain: _____
- Checked with local excavators, installers- (attach documentation)
- Accessed USGS database-explain: _____

You must describe how you established the high ground water elevation:

Soil bore hole below D. Box.

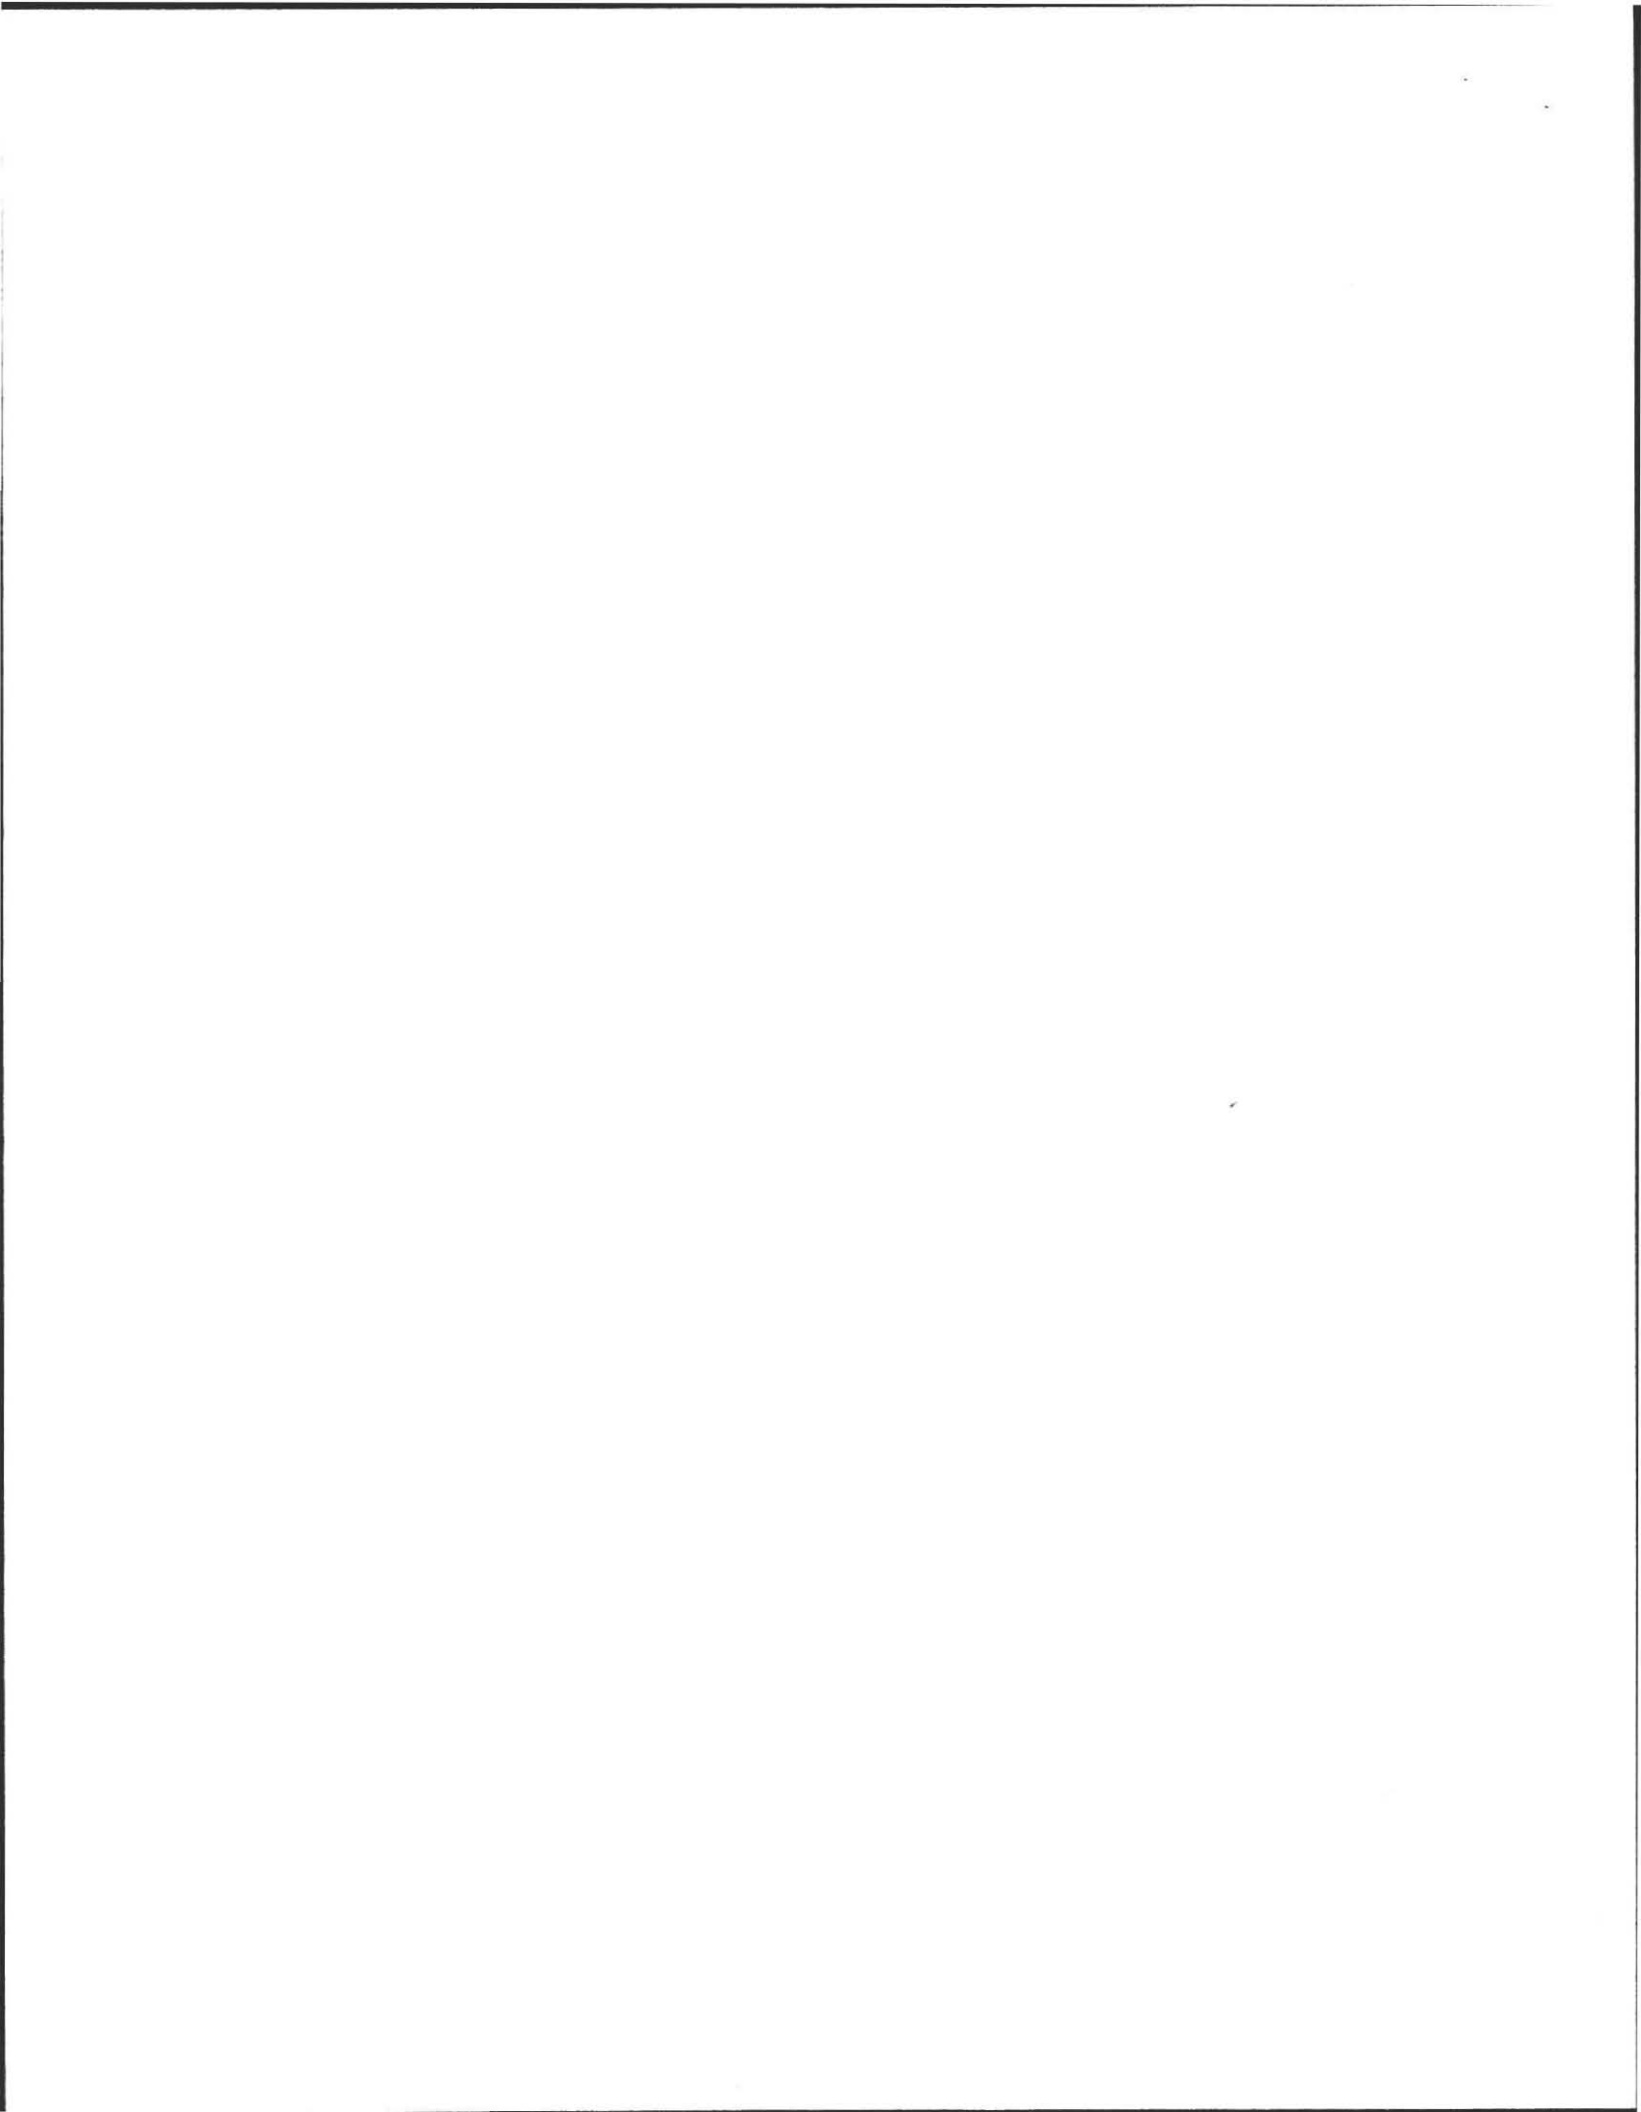

DISTR
OF HC
OF BC

STATION ROAD

1. REPL
USE

DRIVE

2. INS

3. USE

4. USE


5. REPL

6. REN


7. COM

CONNE

PR

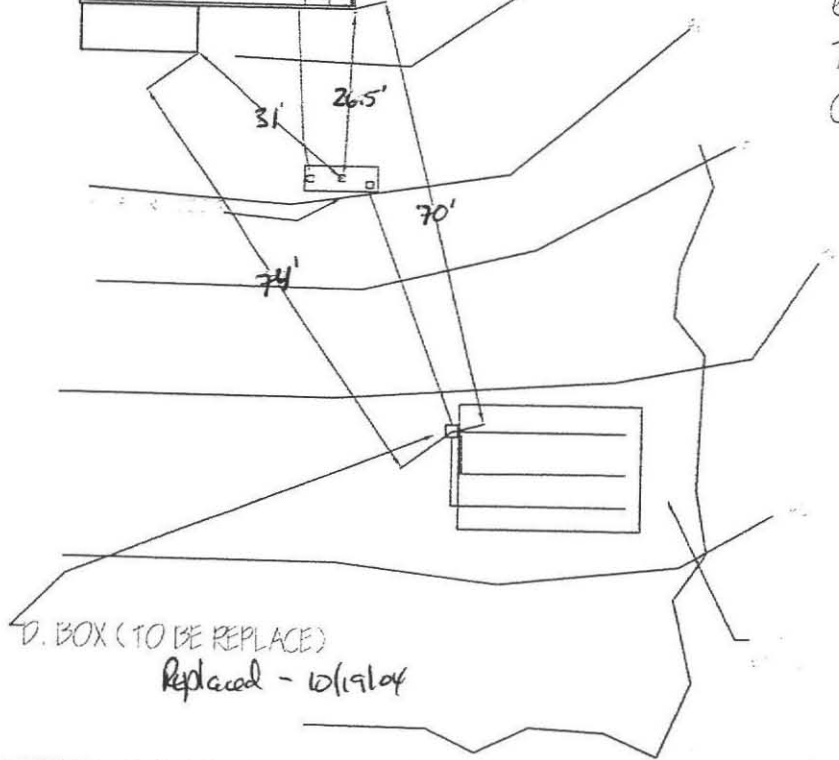


LOCATIONS & ELEVATIONS FOR DISTRIBUTION BOX REPLACEMENT PURPOSES ONLY
(NOT AN ACTUAL SURVEY)

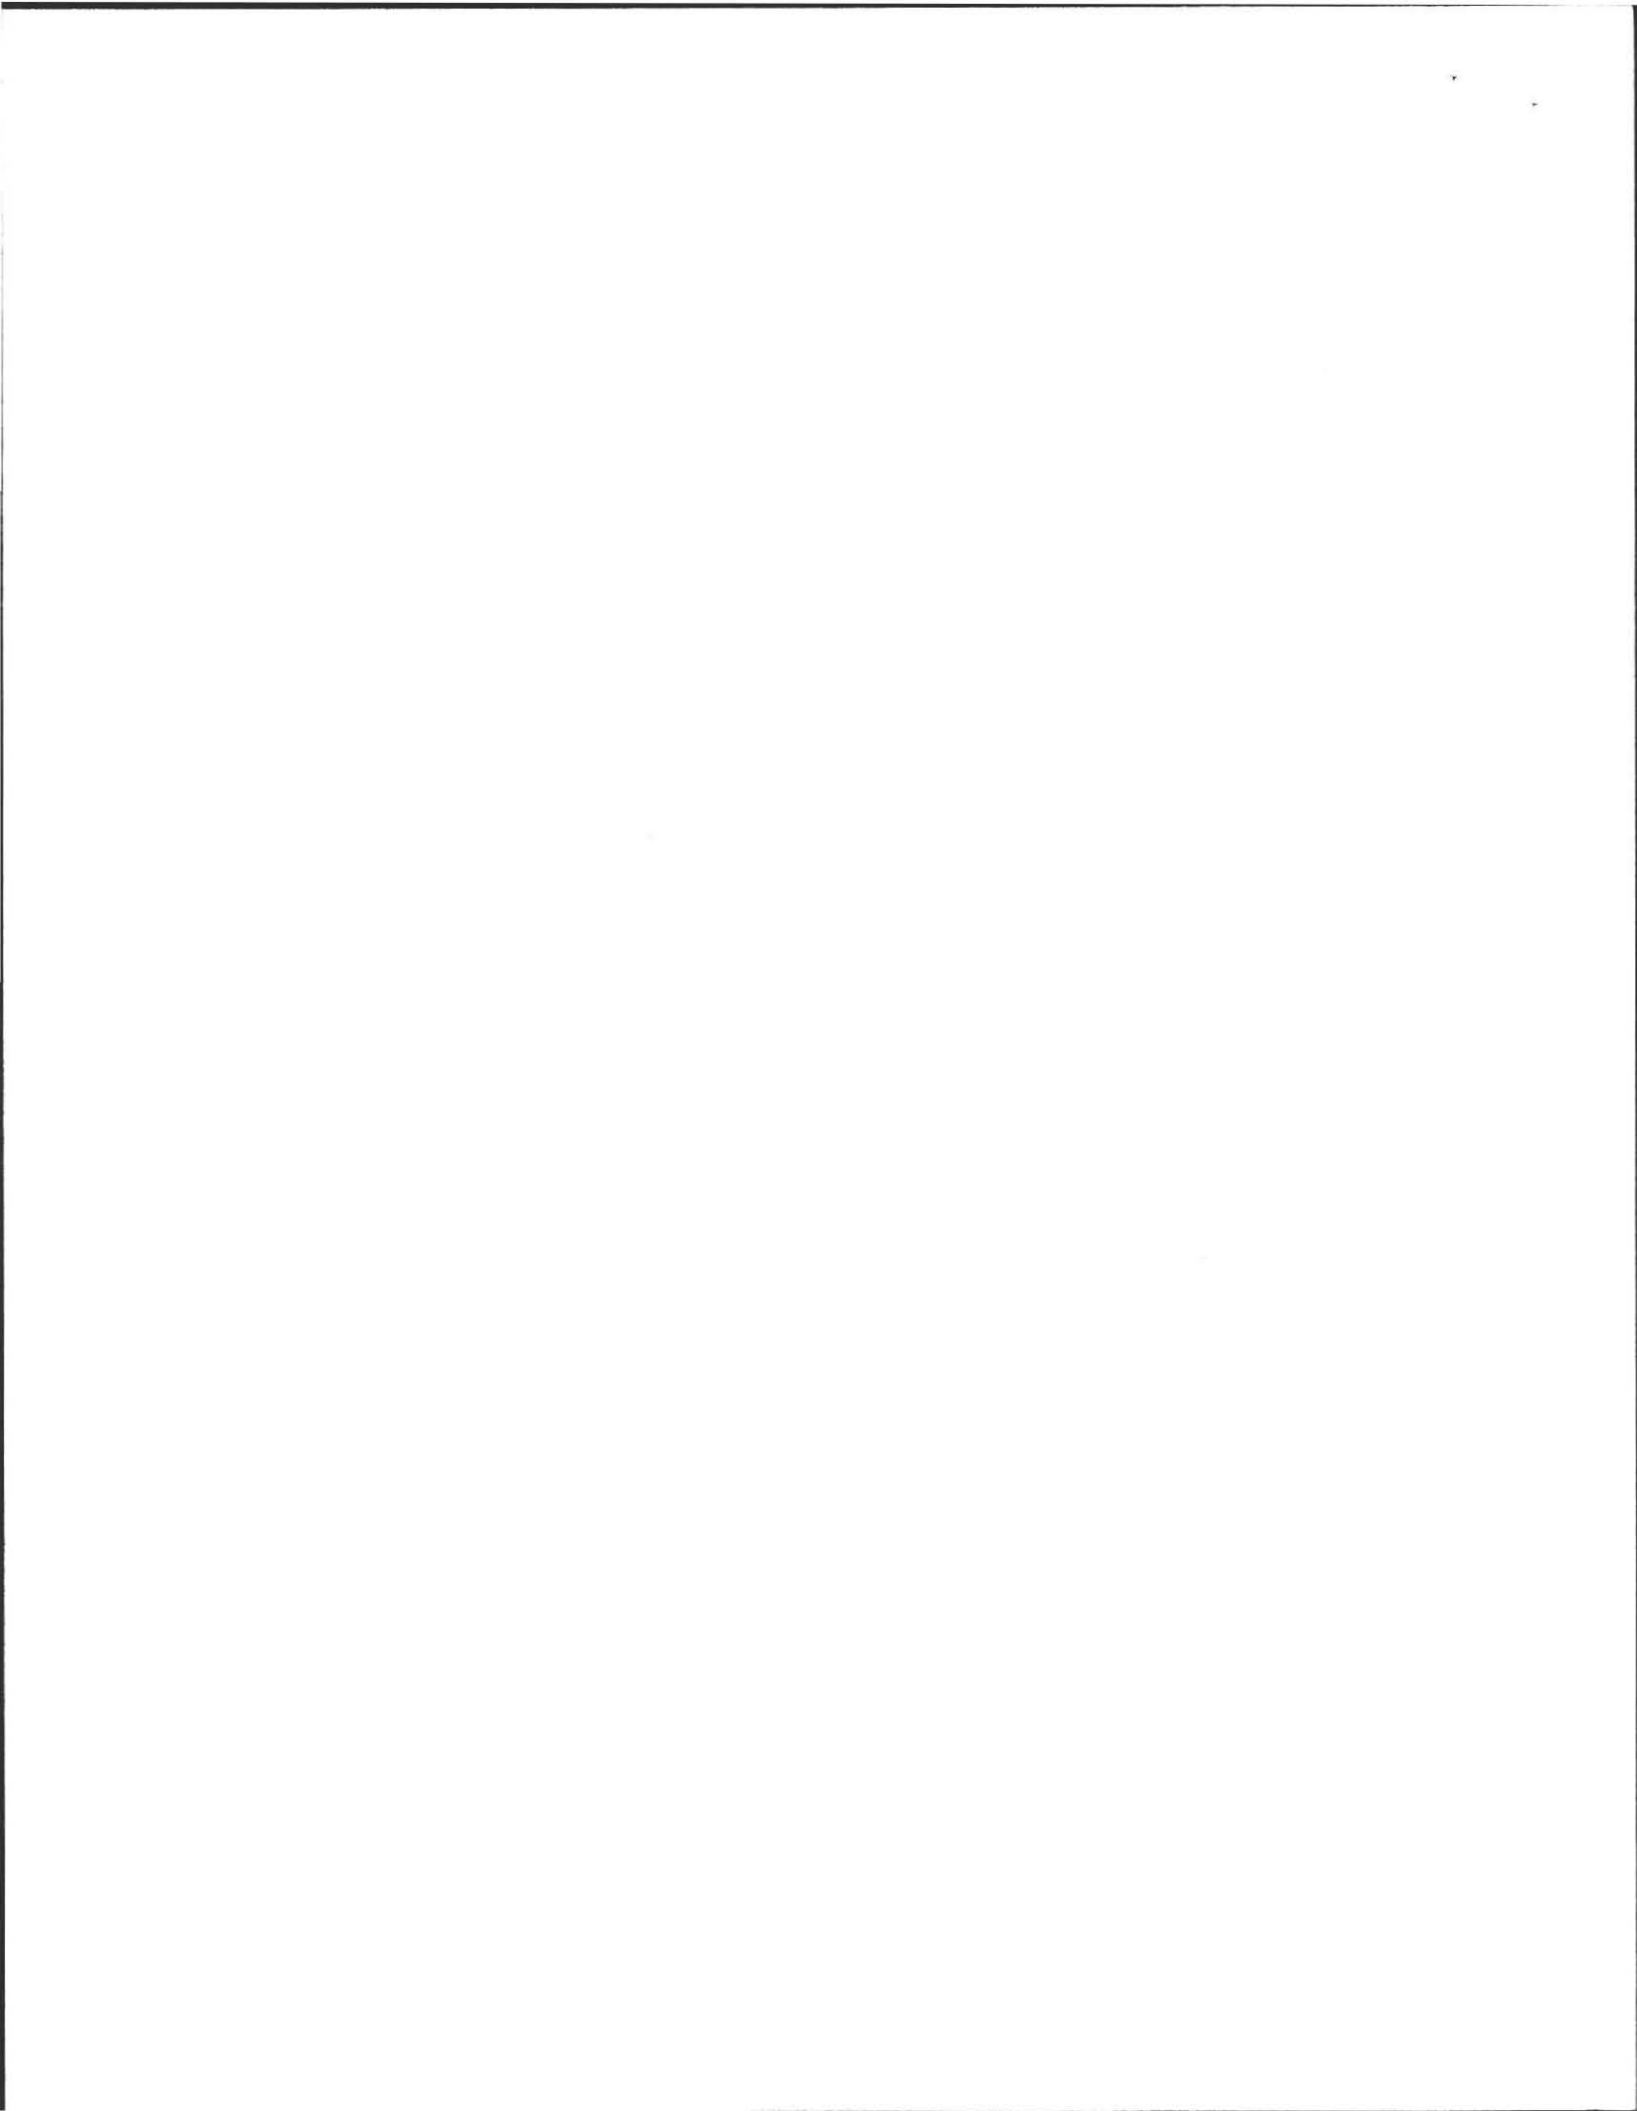

DISTRIBUTION BOX INSTALLATION NOTES: (BM= 100.0' @ SILL OF HOME) (NOTE CONTACT ENGINEER PRIOR TO REPLACEMENT OF BOX IF SATURATED STONE IS OBSERVED.)

J ROAD

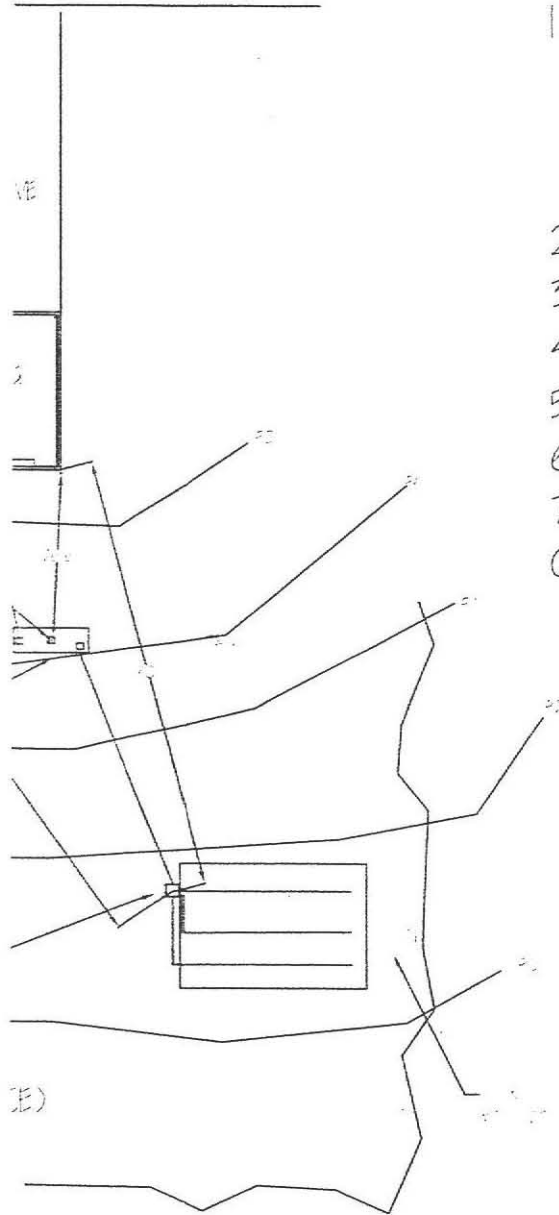

DISTRIBUTION BOX REPLACEMENT PURPOSES ONLY.

1. REPLACE D. BOX WITH NEW WATERTIGHT ONE
USE CONCRETE DIST BOX.

INLET INVERT ELEVATION: 89.35'

OUTLET INVERT ELEVATION: 89.10'

2. INSTALL SCH 40 PVC TEES AS NOTED.

3. USE 6" OF WASHED STONE (.75 TO 1.50") AS BASE

4. USE 0.01 FT/ FT PITCH MIN ON SEWER LINE INTO BOX.

5. REPLACE PIPE CONNECTING TO D. BOX.

6. REMOVE AND DISPOSE OLD BOX.

7. CONTACT ENGINEER & HEALTH DEPT. FOR BOX AND
CONNECTION INSPECTION


PRIOR TO BACKFILL.

Cold Spring Environment

350 Old Enfield
Belchertown, Ma

PLAN DATE: 10/11/04

DIST. BOX REPLACEMENT
605 STATION!

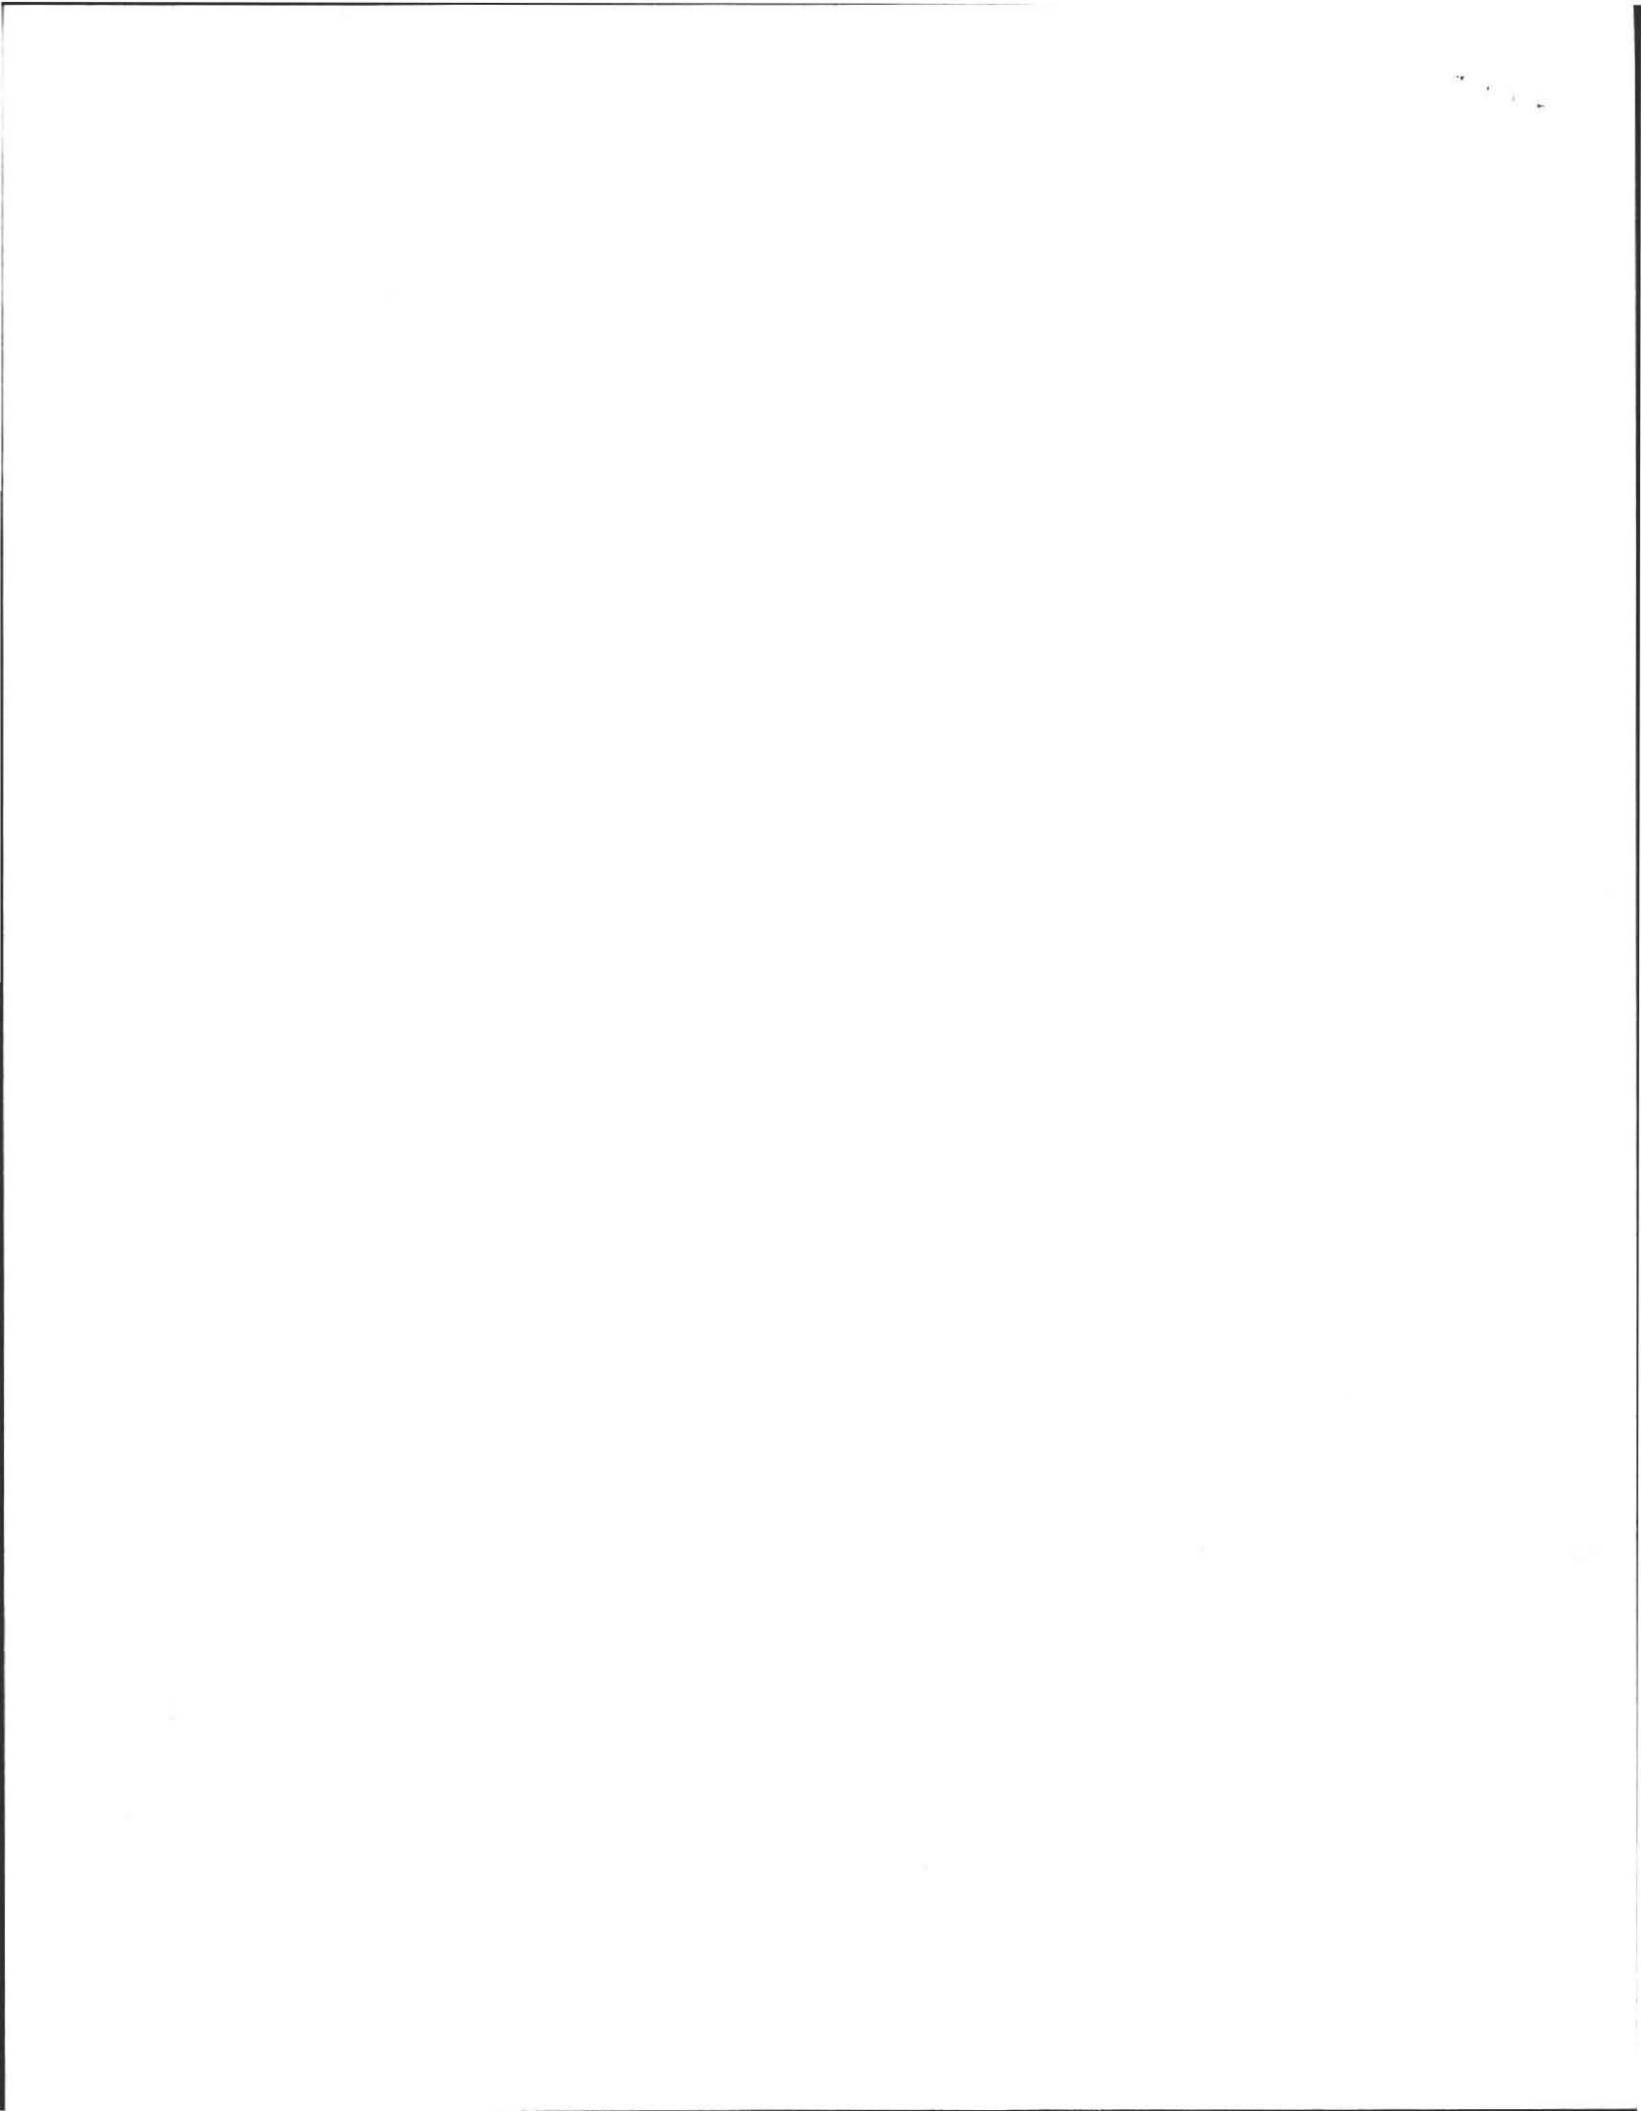

Memo

To: Lara Simon.
From: Alan Weiss, Cold Spring Environmental, Inc.
Date: 10/10/04
Re: D. Box Repair Plan (& Bd. Of Health Approval of Permit),
605 Station Road

Enclosed are Your Septic system Plans for D. Box replacement, the permits must be signed and approved by the Health Dept. prior to the start of work.

Have your contractor contact me before they start work. The D. Box needs to be replaced and re-inspected. It is the jurisdiction of The Board of Health, at the Health Department. Sign the permit copies and attach a check for \$ proper amount 50.00??? the Health Dept is on the second floor of the Bangs Ctr. Then your contactor can simply install a box, I must then reinspect and issue you follow-up report.

- 1) Sign All Copies and submit to the Local Board of Health with the proper fees (\$ 50.00) for approval.
- 2) Should you have any questions, please do not hesitate to call

Thank you,

Enclosed is the inspection report for your Property.


Should you have any questions, please do not hesitate to call 323-5957

Thank you,

Alan Weiss.

Cold Spring Environmental
350 Old Enfield Road
Belchertown, Ma. 01007

413-323-5957, phone, Aeweiss@charter.net

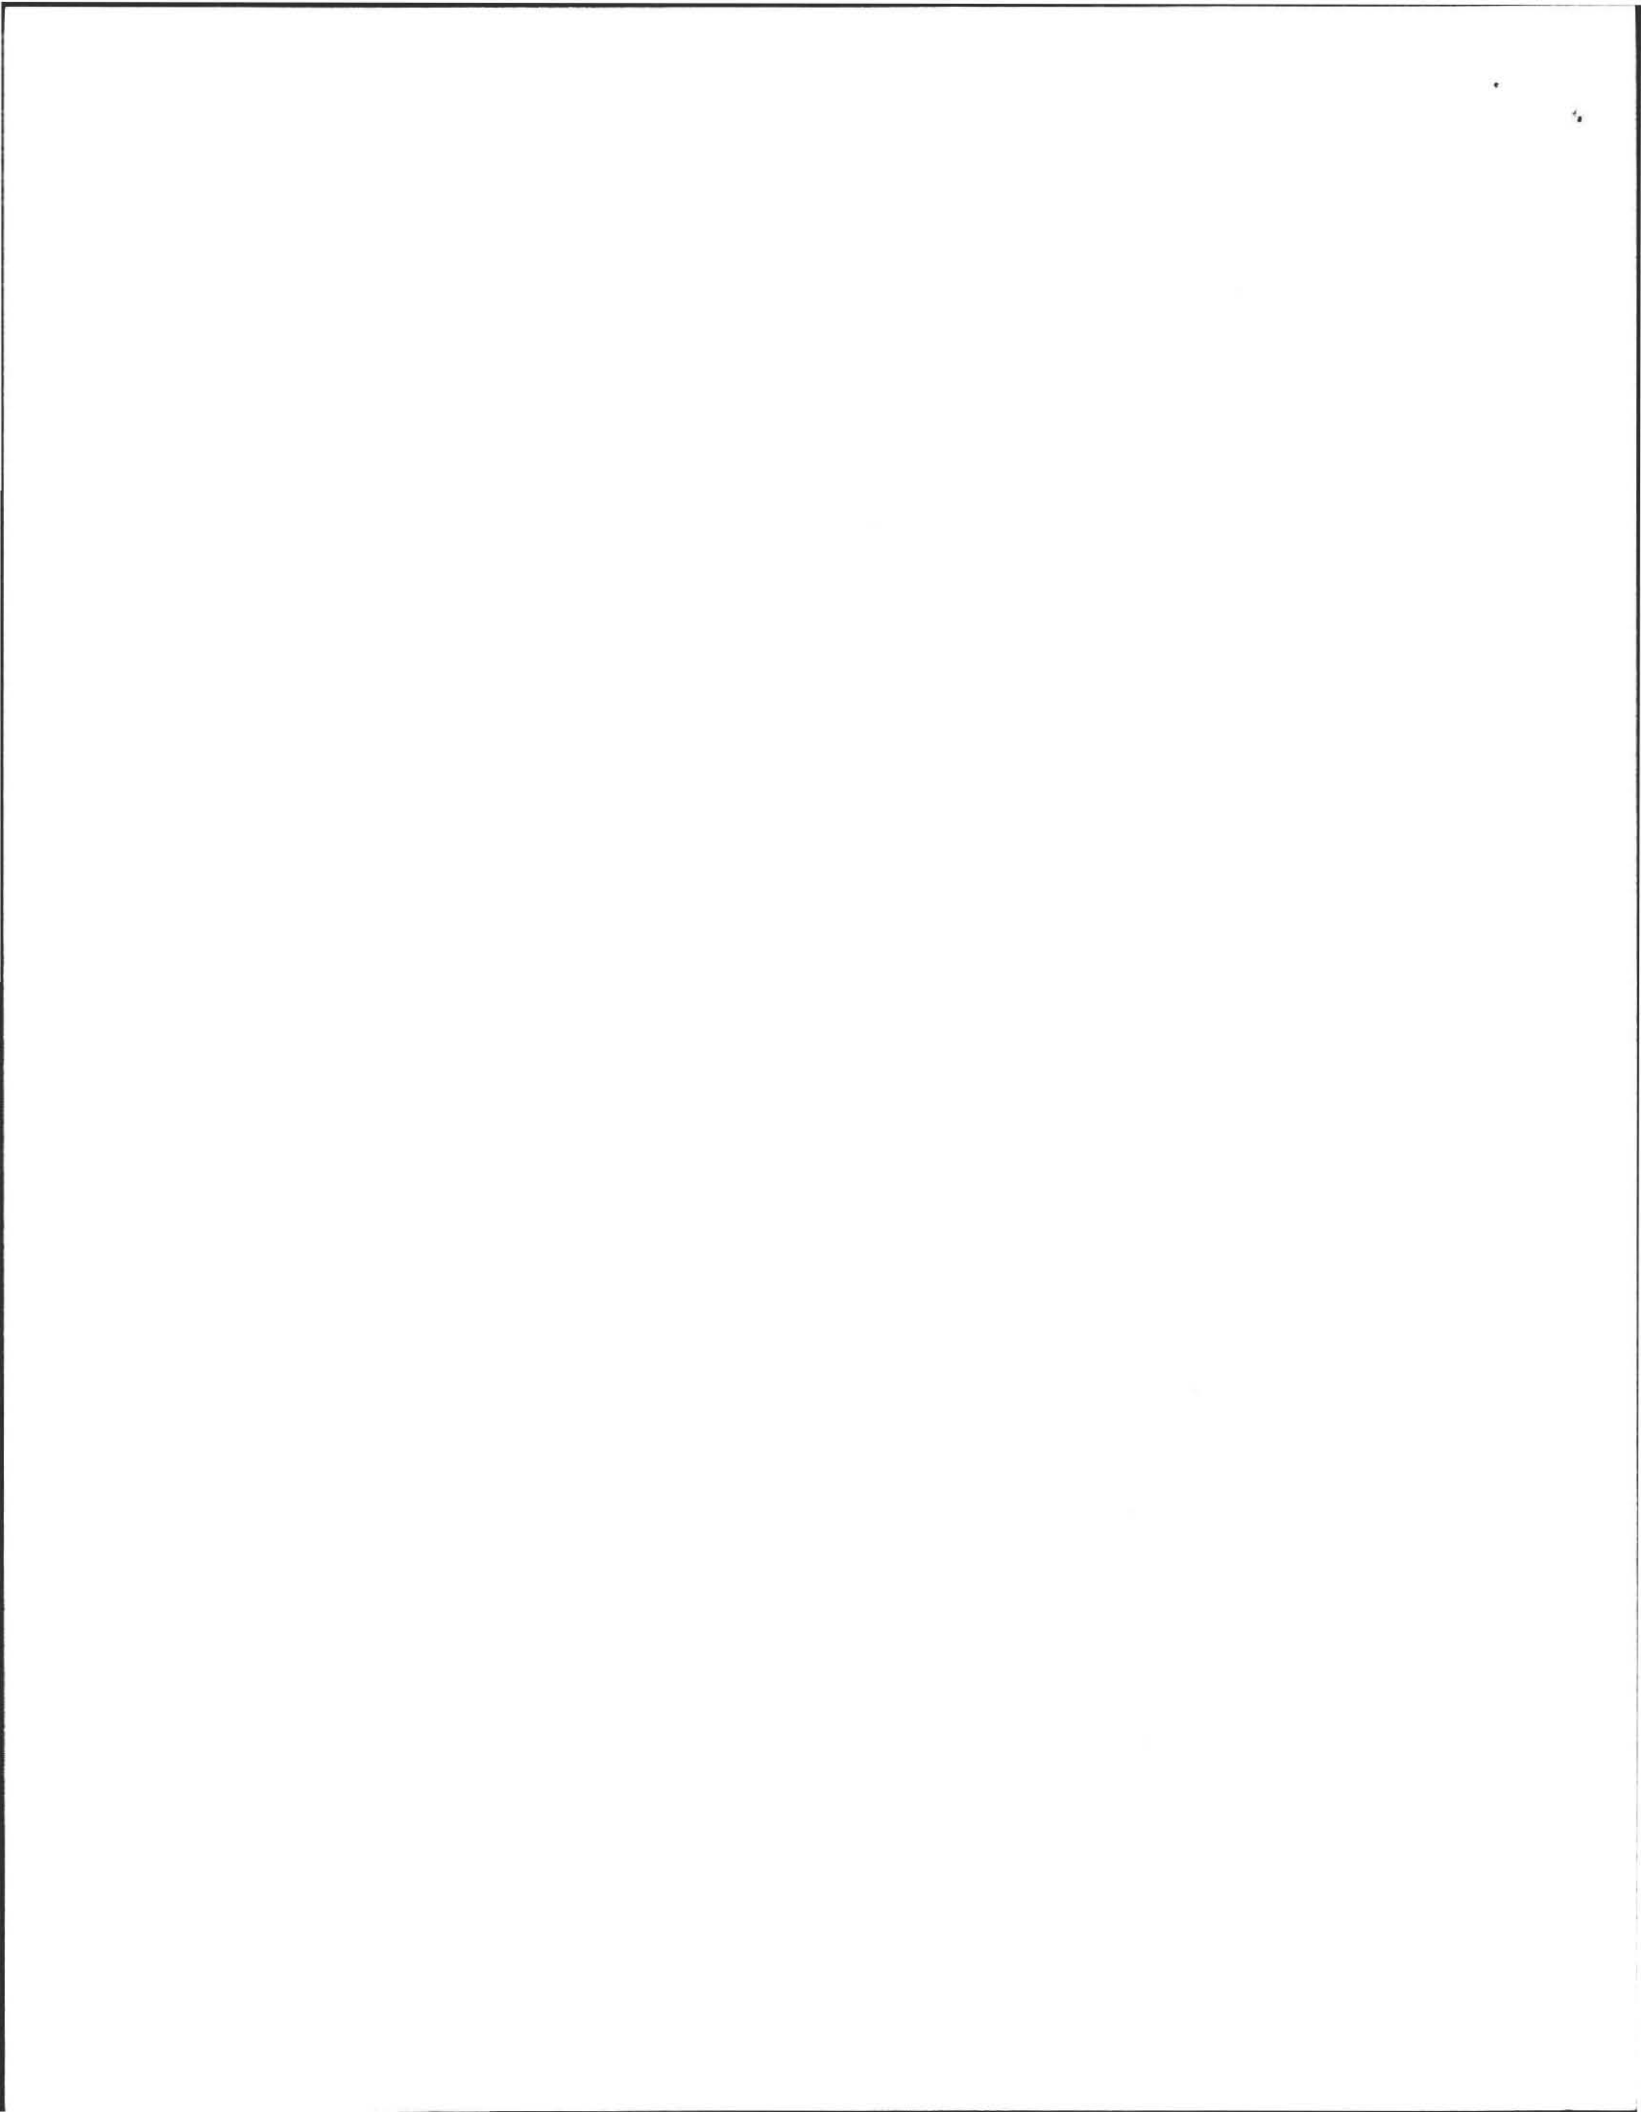

TITLE 5
OFFICIAL INSPECTION FOR - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM FORM
PART A
CERTIFICATION

Property Address: 605 Station Road, Amherst, MA
Owner's Name: Lara Simon
Address: 605 Station Road
Amherst, MA 01002
Date of Inspection: October 7, 2004

Name of Inspector: Alan E. Weiss, R.S # 933
Company Name: Cold Spring Environmental Inc.
Mailing Address: 350 Old Enfield Road
Belchertown, Massachusetts 01007
Telephone Number: (413) 323-5957 fax: 413-323-4916

CERTIFICATION STATEMENT

I certify that I have personally inspected the sewage disposal system at this address and that the information reported below is true, accurate and complete as of the time of the inspection. The inspection was performed based on my training and experience in the proper function and maintenance of on site sewage disposal systems. I am a DEP approved system inspector pursuant to Section 15.340 of Title 5 (310 CMR 15.000). The system:

Passes
 Conditionally Passes
 Needs Further Evaluation by the Local Approving Authority
 Fails


Inspector's Signature: _____ **Date:** October 7, 2004

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system is a shared system or has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

Notes and Comments:

1 person is now living in home. The D. box was crumbled. SAS is 40+/- years old. Septic tank was pumped & has inlet baffle & outlet baffle. D. box must be replaced. We do not recommend garbage disposals on the kitchen sink.

****This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same different conditions of use.

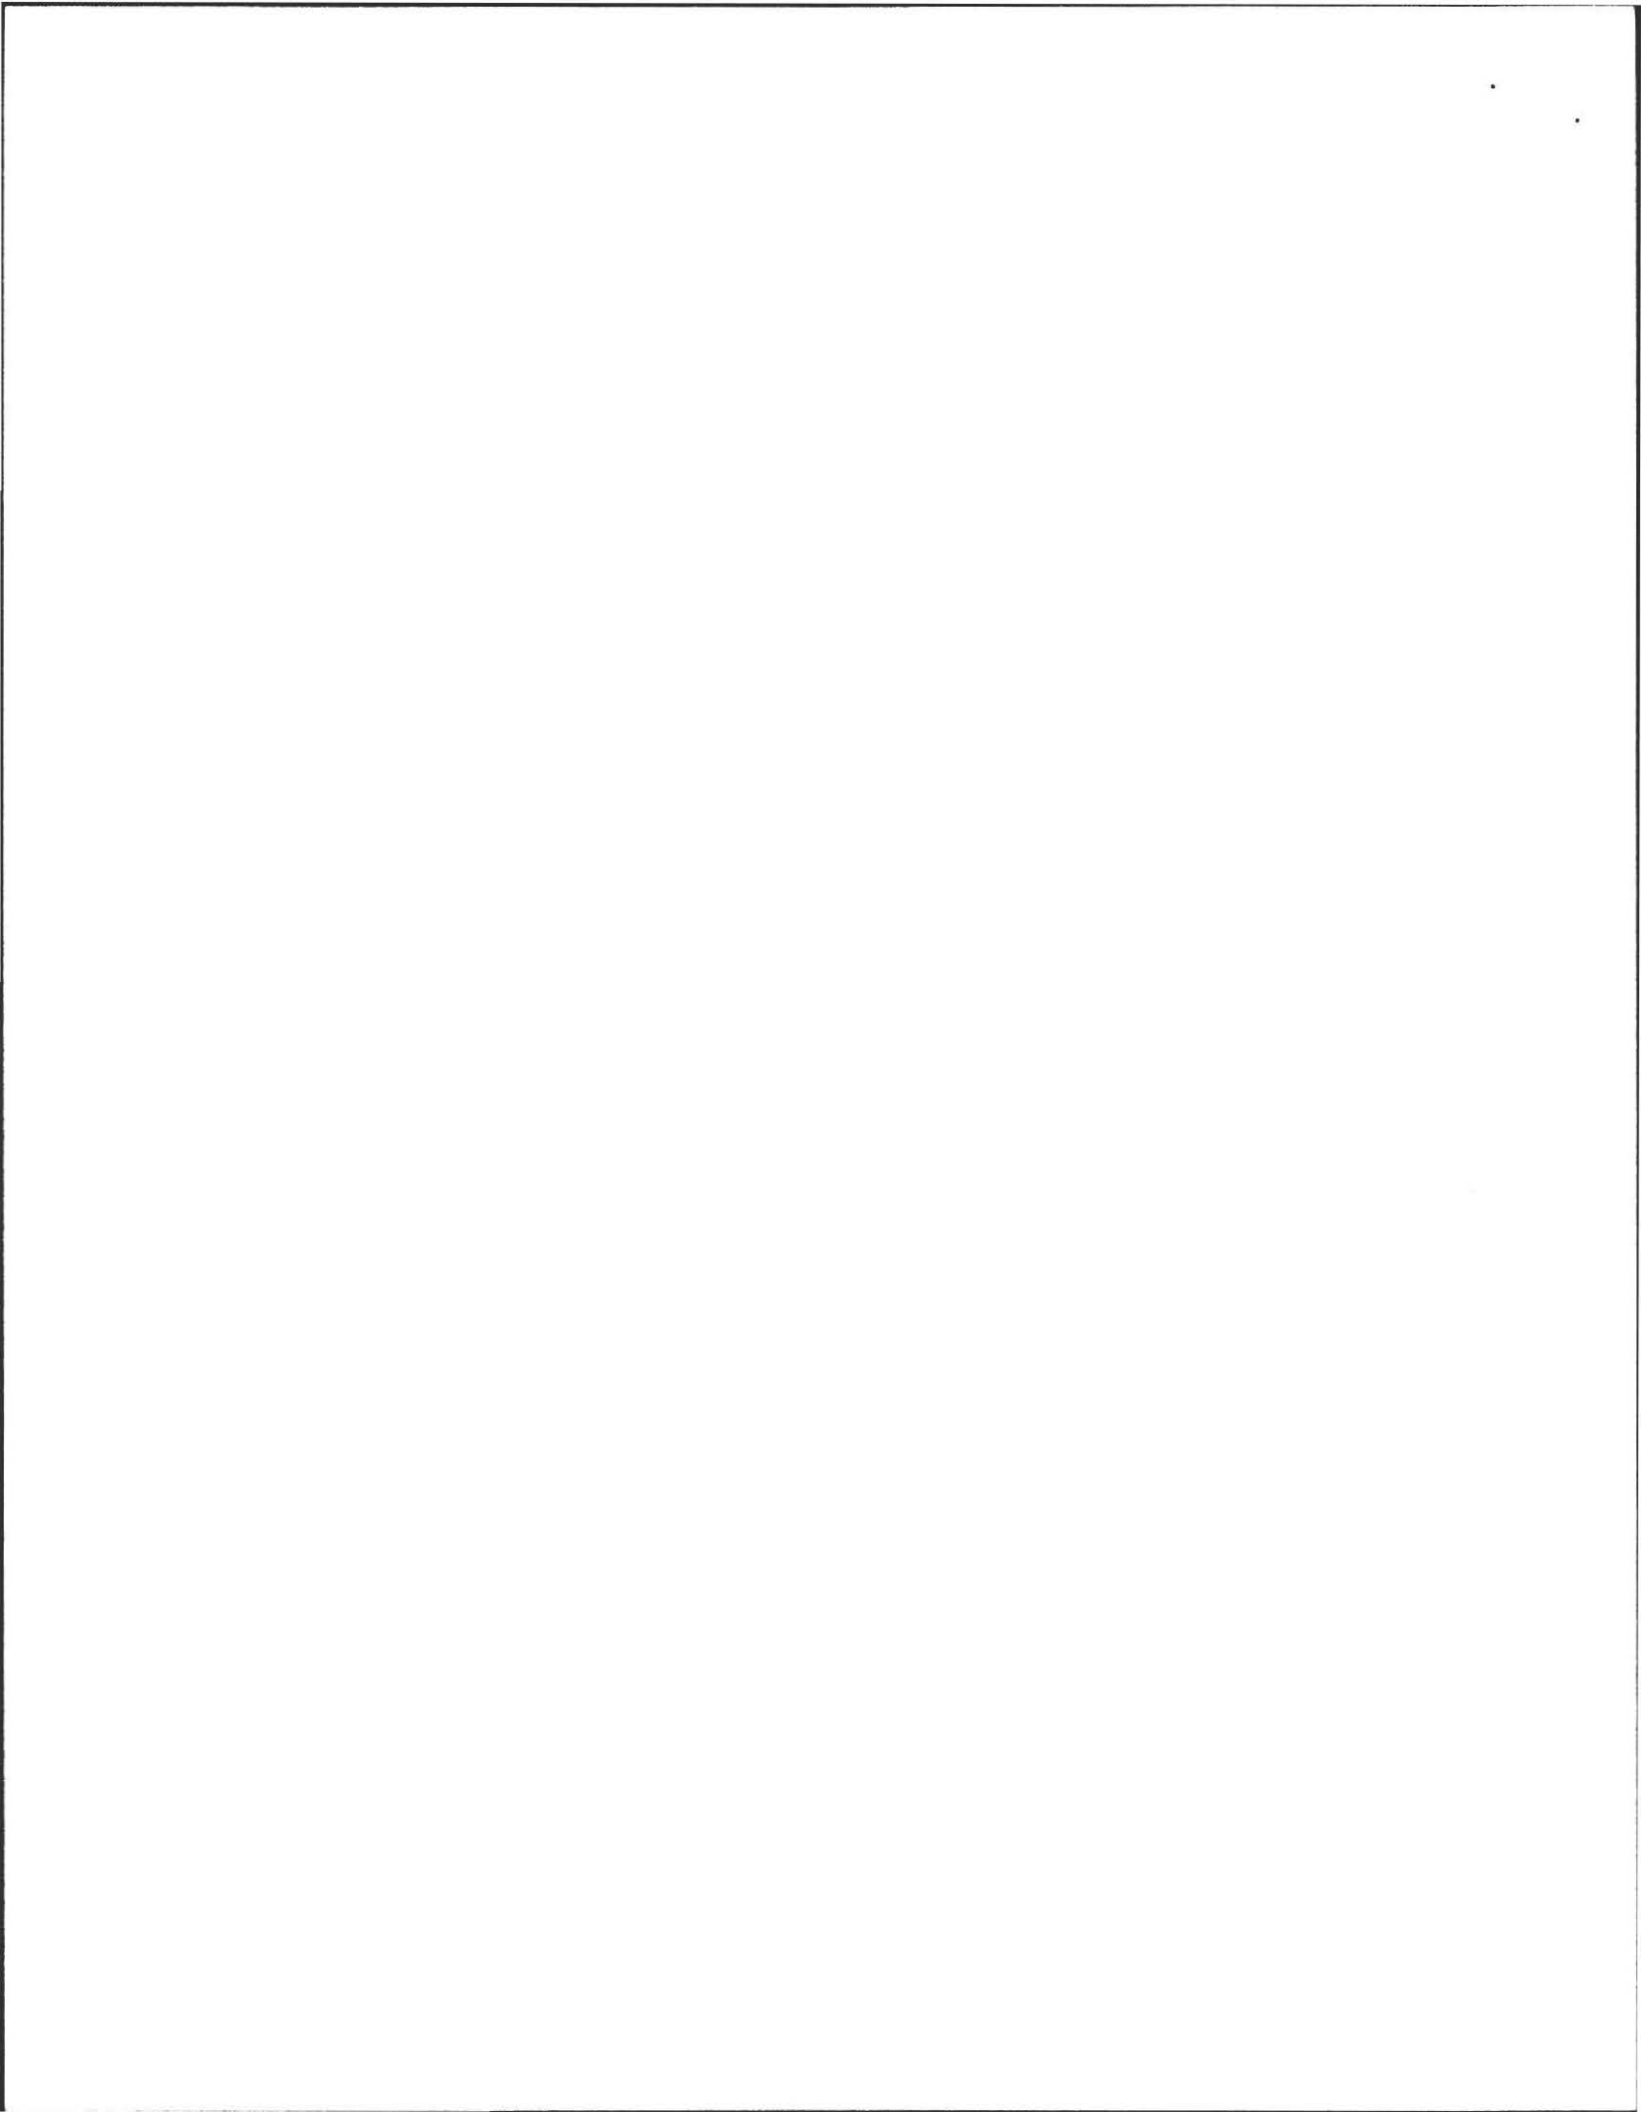

**OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)**

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/17/04

Inspection Summary: Check A,B,C,D or E / ALWAYS complete all of Section D

A. System Passes:

No I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments:

B. System Conditionally Passes:

Yes One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Answer yes, no or not determined (Y,N,ND) in the ____ for the following statements. If "not determined" please explain.

____ The septic tank is metal and over 20 years old* or the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health.

*A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

ND explain:

YES Observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System ~~will~~ ^{may} pass inspection if (with approval of Board of Health):


- broken pipe(s) are replaced
- obstruction is removed
- distribution box is leveled or replaced

ND explain:

____ The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

- broken pipe(s) are replaced
- obstruction is removed

ND explain:

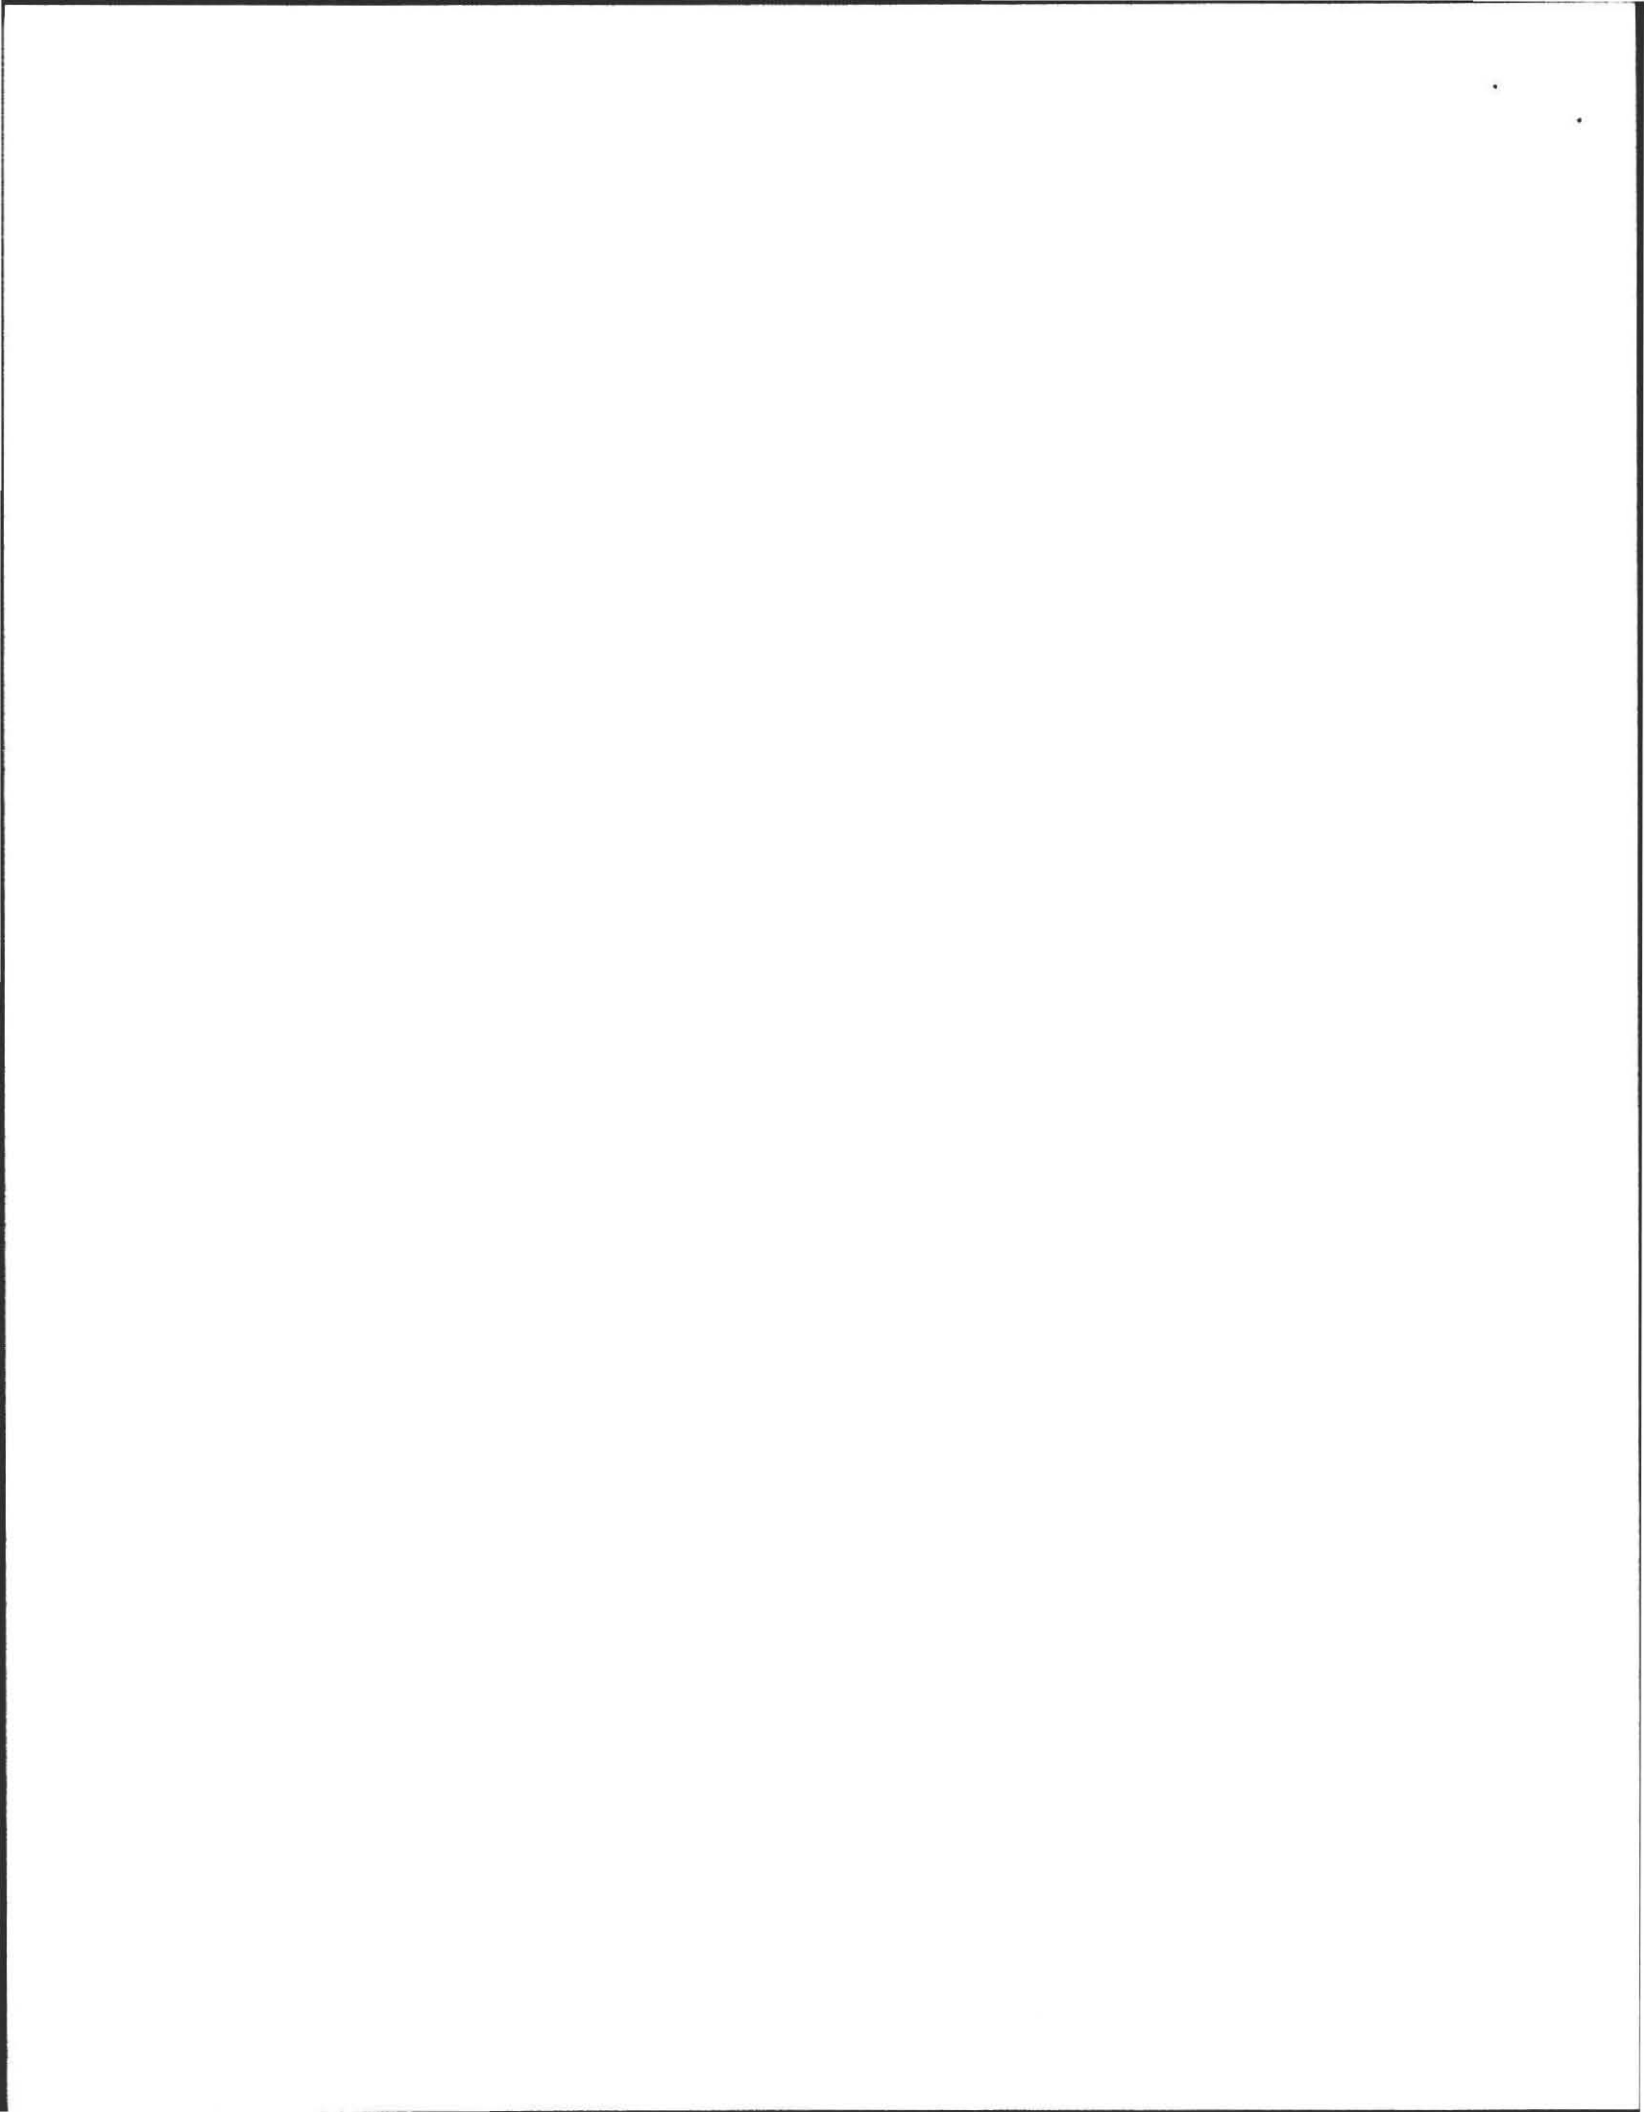

OFFICIAL INSPECTION FORM - NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/2/04

C. Further Evaluation is Required by the Board of Health:

No Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

1. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:


- Cesspool or privy is within 50 feet of a surface water
- Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

2. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:

- The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.
- The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.
- The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.
- The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well**. Method used to determine distance _____

**This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

3. Other:

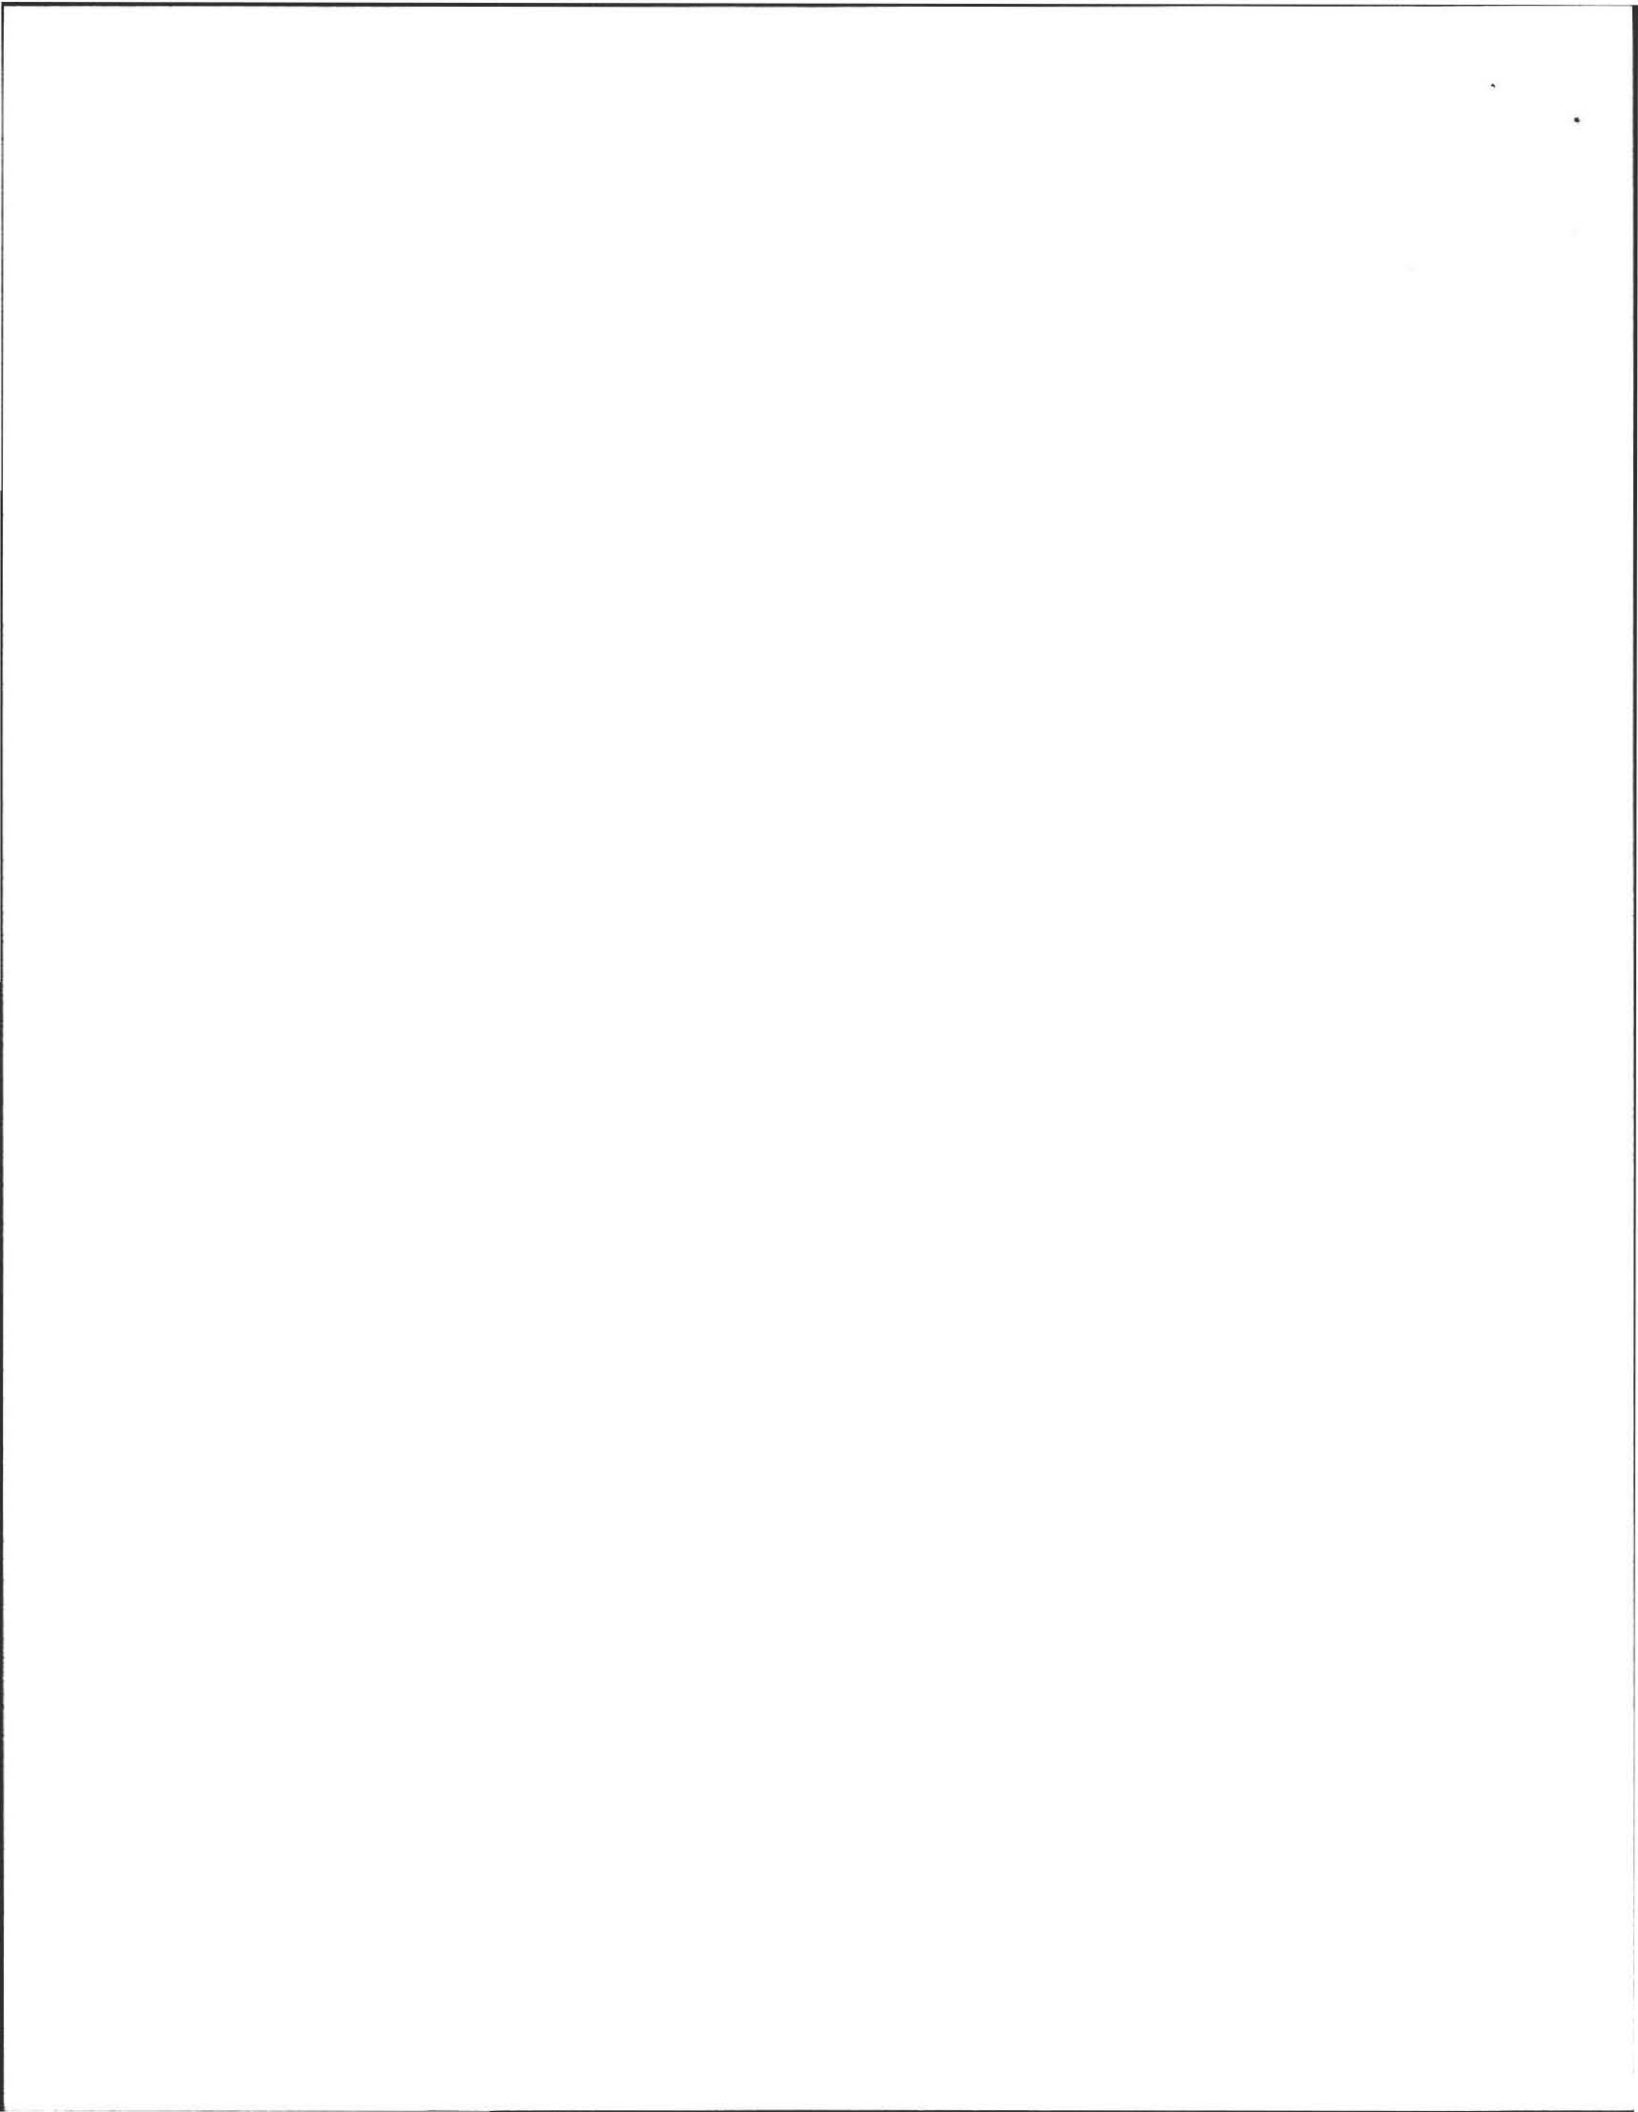

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART A
CERTIFICATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: _____

D. System Failure Criteria applicable to all systems:

You **must** indicate “yes” or “no” to each of the following for **all** inspections:

- | Yes | No | |
|--------------------------|-------------------------------------|---|
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Liquid depth in cesspool is less than 6” below invert or available volume is less than ½ day flow |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Required pumping more than 4 times in the last year NOT due to clogged or obstructed pipe(s). Number of times pumped _____. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of the SAS, cesspool or privy is below high ground water elevation. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within a Zone 1 of a public well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is within 50 feet of a private water supply well. |
| <input type="checkbox"/> | <input checked="" type="checkbox"/> | Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. [This system passes if the well water analysis, performed at a DEP certified laboratory, for coliform bacteria and volatile organic compounds indicates that the well is free from pollution from that facility and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.] |

N (Yes/No) The system **fails**. I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure.

E. Large Systems:


To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.

You must indicate either “yes” or “no” to each of the following:

(The following criteria apply to large systems in addition to the criteria above)

- | yes | no | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 400 feet of a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is within 200 feet of a tributary to a surface drinking water supply |
| <input type="checkbox"/> | <input type="checkbox"/> | the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area – IWPA) or a mapped Zone II of a public water supply well |

If you have answered “yes” to any question in Section E the system is considered a significant threat, or answered “yes” in Section D above the large system has failed. The owner or operator of any large system considered a significant threat under Section E or failed under Section D shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

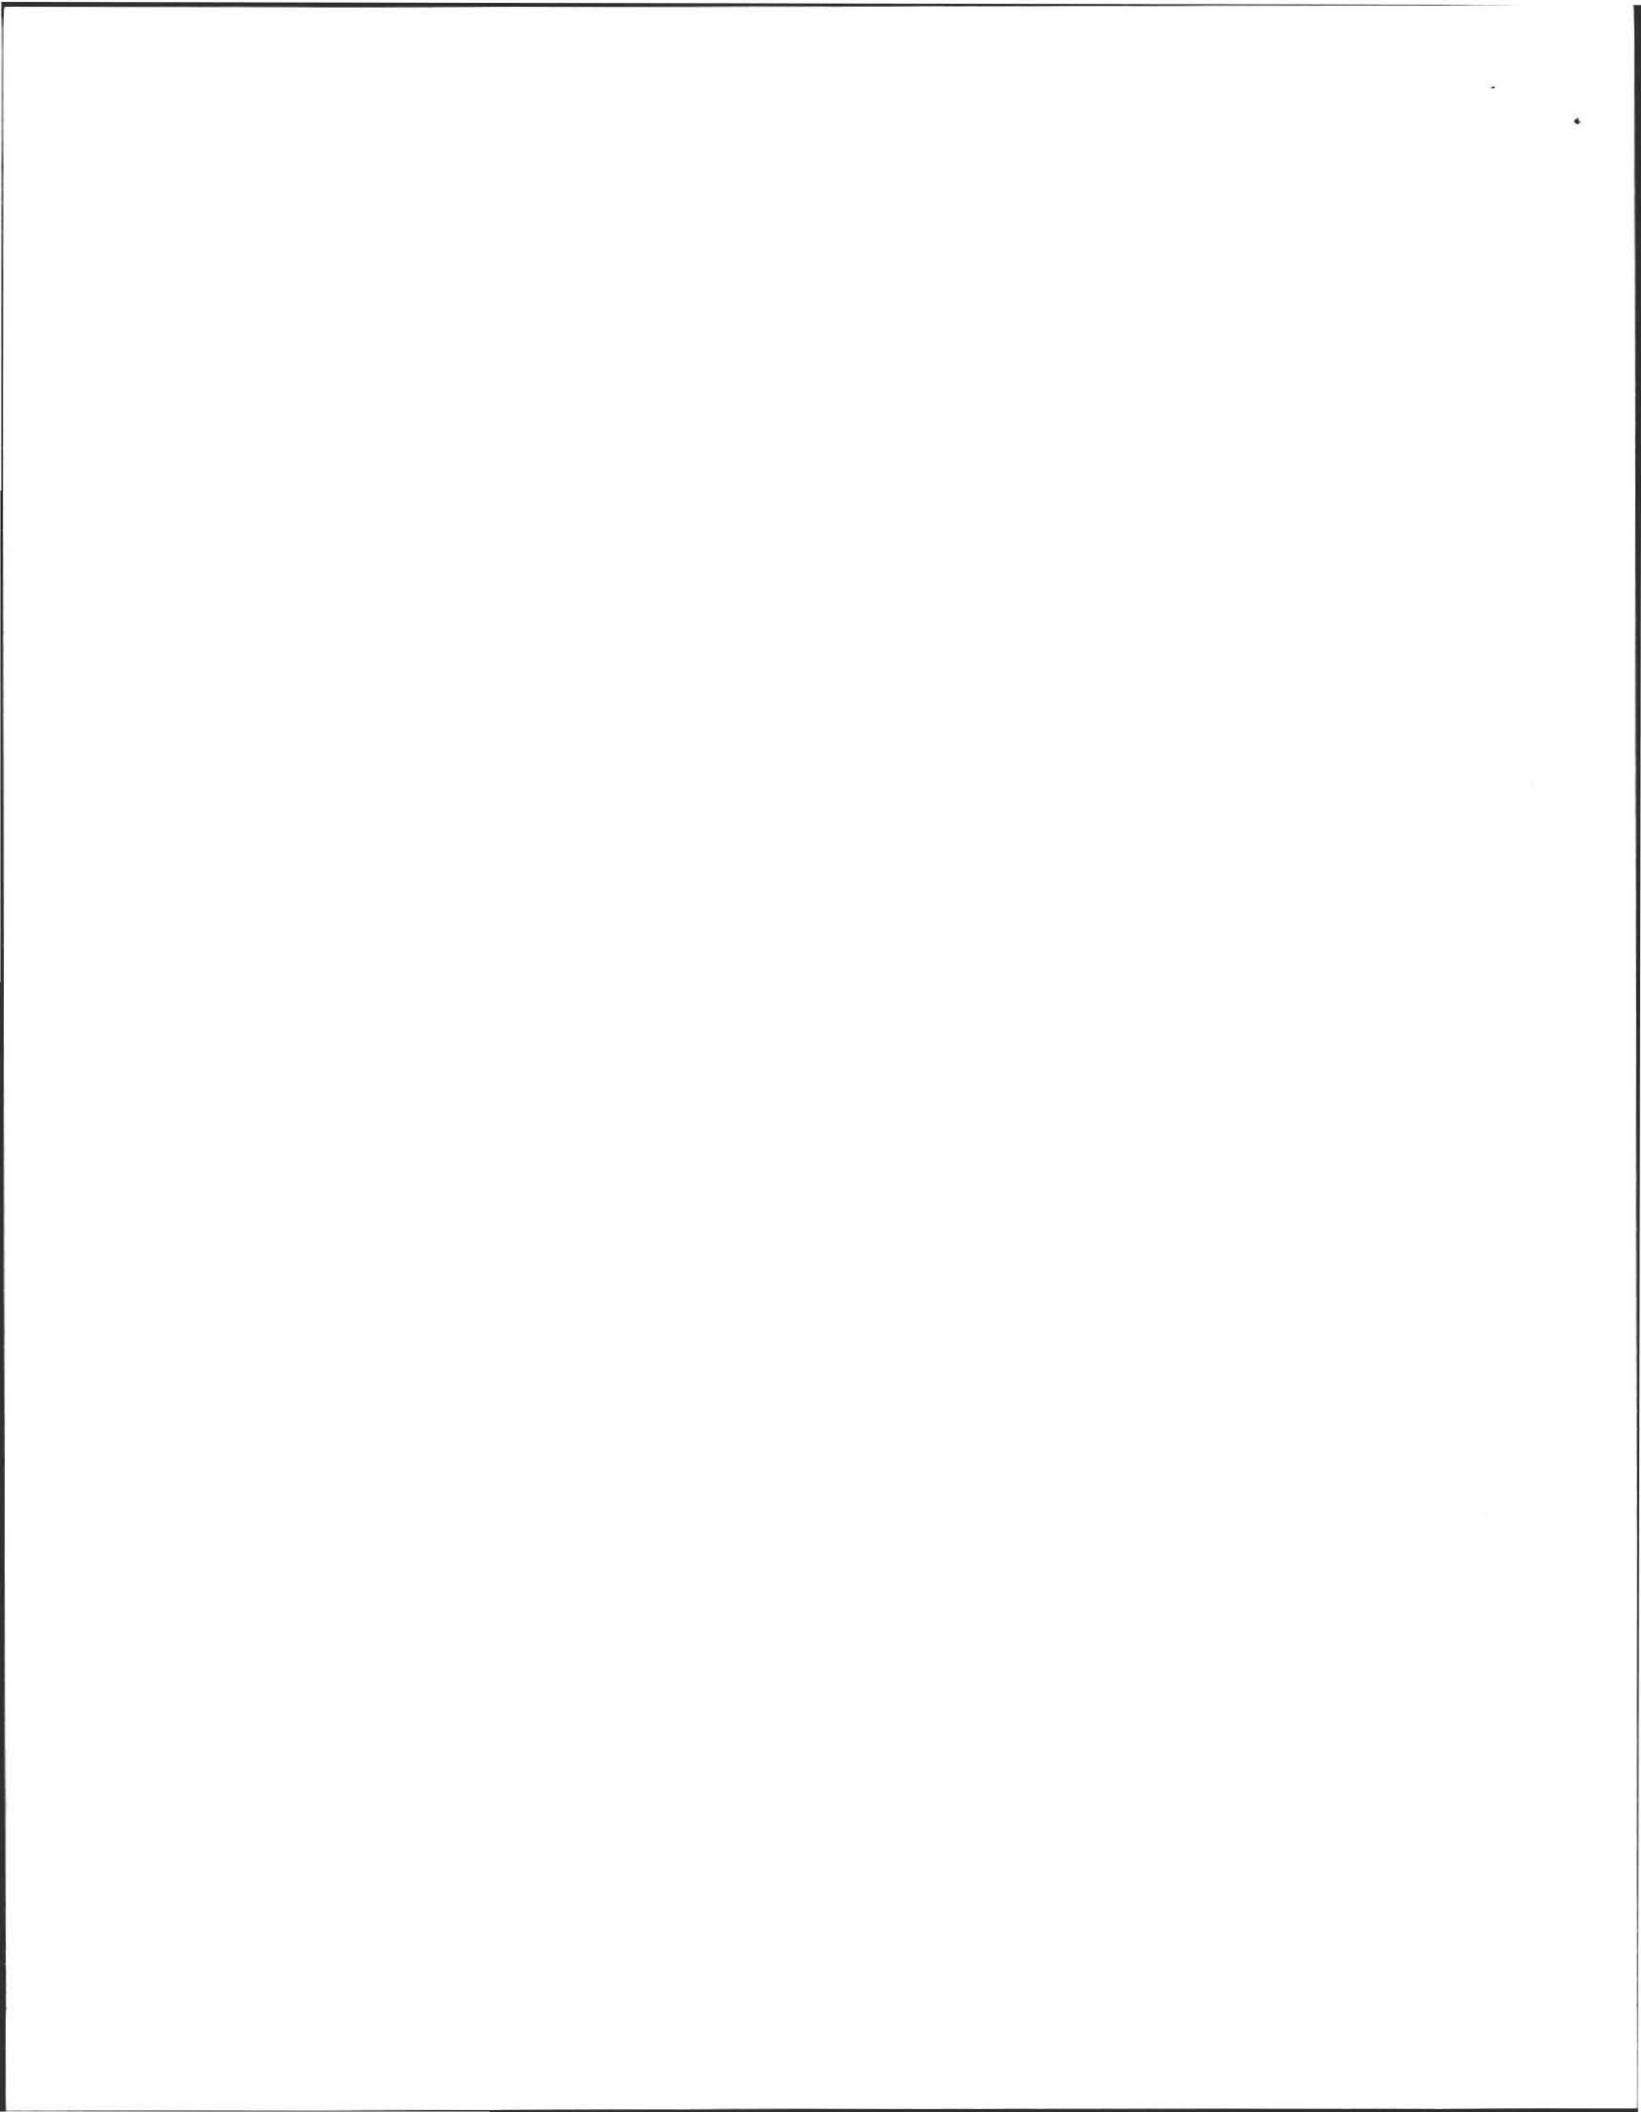

**OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART B
CHECKLIST**

Property Address: 605 Stephen Rd

Owner: S.M.C.

Date of Inspection: 10/7/04

Check if the following have been done. You **must** indicate "yes" or "no" as to each of the following:

Yes No

yes Pumping information was provided by the owner, occupant, or Board of Health

No Were any of the system components pumped out in the previous two weeks ?

yes Has the system received normal flows in the previous two week period ?

No Have large volumes of water been introduced to the system recently or as part of this inspection ?

NA Were as built plans of the system obtained and examined? (If they were not available note as N/A)

yes Was the facility or dwelling inspected for signs of sewage back up ?

yes Was the site inspected for signs of break out ?

yes Were all system components, excluding the SAS, located on site ?


yes Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum ?

yes Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems ?

The size and location of the Soil Absorption System (SAS) on the site has been determined based on:

Yes no
NA no Existing information. For example, a plan at the Board of Health.

yes Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(3)(b)]

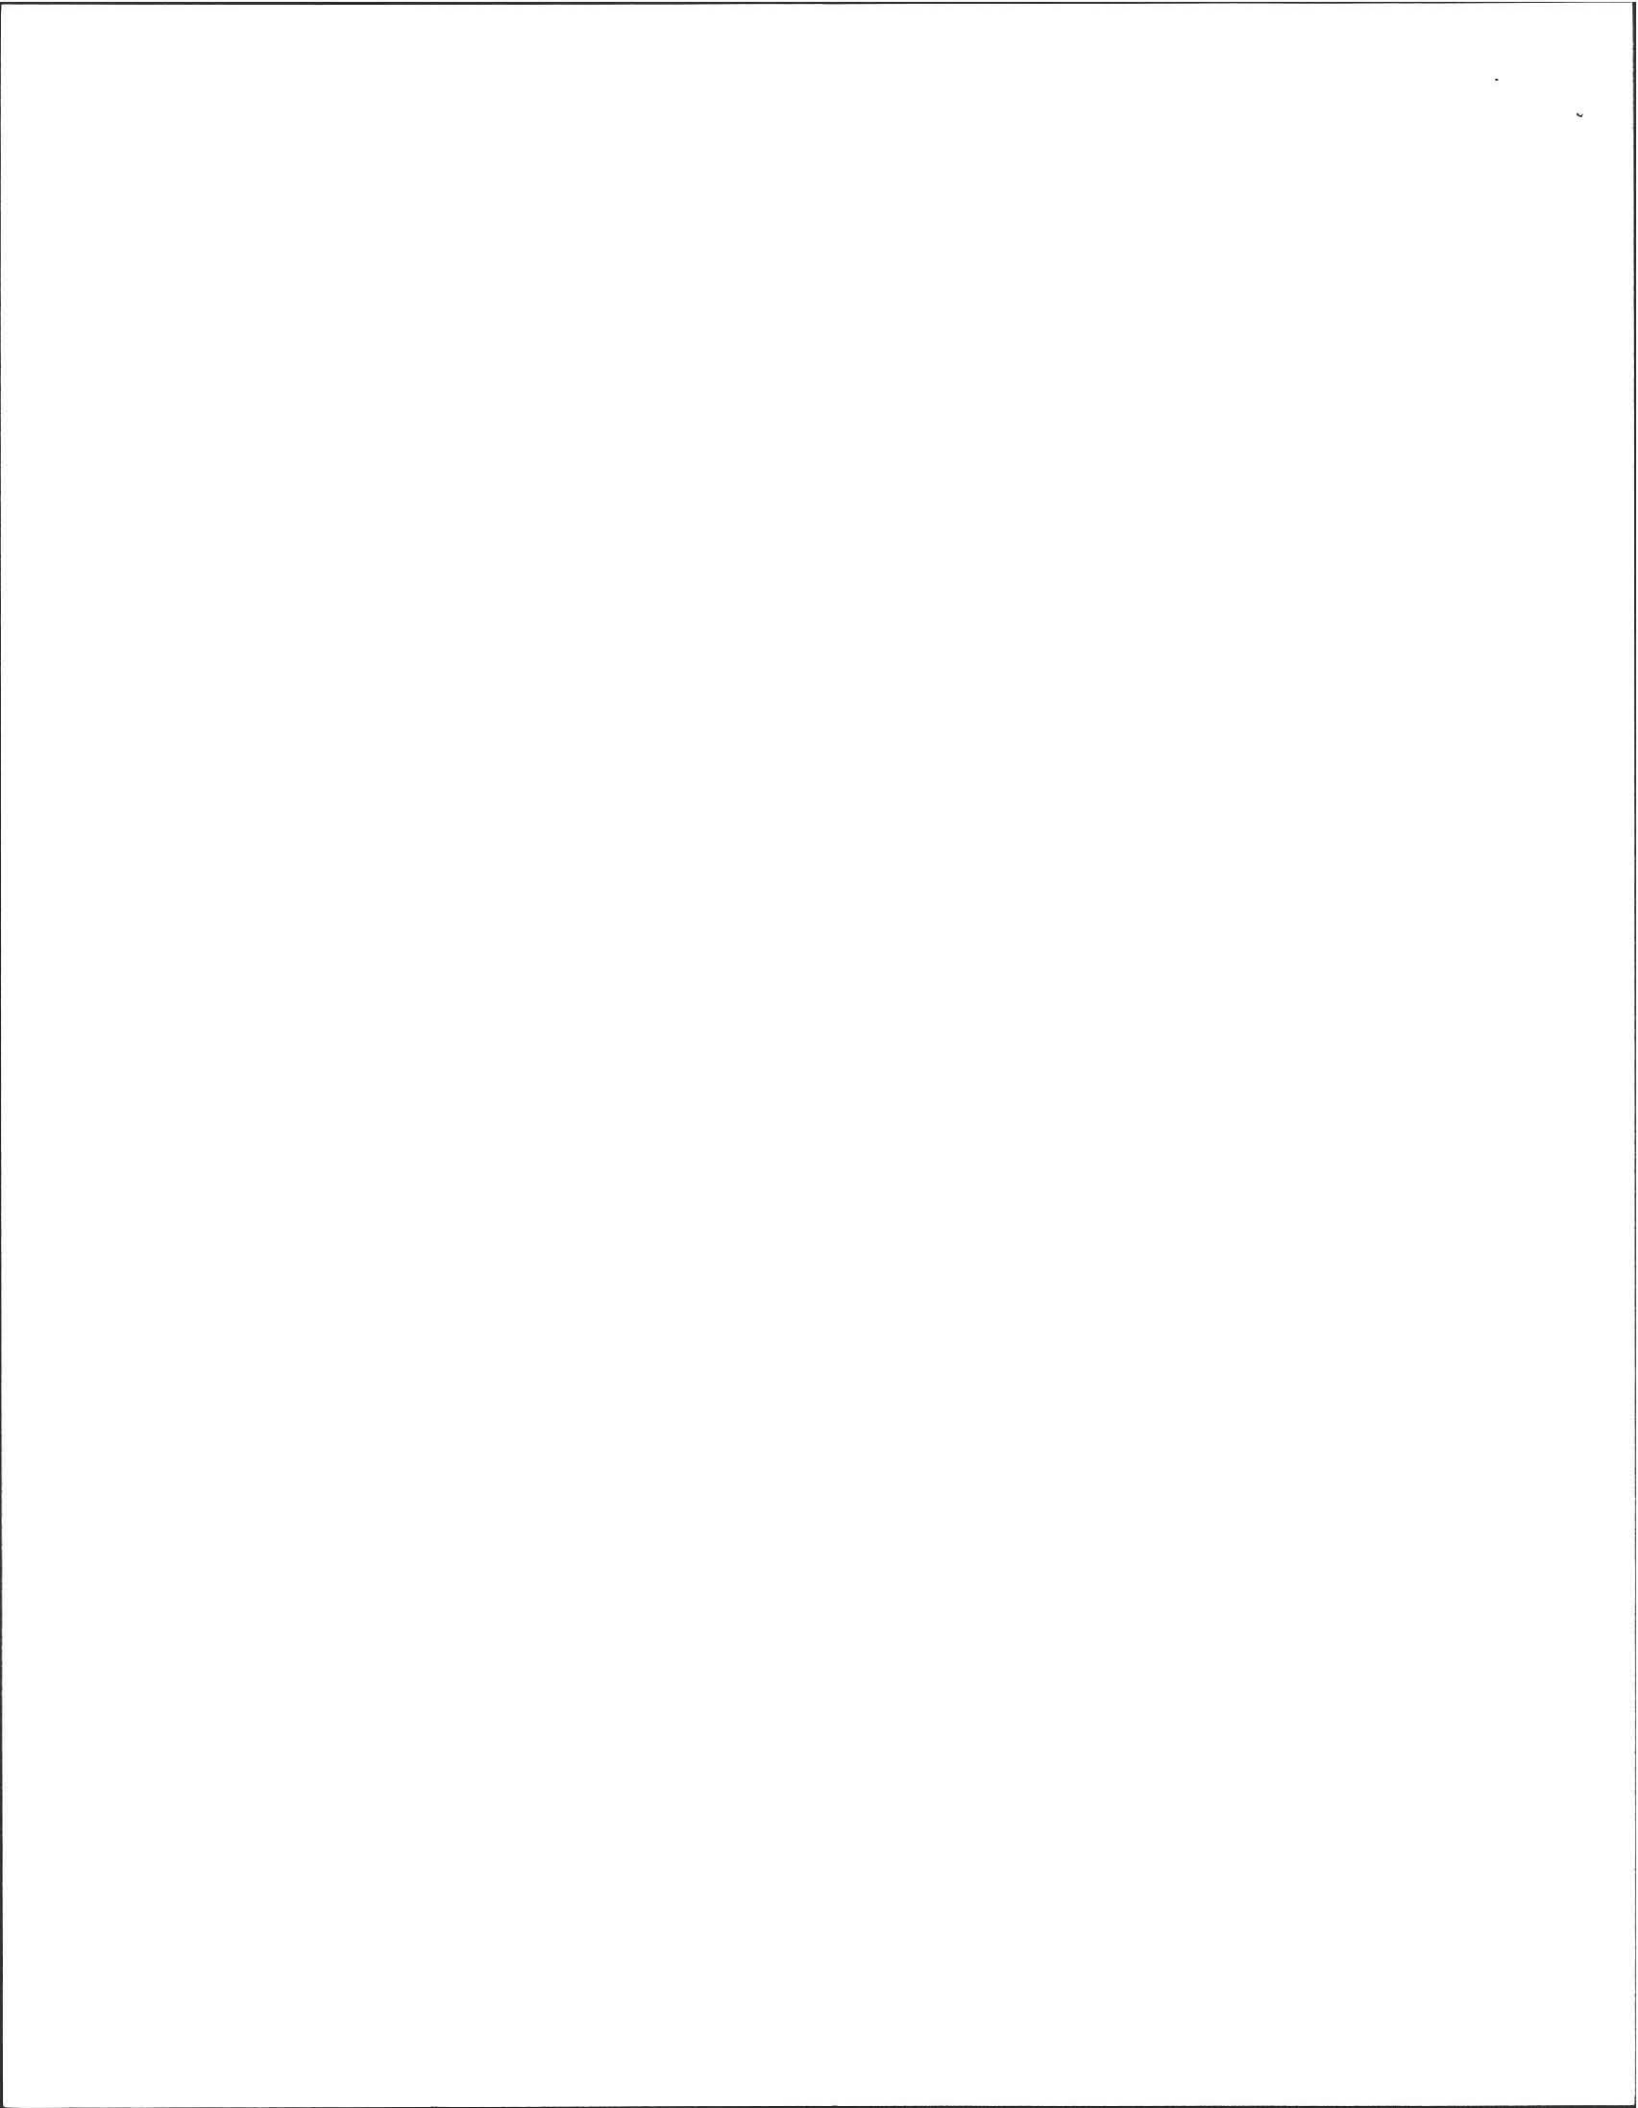

**OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION**

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/7/04

FLOW CONDITIONS

RESIDENTIAL

Number of bedrooms (design): 3 Number of bedrooms (actual): 3
DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): _____
Number of current residents: 1
Does residence have a garbage grinder (yes or no): yes not recommended
Is laundry on a separate sewage system (yes or no): No [if yes separate inspection required]
Laundry system inspected (yes or no): -
Seasonal use: (yes or no): No
Water meter readings, if available (last 2 years usage (gpd)): N/A
Sump pump (yes or no): No
Last date of occupancy: Current (1 person)

COMMERCIAL/INDUSTRIAL

Type of establishment: _____
Design flow (based on 310 CMR 15.203): _____ gpd
Basis of design flow (seats/persons/sqft, etc.): _____
Grease trap present (yes or no): _____
Industrial waste holding tank present (yes or no): _____
Non-sanitary waste discharged to the Title 5 system (yes or no): _____
Water meter readings, if available: _____
Last date of occupancy/use: _____

OTHER (describe): _____

GENERAL INFORMATION

Pumping Records


Source of information: _____
Was system pumped as part of the inspection (yes or no): _____
If yes, volume pumped: 1000 gallons -- How was quantity pumped determined? Mccs.
Reason for pumping: _____

TYPE OF SYSTEM

- Septic tank, distribution box, soil absorption system
- Single cesspool
- Overflow cesspool
- Privy
- Shared system (yes or no) (if yes, attach previous inspection records, if any)
- Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner)
- Tight tank Attach a copy of the DEP approval
- Other (describe): _____

Approximate age of all components, date installed (if known) and source of information:
40 years

Were sewage odors detected when arriving at the site (yes or no): No

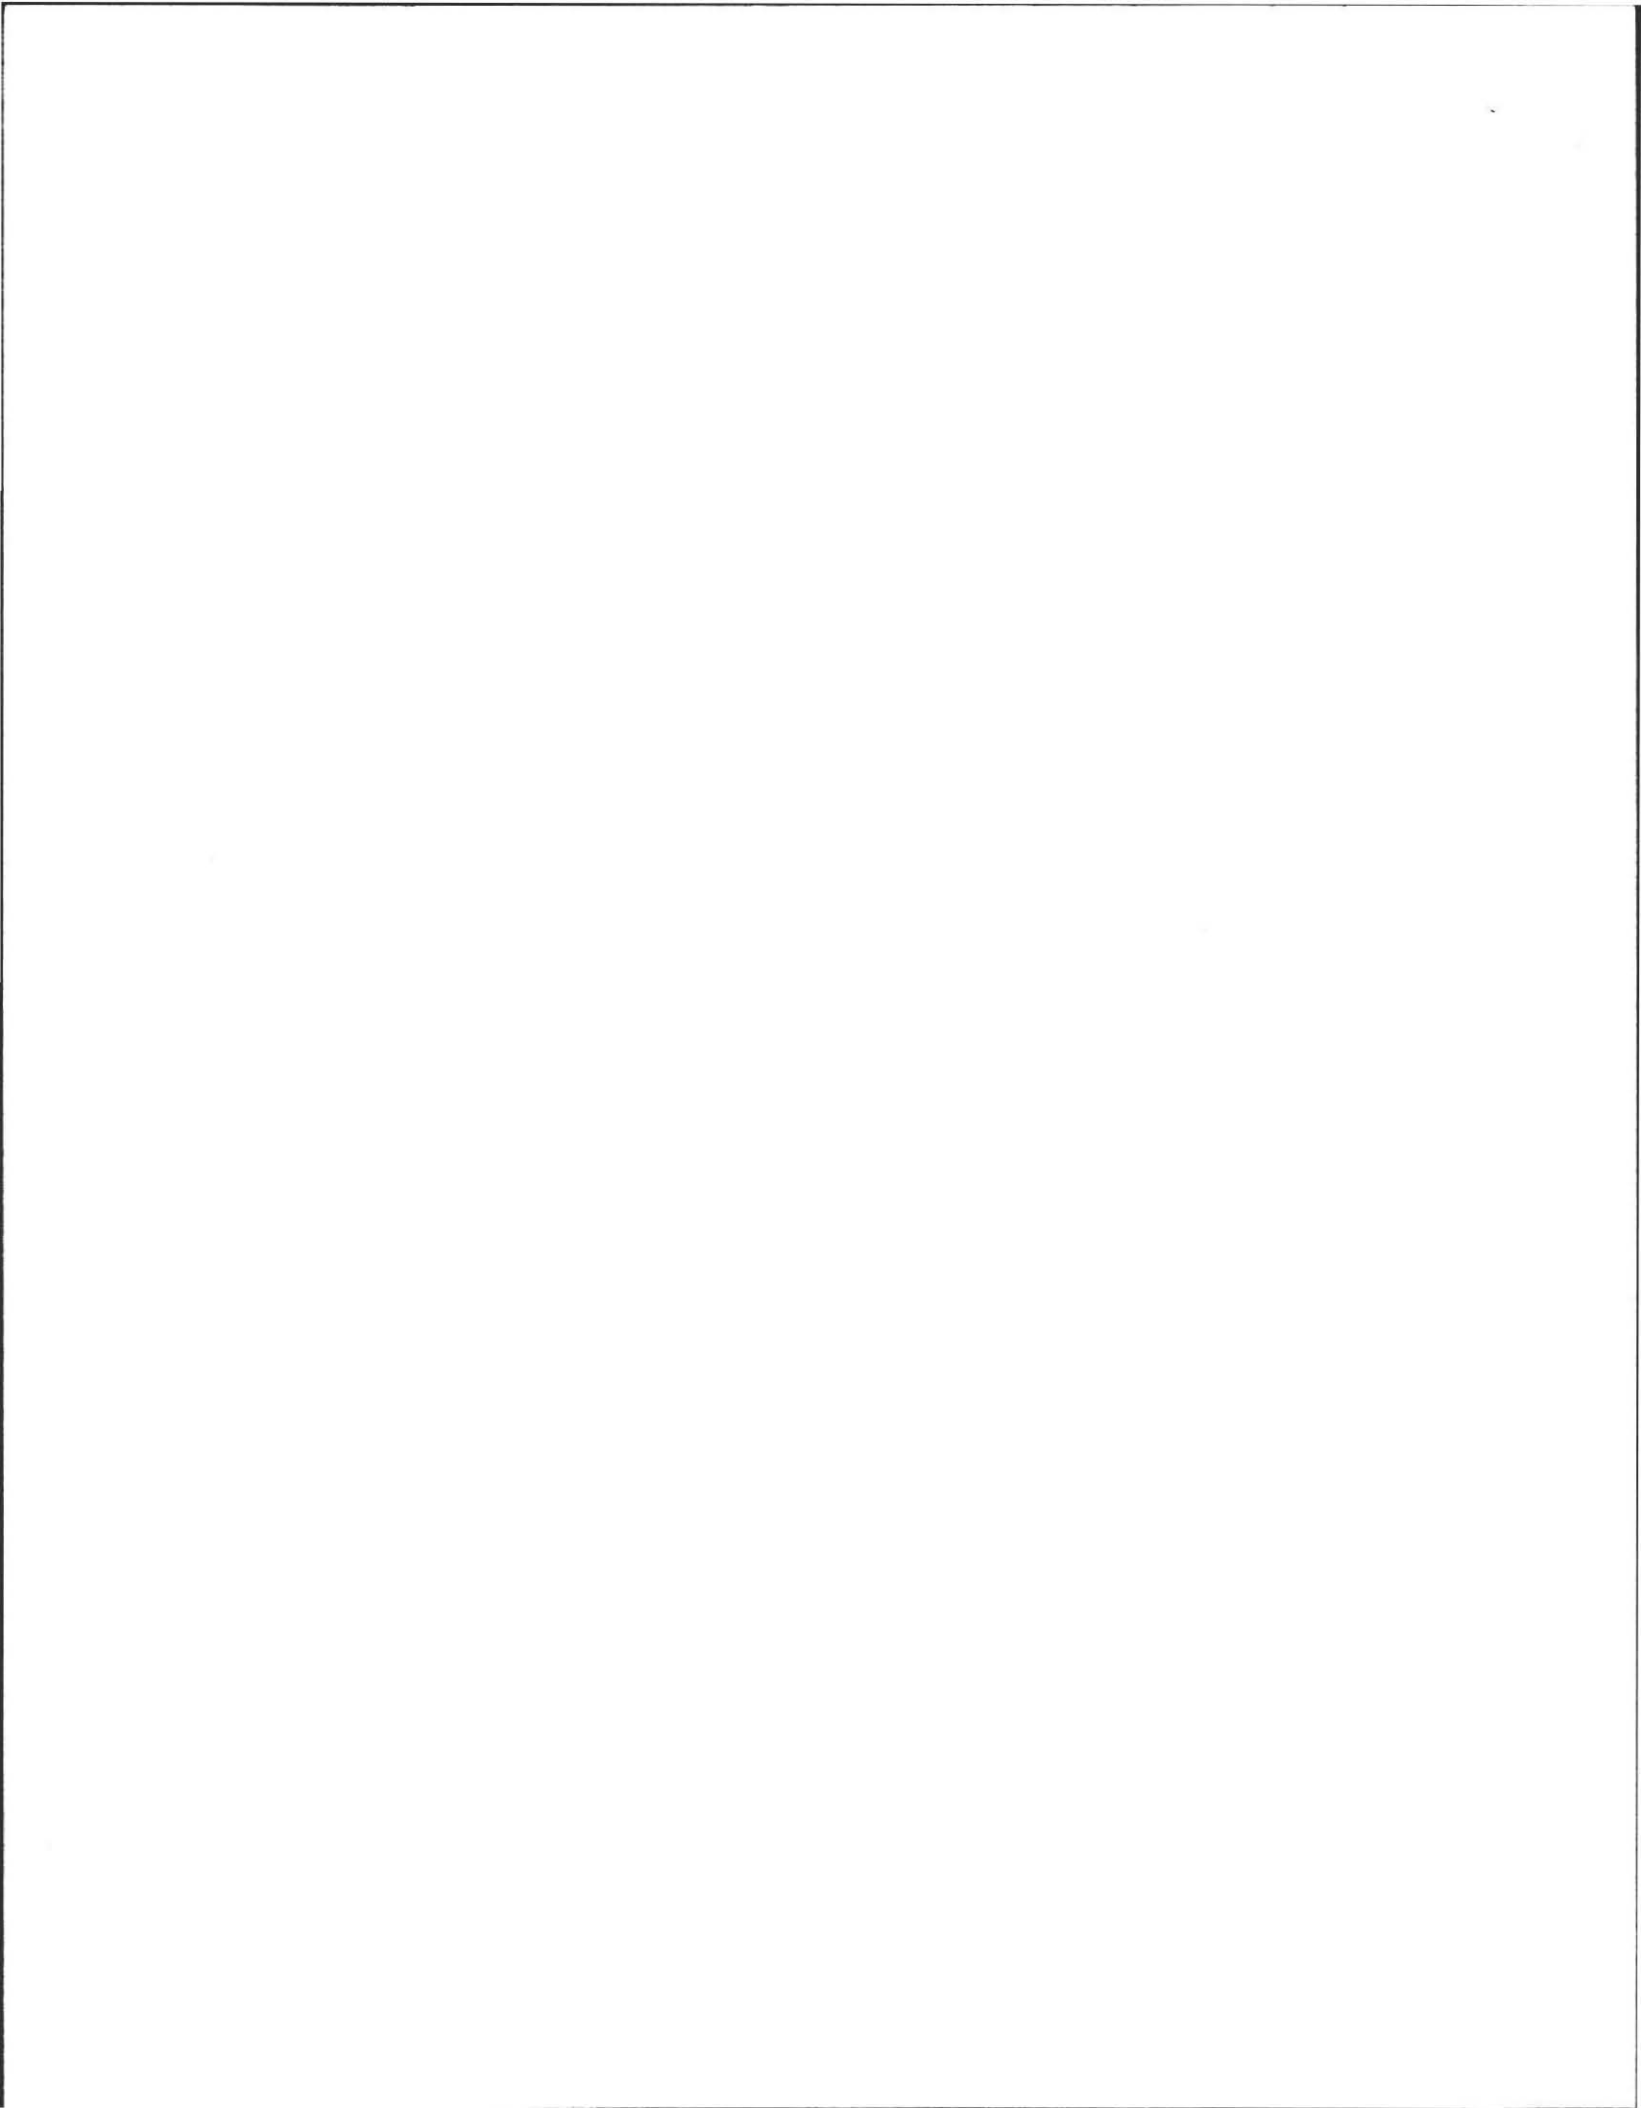

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd

Owner: SIMON

Date of Inspection: 10/7/04

BUILDING SEWER (locate on site plan)

Depth below grade: 12"

Materials of construction: cast iron 40 PVC other (explain): _____

Distance from private water supply well or suction line: 10'

Comments (on condition of joints, venting, evidence of leakage, etc.):

OK.

SEPTIC TANK: Yes (locate on site plan)

Depth below grade: 12"

Material of construction: concrete metal fiberglass polyethylene
 other(explain) _____

If tank is metal list age: ____ Is age confirmed by a Certificate of Compliance (yes or no): ____ (attach a copy of certificate)

Dimensions: 8' x 4' x 4'

Sludge depth: 6"

Distance from top of sludge to bottom of outlet tee or baffle: 36"

Scum thickness: 4"

Distance from top of scum to top of outlet tee or baffle: 4"

Distance from bottom of scum to bottom of outlet tee or baffle: 12"

How were dimensions determined: MERS.

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

OK condition, baffles built in. Levels OK.

GREASE TRAP: No (locate on site plan)

Depth below grade: ____

Material of construction: concrete metal fiberglass polyethylene other (explain): _____

Dimensions: _____


Scum thickness: _____

Distance from top of scum to top of outlet tee or baffle: _____

Distance from bottom of scum to bottom of outlet tee or baffle: _____

Date of last pumping: _____

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

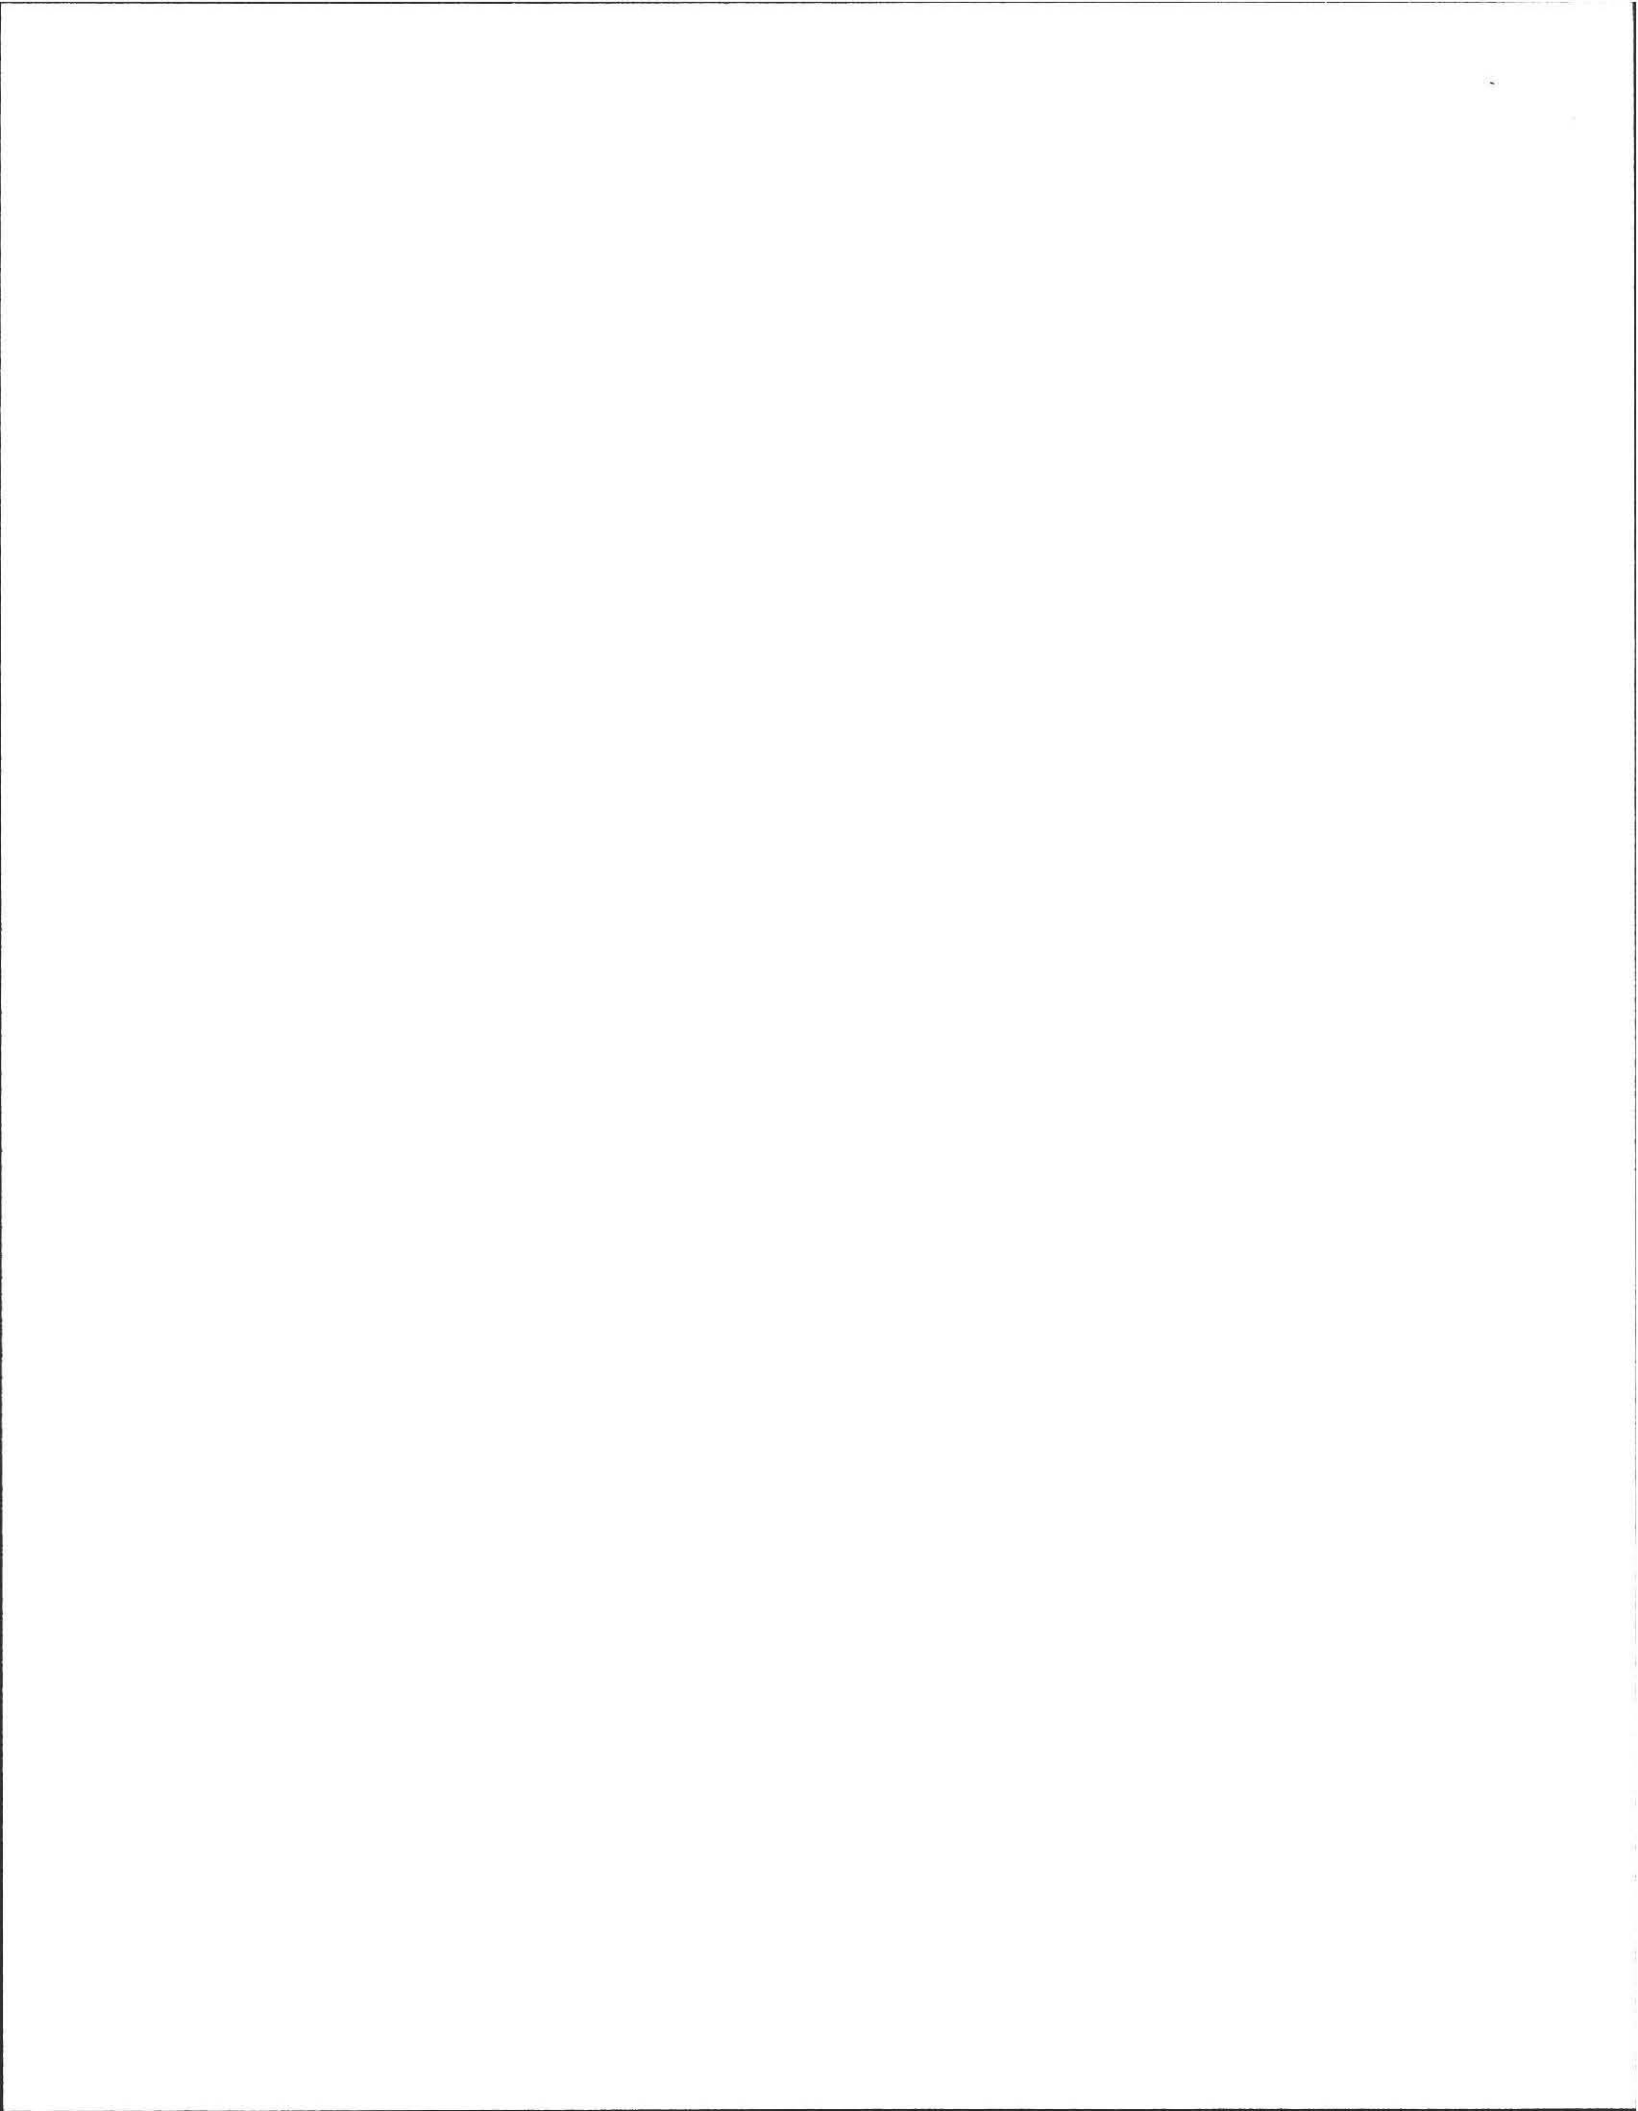

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/2/04

TIGHT or HOLDING TANK: No (tank must be pumped at time of inspection)(locate on site plan)

Depth below grade: _____

Material of construction: _____ concrete _____ metal _____ fiberglass _____ polyethylene _____ other(explain): _____

Dimensions: _____

Capacity: _____ gallons

Design Flow: _____ gallons/day

Alarm present (yes or no): _____

Alarm level: _____ Alarm in working order (yes or no): _____

Date of last pumping: _____

Comments (condition of alarm and float switches, etc.): _____

DISTRIBUTION BOX: Yes (if present must be opened)(locate on site plan)

Depth of liquid level above outlet invert: 2.10.

Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.):


Soft, needs replacement

PUMP CHAMBER: No (locate on site plan)

Pumps in working order (yes or no): _____

Alarms in working order (yes or no): _____

Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.): _____

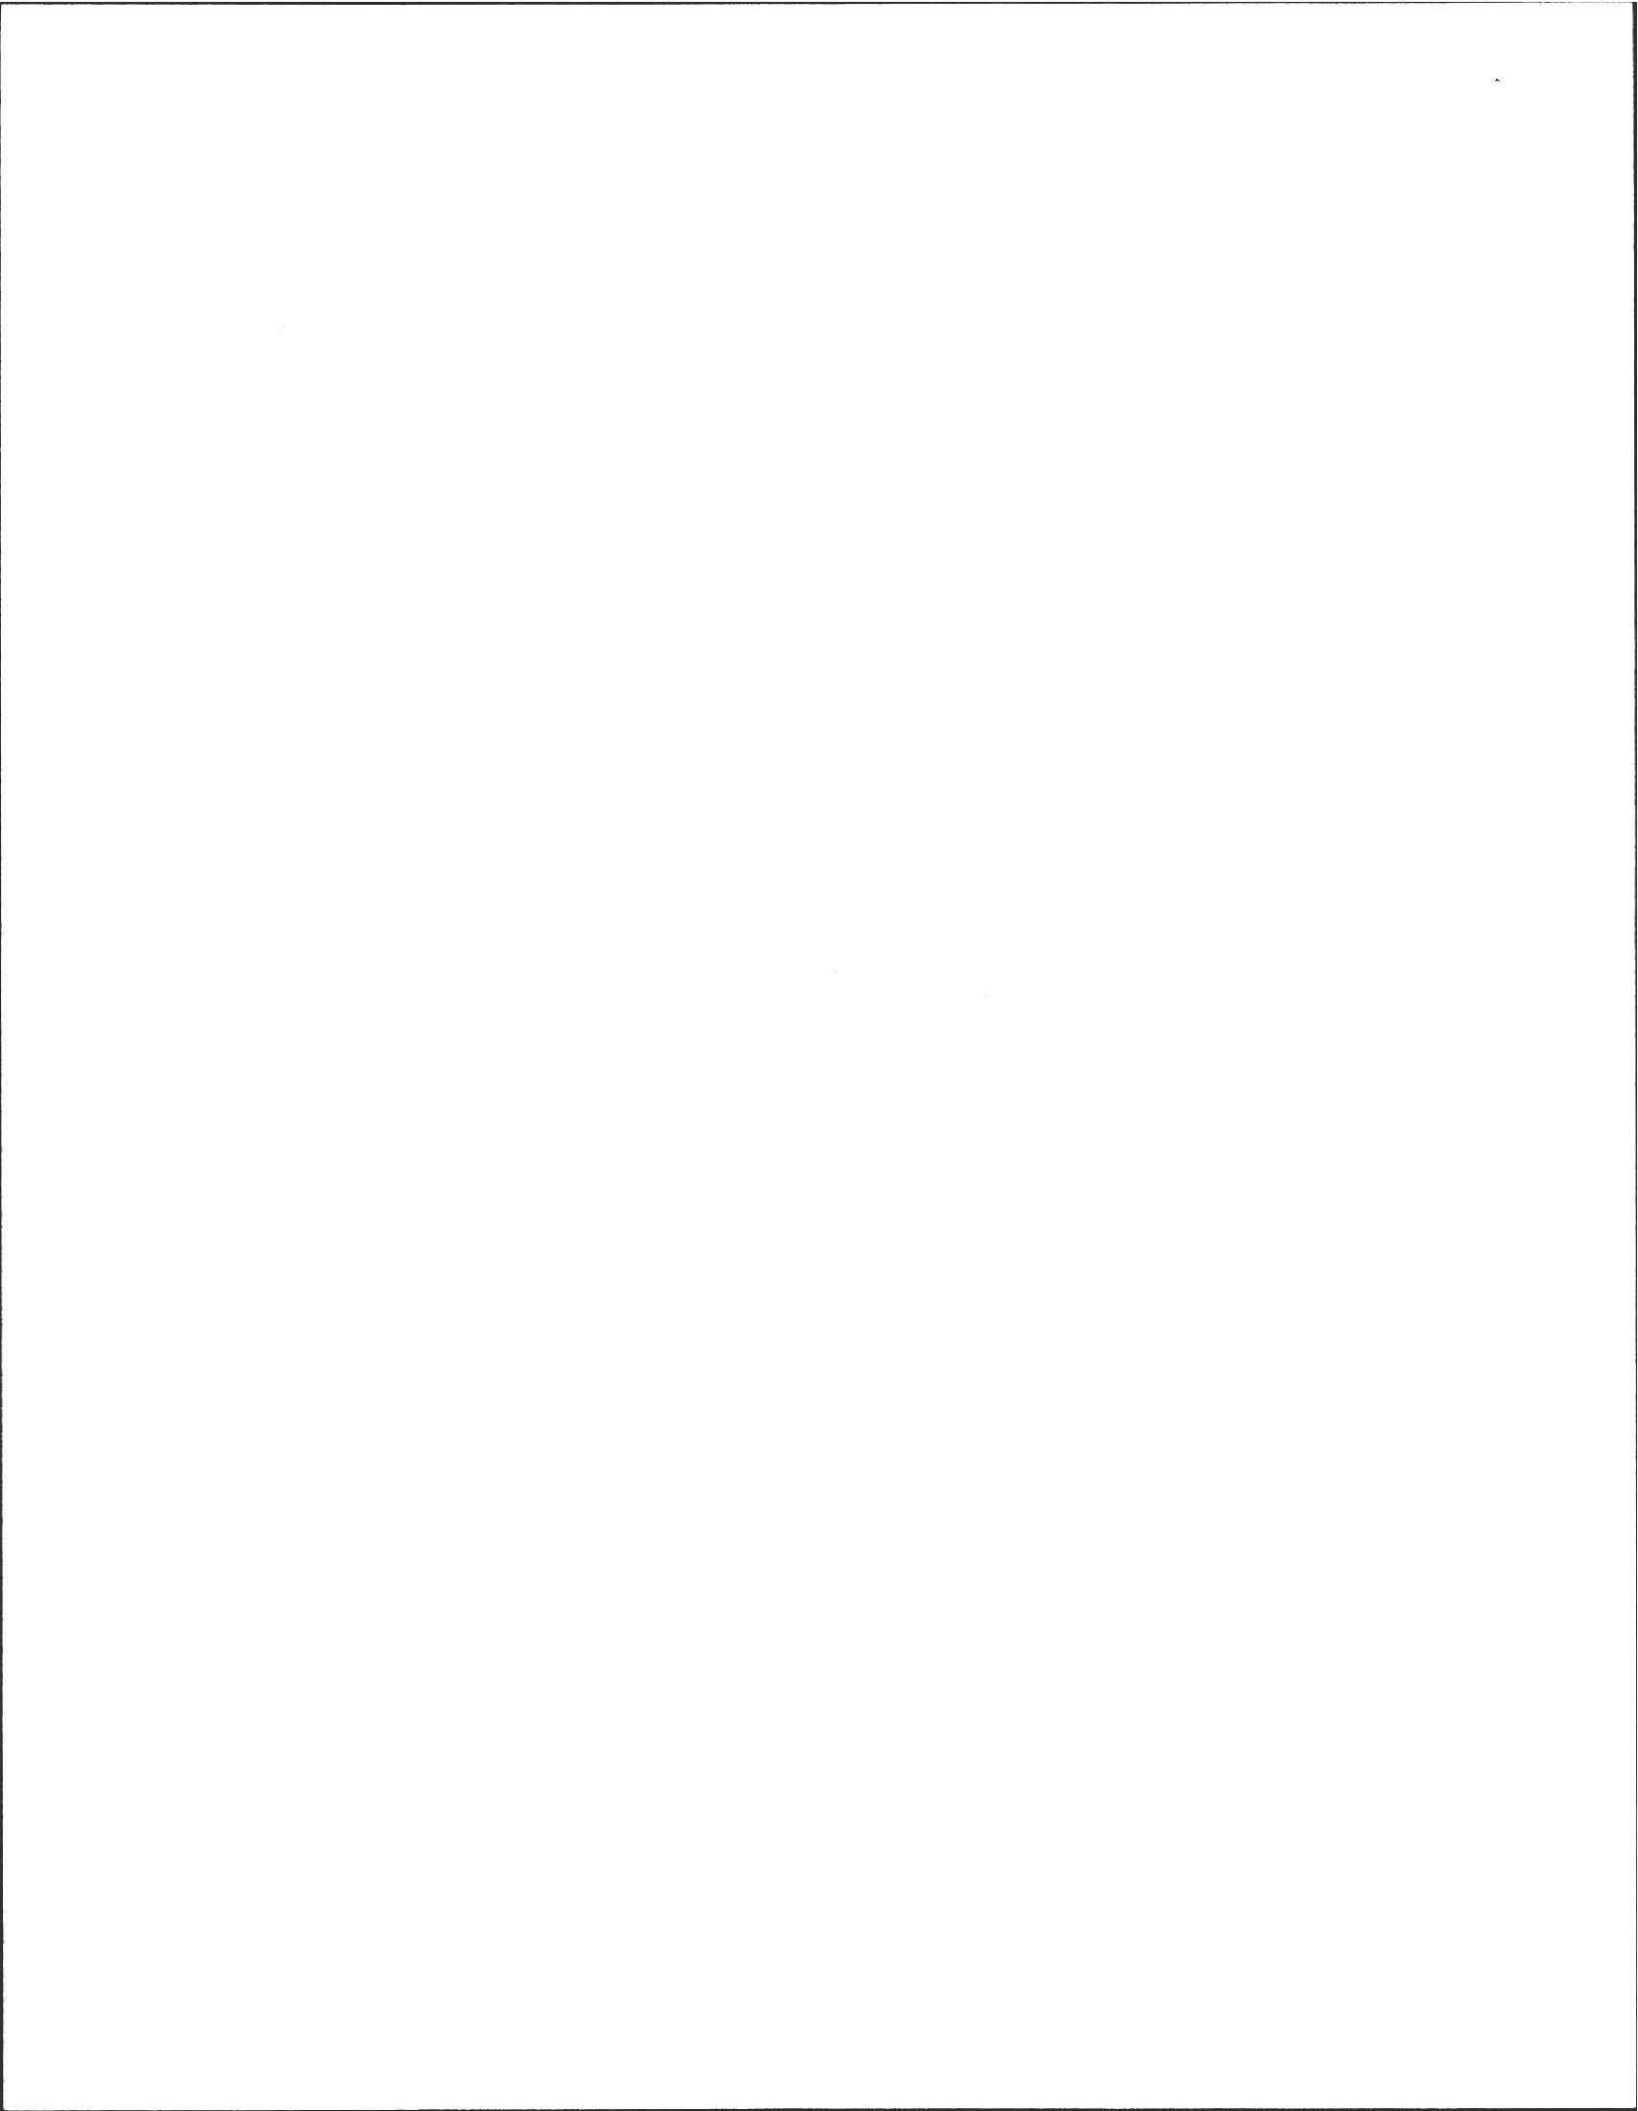

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/7/04

SOIL ABSORPTION SYSTEM (SAS): Yes (locate on site plan, excavation not required)

If SAS not located explain why:

Type

___ leaching pits, number: ___

___ leaching chambers, number: ___

___ leaching galleries, number: ___

___ leaching trenches, number, length: ___

1 leaching fields, number, dimensions: 30' L x 20' W +/-

___ overflow cesspool, number: ___

___ innovative/alternative system Type/name of technology: ___

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.):

No signs of failure noted

CESSPOOLS: No (cesspool must be pumped as part of inspection)(locate on site plan)

Number and configuration: ___

Depth – top of liquid to inlet invert: ___

Depth of solids layer: ___

Depth of scum layer: ___

Dimensions of cesspool: ___

Materials of construction: ___

Indication of groundwater inflow (yes or no): ___

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):


PRIVY: No (locate on site plan)

Materials of construction: ___

Dimensions: ___

Depth of solids: ___

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):

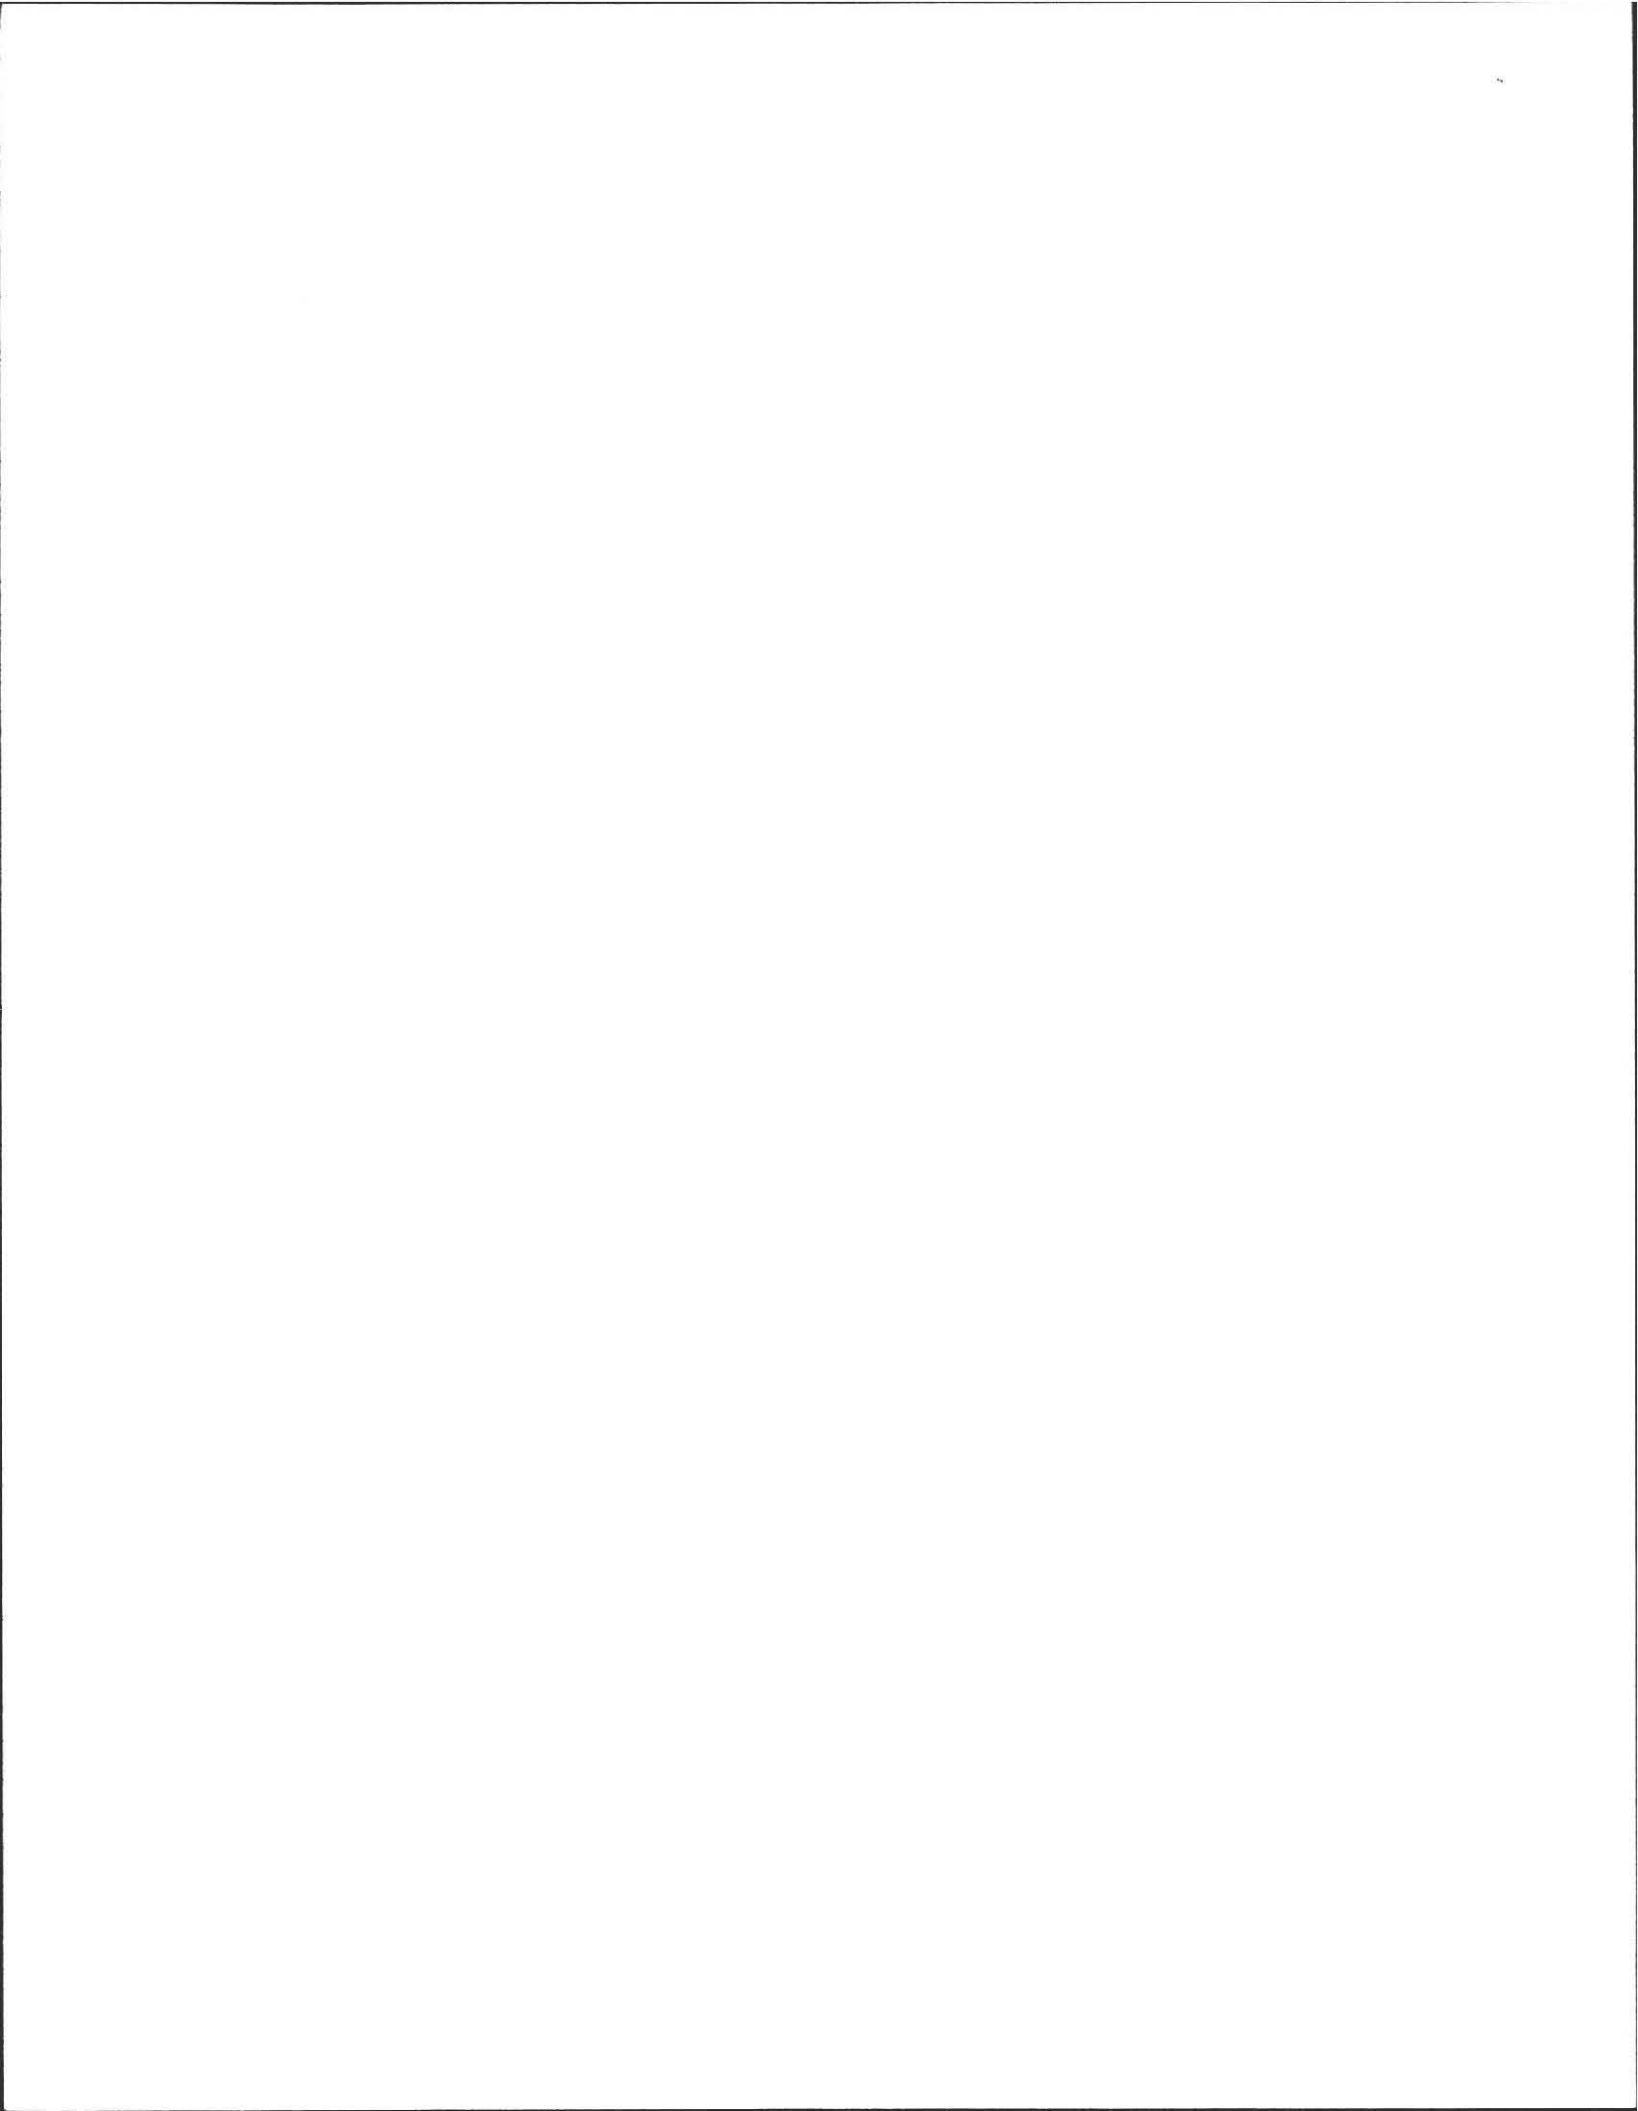

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd


Owner: Simon

Date of Inspection: 10/7/04

SKETCH OF SEWAGE DISPOSAL SYSTEM

Provide a sketch of the sewage disposal system including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building.

See Attached D. Box replacement sketch.

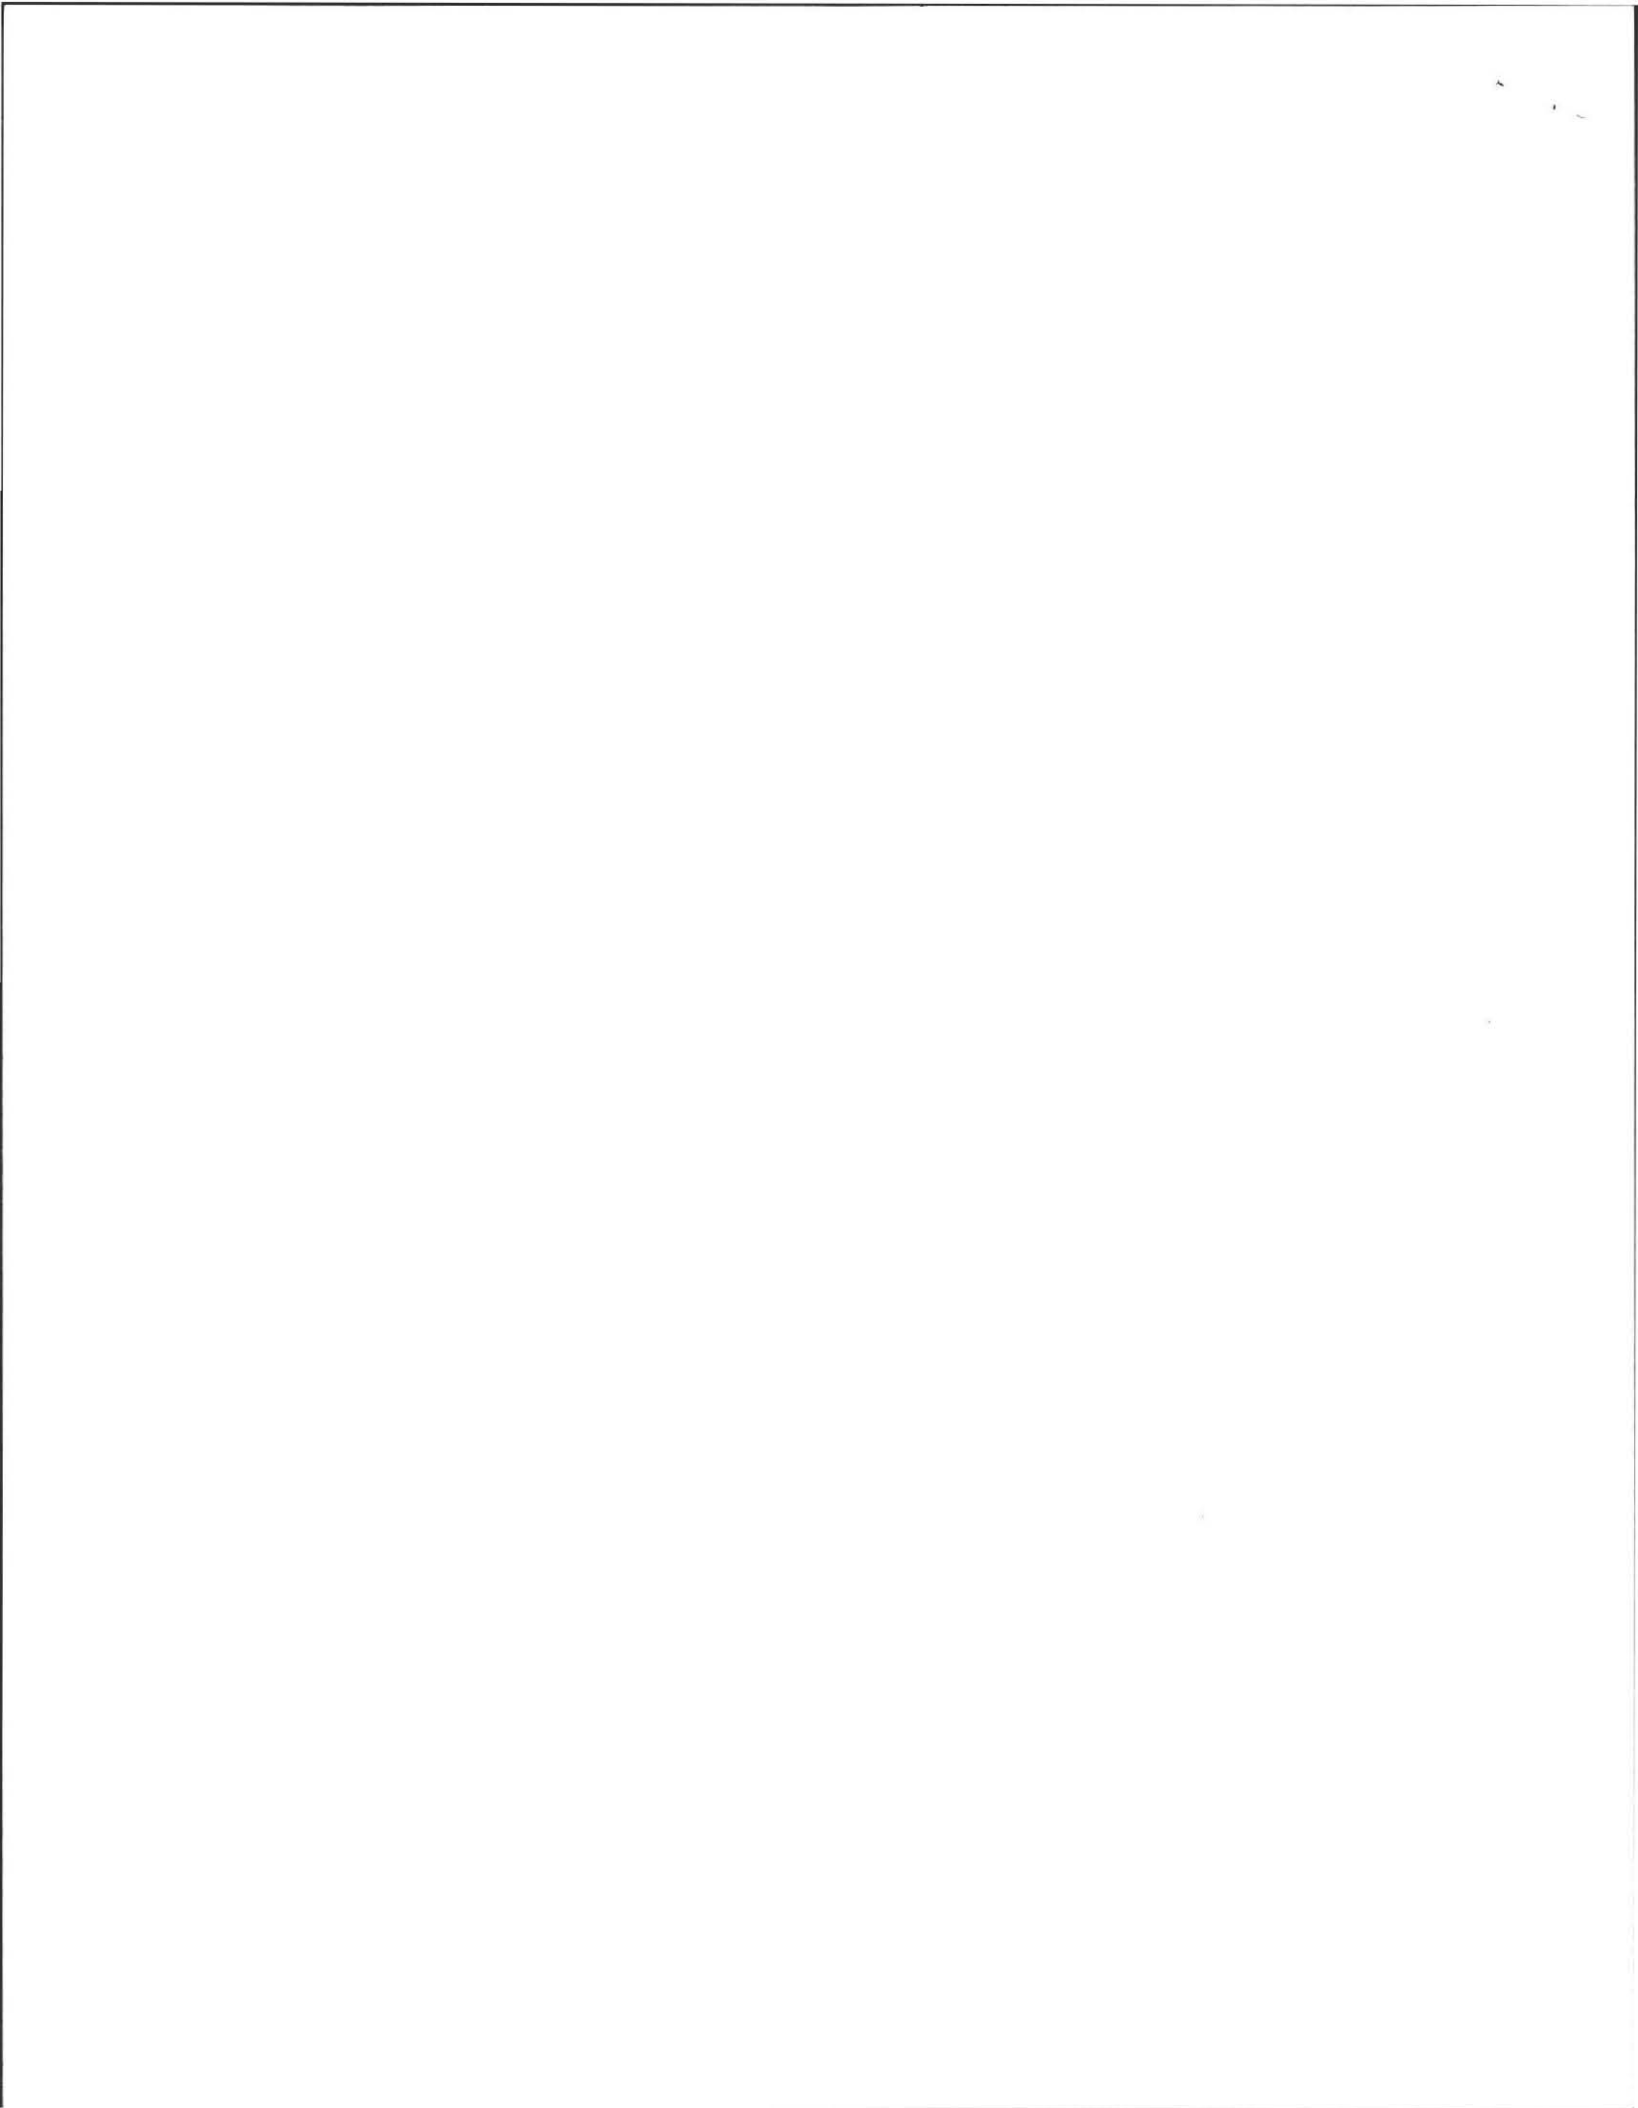

OFFICIAL INSPECTION FORM – NOT FOR VOLUNTARY ASSESSMENTS
SUBSURFACE SEWAGE DISPOSAL SYSTEM INSPECTION FORM
PART C
SYSTEM INFORMATION (continued)

Property Address: 605 Station Rd.

Owner: Simon

Date of Inspection: 10/17/04

SITE EXAM

Slope

Surface water

Check cellar

Shallow wells

Estimated depth to ground water 4' feet

Please indicate (check) all methods used to determine the high ground water elevation:

Obtained from system design plans on record - If checked, date of design plan reviewed: _____

Observed site (abutting property/observation hole within 150 feet of SAS)

_____ Checked with local Board of Health-explain: _____

_____ Checked with local excavators, installers- (attach documentation)

_____ Accessed USGS database-explain: _____

You must describe how you established the high ground water elevation:

Soil bore hole below D. Box.

