

No. 83-28

#3

FEE 90.00 paid 12-6-83

THE COMMONWEALTH OF MASSACHUSETTS
BOARD OF HEALTH

Town OF Amherst, Mass.

Application for Disposal Works Construction Permit

Application is hereby made for a Permit to Construct (x) or Repair () an Individual Sewage Disposal System at:

LOT # 2 3 Wildflower Dr Amherst, Mass 01002
Robert Rivard Location - Address
11 Wildflower Dr. Amherst
Stoney's Excavating Owner
MONTAGUE, MASS Address
Stoney's Excavating Installer

Type of Building Dwelling - No. of Bedrooms Four Expansion Attic (N) Garbage Grinder (N)
Other - Type of Building Frame No. of persons 5 Showers (2) - Cafeteria () Dish Washer
Other fixtures WASHER Hookup 2 1/2 BATH 2 Bowl Kitchen Sink
Design Flow 55 gallons per person per day. Total daily flow 440 gallons.
Septic Tank - Liquid capacity 1500 gallons Length 10' Width 6' Diameter Depth 5'
Disposal Trench - No. Width Total Length Total leaching area sq. ft.
Seepage Pit No. 2 Diameter 750 gal Depth below inlet 2 1/2' Total leaching area 800 sq. ft.
Other Distribution box (x) Dosing tank ()
Percolation Test Results Performed by Fred Filios Date 3/16/81
Test Pit No. 1 1 minutes per inch Depth of Test Pit 36" Depth to ground water None
Test Pit No. 2 --- minutes per inch Depth of Test Pit 120" Depth to ground water None

Description of Soil 0" to 8" loam - 8" to 19" med. sand w/ gravel - 19" to 120" sand & gravel - no water at 120"
Nature of Repairs or Alterations - Answer when applicable MAY SUBSTITUTE 1000 GALLON LEACH TANK

Agreement: The undersigned agrees to install the aforescribed Individual Sewage Disposal System in accordance with the provisions of TITLE 5 of the State Sanitary Code - The undersigned further agrees not to place the system in operation until a Certificate of Compliance has been issued by the board of health.

Signed Robert Rivard Date Dec 1, 83
Application Approved By C. Drab Date 12-7-83

Application Disapproved for the following reasons:
Permit No. 83-28 Issued 12-7-83 Date

THE COMMONWEALTH OF MASSACHUSETTS
BOARD OF HEALTH

OF
Certificate of Compliance

THIS IS TO CERTIFY, That the Individual Sewage Disposal System constructed () or Repaired () by Installer

at has been installed in accordance with the provisions of TITLE 5 of The State Sanitary Code as described in the application for Disposal Works Construction Permit No. dated

THE ISSUANCE OF THIS CERTIFICATE SHALL NOT BE CONSTRUED AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORY.

DATE Inspector

THE COMMONWEALTH OF MASSACHUSETTS
BOARD OF HEALTH

No. 83-28 Town OF AMHERST FEE 90.

Disposal Works Construction Permit

Permission is hereby granted R. Rivard by Stoney's Exc. to Construct (x) or Repair () an Individual Sewage Disposal System at No. Lot # 2 11 Wildflower Dr.

as shown on the application for Disposal Works Construction Permit No. 83-28 Dated 12-7-83
C. Drab Board of Health
DATE 12-7-83

CHECK OR FILL IN WHERE APPLICABLE

30-32

1000

x

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100




← NORTH

DEEP TEST LOG


LOAM	8"
MED. SAND W/ GRAVEL	19"
SAND & GRAVEL	120"
NO WATER	

208.81'

WILD FLOWER DRIVE

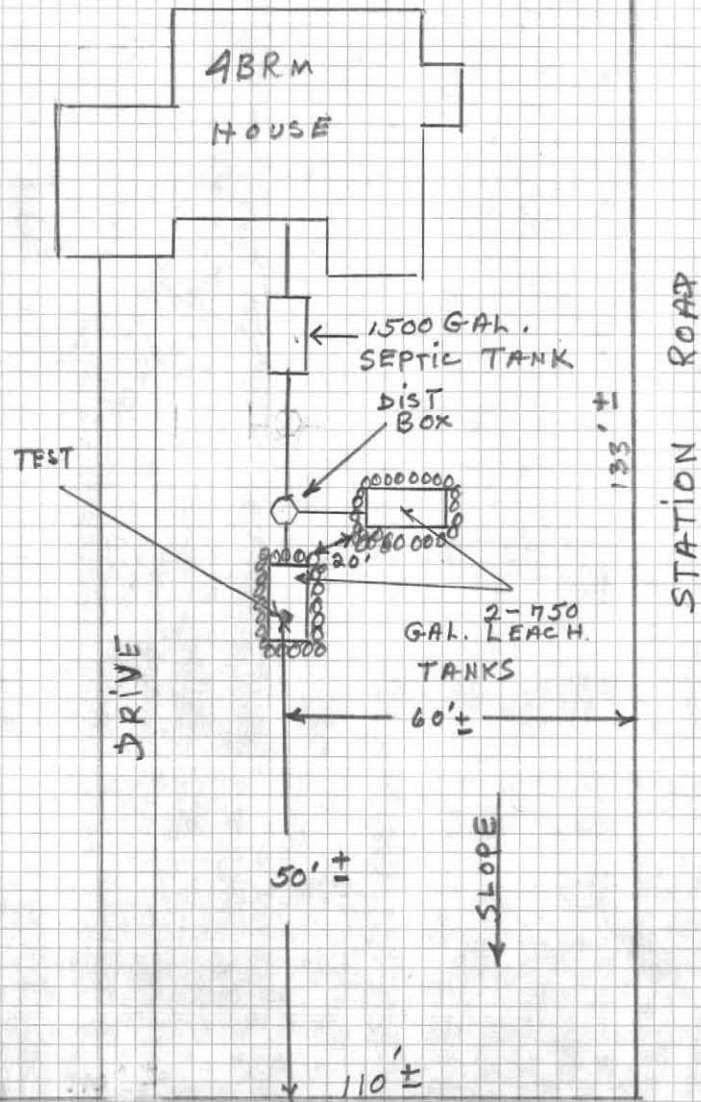




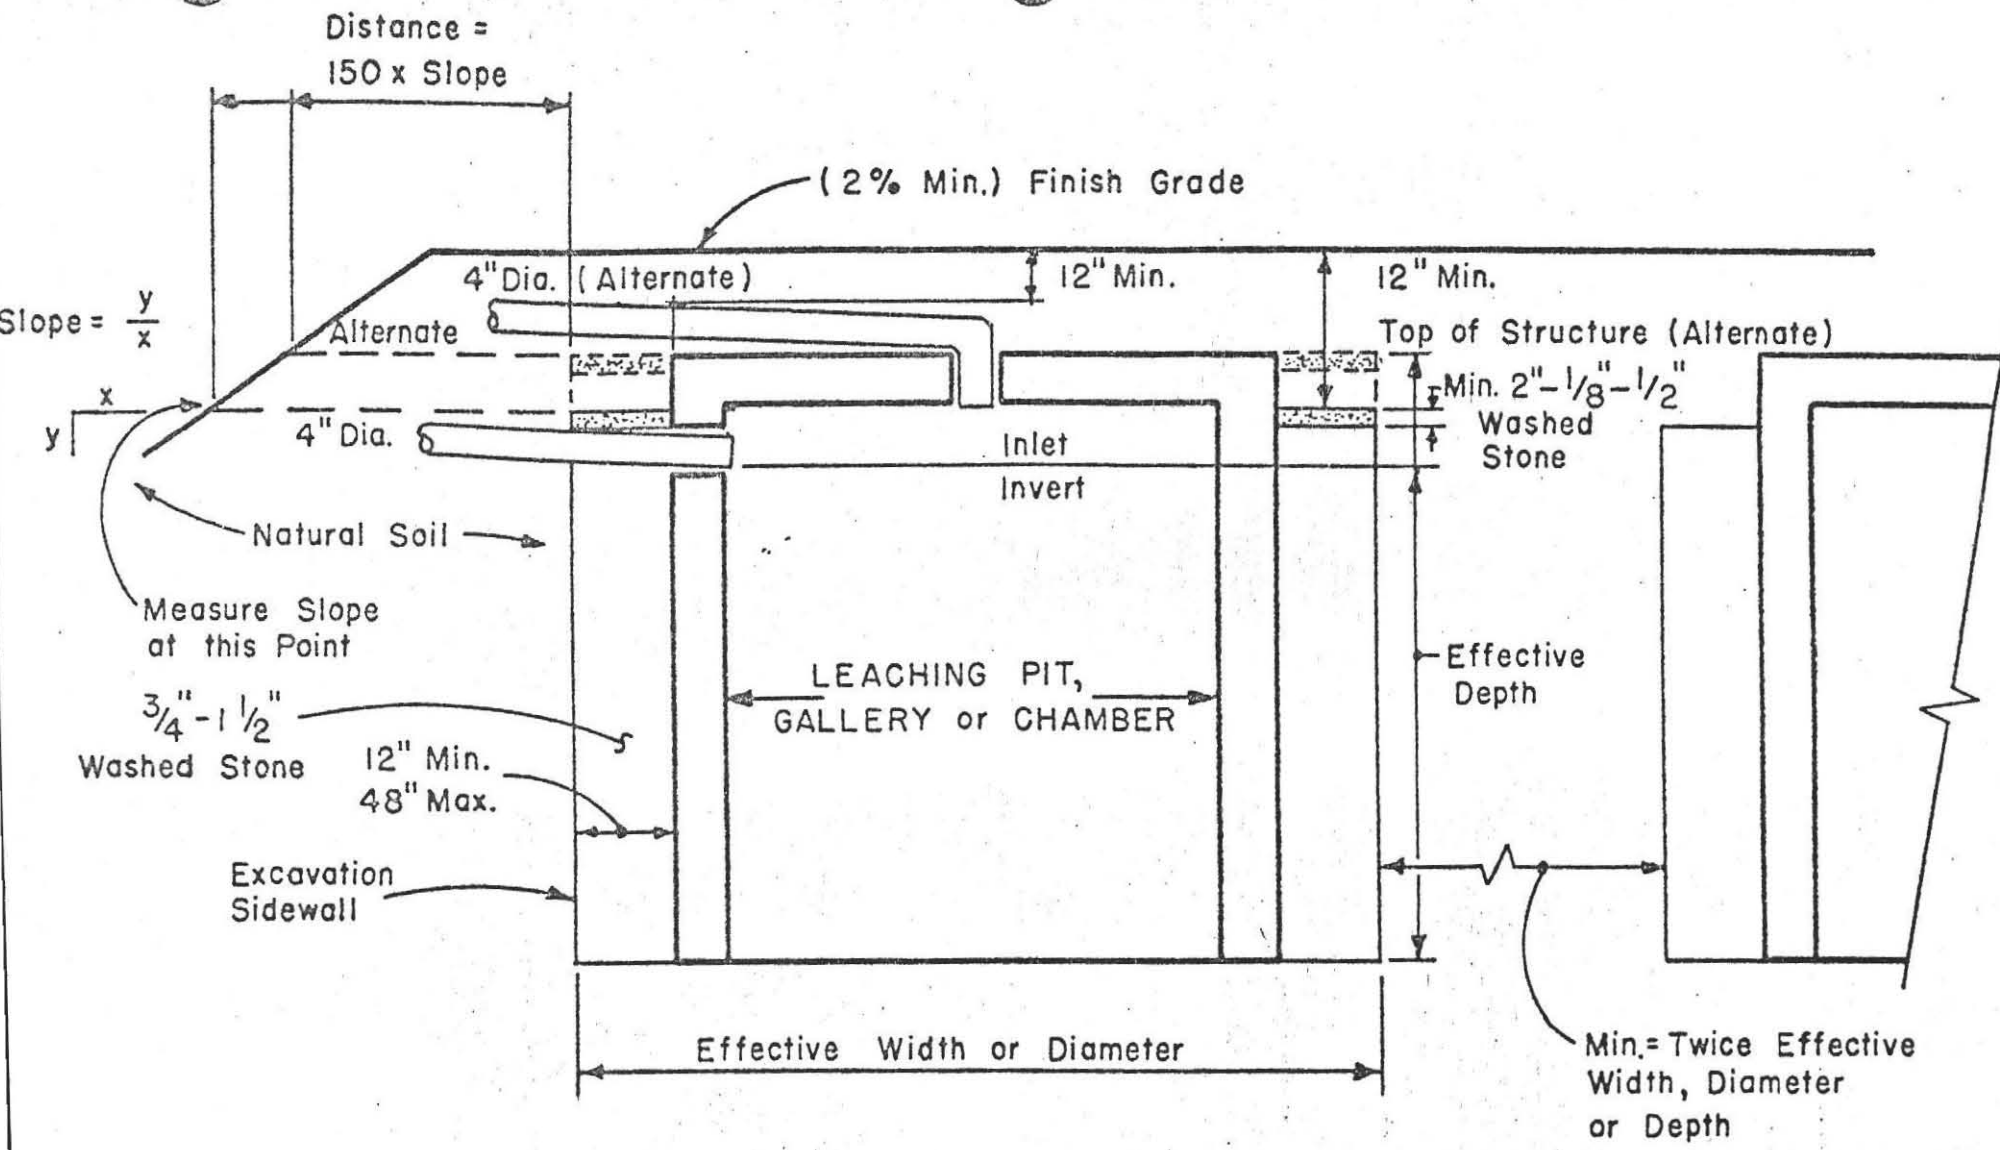

LEACHING PITS, GALLERIES, CHAMBERS

No Scale

Illustration A

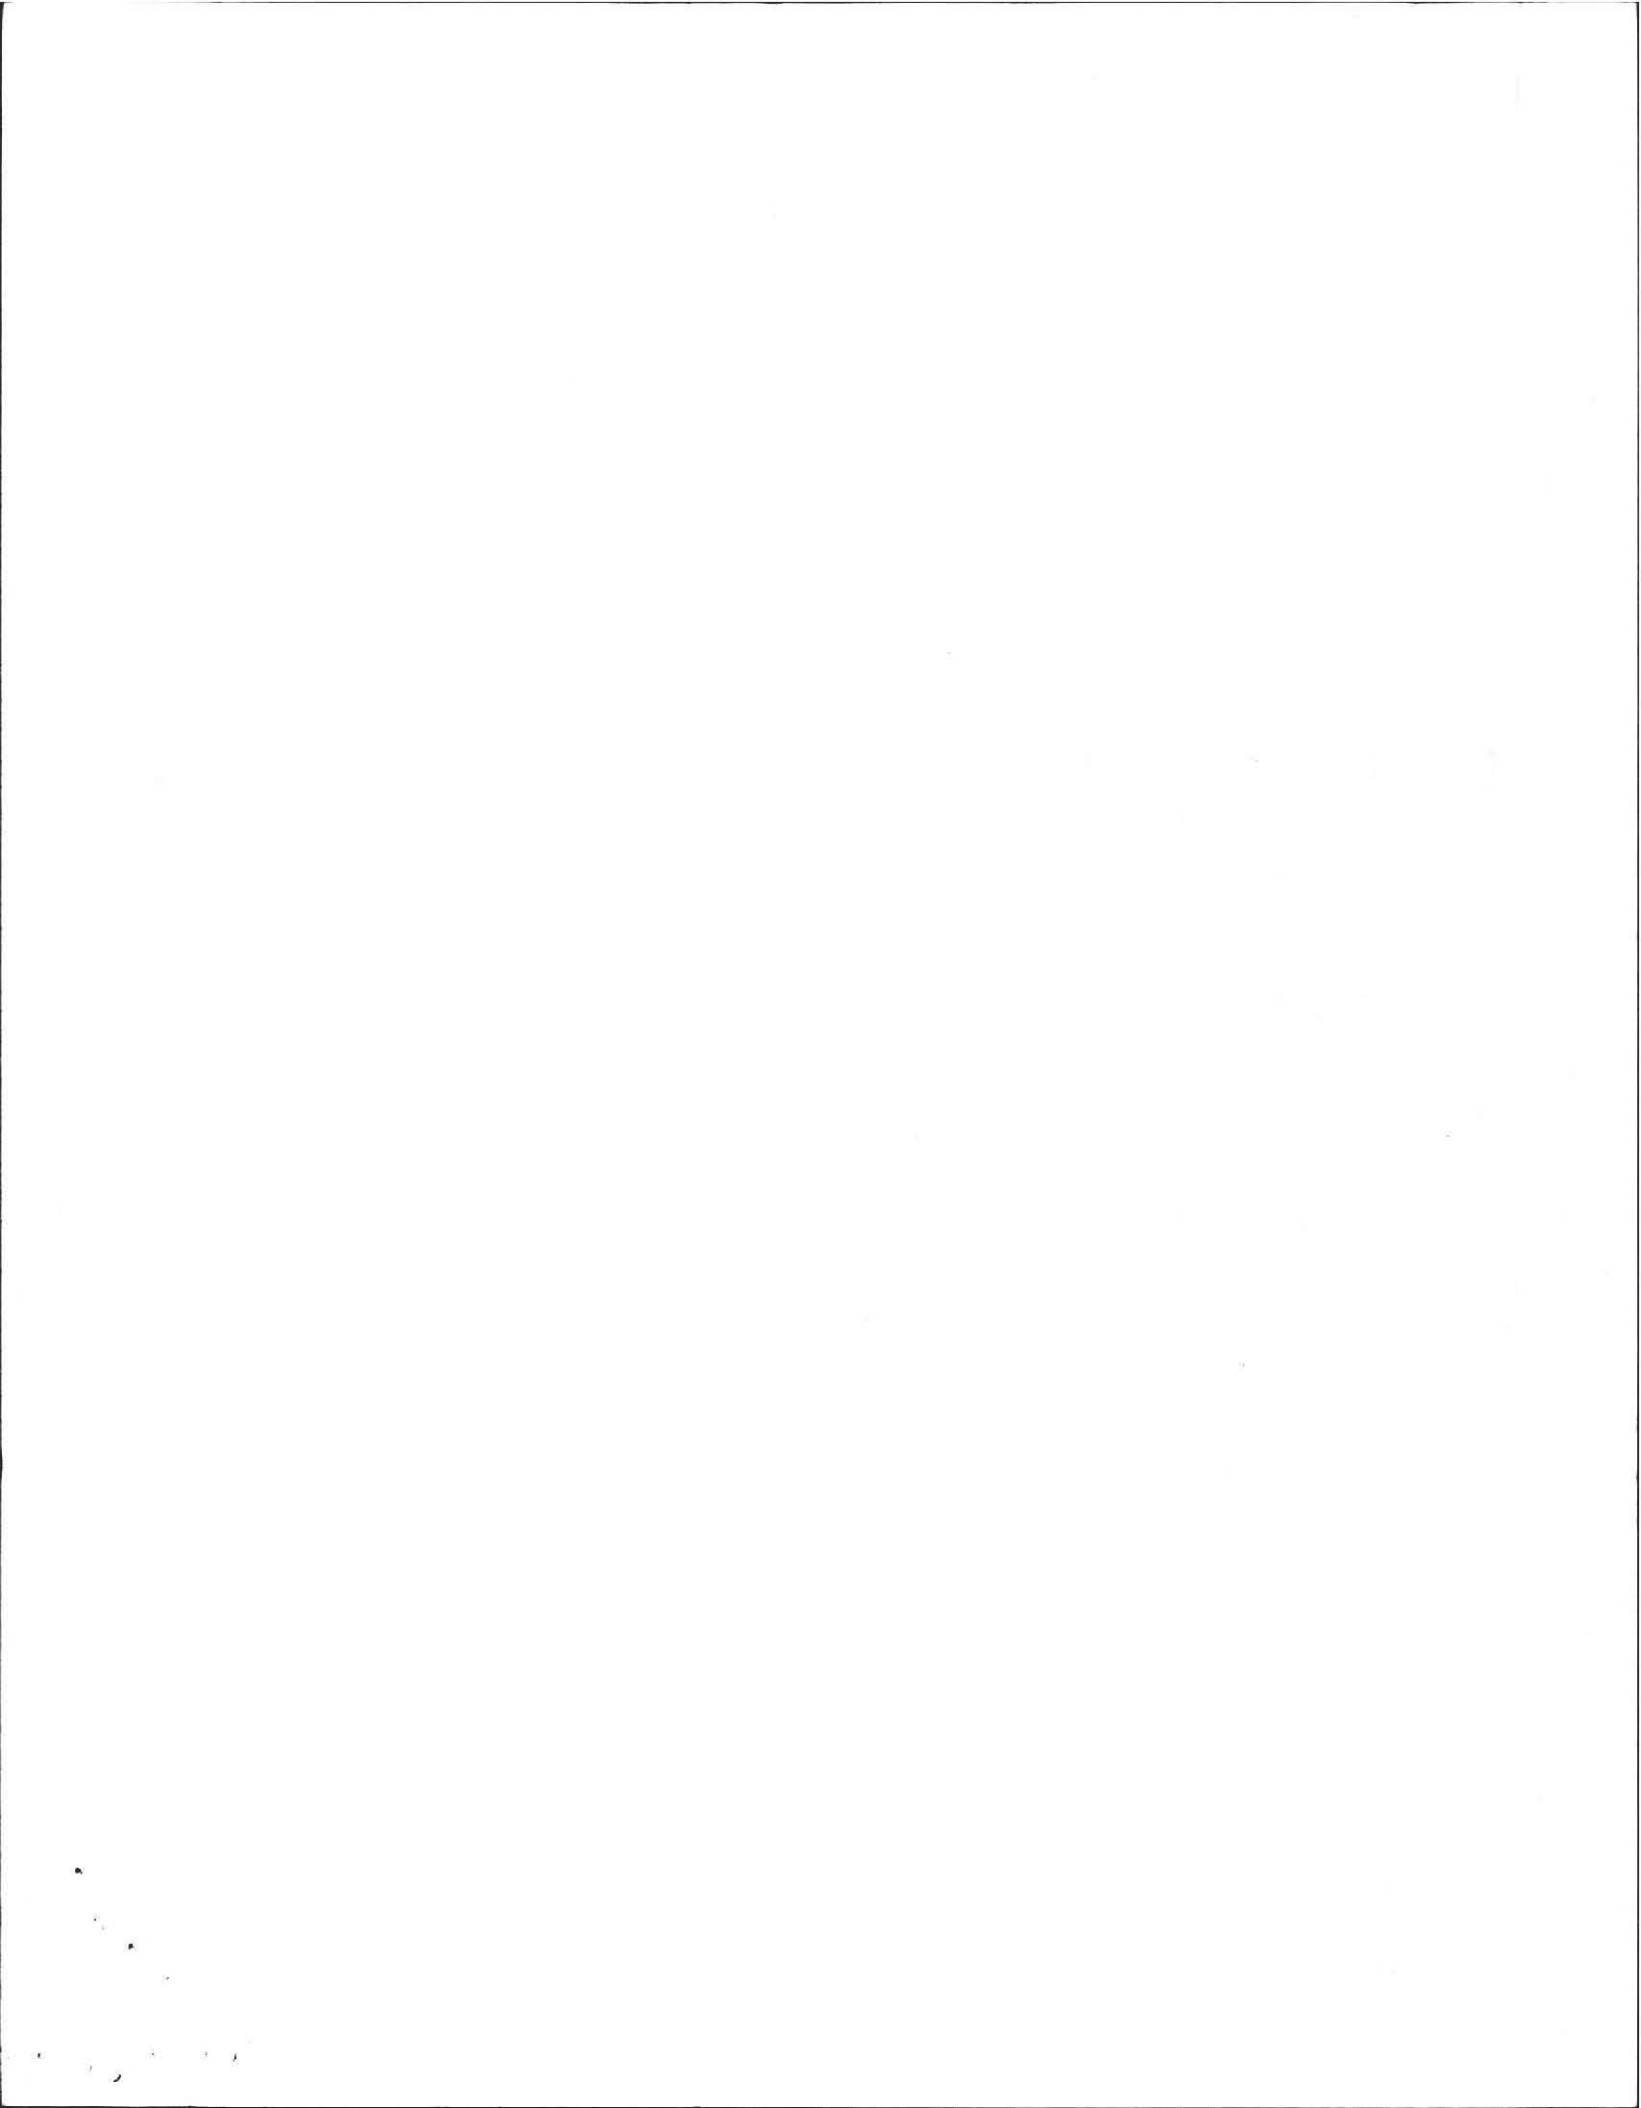


PERCOLATION TEST LOCATION

For: Amherst Woods


Scale: 1" = 40'

By: Frederick Filios

Lot #2

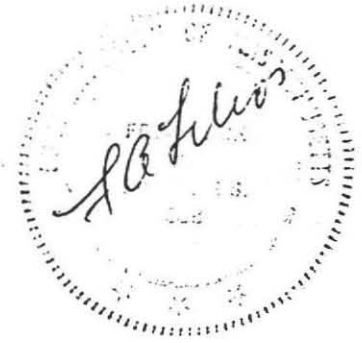


STATION RD.

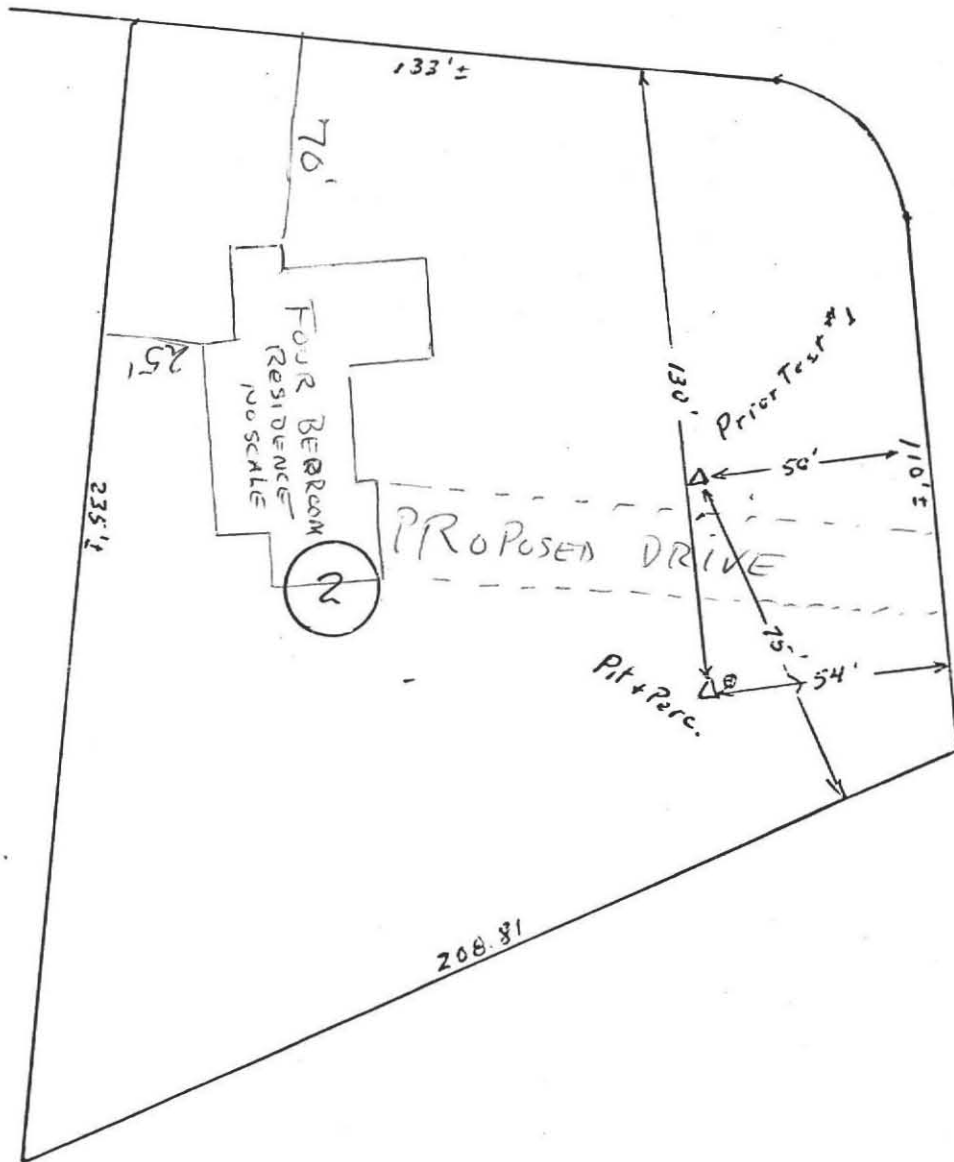

WILDFLOWER DRIVE

1920 ZLL



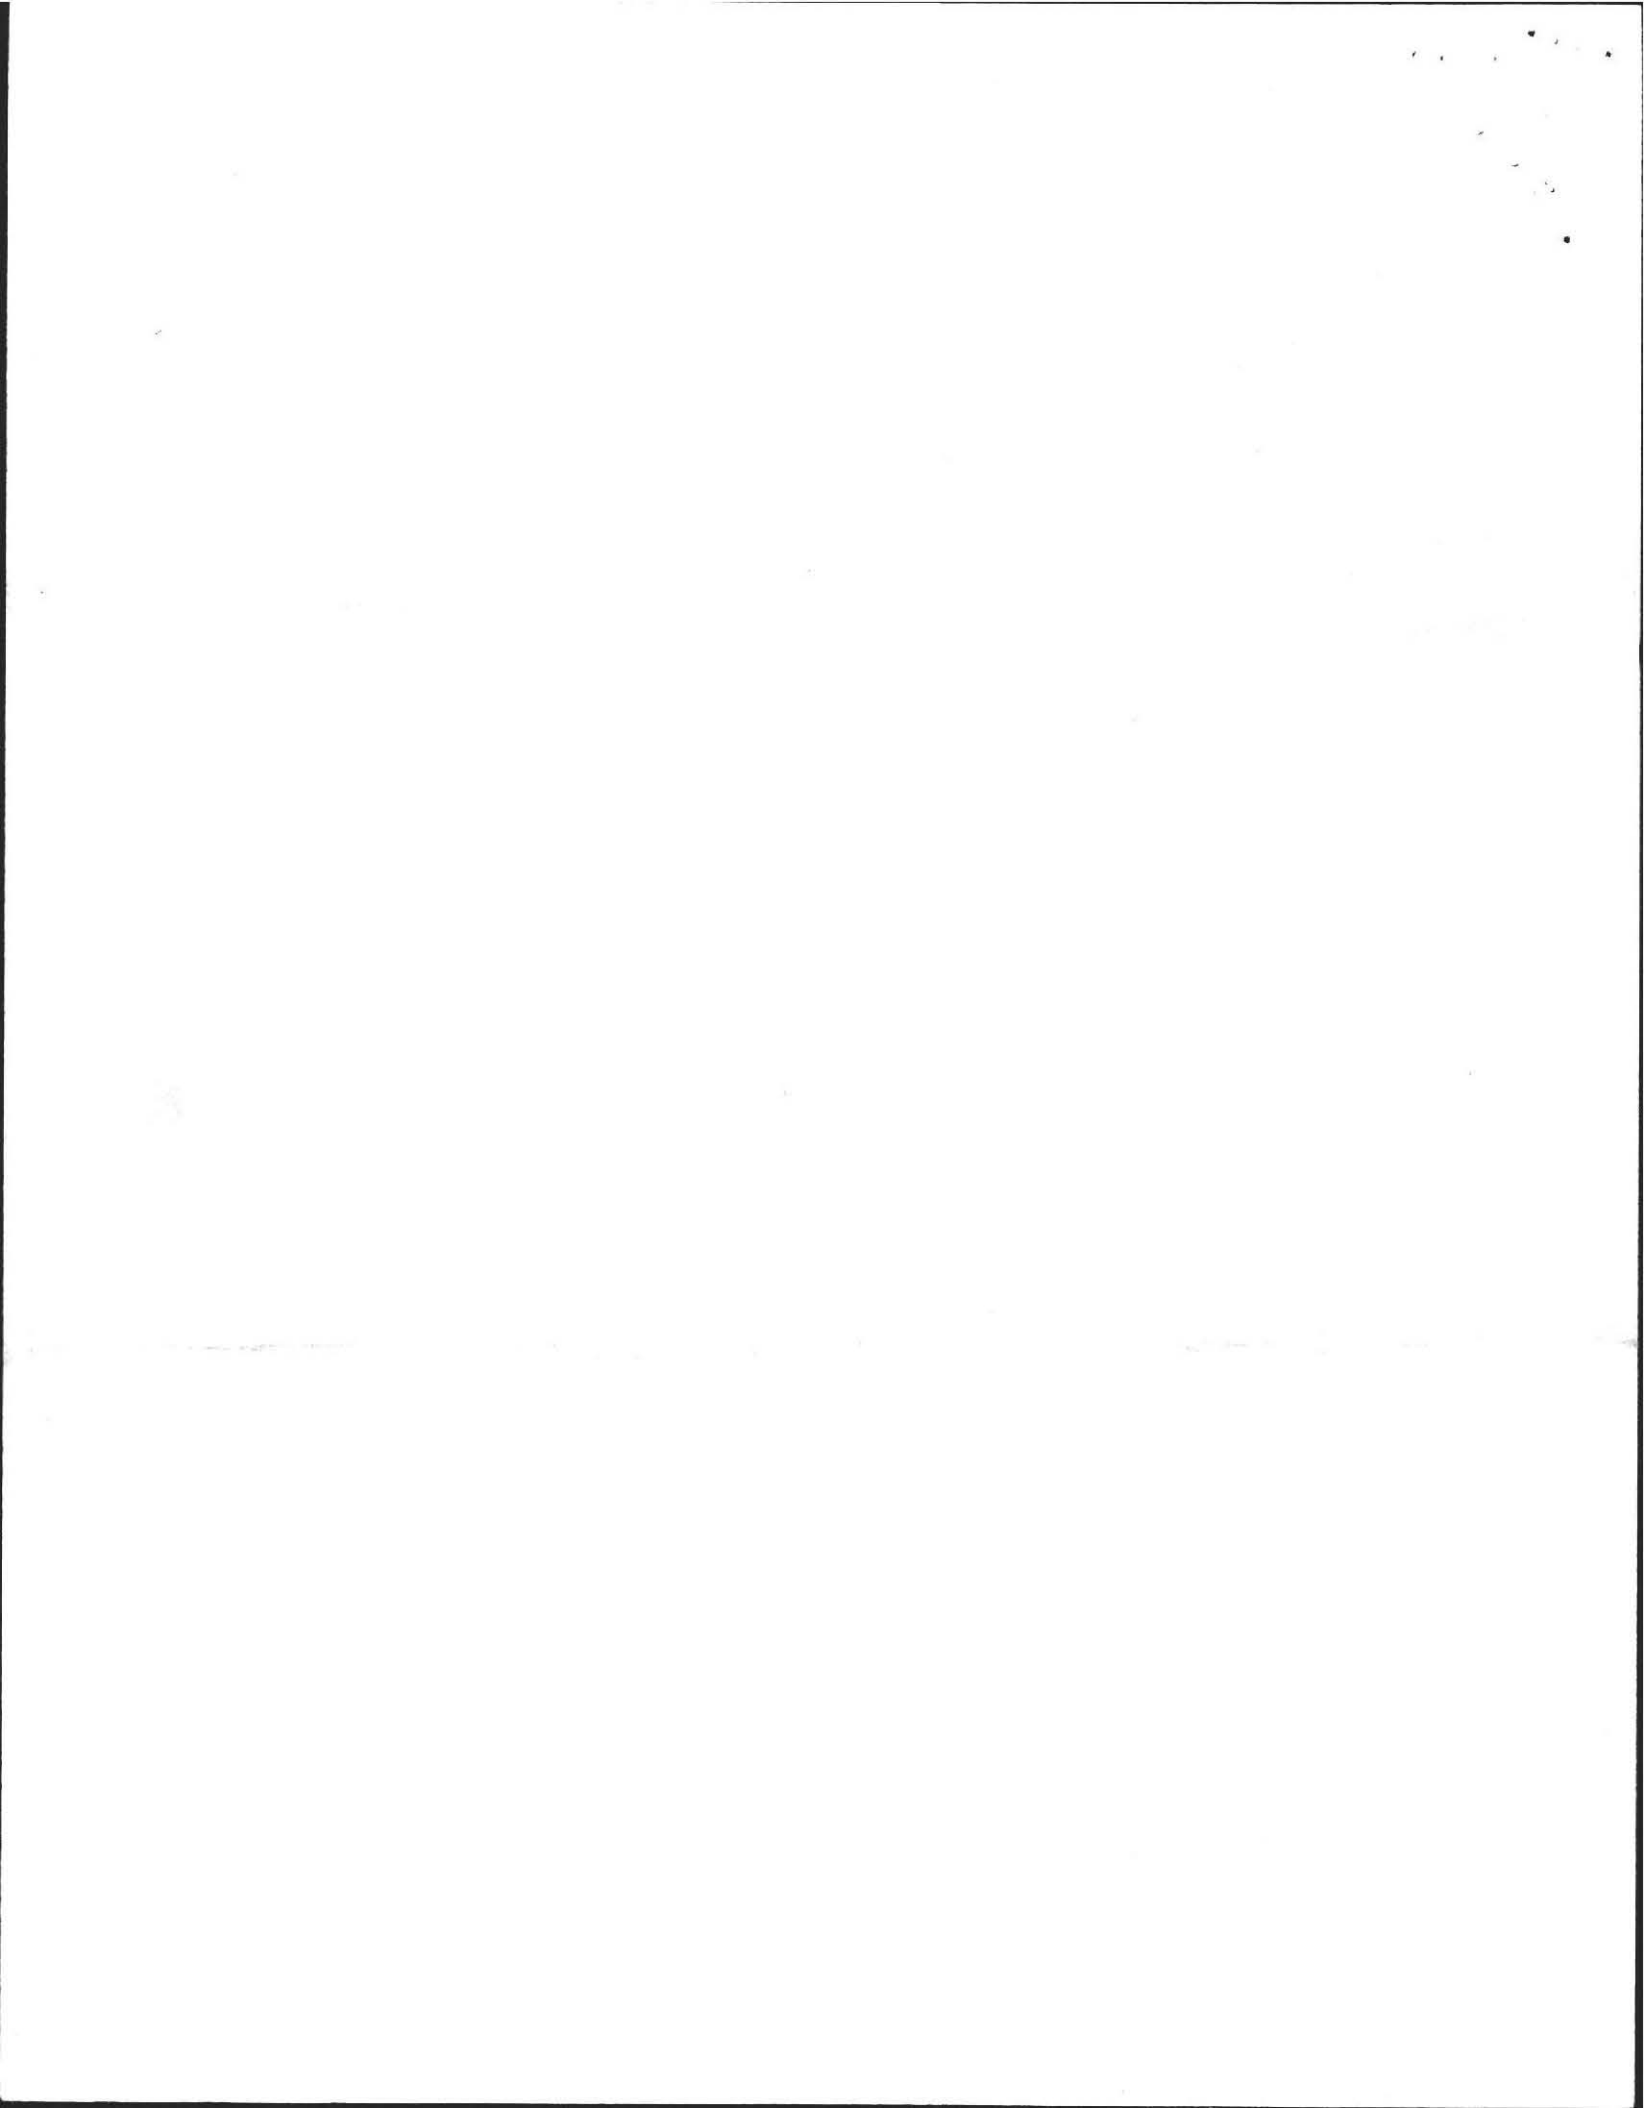

John

On the system ↓
put in on lot #3
check Drake approved
a switch from beech
field to Seepay tanks.
the system cost less to
install. If you see no
problem with that on this
lot I would prefer to
do this route.
Bob R

10/15/01
Green
LAWRENCE

OWNER Amherst Woods Phase I


Date Mar 16 1981

LOCATION Station Rd + Wildflower Drive

OBSERVER EA Filios

Soil

Lot #2

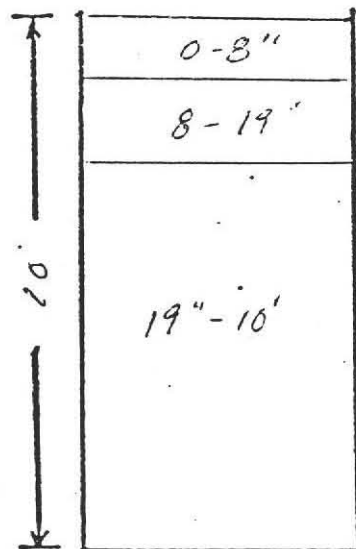


Topsoil


Subsoil; Medium
sandy w/ gravel

Sand and gravel
Stratified


Ground Water wave

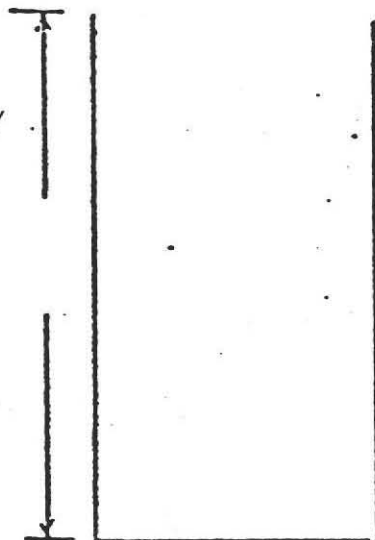

Ground Water

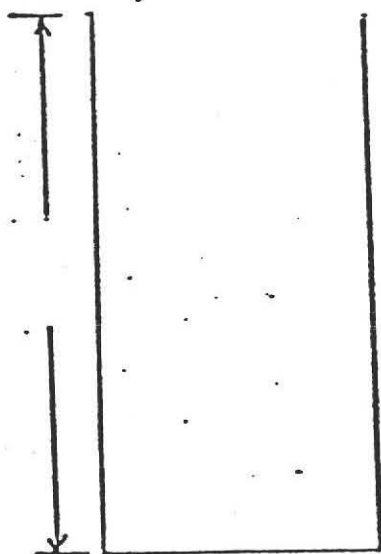

Ground Water

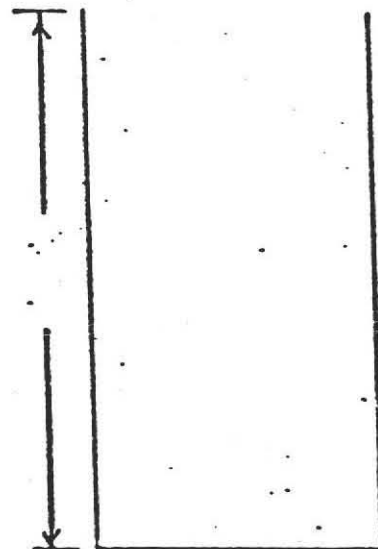

Ground Water

Percolation at 32"

.33 minutes/inch



BOARD OF HEALTH

TOWN OF AMHERST, MASSACHUSETTS

LOT #2 AMHERST WOODS

Important Information Regarding Your Private Sewage Disposal System


DISPLAY THIS DOCUMENT IN A PROMINENT PLACE

Owner JOLLY R. RIVARD Address 11 WINDFLOWER DR.
Installer ED STONE Address WEST ST MONTAGUE MA.
Date Installation Inspected and Approved MAY 1984

Description of System: Tank Capacity: 1500

Leach Field () Bed () Seepage Pit (X) Square Feet; 50
Garbage Grinder Yes (X) No () No. Bedrooms: 4 No. People 8

AS - BUILT PLAN:

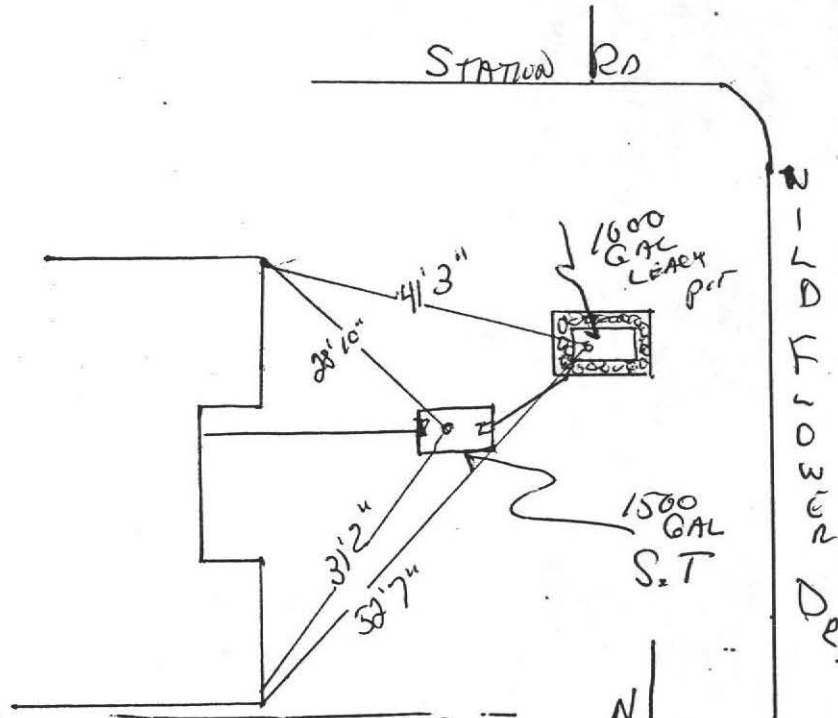

PROPER MAINTENANCE OF YOUR PRIVATE SEWAGE DISPOSAL SYSTEM

1. This system must be inspected periodically and the tank pumped out at an interval not to exceed 3 years.
2. For your protection sanitary pumpers are licensed by the Amherst Board of Health.
3. Regular pumping is crucial to avoid early failure and costly repairs of the system.
4. DO NOT dispose into the system such items as rags, string, sanitary napkins, coffee grounds as they can cause it to clog and fail.
5. Further information can be obtained by contacting your Health Department at 253-7077.

